

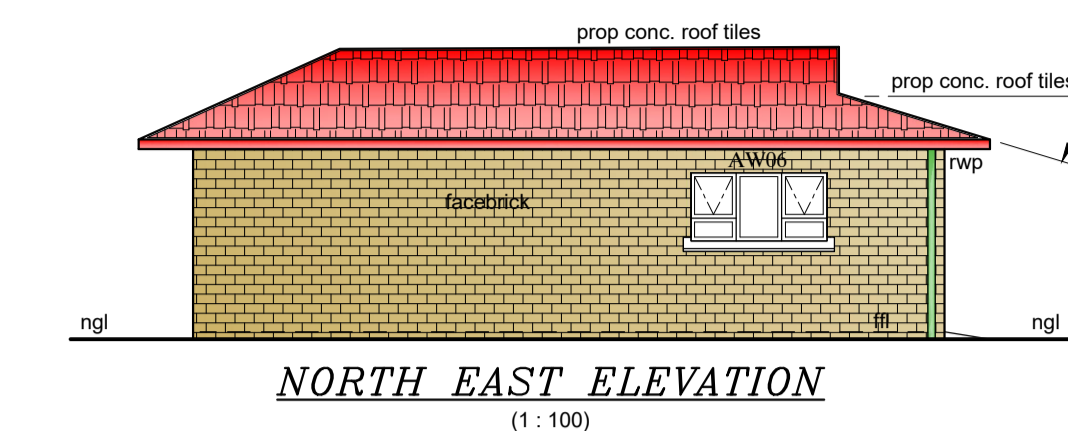
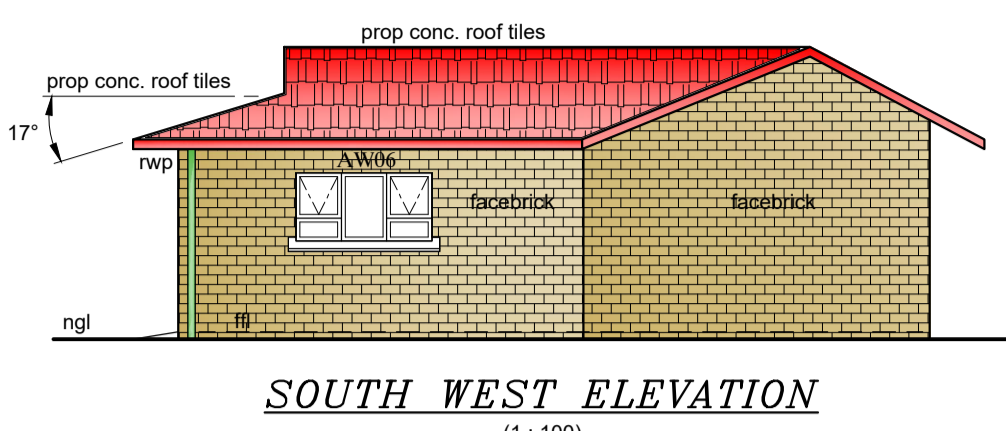
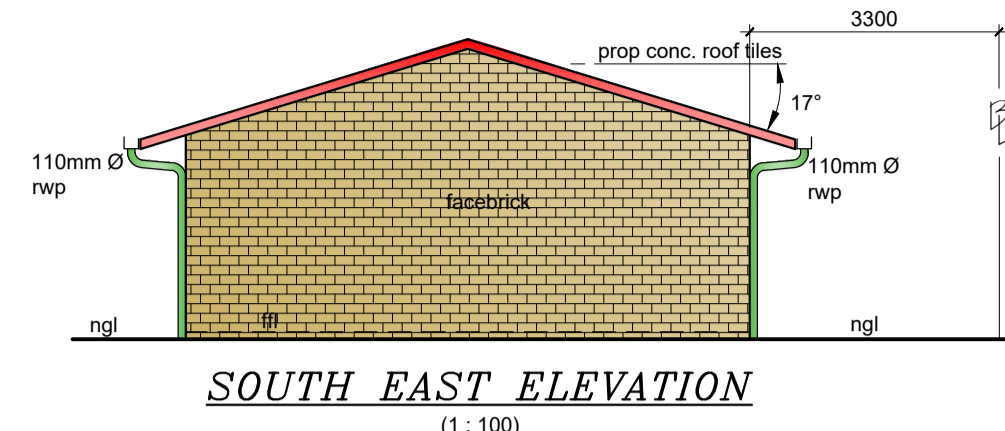


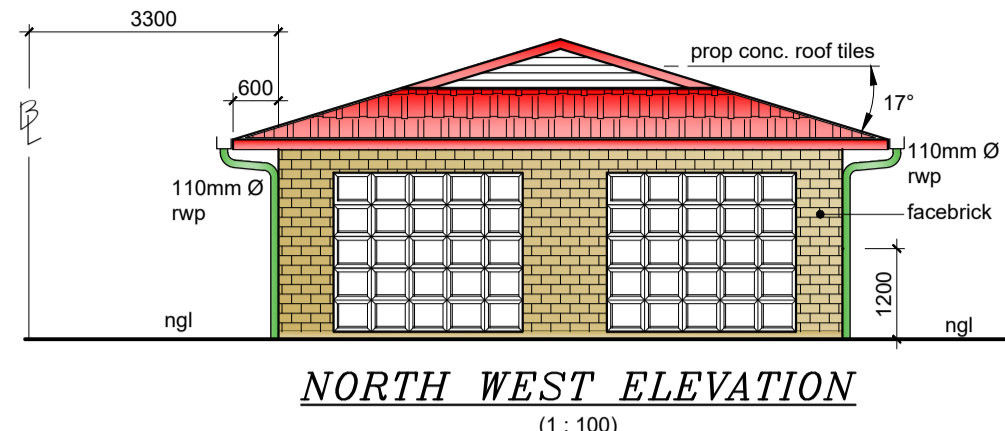



**NOTE : THE FOLLOWING ARE TO BE TO ENGINEERS' DETAILS**  
 1) WALLS & LINTELS (SANS 10400 K)  
 2) ROOF STRUCTURES (SANS 10400 L)  
 3) STAIRS (SANS 10400 M)

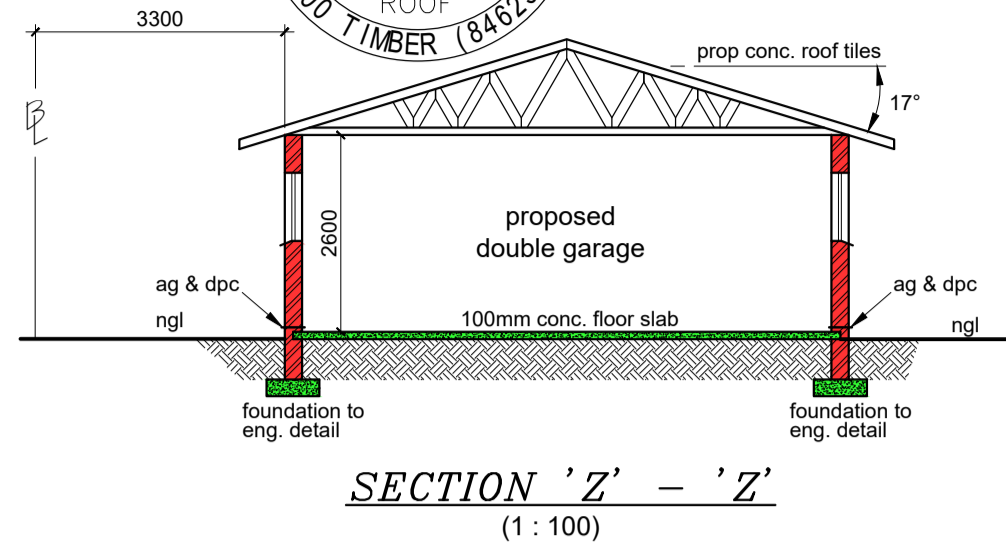

**DETAILS OF DOUBLE GARAGE**




**Water Services:**  
 \* All plumbing to be undertaken by Durban ticked plumber and registered plumber.  
 \* All taps and fittings to be SABS / JASWIC approved.  
 \* All WCs to be fitted with external overflow.  
 \* Geyser to comply with SANS 10254 / 10400. All plumbing undertaken is to be to local authority water supply bylaws.

**NOTE:**  
 ALL INTERNAL PLUMBING TO COMPLY WITH SANS 10400-P (DRAINAGE).

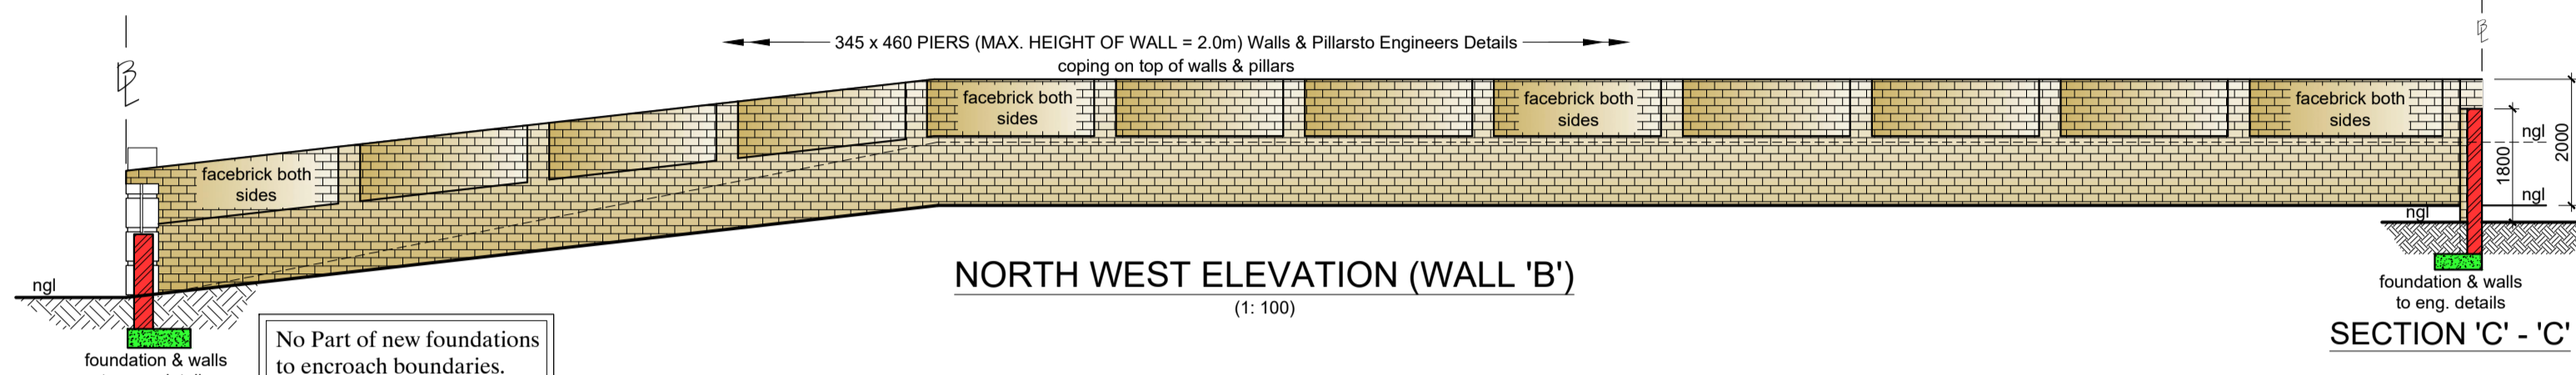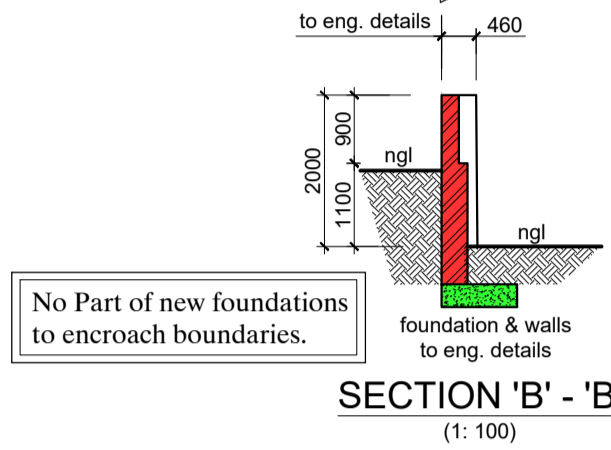

**SEWER & STORMWATER CONNECTIONS:**  
 Contractor to prove Tie-In point invert levels of services before commencing of this project & laying of service pipes.  
 Contractor to lay pipes from Tie-In back to house fittings so that adequate flow is achieved.  
 Note: If any pipe is less than 450mm to the invert, that length of pipe to be encased in concrete.

**SERVICES**  
 1) ALL PLUMBING TO COMPLY WITH SANS 10400.  
 2) ALL NEW SERVICES TO BE LAID 1.5m FROM PERIMETER OF BUILDINGS.

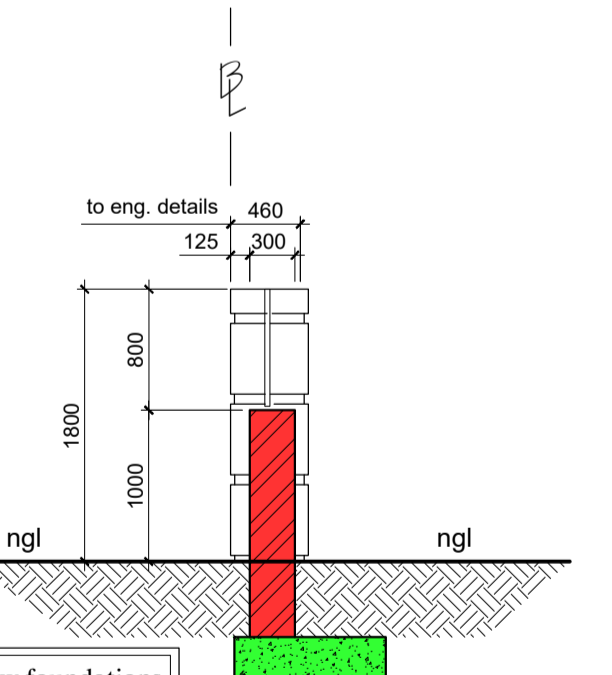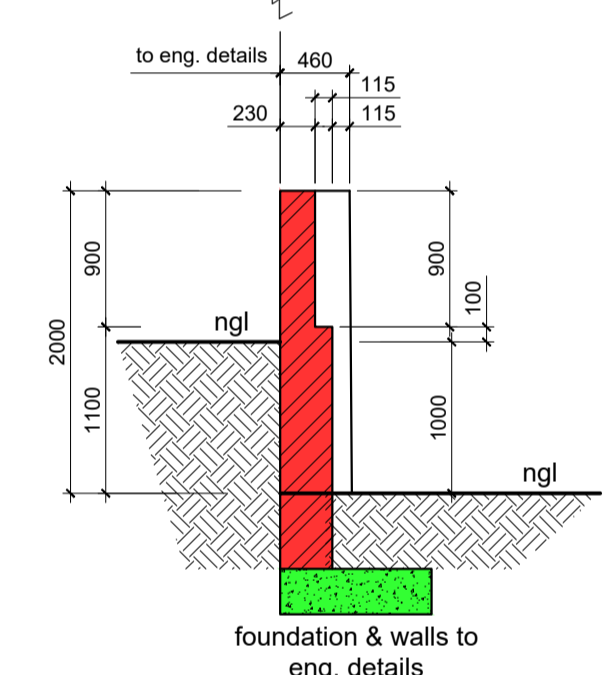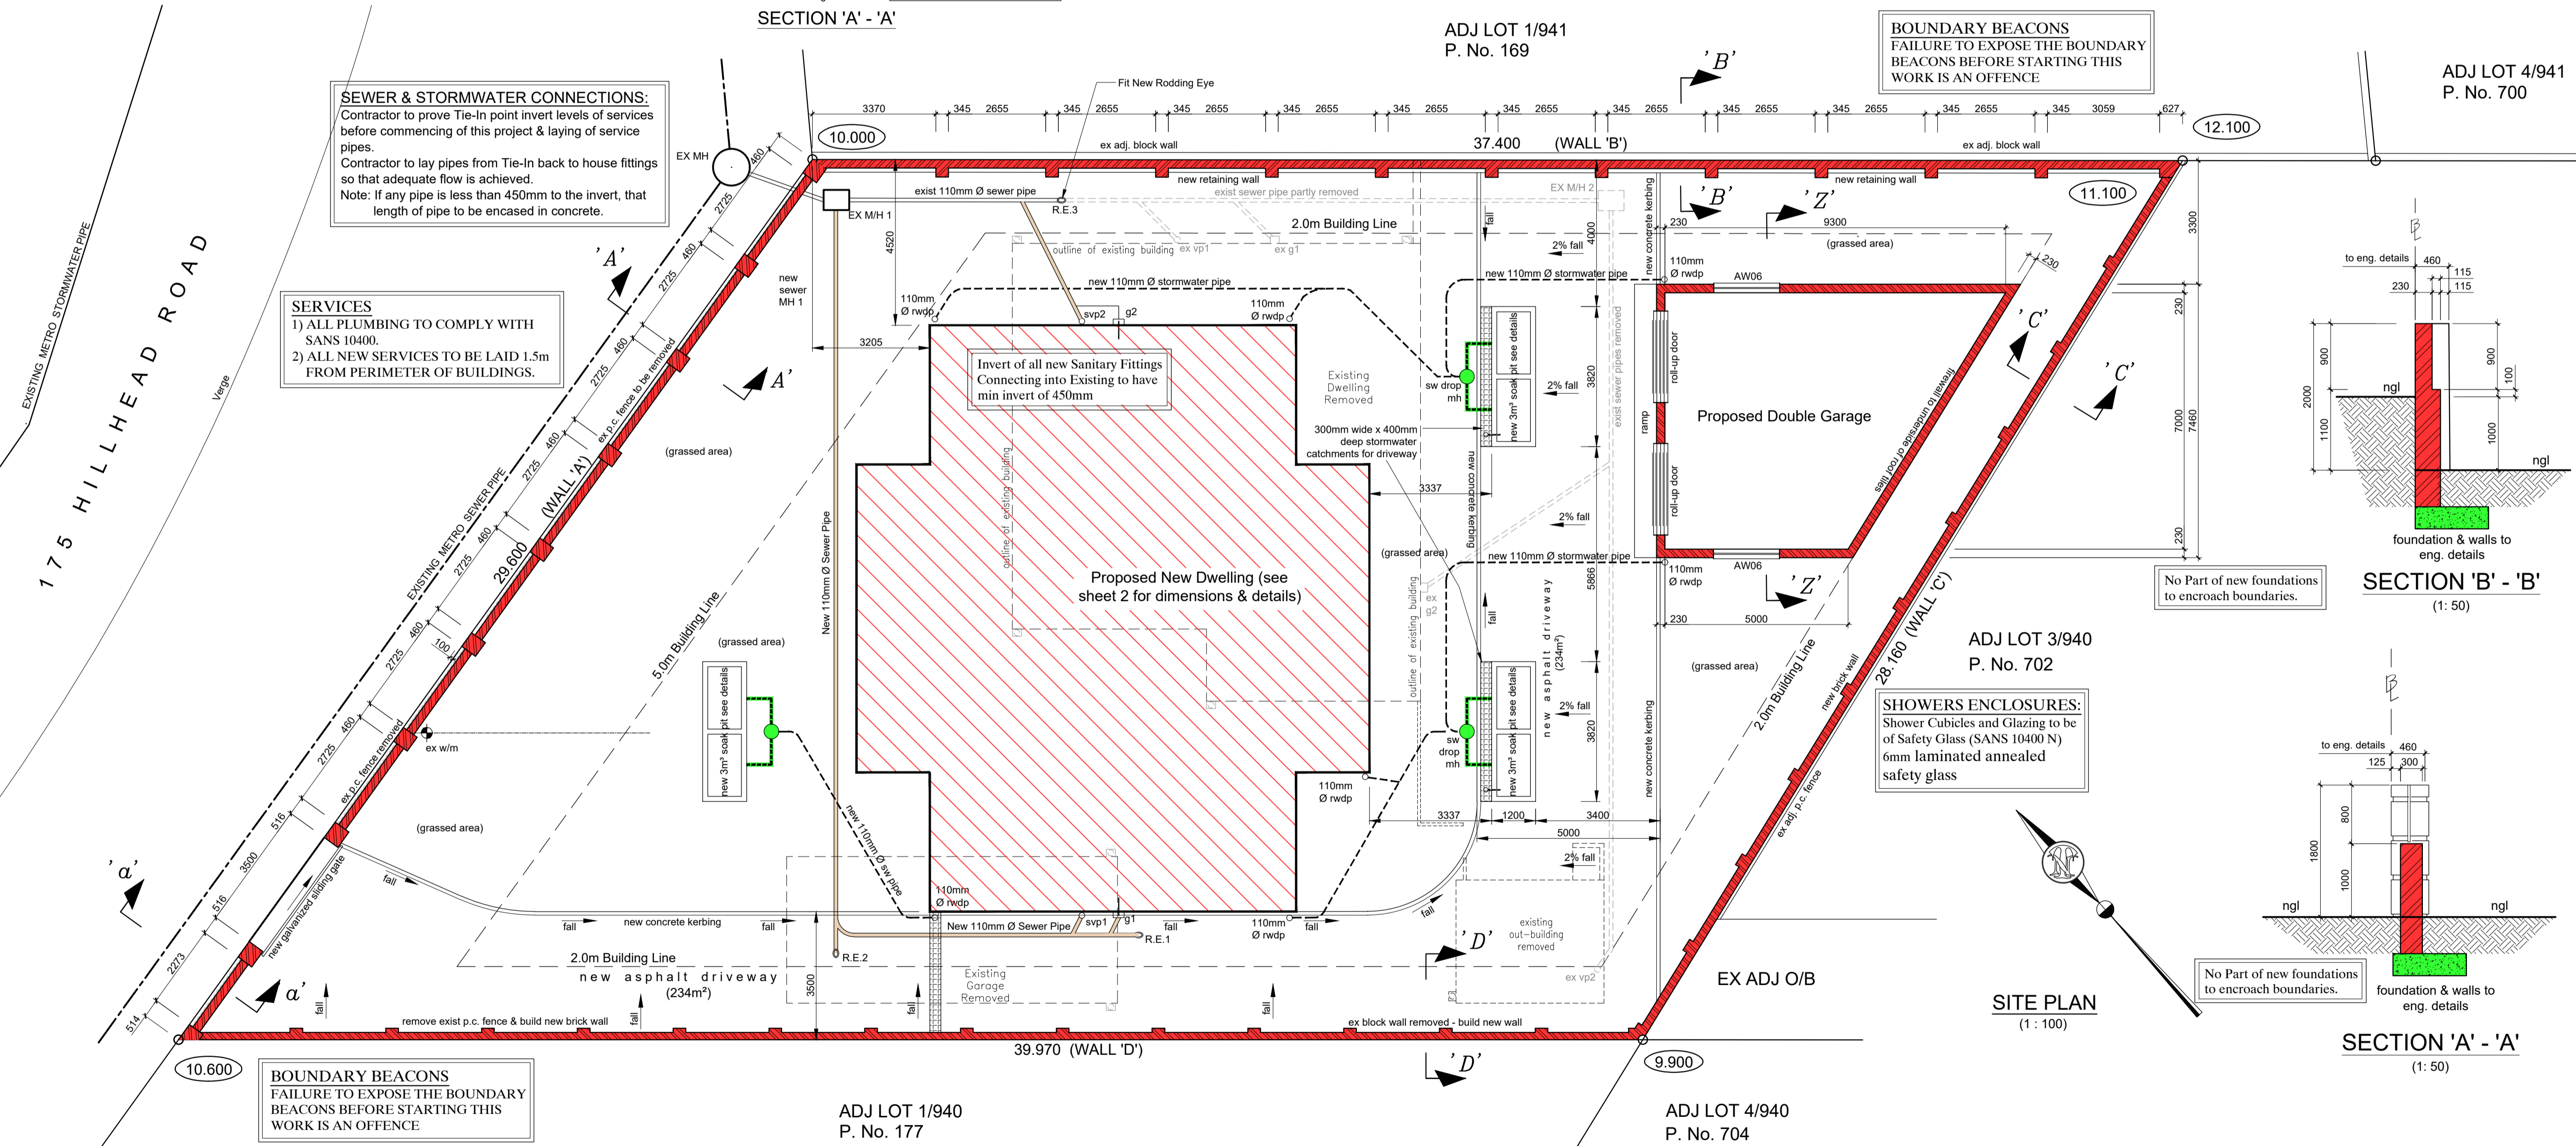

**BOUNDARY BEACONS**  
 FAILURE TO EXPOSE THE BOUNDARY BEACONS BEFORE STARTING THIS WORK IS AN OFFENCE

**SHOWERS ENCLOSURES:**  
 Shower Cubicles and Glazing to be of Safety Glass (SANS 10400 N) 6mm laminated annealed safety glass

**A FLOOR SLAB :**  
 \* 30mm SCREED ON 100mm CONCRETE SLAB REINFORCED WITH BRC MESH ON 250MIC DAMPROOF MEMBRANE ON 50mm BLINDING LAYER OF CLEAN RIVER SAND TO BE LAID ON WELL RAMPED HARDWARE FILL.  
**B WALLS :**  
 \* 2 COURSES OF BRICKWORK (BLOCKWORK EVERY COURSE) REINFORCED WITH BRICKFORCE WITH SOLID JOINTS IN CEMENT MORTAR TO BE PROVIDED IN ALL WALLS AT BOTH WINDOW SILL & WALL PLATE LEVELS.  
**C ROOF :**  
 ALL ROOFING MEMBERS AND FIXTURES TO ENGINEERS' DETAILS AND SPECIFICATIONS  
 \* TILES ON 38 x 38 TIMBER BATONS ON 400 MICRON GUNPLAS DAKSEEL WATER PROOFING MEMBRANE, ON SAP GANG NAIL TRUSSES OR EQUIVALENT AT (TILES - 17.5° PITCH). MAX 880mm CENTERS, ON 114 x 38mm V5 WALL PLATES & TIED INTO MIN OF 3 COURSES OF BRICKWORK (2 COURSES OF BLOCKWORK) USING GALVANISED STEEL STRAPS, ALL TO ENGINEERS SPECIFICATION & DETAILS.  
 \* SANS 10400 APPROVED GUTTERS AND DOWNPIPES.  
 \* SANS 10400 APPROVED BARGE AND FASCIA BOARDS.

**D. GENERAL:**  
 1 ALL WORK TO COMPLY WITH N.B.R. & SANS 10400  
 2 THIS DRAWINGS IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT PROFESSIONAL ENGINEERS DRAWINGS, DETAILS & REPORTS. THE SPECIFICATION FOR THE WORKS, THE RELEVANT ARCHITECTS DRAWINGS & ANY OTHER SPECIALISTS DRAWINGS & REPORTS.  
 3 ALL WORK TO COMPLY WITH THE NATIONAL BUILDING REGULATIONS AND TO BE TO THE SATISFACTION OF THE LOCAL AUTHORITY RESIDENT BUILDING INSPECTOR.  
 4 USE FIGURED DIMENSIONS IN PREFERENCE TO SCALING.  
 5 CONTRACTOR IS TO CHECK ALL DIMENSIONS AND LEVELS PRIOR TO ANY COMMENCEMENT OF WORK AND REPORT ANY DISCREPANCIES TO THE DRAUGHTS PERSON.  
 6 CONTRACTOR IS TO CONFIRM AND ENSURE CORRECTNESS OF FLOOR AND ENTRANCE LEVELS PHYSICALLY ON SITE WITH LOCAL AUTHORITY INSPECTOR BEFORE COMMENCING WORK TO CONSIDER ALL SERVICE DRAINAGE HAS ADEQUATE FALLS TO CONNECTING SERVICES.  
 7 ENTRANCE LEVEL TO BE 270mm ABOVE EDGE OF ROAD DIRECTLY OPPOSITE PROPOSED ENTRANCE.  
 8 ALL CUT AND FILL BANKS TO BE 26 DEGREES TO THE HORIZONTAL.

9 ALL FOUNDATIONS TO BE TAKEN DOWN TO HARD VIRGIN GROUND AND TO BE INSPECTED BY THE PROJECT ENGINEER BEFORE ANY CONCRETE IS POURED.  
 10 PROVIDE A MINIMUM OF TWO AIR BRICKS PER ROOM.  
 11 ALL REINFORCED CONCRETE, FOUNDATIONS, BASES, COLUMNS, BEAMS, SLABS AND RETAINING WALLS ARE TO BE BUILT STRICTLY IN ACCORDANCE WITH PROFESSIONAL ENGINEERS DETAILS AND UNDER HIS SUPERVISION THEREOF.  
 12 OWNER TO ENSURE THAT ALL MUNICIPAL CONNECTION FEES ARE PAID AND ALL ASPECTS OF LICENCING LEGAL REQUIREMENTS ARE ATTENDED TO.  
 13 THE ATTENTION OF THE OWNER IS DRAWN TO THE FACT THAT CHANGES TO THE PLAN AND/OR SPECIFICATIONS AFTER OFFICIAL APPROVAL BY LOCAL AUTHORITY RENDERS THIS PLAN INVALID AND TO BE RESUBMITTED AS A DEVIATION PLAN AT OWNERS COST.  
**BOUNDARY WALLS:**  
 1 NO PART OF BOUNDARY WALLS OR THEIR FOUNDATIONS ARE TO ENDOACH OVER BOUNDARY LINE.  
 2 WALLS SPANNING SERVICES TO BE BUILT ON CONCRETE LINTELS.  
 3 BOUNDARY WALL FOOTINGS PARALLEL WITH SERVICE MUST NOT PROJECT MORE THAN 600mm INTO THE SERVIDUTE.

**DRAINAGE :**  
 1 THE CONTRACTOR IS REQUIRED TO ENSURE THAT THE LOCAL AUTHORITY INSTALLS THE NECESSARY STORMWATER AND OR SEWER CONNECTIONS BEFORE DRAINAGE WORK IS COMMENCED. IT IS THERE AFTER THE CONTRACTORS RESPONSIBILITY TO ENSURE ADEQUATE FALLS TO THESE CONNECTIONS.  
 2 THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT STORMWATER DAMAGE TO THE WORK IN PROGRESS OR NEIGHBOURING PROPERTIES DOES NOT OCCUR DURING CONSTRUCTION AND THAT THE SURFACE WATER DRAINAGE INSTALLED IS ADEQUATE.  
 3 ALL SANITARY FITTINGS TO BE TRAPPED AND/OR VENTED TO LOCAL AUTHORITY REQUIREMENTS.  
 4 ALL BENDS AND JUNCTIONS IN DRAINS TO BE PROVIDED WITH INSPECTION EYES.  
 5 ADEQUATE ACCESS PANELS TO BE FITTED IN ALL DUCTS OVER INSPECTION EYES.  
**CERTIFICATES OF COMPLIANCE**  
 1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL CERTIFICATES, OR CERTIFICATES OF COMPLIANCE THAT ARE REQUIRED BY THE LOCAL AUTHORITY ARE OBTAINED BY HIM FROM ALL REGISTERED SERVICE PROVIDERS AND HANDED TO THE LOCAL AUTHORITY ON REQUEST.

SCHEDULE OF AREAS (m <sup>2</sup> )	
SITE AREA	929.00
EXISTING:	
Main Dwelling (to be Demolished)	-129.00
Out-Building (to be Demolished)	-14.00
Single Garage (to be Demolished)	-36.00
TOTAL:	
PROPOSED:	
New Dwelling (storey plan)	193.60
(1st storey plan)	190.70
Double Garage	57.10
TOTAL:	441.4
EXIST COVER	
PROP COVER	250.70
TOTAL COVERAGE:	250.70

**SBD**  
**ShauBridge Designs**  
 ARCHITECTURAL AND DRAUGHTING SERVICES  
 N. Adams: Prof. Arch. Tech. Reg. No. T1154  
 26 MARIA CRESCENT AUSTERVILLE DURBAN 4052 cell: 083 7850276

PROJECT: DEMOLISH EX DWELL. & GARAGE PROPOSED NEW DWELLING, DOUBLE GARAGE AND BOUNDARY/RETAINING WALLS


STREET ADDRESS: 175 HILLHEAD ROAD

LOT DISCUSSION: REMAINDER OF ERF 940 OF WENTWORTH


CLIENT: MARLIN DEON KINSEY CLIENT TEL: 072 465 0215

RATE NUMBER: CLIENT SIGNATURE:

SHEET 1 OF 3  
 DRAWN: N.A. CHECKED BY: N. Adams SCALE: AS SHOWN  
 DATE: 15-05-2023 DRG No. SBD 15052023

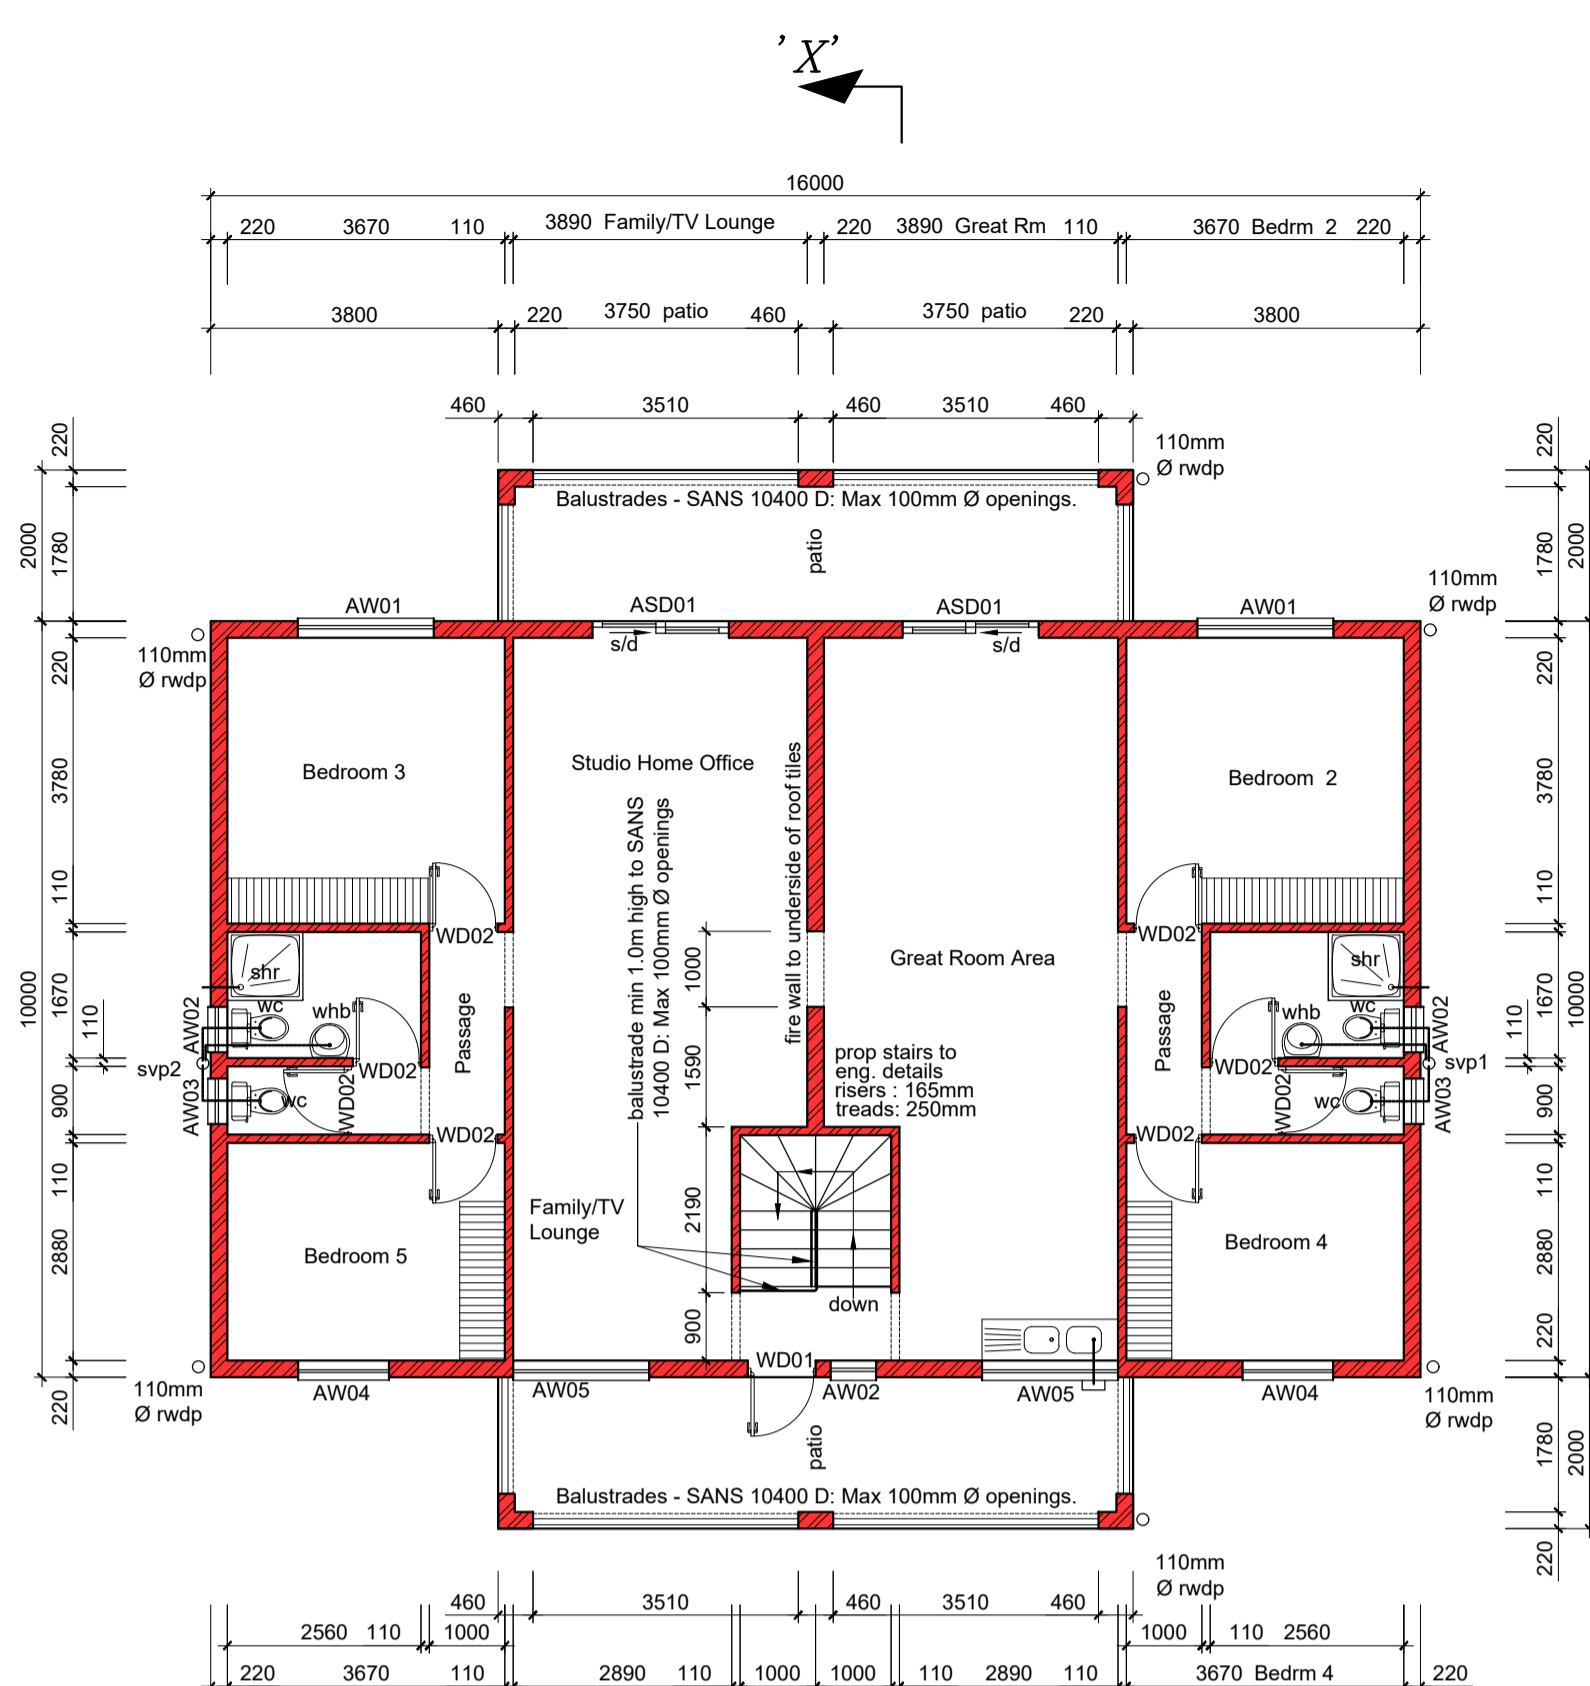


**NOTE: THE FOLLOWING ARE TO BE TO ENGINEERS' DETAILS**  
 1) WALLS & LINTELS (SANS 10400 K)  
 2) ROOF STRUCTURES (SANS 10400 L)  
 3) STAIRS (SANS 10400 M)

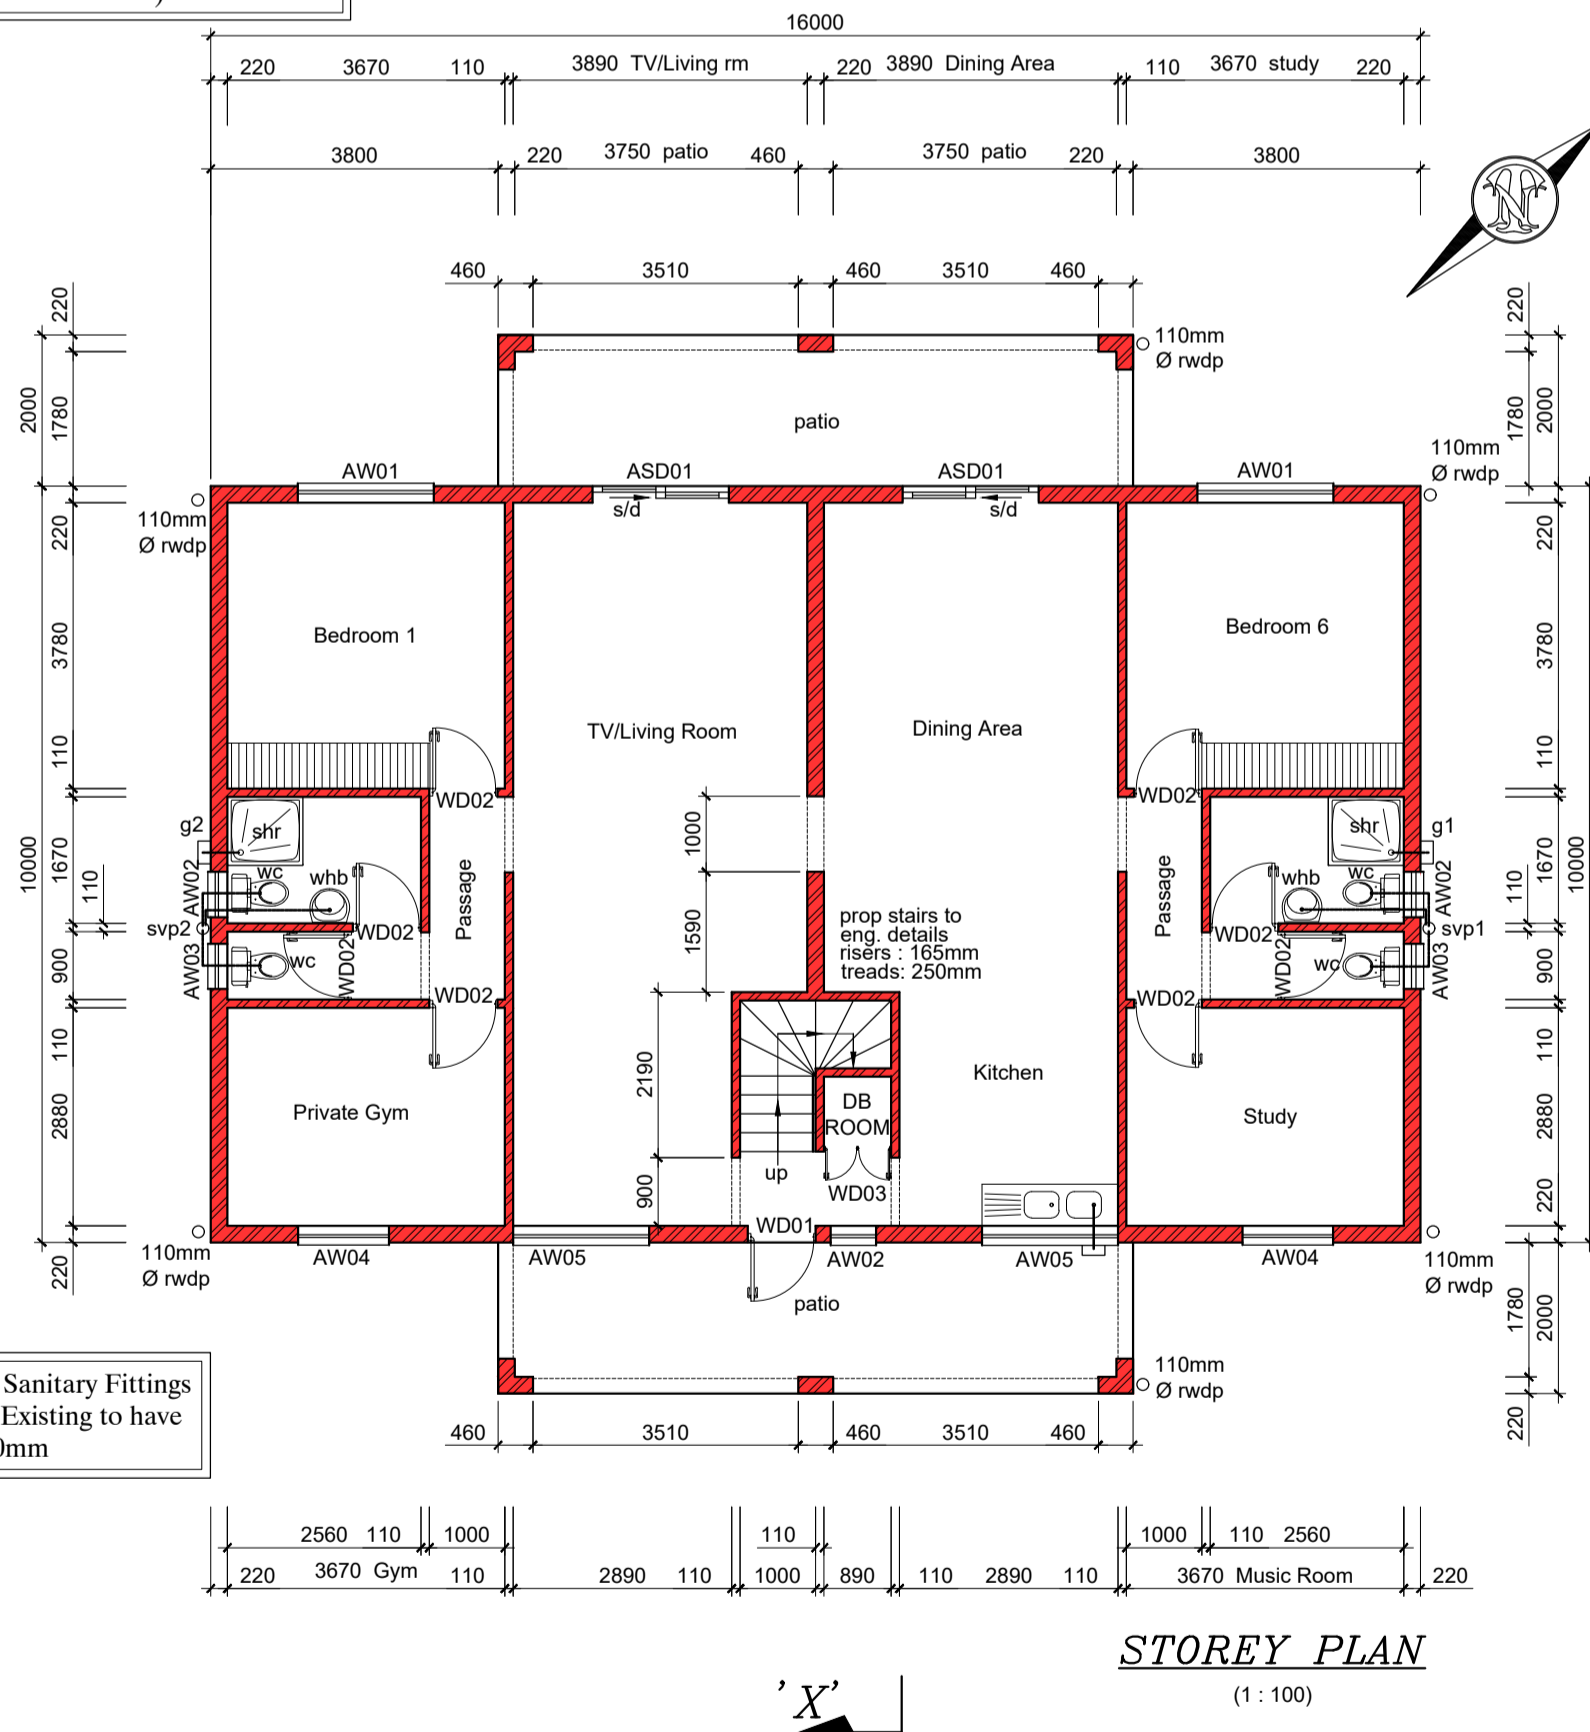

Invert of all new Sanitary Fittings Connecting into Existing to have min invert of 450mm




**NOTE: ENGINEER TO CERTIFY ADDITIONAL LOADING TO ROOF STRUCTURE DUE TO USE OF SOLAR PANELS**

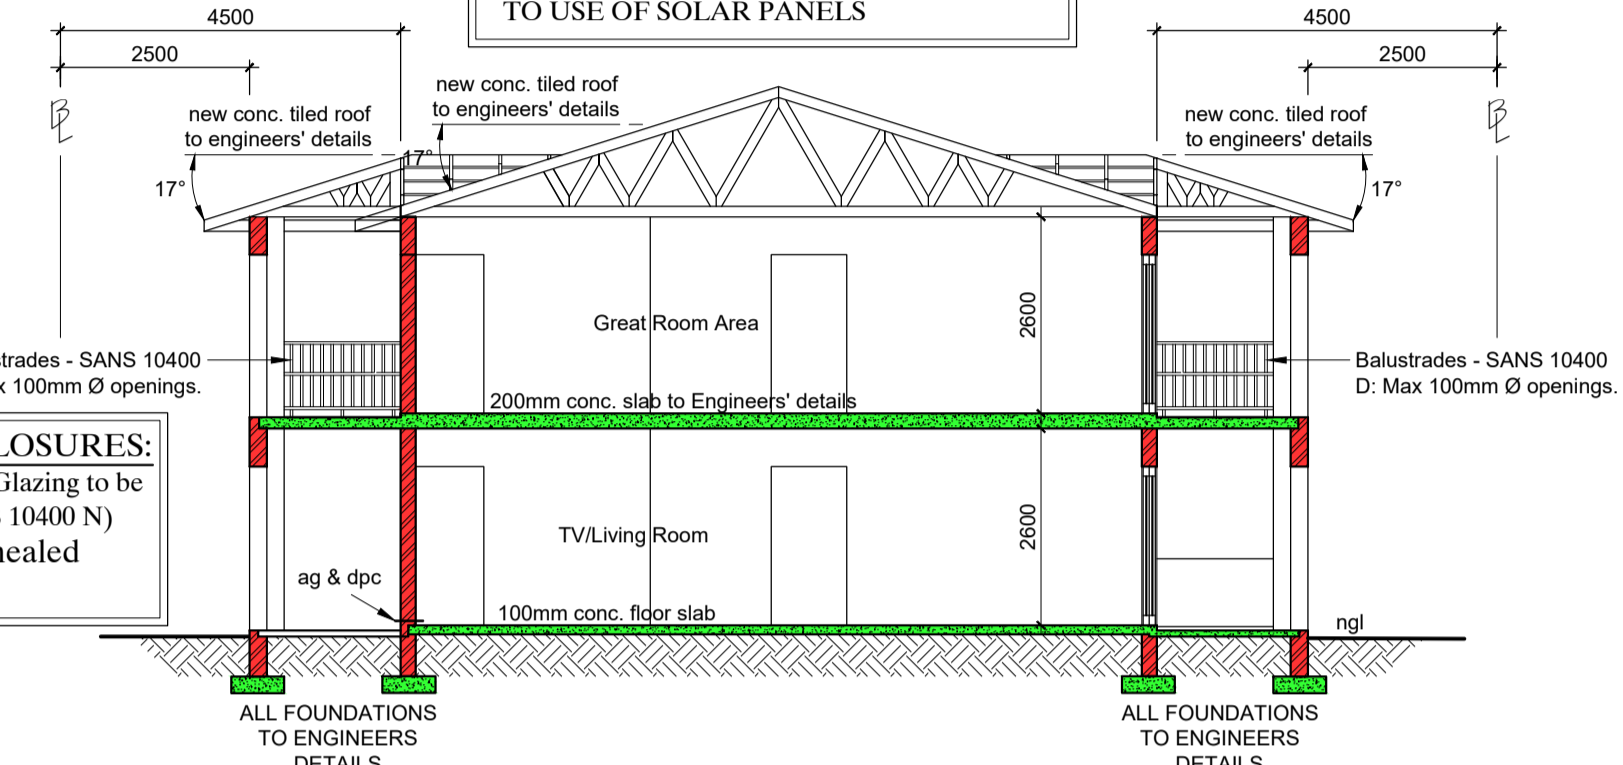


**SHOWERS ENCLOSURES:**  
 Shower Cubicles and Glazing to be of Safety Glass (SANS 10400 N) 6mm laminated annealed safety glass

**NOTE: ENGINEER TO CERTIFY ADDITIONAL LOADING TO ROOF STRUCTURE DUE TO USE OF SOLAR PANELS**

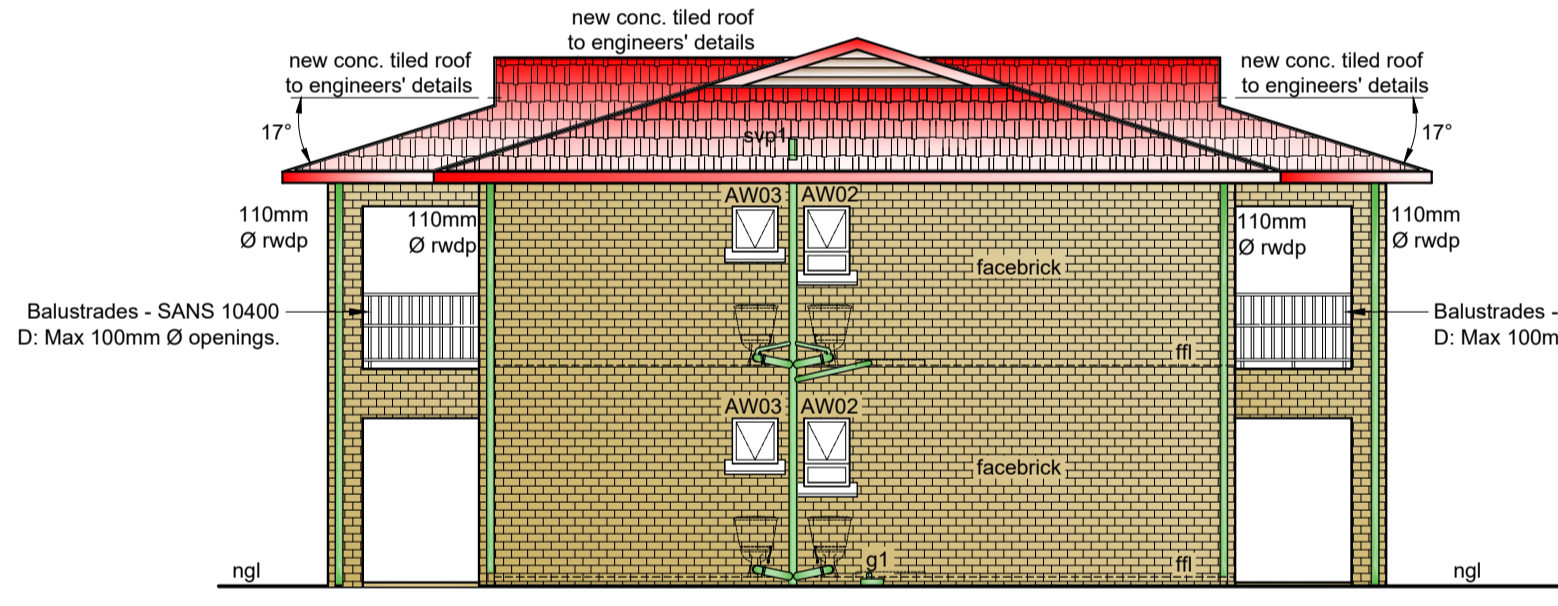

**SHOWERS ENCLOSURES:**  
 Shower Cubicles and Glazing to be of Safety Glass (SANS 10400 N) 6mm laminated annealed safety glass

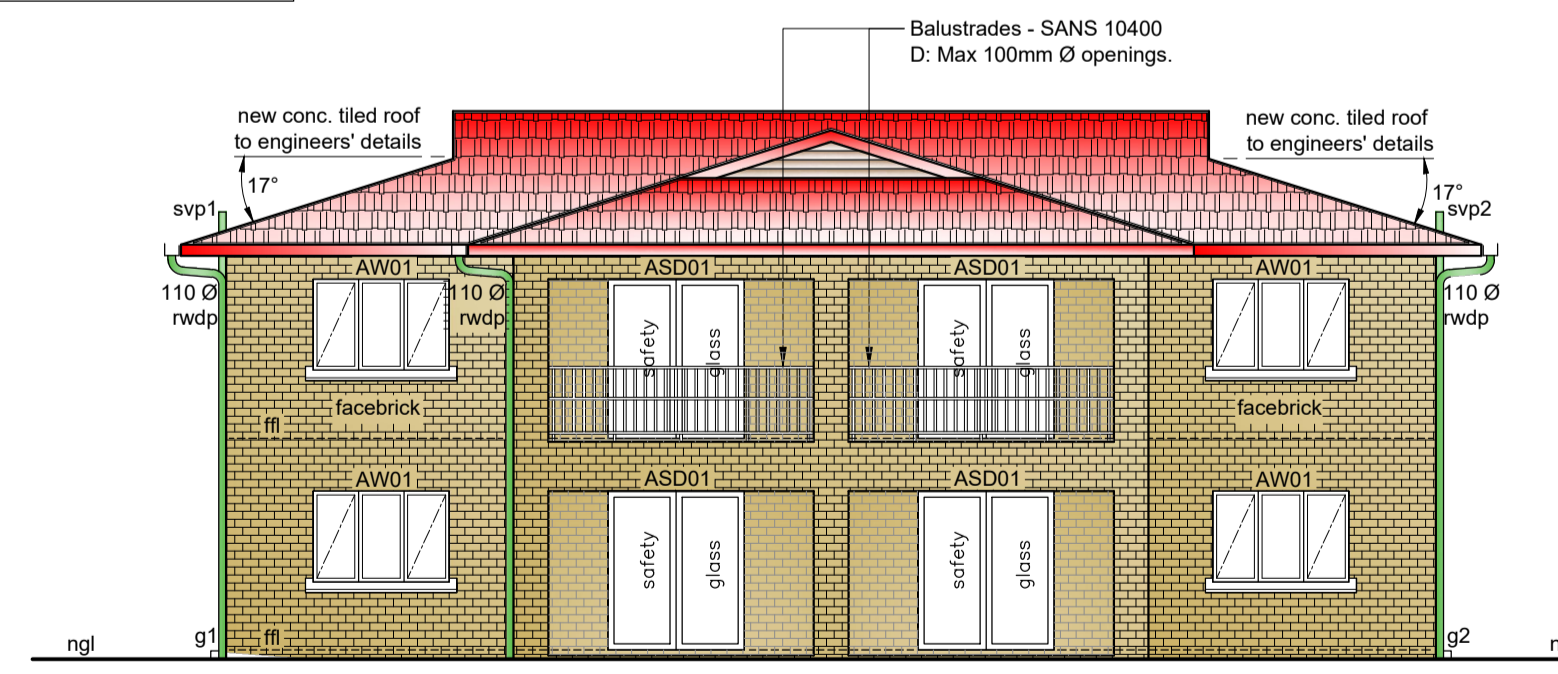


**Water Services:**  
 \* All plumbing to be undertaken by Durban ticked plumber and registered plumber.  
 \* All taps and fittings to be SABS / JASWIC approved.  
 \* All WCs to be fitted with external overflow.  
 \* Geyser to comply with SANS 10254 / 10400. All plumbing undertaken is to be to local authority water supply bylaws.

**SEWER & STORMWATER CONNECTIONS:**  
 Contractor to prove Tie-in point invert levels of services before commencing of this project & laying of service pipes.  
 Contractor to lay pipes from Tie-in back to house fittings so that adequate flow is achieved.  
 Note: If any pipe is less than 450mm to the invert, that length of pipe to be encased in concrete.


**SERVICES**  
 1) ALL PLUMBING TO COMPLY WITH SANS 10400  
 2) ALL NEW SERVICES TO BE LAID 1.5m FROM PERIMETER OF BUILDINGS.

**GLAZING**


Component	Type of glass	Max Size m <sup>2</sup>	Material Type	Thickness
AW01	non-safety glass	0.720	Monolithic annealed glass	3mm
AW02	safety glass	0.360	Laminated annealed safety glass	6mm
AW03	safety glass	0.360	Laminated annealed safety glass	6mm
AW04	non-safety glass	0.720	Monolithic annealed glass	3mm
AW05	non-safety glass	0.540	Monolithic annealed glass	3mm
ASD01	safety glass	1.890	Laminated annealed safety glass	6mm

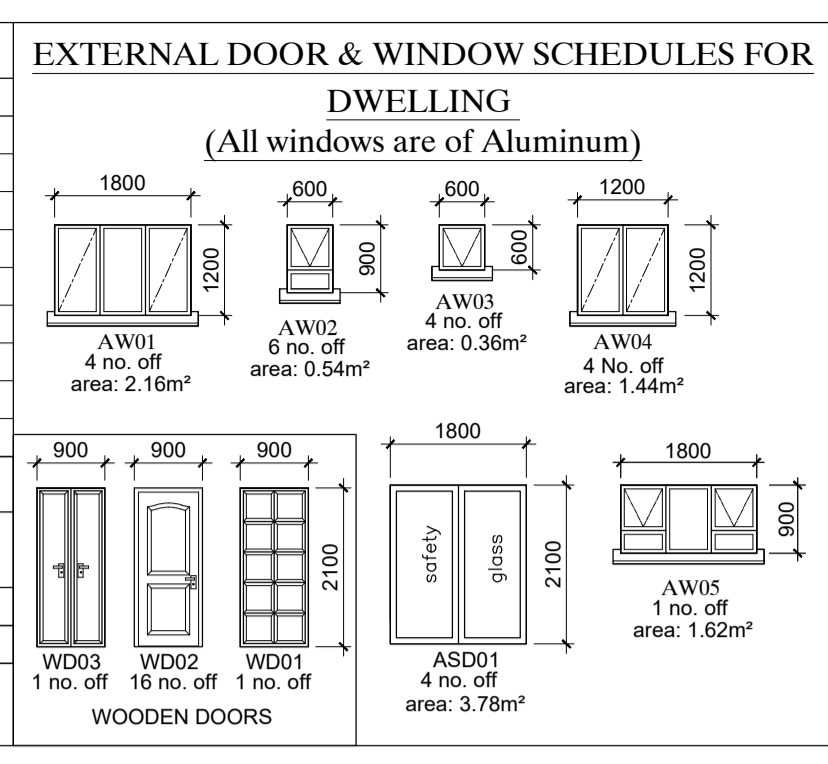

**NOTE:**  
 ALL INTERNAL PLUMBING TO COMPLY WITH SANS 10400-P (DRAINAGE).

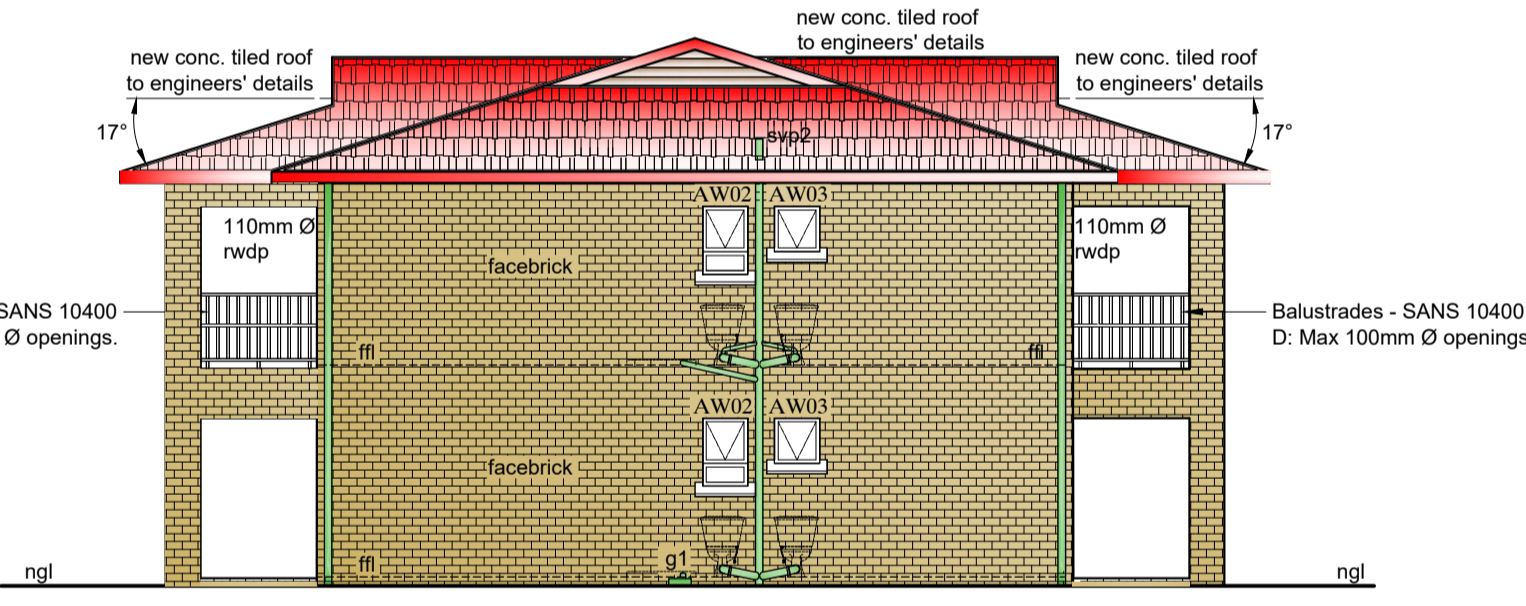

**NOTE: ENGINEER TO CERTIFY ADDITIONAL LOADING TO ROOF STRUCTURE DUE TO USE OF SOLAR PANELS**

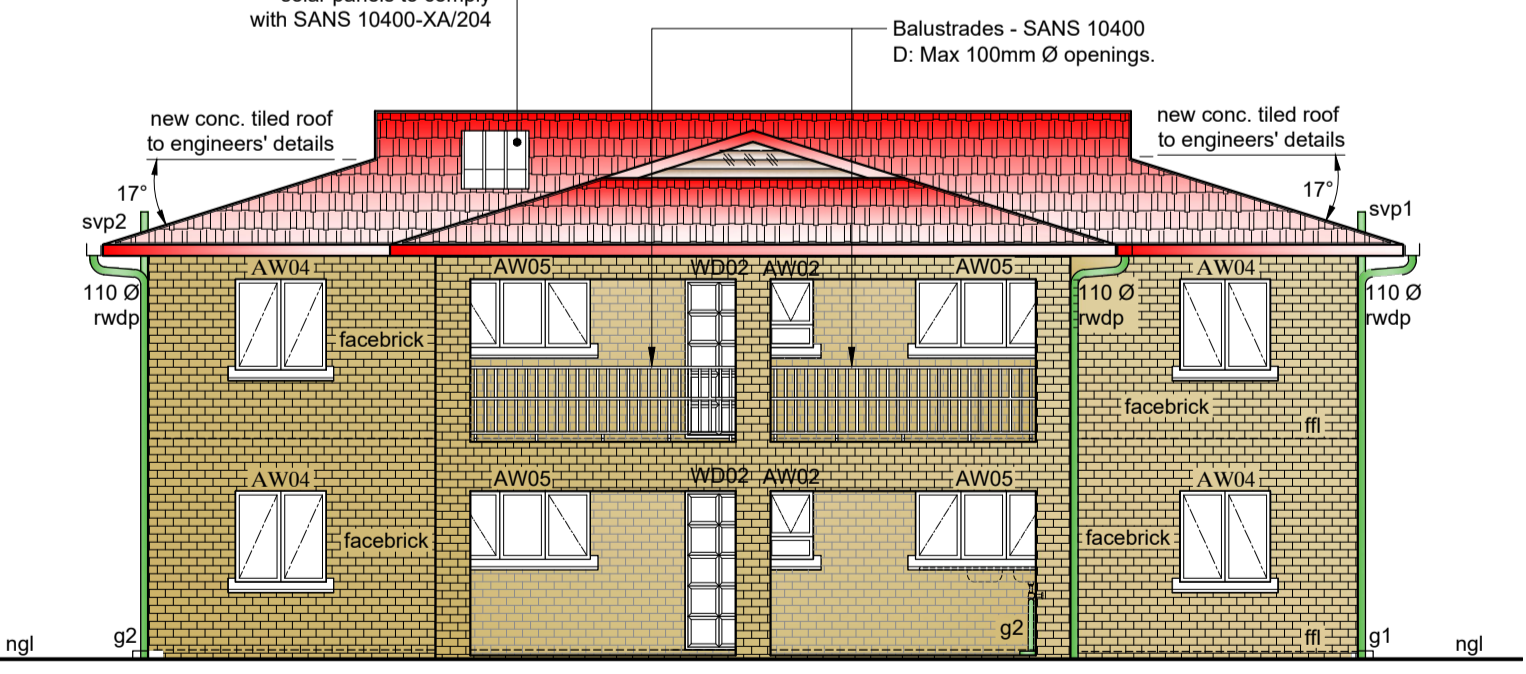

**SBD ShauBridge Designs**  
 ARCHITECTURAL AND ARCHITECTURAL SERVICES  
 N. Adams: Prof. Arch. Tech. Reg. No. T1154  
 26 MARIA CRESCENT AUSTERVILLE DURBAN 4052 cell: 083 7850276

**PROJECT:** DEMOLISH EX DWELL. & GARAGE PROPOSED NEW DWELLING, DOUBLE GARAGE AND BOUNDARY/RETAINING WALLS

**STREET ADDRESS:** 175 HILLHEAD ROAD

**LOT DISCRPTION:** REMAINDER OF ERF 940 OF WENTWORTH

**CLIENT:** MARLIN DEON KINSEY **CLIENT TEL:** 072 465 0215

**RATE NUMBER:** **CLIENT SIGNATURE:**

**SHEET 2 OF 3**  
**DRAWN:** N.A. **CHECKED BY:** N. Adams **SCALE:** AS SHOWN  
**DATE:** 15-05-2023 **DRG No.:** SBD 15052023

**SOIL CLASSIFICATION:**  
**A FLOOR SLAB:**  
 \* 30mm SCREED ON 100mm CONCRETE SLAB REINFORCED WITH BRC MESH ON 250MIC DAMPROOF MEMBRANE ON 50mm BLINDING LAYER OF CLEAN RIVER SAND TO BE LAID ON WELL RAMMED HARDWARE FILL.  
**B WALLS:**  
 \* 2 COURSES OF BRICKWORK (BLOCKWORK EVERY COURSE) REINFORCED WITH BRICKFORCE WITH SOLID JOINTS IN CEMENT MORTAR TO BE PROVIDED IN ALL WALLS AT BOTH WINDOWSILL & WALL PLATE LEVELS.  
**C ROOF:**  
 ALL ROOFING MEMBERS AND FIXTURES TO ENGINEERS' DETAILS AND SPECIFICATIONS  
 \* TILES ON 38 x 38 TIMBER BATONS ON 400 MICRON GUNPLAS DAKSEEL WATER PROOFING MEMBRANE, ON SAP GANG NAIL TRUSSES OR EQUIVALENT AT (TILES - 17.5° PITCH). MAX 880mm CENTERS, ON 114 x 38mm V5 WALL PLATES & TIED INTO MIN OF 3 COURSES OF BRICKWORK (2 COURSES OF BLOCKWORK) USING GALVANISED STEEL STRAPS, ALL TO ENGINEERS SPECIFICATION & DETAILS.  
 \* SANS 10400 APPROVED GUTTERS AND DOWNPIPES.  
 \* SANS 10400 APPROVED BARGE AND FASCIA BOARDS.

**D. GENERAL:**  
 1 ALL WORK TO COMPLY WITH N.B.R. & SANS 10400  
 2 THIS DRAWINGS IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT PROFESSIONAL ENGINEERS DRAWINGS, DETAILS & REPORTS. THE SPECIFICATION FOR THE WORKS, THE RELEVANT ARCHITECTS DRAWINGS & ANY OTHER SPECIALISTS DRAWINGS & REPORTS.  
 3 ALL WORK TO COMPLY WITH THE NATIONAL BUILDING REGULATIONS AND TO BE TO THE SATISFACTION OF THE LOCAL AUTHORITY RESIDENT BUILDING INSPECTOR.  
 4 USE FIGURED DIMENSIONS IN PREFERENCE TO SCALING.  
 5 CONTRACTOR IS TO CHECK ALL DIMENSIONS AND LEVELS PRIOR TO ANY COMMENCEMENT OF WORK AND REPORT ANY DISCREPANCIES TO THE DRAUGHTS PERSON.  
 6 CONTRACTOR IS TO CONFIRM AND ENSURE CORRECTNESS OF FLOOR AND ENTRANCE LEVELS PHYSICALLY ON SITE WITH LOCAL AUTHORITY INSPECTOR BEFORE COMMENCING WORK TO CONSIDER ALL SERVICE DRAINAGE HAS ADEQUATE FALLS TO CONNECTING SERVICES.  
 7 ENTRANCE LEVEL TO BE 270mm ABOVE EDGE OF ROAD DIRECTLY OPPOSITE PROPOSED ENTRANCE.  
 8 ALL CUT AND FILL BANKS TO BE 26 DEGREES TO THE HORIZONTAL.


**BOUNDARY WALLS:**  
 1 NO PART OF BOUNDARY WALLS OR THEIR FOUNDATIONS ARE TO ENDOACH OVER BOUNDARY LINE.  
 2 WALLS SPANNING SERVICES TO BE BUILT ON CONCRETE LINTELS.  
 3 BOUNDARY WALL FOOTINGS PARALLEL WITH SERVICE MUST NOT PROJECT MORE THAN 600mm INTO THE SERVIDUTE.

**DRAINAGE:**  
 1 THE CONTRACTOR IS REQUIRED TO ENSURE THAT THE LOCAL AUTHORITY INSTALLS THE NECESSARY STORMWATER AND OR SEWER CONNECTIONS BEFORE DRAINAGE WORK IS COMMENCED. IT IS THERE AFTER THE CONTRACTORS RESPONSIBILITY TO ENSURE ADEQUATE FALLS TO THESE CONNECTIONS.  
 2 THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT STORMWATER DAMAGE TO THE WORK IN PROGRESS OR NEIGHBOURING PROPERTIES DOES NOT OCCUR DURING CONSTRUCTION AND THAT THE SURFACE WATER DRAINAGE INSTALLED IS ADEQUATE.  
 3 ALL SANITARY FITTINGS TO BE TRAPPED AND/OR VENTED TO LOCAL AUTHORITY REQUIREMENTS.  
 4 ALL BENDS AND JUNCTIONS IN DRAINS TO BE PROVIDED WITH INSPECTION EYES.  
 5 ADEQUATE ACCESS PANELS TO BE FITTED IN ALL DUCTS OVER INSPECTION EYES.

**CERTIFICATES OF COMPLIANCE**  
 1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL CERTIFICATES, OR CERTIFICATES OF COMPLIANCE THAT ARE REQUIRED BY THE LOCAL AUTHORITY ARE OBTAINED BY HIM FROM ALL REGISTERED SERVICE PROVIDERS AND HANDED TO THE LOCAL AUTHORITY ON REQUEST.


**SCHEDULE OF AREAS (m<sup>2</sup>)**

SITE AREA	929.00
<b>EXISTING:</b>	
Main Dwelling (to be Demolished)	-129.00
Out-Building (to be Demolished)	-14.00
Single Garage (to be Demolished)	-36.00
<b>TOTAL:</b>	
PROPOSED:	
New Dwelling (storey plan)	193.60
(1st storey plan)	190.70
Double Garage	57.10
<b>TOTAL:</b>	441.4
EXIST COVER	
PROP COVER	250.70
<b>TOTAL COVERAGE:</b>	250.70

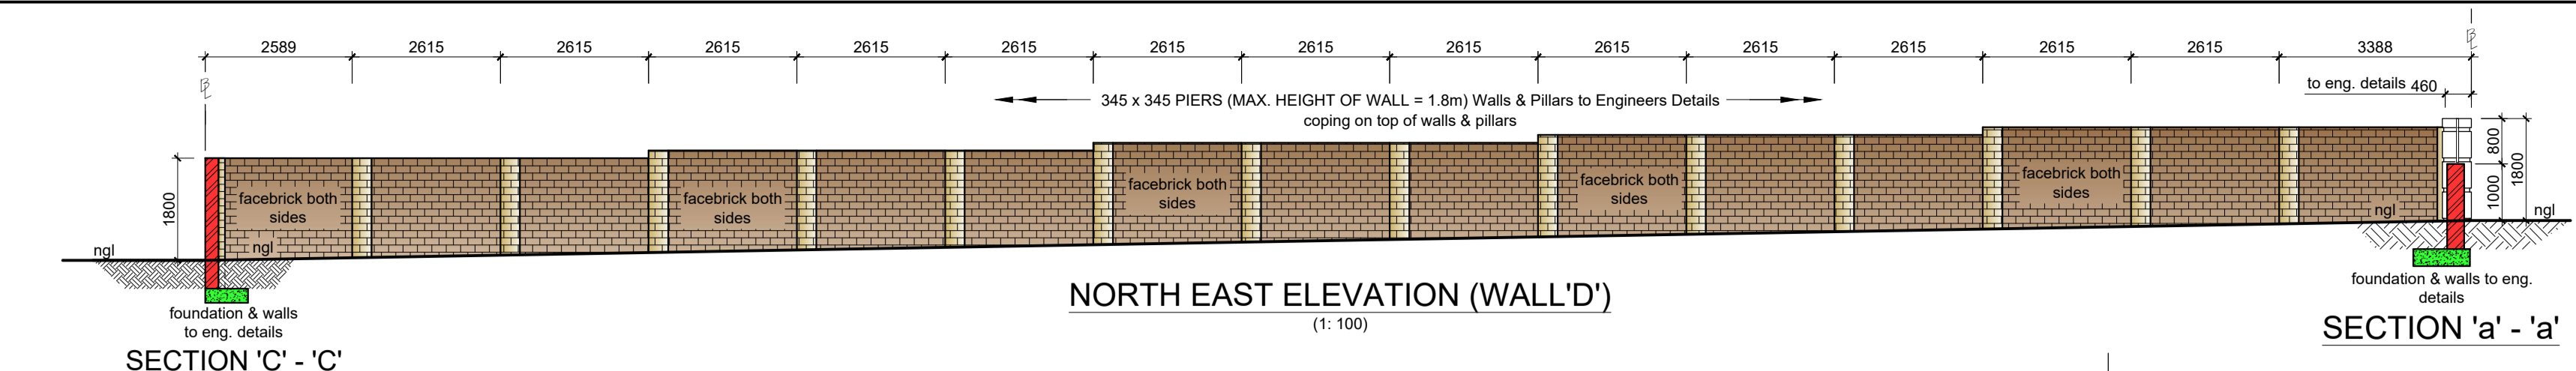


**NORTH EAST ELEVATION (WALL'D)**  
(1:100)

**SECTION 'a' - 'a'**  
(1:100)

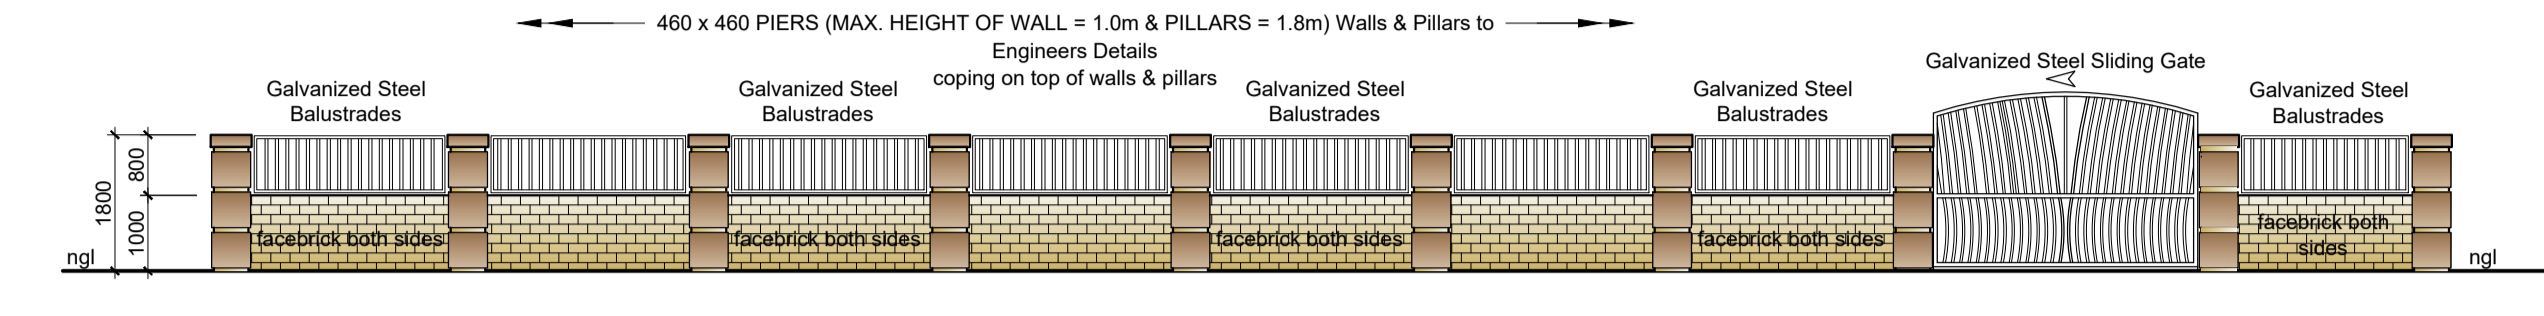


**NORTH WEST ELEVATION (WALL'A)**  
(1:100)

**SECTION 'A' - 'A'**  
(1:100)

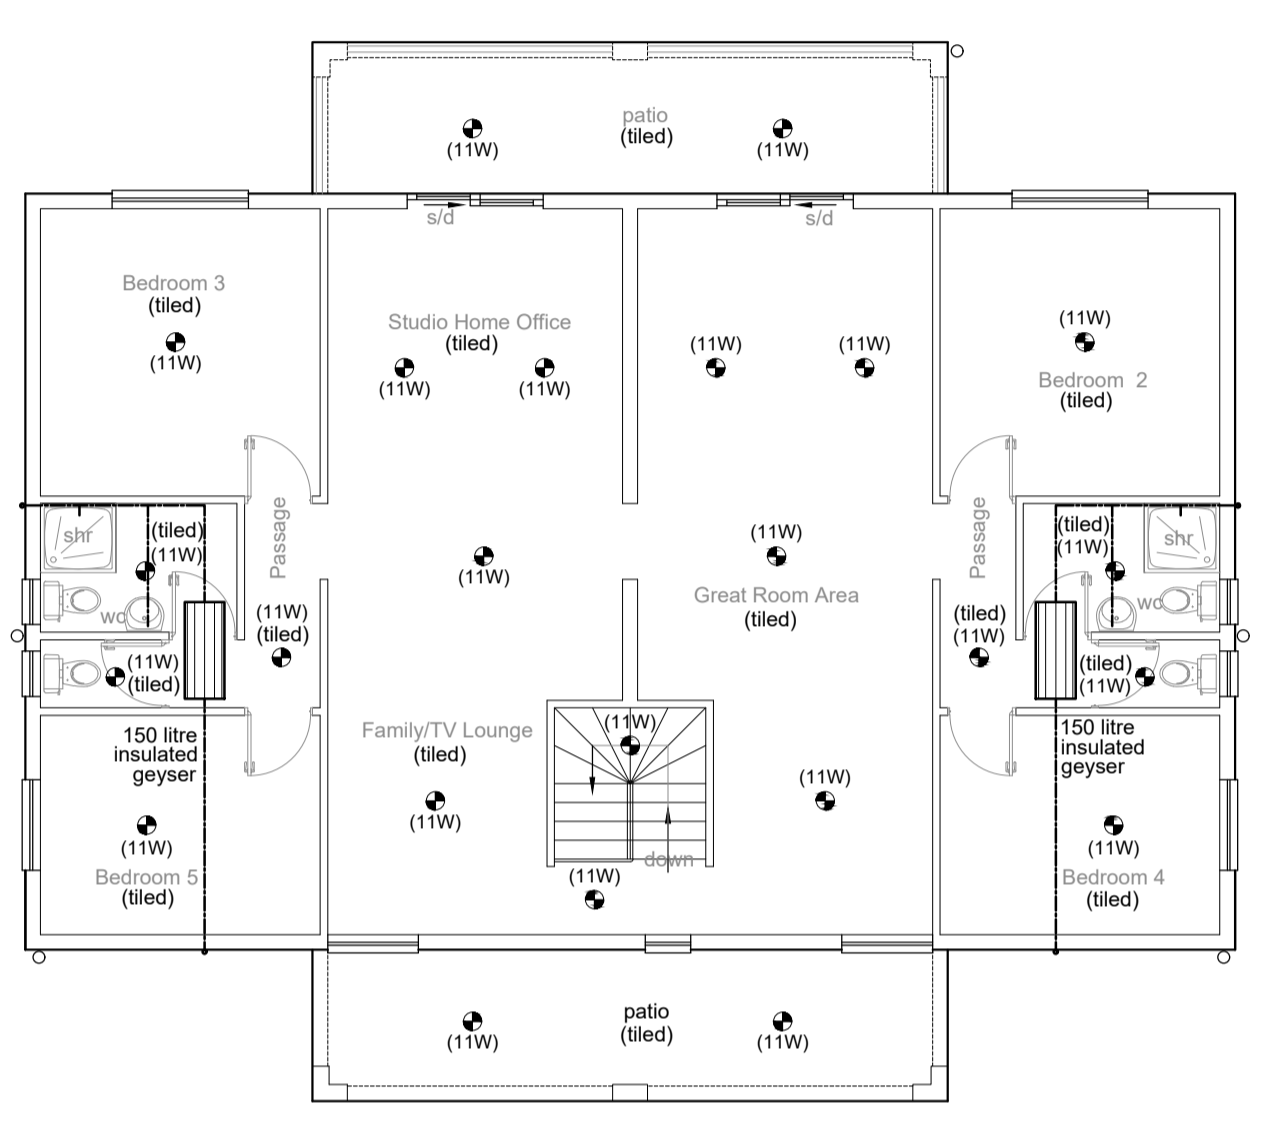

**FIRST STOREY PLAN**  
(1:100)

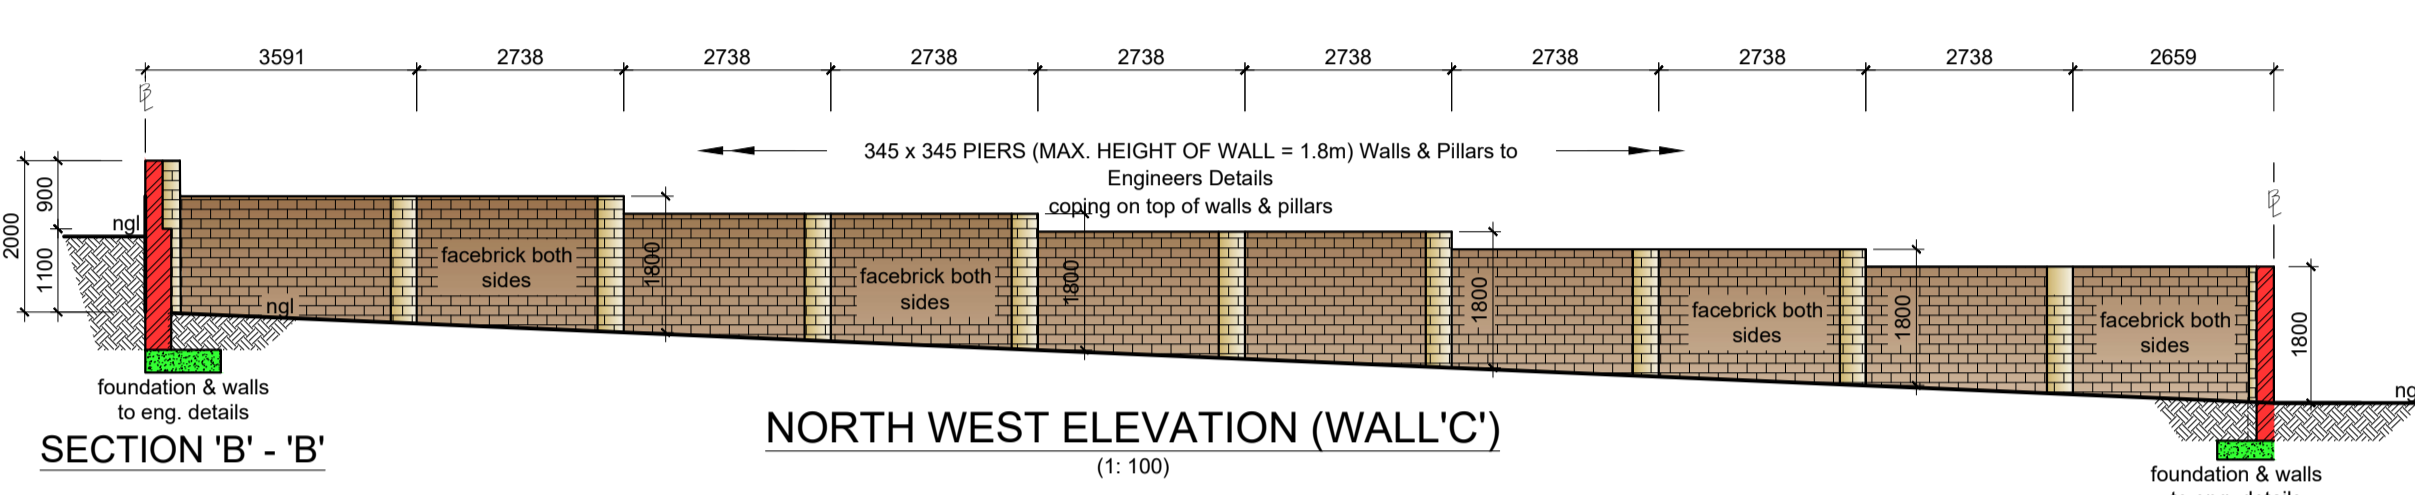

**NORTH WEST ELEVATION (WALL'C)**  
(1:100)

**SECTION 'B' - 'B'**  
(1:100)

**SECTION 'D' - 'D'**  
(1:100)




**STOREY PLAN**  
(1:100)


**SERVICES**  
1) ALL PLUMBING TO COMPLY WITH SANS 10400.  
2) ALL NEW SERVICES TO BE LAID 1.5m FROM PERIMETER OF BUILDINGS.

**Water Services:**  
\* All plumbing to be undertaken by ticketed and registered plumber.  
\* All taps and fittings to be SABS / JASWIC approved.  
\* All WCs to be fitted with external overflow.  
\* Geyser to comply with SANS 10254 / 10400. All plumbing undertaken is to be local authority water supply bylaws.  
**NOTE:** ALL INTERNAL PLUMBING TO COMPLY WITH SANS 10400-P (DRAINAGE).  
**WATER RETICULATION TO COMPLY WITH SANS 10252**


**SEWER & STORMWATER CONNECTIONS:**  
Contractor to prove Tie-In point invert levels of services before commencing of this project & laying of service pipes.  
Contractor to lay pipes from Tie-In back to house fittings so that adequate flow is achieved.  
**Note:** If any pipe is less than 450mm to the invert, that length of pipe to be encased in concrete.

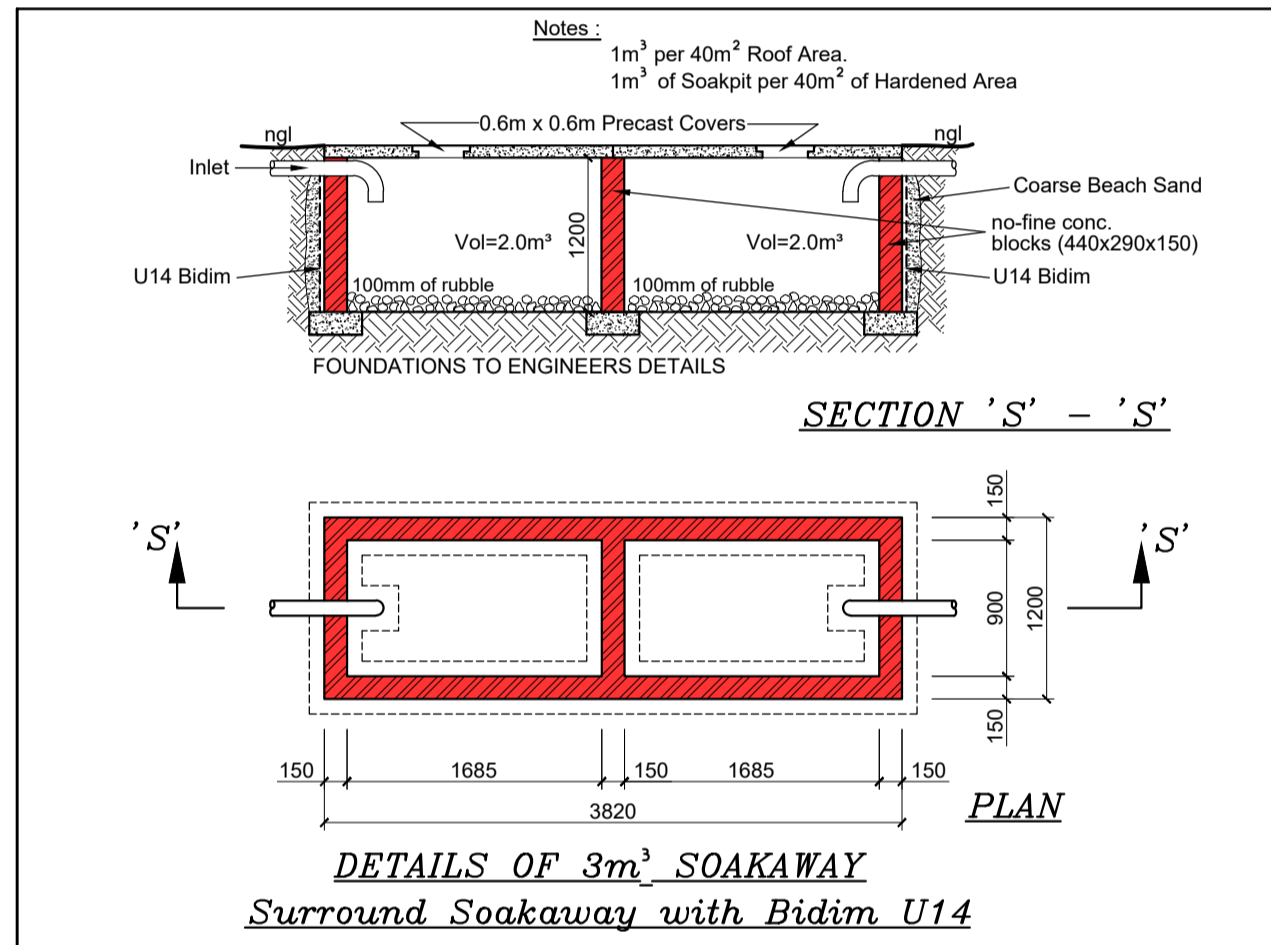

**DETAILS OF 3m<sup>3</sup> SOAKAWAY**  
Surround Soakaway with Bidim U14

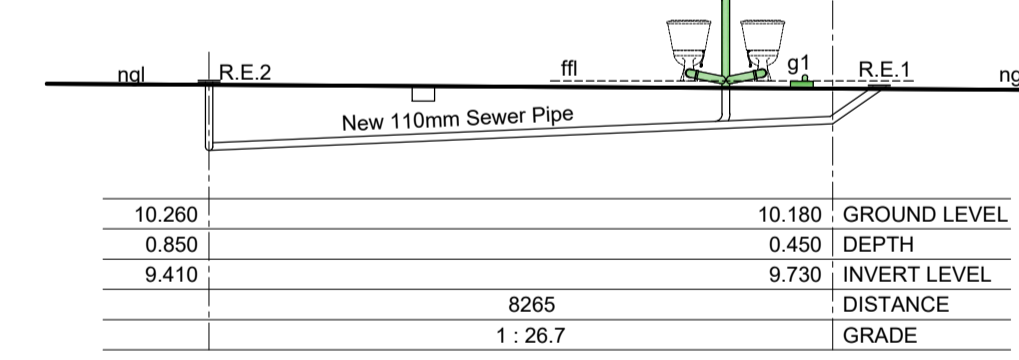


**SEWER SECTION**  
(from RE 1 to RE 2)  
(1:100)

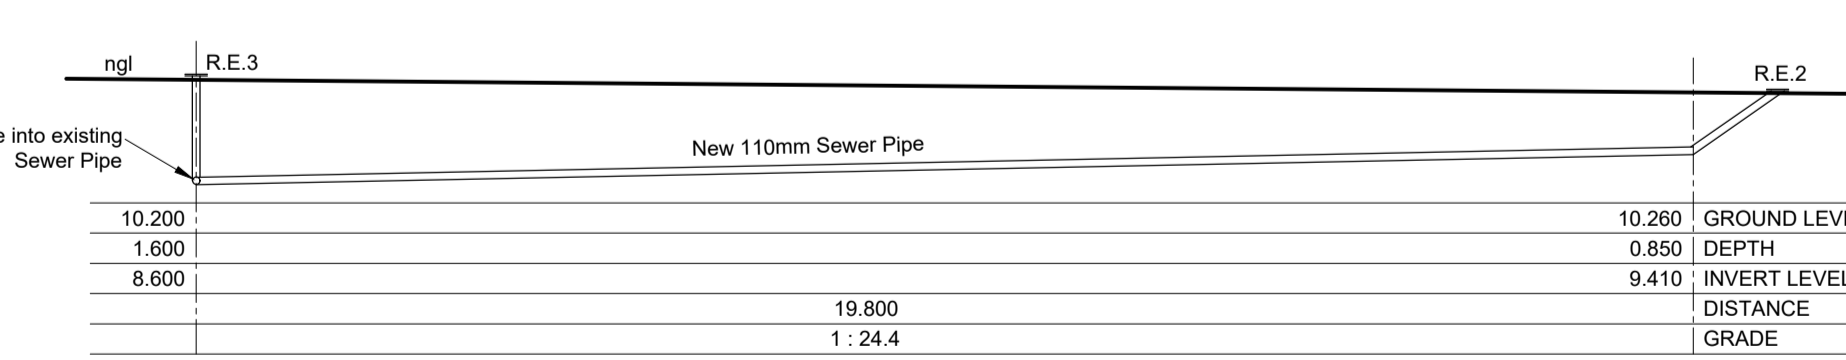

**SEWER SECTION**  
(from RE 2 to RE 3)  
(1:100)

STORMWATER MANAGEMENT CONTROL			
	Area (m <sup>2</sup> )	m <sup>2</sup>	m <sup>2</sup>
Site Area	990		
Site Area (40%)	396		
Roof Area	257		
Hardened Area	257		
Roof + Hardened Area	514		
Less 40% of Site Area	118		
Soakaway (1m <sup>3</sup> = 40m <sup>2</sup> )	360	9	40
Less 4m soakaway (160m <sup>2</sup> )	-242		
	-242 / 40 x 1.667 =		-10.085
Size of Water Tank req = -10085 Litres			
No Water Tank Needed			

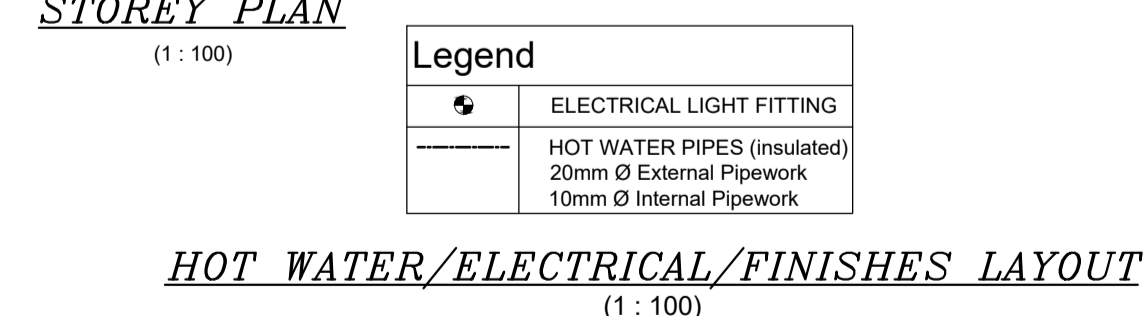

**HOT WATER/ELECTRICAL/FINISHES LAYOUT**  
(1:100)

**A FLOOR SLAB:**  
\* 30mm SCREED ON 100mm CONCRETE SLAB REINFORCED WITH BRC MESH ON 250MIC DAMPROOF MEMBRANE ON 50mm BLINDING LAYER OF CLEAN RIVER SAND TO BE LAID ON WELL RAMMED HARDWARE FILL.  
**B WALLS:**  
\* 2 COURSES OF BRICKWORK (BLOCKWORK EVERY COURSE) REINFORCED WITH BRICKFORCE WITH SOLID JOINTS IN CEMENT MORTAR TO BE PROVIDED IN ALL WALLS AT BOTH WINDOWSILL & WALL PLATE LEVELS.  
**C ROOF:**  
ALL ROOFING MEMBERS AND FIXTURES TO ENGINEERS' DETAILS AND SPECIFICATIONS  
\* TILES ON 38 x 38 TIMBER BATONS ON 400 MICRON GUNPLAS DAKSEEL WATER PROOFING MEMBRANE, ON SAP GANG NAIL TRUSSES OR EQUIVALENT AT (TILES - 17.5° PITCH). MAX 880mm CENTERS, ON 114 x 38mm V5 WALL PLATES & TIED INTO MIN OF 3 COURSES OF BRICKWORK (2 COURSES OF BLOCKWORK) USING GALVANISED STEEL STRAPS, ALL TO ENGINEERS SPECIFICATION & DETAILS.  
\* SANS 10400 APPROVED GUTTERS AND DOWNPIPES.  
\* SANS 10400 APPROVED BARGE AND FASCIA BOARDS.

**D. GENERAL:**  
1 ALL WORK TO COMPLY WITH N.B.R. & SANS 10400  
2 THIS DRAWINGS IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT PROFESSIONAL ENGINEERS DRAWINGS, DETAILS & REPORTS. THE SPECIFICATION FOR THE WORKS, THE RELEVANT ARCHITECT'S DRAWINGS & ANY OTHER SPECIALISTS DRAWINGS & REPORTS.  
3 ALL WORK TO COMPLY WITH THE NATIONAL BUILDING REGULATIONS AND TO BE TO THE SATISFACTION OF THE LOCAL AUTHORITY RESIDENT BUILDING INSPECTOR.  
4 USE FIGURED DIMENSIONS IN PREFERENCE TO SCALING.  
5 CONTRACTOR IS TO CHECK ALL DIMENSIONS AND LEVELS PRIOR TO ANY COMMENCEMENT OF WORK AND REPORT ANY DISCREPANCIES TO THE DRAUGHTS PERSON.  
6 CONTRACTOR IS TO CONFIRM AND ENSURE CORRECTNESS OF FLOOR AND ENTRANCE LEVELS PHYSICALLY ON SITE WITH LOCAL AUTHORITY INSPECTOR BEFORE COMMENCING WORK TO CONSIDER ALL SERVICE DRAINAGE HAS ADEQUATE FALLS TO CONNECTING SERVICES.  
7 ENTRANCE LEVEL TO BE 270mm ABOVE EDGE OF ROAD DIRECTLY OPPOSITE PROPOSED ENTRANCE.  
8 ALL CUT AND FILL BANKS TO BE 26 DEGREES TO THE HORIZONTAL.

9 ALL FOUNDATIONS TO BE TAKEN DOWN TO HARD VIRGIN GROUND AND TO BE INSPECTED BY THE PROJECT ENGINEER BEFORE ANY CONCRETE IS POURED.  
10 PROVIDE A MINIMUM OF TWO AIR BRICKS PER ROOM.  
11 ALL REINFORCED CONCRETE, FOUNDATIONS, BASES, COLUMNS, BEAMS, SLABS AND RETAINING WALLS ARE TO BE BUILT STRICTLY IN ACCORDANCE WITH PROFESSIONAL ENGINEERS DETAILS AND UNDER HIS SUPERVISION THEREOF.  
12 OWNER TO ENSURE THAT ALL MUNICIPAL CONNECTION FEES ARE PAID AND ALL ASPECTS OF LICENCING LEGAL REQUIREMENTS ARE ATTENDED TO.  
13 THE ATTENTION OF THE OWNER IS DRAWN TO THE FACT THAT CHANGES TO THE PLAN AND/OR SPECIFICATIONS AFTER OFFICIAL APPROVAL BY LOCAL AUTHORITY RENDERS THIS PLAN INVALID AND TO BE RESUBMITTED AS A DEVIATION PLAN AT OWNERS COST.  
**BOUNDARY WALLS:**  
1 NO PART OF BOUNDARY WALLS OR THEIR FOUNDATIONS ARE TO ENCRDACH OVER BOUNDARY LINE.  
2 WALLS SPANNING SERVITUDES TO BE BUILT ON CONCRETE LINTOLS.  
3 BOUNDARY WALL FOOTINGS PARALLEL WITH SERVITUDE MUST NOT PROJECT MORE THAN 600mm INTO THE SERVITUDE.

**DRAINAGE:**  
1 THE CONTRACTOR IS REQUIRED TO ENSURE THAT THE LOCAL AUTHORITY INSTALLS THE NECESSARY STORMWATER AND OR SEWER CONNECTIONS BEFORE DRAINAGE WORK IS COMMENCED. IT IS THERE AFTER THE CONTRACTORS RESPONSIBILITY TO ENSURE ADEQUATE FALLS TO THESE CONNECTIONS.  
2 THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT STORMWATER DAMAGE TO THE WORK IN PROGRESS OR NEIGHBOURING PROPERTIES DOES NOT OCCUR DURING CONSTRUCTION AND THAT THE SURFACE WATER DRAINAGE INSTALLED IS ADEQUATE.  
3. ALL SANITARY FITTINGS TO BE TRAPPED AND/OR VENTED TO LOCAL AUTHORITY REQUIREMENTS.  
4. ALL BENDS AND JUNCTIONS IN DRAINS TO BE PROVIDED WITH INSPECTION EYES.  
5. ADEQUATE ACCESS PANELS TO BE FITTED IN ALL DUCTS OVER INSPECTION EYES.  
**CERTIFICATES OF COMPLIANCE**  
1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL CERTIFICATES, OR CERTIFICATES OF COMPLIANCE THAT ARE REQUIRED BY THE LOCAL AUTHORITY ARE OBTAINED BY HIM FROM ALL REGISTERED SERVICE PROVIDERS AND HANDED TO THE LOCAL AUTHORITY ON REQUEST.

**POWER & LIGHTING CALCULATIONS FOR DWELING**

Occupancy:	H4	
Area :	Storey Plan=	320 m <sup>2</sup>
	Total =	320 m <sup>2</sup>

**Energy Demand**

320 x 5Wm = 1600 W

320 x 5Wm = 1600 kwh

**List of Rooms**

Bedroom 1	1 x 11W =	11 W
Bedroom 2	1 x 11W =	11 W
Bedroom 3	1 x 11W =	11 W
Bedroom 4	1 x 11W =	11 W
Bedroom 5	1 x 11W =	11 W
Shr/Toilet x 4	4 x 11W =	44 W
Toilet x 4	4 x 11W =	44 W
Kitchen / Dining Room	4 x 11W =	44 W
TV/Living Room	4 x 11W =	44 W
Great Room Area	4 x 11W =	44 W
Studio Home Office	2 x 11W =	22 W
Family/TV Lounge	2 x 11W =	22 W
Passage x 4	4 x 11W =	44 W
Private Gym	1 x 11W =	11 W
Study	1 x 11W =	11 W
Music Room	1 x 11W =	11 W
Stairwell	3 x 11W =	33 W
patio x 2	4 x 11W =	44 W
DB Room	1 x 11W =	11 W
<b>Total :</b>	<b>43 x 11W =</b>	<b>473 W</b>

**Light Usage :** Morning 2hrs + Evening 5hrs = Total 7hrs

Annual Usage : 7hrs @ 7 days @ 52 weeks = 2548 hrs

Annual Consumption : 473 W x 2548 hrs = 1205204 WH

= 1205.204 KWH

**Result :**

Maximum Energy Demand : 473 W

Maximum Energy Consumption : 1205.204 WH

Achieved Demand < Permitted Demand

473 W < 1600 W

Achieved Consumption < Permitted Demand

1205.204 KWH < 1600 KWH

**Hot Water Supply**

- All internal hot water supply pipes (19mm) to be insulated with a material with a minimum 'R' Value of 1,000 (40 x 40 x 6mm pvc or fibre glass pipe insulation.)
- All hot water vessels/tanks to be insulated with a material achieving a minimum 'R' Value of 2,000 (foil faced glasswool blanket)

(All to manufacturers specifications and to comply with SANS 10400-Part XA)

**Consumption**

12 persons @ 30 litres per person @ 365 days

= 131400 litres per annum (total consumption)

Hot water per person = 15 litres

12 persons x 15 litres per person x 365 days

= 65700 litres per annum (total hot water consumption)

50% of hot water to be by solar panels:

0,5 x 65700

= 32850 litres

**Roof Insulation**

Ventilation : Unvented

Climatic Zone : 5

Orientation : South East

**R' Values**

Clay Roof Tiles :	0.48
Plaster Board Gypsum Ceiling	0.06
80mm Roof Insulation - Fibreglass blanket at 300mm Overlap (Required R Value)	2.83
<b>Total 'R' Value for roof</b>	<b>3.37</b>
<b>Direction of heat flow</b>	<b>downwards</b>

**Ceiling**

Ceiling insulation : 11,5

Thermal Conductivity : 0,046w/mk

Ceiling insulation is to be by 80mm flexible Polyester blanket with a density of : 11,5kg/m<sup>3</sup>

**Walls**

Walls to have a 'CR' Value of 60 and to have an 'R' Value of 0,35

**SCHEDULE OF AREAS (m<sup>2</sup>)**

SITE AREA	929.00
EXISTING:	
Main Dwelling (to be Demolished)	-129.00
Out-Building (to be Demolished)	-14.00
Single Garage (to be Demolished)	-36.00
TOTAL:	
PROPOSED:	
New Dwelling (storey plan)	193.60
(1st storey plan)	190.70
Double Garage	57.10
TOTAL:	441.4
EXIST COVER	
PROP COVER	250.70
TOTAL COVERAGE:	250.70
F.A.R.	

**SBD**  
**ShauBridge Designs**  
ARCHITECTURAL AND DRAUGHTING SERVICES  
N. Adams: Prof. Arch. Tech. Reg. No. T1154  
26 MARIA CRESCENT  
AUSTERVILLE  
DURBAN  
cell : 083 7850276

PROJECT : DEMOLISH EX DWELL. & GARAGE  
PROPOSED NEW DWELLING,  
DOUBLE GARAGE AND  
BOUNDARY/RETAINING WALLS

STREET ADDRESS :  
**175 HILLHEAD ROAD**

LOT DISCRPTION :  
**REMAINDER OF ERF 940 OF WENTWORTH**

CLIENT :  
**MARLIN DEON KINSEY** CLIENT TEL :  
072 465 0215

RATE NUMBER :  
CLIENT SIGNATURE :  
*[Signature]*

SHEET **3** OF **3**  
DRAWN : N.A.  
CHECKED BY : N. Adams  
DATE : 15-05-2023  
SCALE : AS SHOWN  
DRG No. SBD 15052023