

CAMDEN I WIND RF (PTY) LTD

ENVIRONMENTAL ACOUSTIC IMPACT ASSESSMENT

CAMDEN I WIND ENERGY FACILITY

21 JULY 2022





ENVIRONMENTAL ACOUSTIC IMPACT ASSESSMENT

CAMDEN I WIND ENERGY FACILITY

CAMDEN I WIND RF (PTY) LTD

REPORT (VERSION 01)

PROJECT NO.: 41103247

DATE: JULY 2022




WSP
BUILDING C, KNIGHTSBRIDGE
33 SLOANE STREET
BRYANSTON, 2191
SOUTH AFRICA

T: +27 11 361 1380

F: +086 606 7121

WSP.COM

QUALITY MANAGEMENT

ISSUE/REVISION	FIRST ISSUE	REVISION 1	REVISION 2	REVISION 3
Remarks	Report	Report		
Date	16 May 2022	21 July 2022		
Prepared by	K. Collett	K. Collett		
Signature				
Checked by	B. Keiser	B. Keiser		
Signature				
Authorised by	B. Keiser	B. Keiser		
Signature				
Project number	41103247			
Report number	1 of 1			
File reference	\\corp.pbwan.net\za\Central_Data\Projects\41100xxx\41103247 - Enertrag Mpumalanga EIA\41 AQ\01-Reports\01-Final\Noise\NIA			

GLOSSARY OF TERMS

Sound	Sound is small fluctuations in air pressure, measured in Newtons per square meter (N/m^2) or Pascals (Pa) that are transmitted as vibrational energy via a medium (air) from the source to the receiver. The human ear is a pressure transducer, which converts these small fluctuations in air pressure into electrical signals, which the brain then interprets as sound.
Noise	Noise is generally defined as unwanted sound.
Sound or noise level	A sound or noise level is a sound measurement that is expressed in decibels (dB or dB(A)).
dB or dB(A)	The human ear is a sensitive instrument that can detect fluctuations in air pressure over a wide range of amplitudes. This limits the usefulness of sound quantities in absolute terms. For this reason, a sound measurement is expressed as ten times the logarithm of the ratio of the sound measurement to a reference value, 20 micro (millionth) Pa. This process converts a scale of constant increases to a scale of constant ratios and considerably simplifies the handling of sound measurement quantities. The attached 'A' indicates that the sound measurement has been A-weighted.
dB(Z)	Historically sound levels were read off a hand-held meter and the noise levels were noted in dB, after the development of different weighting curves sound levels were noted as Z-weighting or dB(Z) to reduce the confusion with different type of weighting applied noise levels. dB(Z) refers to linear noise levels.
A-weighting	The human ear is not equally sensitive to sound of all frequencies, i.e. it is less sensitive to low pitched (or 'bass') than high pitched (or 'treble') sounds. In order to compensate when making sound measurements, the measured value is passed through a filter that simulates the human hearing characteristic. Internationally this is an accepted procedure when working with measurements that relate to human responses to sound/noise.
Ambient sound level	Ambient noise will be defined as the totally encompassing sound in a given situation at a given time, and is usually composed of sound from many sources, both near and far.
Annoyance	General negative reaction of the community or person to a condition creating displeasure or interference with specific activities.
Sound pressure	Sound pressure is the force of sound exerted on a surface area perpendicular to the direction of the sound and is measured in N/m^2 or Pa. The human ear perceives sound pressure as loudness and can also be expressed as the number of air pressure fluctuations that a noise source creates.
Sound pressure level	The sound pressure level is a relative quantity as it is a ratio between the actual sound pressure and a fixed reference pressure. The reference pressure is usually the threshold of hearing, namely 20 microPascals (μPa).
Sound power	Sound power is the rate of sound energy transferred from a noise source per unit of time in Joules per second (J/s) or Watts (W).
Sound power level	The sound power level is a relative quantity as it relates the sound power of a source to the threshold of human hearing (10^{-12} W). Sound power levels are expressed in dB(A), as they are referenced to sound detected by the human ear (A-weighted).
Noise nuisance	Noise nuisance means any sound which disturbs or impairs or may disturb or impair the convenience or peace of any person.
Octave bands	The octave bands refer to the frequency groups that make a sound. The sound is generally divided in to nine groups (octave bands) ranging from 32 Hertz (Hz) to 8,000 Hz. The lower frequency ranges of a sound have a vibrating character where the higher frequency of sound has the character of high-pitched sound. In viewing the total octave bands scale from 32 Hz to 8000 Hz the character of the sound can be described.

ACRONYMS AND ABBREVIATIONS

CadnaA	Computer Aided Noise Abatement
CIW	Camden I Wind RF (Pty) Ltd
dB	Decibel
dB(A)	A-weighted sound measurement
dB(C)	C-weighted sound measurement
dB(Z)	Z-weighted sound measurement
DMRE	Department of Mineral Resources and Energy
EHS	Environmental health and Safety
ESIA	Environmental and Social Impact Assessment
ETSU	Energy Technology Support Unit
ha	Hectare
Hz	Hertz
IFC	International Finance Corporation
km	Kilometre
kV	Kilovolt
L _{A90}	Noise level exceeded for 90% of the measurement period
L _{Aeq}	Equivalent continuous sound pressure level
L _{R,dn}	Equivalent continuous day/night rating level
L _{Req,d}	Equivalent continuous rating level for day-time
L _{Req,n}	Equivalent continuous rating level for night-time
L _{Req,T}	Typical noise rating levels
m	Metre
m/s	Meters per second
MW	Megawatt
OECD	Organisation for Economic Co-operation and Development
REIPP	Renewable Energy Independent Power Producer Procurement Programme
SACNASP	South African Council for Natural Scientific Professions
SANS	South African National Standards
WEF	Wind Energy Facility
WHO	World Health Organisation
WSP	WSP Group Africa (Pty) Ltd

EXECUTIVE SUMMARY

ENERTRAG South Africa (Pty) Ltd a subsidiary of the renewable energy company, ENERTRAG SE, are proposing to establish the Camden I Wind Energy Facility (WEF) near Ermelo, in the Mpumalanga Province. The proposed WEF will consist of up to 37 wind turbines, with a hub height and rotor diameter of up to 200 m. The Camden I WEF forms part of the Camden Renewable Energy Complex.

WSP Group Africa (Pty) Ltd has been appointed to undertake the Environmental and Social Impact Assessment (ESIA) for the Project. Wind turbines have the potential to generate noise and as such a specialist Environmental Acoustic Impact Assessment is required as part of the ESIA process for the Camden I WEF. This report presents the findings of the Screening-Level Environmental Acoustic Impact Assessment performed. It is noted that noise impacts are anticipated from the wind turbines, however, noise from the powerlines will be negligible and as such impacts for these have not been assessed.

The International Finance Corporation (IFC) Environmental Health and Safety (EHS) guidelines for Wind Energy were followed for this assessment, which is primarily based on the Energy Technology Support Unit's (ETSU) ETSU-R-97 report. Such guidance stipulates that a preliminary modelling exercise is executed using a simple model which assumes hemispherical propagation of noise from each turbine to determine potential impact on receptors within a 2 km radius of the turbines. If L_{A90} noise levels at all sensitive receptors are below 35 dB(A) at a wind speed of 10 m/s (at a height of 10 m) during day and night times, this would be sufficient to assess the noise impact of the proposed facility, offering adequate protection of amenity at these receptors. If L_{A90} levels at any receptor location are above 35 dB(A), then impacts at these receptors may be perceived and potential turbine relocations may need to be considered. In low noise environments, the ETSU-R-97 report itself, however, stipulates that noise from wind farms should be limited to a range between 35 and 40 dB(A) (daytime). Additionally, a fixed limit of 43 dB(A) should be implemented during night-time. This should increase to 45 dB(A) (day and night) if the potential receptors have financial investments in the facility. With the Camden I WEF being located within a low noise environment a combination of the IFC and ETSU methodology was followed in this assessment.

Twelve sensitive receptors (farmhouses) were identified within 2 km of the site. Based on WSP's preliminary model (following the IFC methodology), the following was determined:

- Results indicate that predicted L_{A90} noise levels during both day and night are below the 35 dB(A) threshold, as stipulated in the IFC EHS guidance, at four of the twelve receptors.
- Noise levels at C1_Rec 01, C1_Rec 02, C1_Rec 05, C1_Rec 07, C1_Rec 08, C1_Rec 09, C1_Rec 10 and C1_Rec 12 are predicted to be above the threshold indicating that noise from the turbines could create a nuisance or impact at these locations.
- However, being a low noise environment, with reference to the ETSU daytime limit range of 35 – 40 dB(A), L_{A90} noise levels at seven of the twelve receptor locations are below this threshold. Additionally, at night, L_{A90} levels at all receptor locations are below the ETSU 43 dB(A) threshold.
- It is, however, understood that all of the surrounding receptors have direct interest and are vested in the Project, thus a blanket threshold value of 45 dB(A) (day and night) applies. Predicted noise levels at all receptor locations are below this 45 dB(A) threshold, and complaints are not anticipated.

The resultant environmental acoustic risks associated with the construction phase of the Project are anticipated to be “low” to “very low” with general mitigation options employed. For the operational phase, impacts are anticipated to be “low” as it is understood that the surrounding receptors are all vested in the Project. Ultimately, should no complaints from receptors arise, it is recommended that the Project can be considered for authorisation.

TABLE OF CONTENTS

1	INTRODUCTION.....	1
1.1	TERMS OF REFERENCE.....	1
1.2	NOISE SPECIALIST PROTOCOL CHECKLIST	1
1.3	DECLARATION OF INDEPENDENCE	4
2	BACKGROUND.....	4
2.1	LOCALITY	4
2.2	TOPOGRAPHY	4
2.3	SENSITIVE RECEPTORS	4
2.4	PROJECT DESCRIPTION	10
2.5	WIND TURBINES AND NOISE	11
2.6	EXISTING NOISE CLIMATE	12
3	ACOUSTIC FUNDAMENTALS.....	13
3.1	PRINCIPLES	13
3.2	NOISE PROPAGATION.....	14
3.3	CHARACTERISTICS OF NOISE	14
4	LEGISLATIVE FRAMEWORK.....	16
4.1	SOUTH AFRICAN LEGISLATION.....	16
4.2	WORLD HEALTH ORGANISATION GUIDELINES FOR COMMUNITY NOISE	19
4.3	INTERNATIONAL FINANCE CORPORATION GUIDELINES	19



4.4	THE ASSESSMENT AND RATING OF NOISE FROM WIND FARMS (ETSU).....	19
5	METHODOLOGY	21
6	ASSUMPTIONS AND LIMITATIONS	21
7	RESULTS.....	22
7.1	CONSTRUCTION PHASE	22
7.2	OPERATIONAL PHASE.....	22
7.3	CUMULATIVE ASSESSMENT.....	23
8	ASSESSMENT OF IMPACTS	24
9	CONCLUSIONS	25
10	REFERENCES.....	26

TABLES

TABLE 1:	SENSITIVE RECEPTORS SURROUNDING THE PROJECT SITE	5
TABLE 2:	PROJECT SUMMARY OF THE CAMDEN I WEF	11
TABLE 3:	TYPICAL NOISE LEVELS	13
TABLE 4:	FREQUENCY WEIGHTING TABLE FOR THE DIFFERENT WEIGHTING CURVES	15
TABLE 5:	TYPICAL RATING LEVELS FOR NOISE IN DISTRICTS (ADAPTED FROM SANS 10103:2008).....	18
TABLE 6:	CATEGORIES OF COMMUNITY/GROUP RESPONSE (ADAPTED FROM SANS 10103:2008).....	18
TABLE 7:	IFC ENVIRONMENTAL NOISE LEVEL GUIDELINES.....	19
TABLE 8:	PREDICTED NOISE LEVELS AT SENSITIVE RECEPTORS.....	23
TABLE 9:	IMPACT ASSESSMENT OF RISKS ASSOCIATED WITH THE OPERATION OF THE CAMDEN I WEF	24

FIGURES

FIGURE 1:	LOCATION OF THE PROJECT SITE.....	6
FIGURE 2:	LAYOUT OF PROPOSED CAMDEN I WEF	7
FIGURE 3:	TERRAIN MAP	8
FIGURE 4:	LOCATION OF SENSITIVE RECEPTORS	9
FIGURE 5:	COMPONENTS OF A TYPICAL WIND TURBINE (COUNCIL OF CANADIAN ACADEMICS, 2015) 10	
FIGURE 6:	WEIGHTING CURVES	15

APPENDICES

A	CURRICULUM VITAE
B	IMPACT ASSESSMENT METHODOLOGY

1 INTRODUCTION

ENERTRAG South Africa (Pty) Ltd, a subsidiary of the renewable energy company, ENERTRAG SE, proposes to establish the Camden Renewable Energy Complex near Ermelo, in the Mpumalanga Province. The proposed complex forms part of the Renewable Energy Independent Power Producer Procurement Programme (REIPPP) developed and instituted by the National Department of Mineral Resources and Energy (DMRE), with further potential for private off-take by nearby mining and industrial operations. The proposed Camden Complex includes the following:

- Camden I Wind Energy Facility (up to 200 MW).
- Camden I Wind Grid Connection (up to 132 kV).
- Camden I up to 400 kV Grid Connection and Collector substation.
- Camden I Solar (100 MW).
- Camden I Solar Grid Connection (up to 132 kV).
- Camden Green Hydrogen and Ammonia Facility, including grid connection infrastructure.
- Camden II Wind Energy Facility (up to 200 MW).
- Camden II Wind Grid Connection (up to 132 kV).

WSP Group Africa (Pty) Ltd has been appointed to undertake the Environmental and Social Impact Assessment (ESIA) for the Projects. This report specifically addresses the Camden I Wind Energy Facility (WEF) proposed by Camden I Wind RF (Pty) Ltd (CIW).

Wind turbines have the potential to generate noise and as such a specialist Environmental Acoustic Impact Assessment is required as part of the ESIA process for the Camden I Wind Energy Facility (WEF). This report presents the findings of the Screening-Level Environmental Acoustic Impact Assessment performed. It is noted that noise impacts are anticipated from the wind turbines, however, noise from the powerlines will be negligible and as such impacts for these have not been assessed.

1.1 TERMS OF REFERENCE

The terms of reference, designed to best meet the project requirements and the requirements of the Noise Specialist Protocol (contained in GNR 320 of March 2020), are summarised below:

- Execution of a preliminary modelling exercise using a simple model which assumes hemispherical propagation of noise from each turbine to determine potential impact on receptors within a 2 km radius of the turbines.
- If L_{A90} noise levels at all sensitive receptors are below 35 dB(A) at a wind speed of 10 m/s (at a height of 10 m) during day and night times, this would be sufficient to assess the noise impact of the proposed facility. If L_{A90} levels at any receptor location are above 35 dB(A) then impacts at these receptors may be perceived and potential turbine relocations may need to be considered.
- Presentation of modelled results in the form of an environmental acoustic impact assessment report (this report), as per the requirements of the Noise Specialist Protocol (contained in GNR 320 of March 2020).

1.2 NOISE SPECIALIST PROTOCOL CHECKLIST

As per GNR 320 of March 2020 a site sensitivity verification in terms of noise was undertaken on project commencement. From the screening tool, it was determined that the noise impacts of the proposed Camden I WEF were noted as very high. As such a full Noise Specialist Assessment (this report) must be submitted in fulfilment of the environmental authorisation process. Included in this assessment are the following:

Sensitivity Ranking	Items	Applicable section of this report
<p>VERY HIGH SENSITIVITY RATING – Likelihood of a negative noise impact at the receptor.</p>	<p>2. Noise Specialist Assessment</p>	
	<p>2.1. The assessment must be undertaken by a noise specialist on the site being submitted as the preferred site.</p>	<p>Section 1.3</p>
	<p>2.2. The assessment must be undertaken based on a site inspection as well as applying the noise standards and methodologies stipulated in SANS 10103:2008 and SANS 10328:2008 (or latest versions) for residential and non-residential areas as defined in these standards.</p>	<p>Site visit not required as followed IFC Guidance for WEFs. Section 4</p>
	<p>2.3. A baseline description must be provided of the potential receptors and existing ambient noise levels. The receptors could include places of residence or tranquillity that have amenity value associated with low noise levels. As a minimum, this description must include the following:</p>	<p>Section 2.3 and 2.6</p>
	<p>2.3.1. current ambient sound levels recorded at relevant locations (e.g. receptors and proposed new noise sources) over a minimum of two nights and that provide a representative measurement of the ambient noise climate, with each sample being a minimum of ten minutes and taken at two different times of the night (such as early evening and late at night) on each night, in order to record typical ambient sound levels at these different times of night;</p>	<p>Baseline monitoring not required as followed IFC Guidance for WEFs.</p>
	<p>2.3.2. records of the approximate wind speed at the time of the measurement;</p>	<p>N/A</p>
	<p>2.3.3. mapped distance of the receiver from the proposed development that is the noise source; and</p>	<p>Section 2.3</p>
	<p>2.3.4. discussion on temporal aspects of baseline ambient conditions.</p>	<p>N/A</p>
	<p>2.4. Assessment of impacts done in accordance with SANS 10103:2008 and SANS 10328:2008 (or latest versions) must include the following aspects which must be considered as a minimum in the predicted impact of the proposed development:</p>	<p>Impacts assessed in accordance with the IFC Guidance for WEFs and ETSU report – these are specifically for WEFs, for which South African standards are not.</p>
	<p>2.4.1. characterisation and determination of noise emissions from the noise source, where characterization could include types of noise, frequency, content, vibration and temporal aspects;</p>	
<p>2.4.2. projected total noise levels and changes in noise levels as a result of the construction, commissioning and operation of the proposed development for the nearest receptors using industry accepted models and forecasts; and</p>	<p>Section 7</p>	
<p>2.4.3. desired noise levels for the area.</p>	<p>Section 7</p>	
<p>2.5. The findings of the Noise Specialist Assessment must be written up in a Noise Specialist Report that must contain as a minimum the following information:</p>		
<p>2.5.1. details and relevant qualifications and experience of the noise specialist preparing the assessment including a curriculum vitae;</p>	<p>Section 1.3 and Appendix A</p>	
<p>2.5.2. a signed statement of independence by the specialist;</p>	<p>Section 1.3</p>	

	<p>2.5.3. the duration and date of the site inspection and the relevance of the season and weather conditions to the outcome of the assessment;</p>	N/A
	<p>2.5.4. a description of the methodology used to undertake the on-site assessment inclusive of the equipment and models used, as relevant, together with results of the noise assessment;</p>	Section 5
	<p>2.5.5. a map showing the proposed development footprint (including supporting infrastructure) with a 50m buffered development envelope;</p>	Section 2
	<p>2.5.6. confirmation from the specialist that all reasonable measures have been considered, or not, in the micro-siting of the proposed development to minimise disturbance of receptors;</p>	Section 7
	<p>2.5.7. a substantiated statement from the specialist on the acceptability, or not, of the proposed development and a recommendation on the approval, or not, of the proposed development;</p>	Section 9
	<p>2.5.8. any conditions to which this statement is subjected;</p>	Section 9
	<p>2.5.9. the assessment must identify alternative development footprints within the preferred site which would be of a "low" sensitivity as identified by the screening tool and verified through the site sensitivity verification and which were not considered;</p>	N/A
	<p>2.5.10. a motivation must be provided if there were development footprints identified as per paragraph 2.5.9. above that were identified as having a "low" noise sensitivity and that were not considered appropriate;</p>	N/A
	<p>2.5.11. where identified, proposed impact management outcomes, mitigation measures for noise emissions during the construction and commissioning phases that may be of relative short duration, or any monitoring requirements for inclusion in the Environmental Management Programme (EMPr); and</p>	Section 7
	<p>2.5.12. a description of the assumptions made and any uncertainties or gaps in knowledge or data.</p>	Section 6
	<p>2.6. The findings of the Noise Specialist Assessment must be incorporated into the Basic Assessment Report or the Environmental Impact Assessment Report including the mitigation and monitoring measures as identified for inclusion in the EMPr.</p>	To be completed by Environmental Assessment Practitioner (EAP)
	<p>2.7. A signed copy of the specialist assessment must be appended to the Basic Assessment Report or Environmental Impact Assessment Report.</p>	To be completed by Environmental Assessment Practitioner (EAP)

1.3 DECLARATION OF INDEPENDENCE

Kirsten Collett is an air quality and acoustic consultant with a Master of Science (Atmospheric Sciences) degree obtained from the University of the Witwatersrand. She is currently employed by WSP and has worked on environmental acoustic impact assessments, monitoring and modelling for a variety of clients over the past nine years. She has provided acoustic consulting support to various client industries including petrochemical, mining and production industries among others. She is also a registered Professional Natural Scientist (Pr. Nat. Sci.) with the South African Council for Natural Scientific Professions (SACNASP). Please see **Appendix A** for a short CV detailing project experience.

I hereby declare that I am fully aware of my responsibilities in terms of the National Environmental Management Act: Environmental Impact Assessment Regulations of 2014 and that I have no financial or other interest in the undertaking of the proposed activity other than the imbursement of consultant's fees.

Name: Kirsten Collett
Company: WSP Group Africa (Pty) Ltd
Contact Details: +27 11 361 1372
Kirsten.Collett@wsp.com

Signature:



2 BACKGROUND

2.1 LOCALITY

CIW are proposing to construct the Camden I WEF, near Camden in the Mpumalanga Province. The WEF will be located ~ 7 km south of Ermelo, close to the Camden Power Station (**Figure 1**). Energy produced will be fed via a 132 kV overhead line to the collector substation followed by a 400 kV loop-in-loop-out or direct connection to the Camden Power Station.

The Camden I WEF will consist of 37 wind turbines, covering an extent of 6,000 ha. A layout of the proposed WEF is presented in **Figure 2**.

2.2 TOPOGRAPHY

The surrounding landscape has a rolling hill topography which is suitable for the development of a wind project. The Project site itself is located on the highest lying ground near the Camden Power Station and thus has the greatest wind resource within the immediate area. A map showing the typical terrain across the area is presented in **Figure 3**.

2.3 SENSITIVE RECEPTORS

Sensitive receptors are identified as areas that may be impacted negatively due to noise associated with the proposed WEF. Examples of receptors include, but are not limited to, schools, shopping centres, hospitals, office blocks and residential areas. Being such a remotely located site, dominant receptors in the area surrounding the site include small farmsteads and farmhouses. The specific sensitive receptors (farmhouses) considered in this study are presented in **Figure 4** and **Table 1**.

Table 1: Sensitive receptors surrounding the project site

ID	Description	Latitude (°S)	Longitude (°E)	Nearest Turbine	Distance from Nearest Turbine (m)	Direction from Nearest Turbine
C1_Rec 01	Farmhouse	26.634611	30.033396	WTG08	930	NW
C1_Rec 02	Farmhouse	26.632051	30.078345	WTG10	940	ENE
C1_Rec 03	Farmhouse	26.670771	30.069023	WTG33	1,195	E
C1_Rec 04	Farmhouse	26.673473	30.069255	WTG33	1,255	ESE
C1_Rec 05	Farmhouse	26.678195	30.058971	WTG33	875	SSE
C1_Rec 06	Farmhouse	26.686489	30.060385	WTG22	1,445	ENE
C1_Rec 07	Farmhouse	26.678784	29.997393	WTG27	700	NE
C1_Rec 08	Farmhouse	26.678657	29.995743	WTG27	600	NE
C1_Rec 09	Farmhouse	26.675015	29.995617	WTG29	685	NE
C1_Rec 10	Farmhouse	26.658901	30.006440	WTG03	665	SW
C1_Rec 11	Farmhouse	26.650513	29.995569	WTG03	1,480	WNW
C1_Rec 12	Farmhouse	26.644297	30.012122	WTG04	635	W



Figure 1: Location of the project site

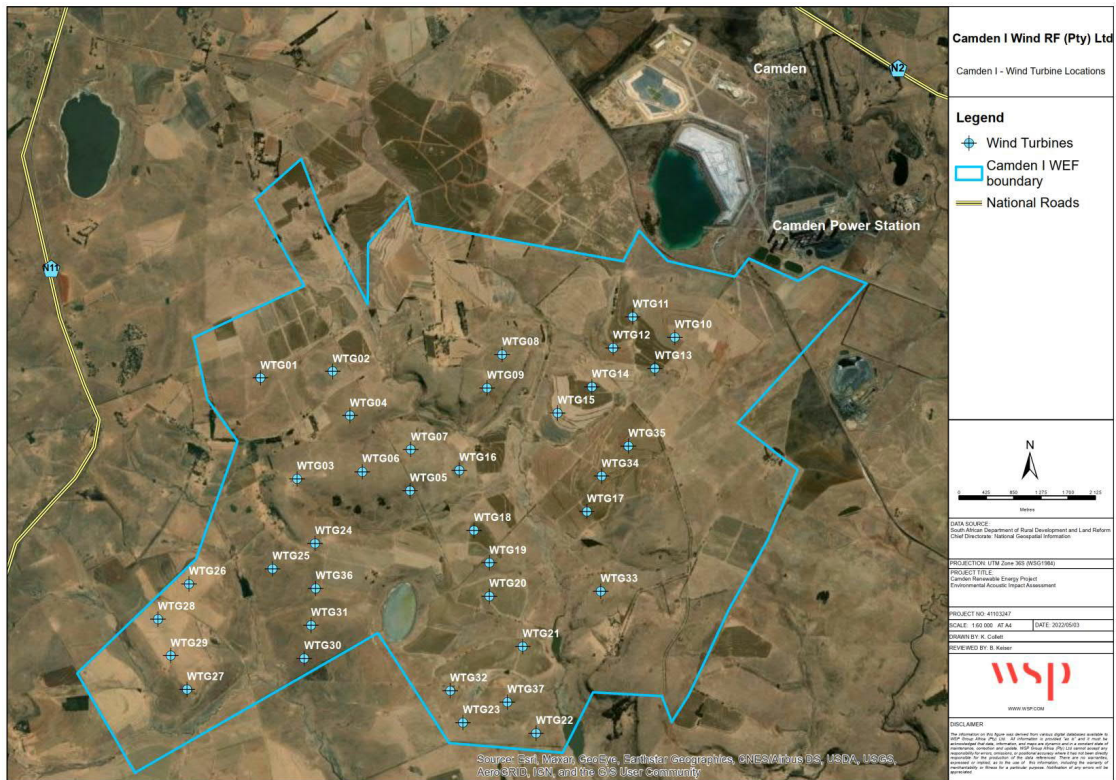


Figure 2: Layout of proposed Camden I WEF

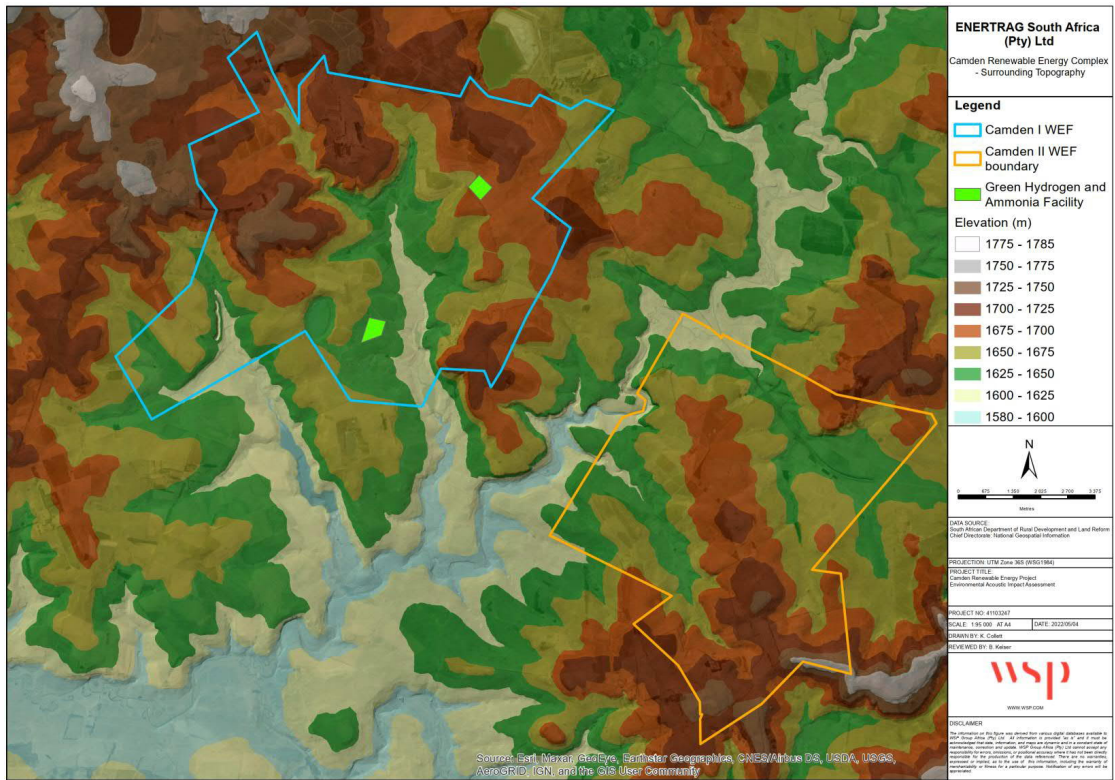


Figure 3: Terrain map



Figure 4: Location of sensitive receptors

2.4 PROJECT DESCRIPTION

2.4.1 WIND ENERGY POWER GENERATION PROCESS

Wind power is the conversion of wind energy into a useful form of energy, such as electricity, using modern and highly reliable wind turbines. Wind power is non-dispatchable, meaning that for economic operation, all of the available output must be taken when it is available.

The main components of a modern utility-scale wind turbine are illustrated in **Figure 5**. When the wind blows around the blades, the shape of the blades creates aerodynamic lift and drag. These forces are used to generate torque, which causes the blades to spin the rotor on its axis, creating mechanical power that is converted into electricity in a generator housed in the nacelle (Council of Canadian Academics, 2015).

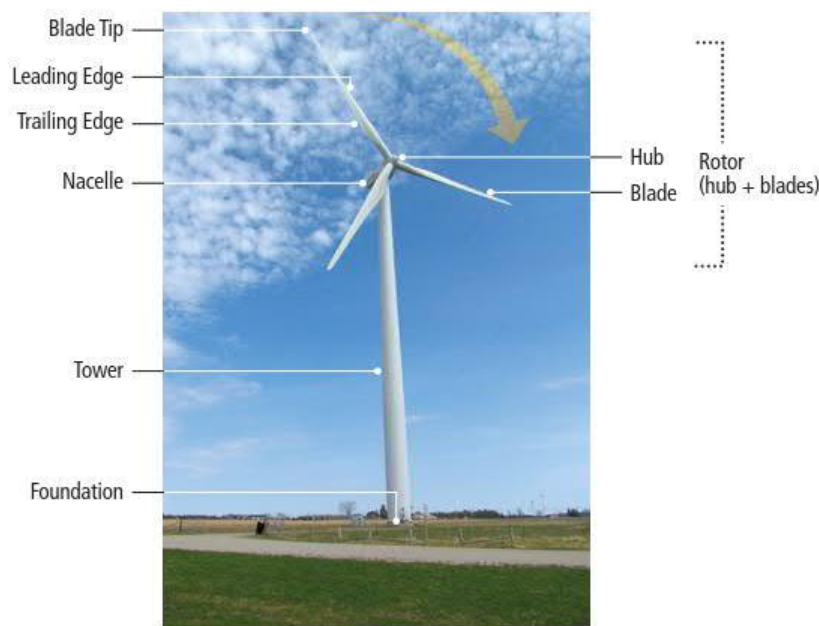


Figure 5: Components of a typical wind turbine (Council of Canadian Academics, 2015)

The electricity generated by the wind turbines is passed through a step-up transformer and then transmitted via either underground or overhead cables to a central substation, which connects the wind energy facility to a high voltage network. Wind turbines are designed to operate automatically with minimal maintenance for approximately 20-25 years.

2.4.2 PROJECT INFRASTRUCTURE

The details of the Camden I WEF are outlined in **Table 2**. A map indicating the location of the wind turbines is presented in **Figure 2**.

Table 2: Project Summary of the Camden I WEF

Municipality	Msukaligwa Local Municipality of the Gert Sibande District Municipality
Extent	6,000 ha
Capacity	Up to 200 MW
Number of Turbines	Up to 37
Turbine Hub Height	Up to 200 m
Rotor Diameter	Up to 200 m
Sound Power Level (at 10 m/s)	106.0 dB(A)

2.5 WIND TURBINES AND NOISE

Noise from wind turbines can be classified into two categories, namely mechanical noise generated from the turbine's mechanical components and aerodynamic noise, produced by flow of air over the turbine blades.

2.5.1 MECHANICAL NOISE

The mechanical noise generated by a wind turbine is predominantly tonal (dominated by a narrow range of frequencies), but may also be broadband in character, displaying a wide range of frequencies (Council of Canadian Academics, 2015). Such noise is produced by the physical movement of the following components:

- Gearbox
- Generator
- Yaw drives
- Cooling fans
- Auxiliary equipment.

Over time, appropriate design and manufacturing have reduced the mechanical noise produced from wind turbines. As such, the aerodynamic noise from the blades has become the dominant source of noise for modern turbines, however, low frequency tones associated with mechanical sources are audible for some turbines (Hau, 2006; Manwell *et al.*, 2009; Oerlemans, 2011).

2.5.2 AERODYNAMIC NOISE

Aerodynamic noise is typically broadband in nature and is generated by the interaction between air flow and different parts of the turbine blades. These interactions depend on the speed and turbulence of the wind; the shape of the blade; the angle between the blade and relative wind velocity flowing over the blade; and the distance from the hub. The noise levels produced are relative to the velocity of the air flow, with higher rotor speeds resulting in higher noise levels. Specifically, parts of the blade closer to the tips move faster than those closer to the hub, resulting in faster relative air velocities and create higher aerodynamic noise levels. As such, most of the aerodynamic noise is produced near (but not at) the blade tips. This is partly why turbines with longer blades have a higher sound power level (Oerlemans, 2011).

Aerodynamic noise from wind turbines also has a strong directional component, projecting primarily downward, upward, or even perpendicular depending on the dominant mechanism (Oerlemans, 2011). As such, noise levels measured at a particular location can vary depending on the direction, speed and turbulence of the prevailing wind. Furthermore, as the rotor turns, the orientation of each blade changes in relation to a stationary receiver. As such, the noise levels at the receiver will vary as the blades rotate, resulting in periodic regular changes in noise levels over time (Renewable UK, 2013).

As wind speed increases, the aerodynamic noise of the turbines also increases. At low speeds the noise created is generally low and increases to a maximum at a certain speed (around 10 m/s) where it either remains constant or can even slightly decrease.

2.5.3 LOW FREQUENCY NOISE AND INFRASOUND

In addition to the noise discussed above, wind turbines also produce some steady, deep, low frequency sounds (between 1 – 100 Hz), particularly under turbulent wind conditions. Sound waves below 20 Hz are called infrasound. These infrasound levels are only audible at very high sound pressure levels. Older wind turbines that had downwind rotors created noticeable amounts of infrasound. Levels produced by modern-day, up-wind style turbines are below the hearing threshold for most people (Jakobsen, 2005).

The human ear is substantially less sensitive to sound at very low or very high frequencies. For most people, a very low pitch sound (20 Hz) must have a sound pressure level of 70 dB to be audible. Levels of infrasound near modern commercial wind turbines are far below this level and are generally not perceptible to people (Leventhall, 2006).

Low frequency sound, like all other sound, decreases as it travels away from the source. Siting wind turbines further away from sensitive receptors will therefore decrease the risk of infrasound. It is, however, important to note that in flat terrain, low frequency sound can travel more effectively than high frequency sound. Most environmental sound measurements and noise regulations are based on the A-weighted decibel scale (dB(A)), which under-weights low frequency sounds in order to mimic the human ear. Thus, noise limits based on the dB(A) levels do not fully regulate infrasound. The dB(C) scale offers an alternative of measuring sound that provides more weight to lower frequencies (Jakobsen, 2005; Bolin *et al.*, 2011).

SANS 10103 proposes a methodology to identify whether low frequency noise could be an issue. The method suggests that if the difference between L_{Aeq} and L_{Ceq} is greater than 10 dB, then a predominant low frequency component may be present. However, in all cases the existing acoustic energy in low frequencies associated with wind must be considered.

2.5.4 SUBSTATION AND TRANSFORMER NOISE

In addition to the noise from wind turbines, wind farms require a substation and transformers, which produce a characteristic “hum” or “crackle” noise. Utility companies have experience with building and siting such sources to minimise their impact. Substation-related noise is relatively easy to mitigate should this be required, based on the use of acoustic shielding and careful planning regarding placement away from sensitive receptors. As such, noise associated with this source is not considered in this assessment.

2.6 EXISTING NOISE CLIMATE

The existing noise climate surrounding the Camden I WEF is predominantly rural with very low baseline noise levels. Noise sources include birds, insects, livestock and activities of resident farmers. Anthropogenic influences include traffic on local roads and on the nearby N2 and N11 National roads as well as train activity along the railway line located just northeast of the study area. A distinctive hum from the nearby Camden Power Station is also evident at receptors in close proximity to the power station.

3 ACOUSTIC FUNDAMENTALS

3.1 PRINCIPLES

Sound is defined as any pressure variation (in air, water or other medium) that the human ear can detect. Noise is defined as “unwanted sound”. Noise can lead to health impacts and can negatively affect people’s quality of life. Hearing impairment is typically defined as a decrease in the threshold of hearing. Severe hearing deficits may be accompanied by tinnitus (ringing in the ears). Noise-induced hearing impairment occurs predominantly in the higher frequency range of 3,000 to 6,000 Hertz (Hz), with the largest effect at 4,000 Hz. With increasing L_{Aeq} and increasing exposure time, noise-induced hearing impairment occurs even at frequencies as low as 2,000 Hz. However, hearing impairment is not expected to occur at L_{Aeq} levels of 75 dB(A) or below, even for prolonged occupational noise exposure.

Speech intelligibility is adversely affected by noise. Most of the acoustical energy of speech is in the frequency range of 100 to 6,000 Hz, with the most important cue-bearing energy being between 300 and 3,000 Hz. Speech interference is basically a masking process in which simultaneous interfering noise renders speech incapable of being understood. Environmental noise may also mask other acoustical signals that are important for daily life such as doorbells, telephone signals, alarm clocks, music, fire alarms and other warning signals.

Sleep disturbance is a major effect of environmental noise. It may cause primary effects during sleep and secondary effects that can be assessed the day after night-time noise exposure. Uninterrupted sleep is a prerequisite for good physiological and mental functioning and the primary effects of sleep disturbance are: (a) difficulty in falling asleep; and (b) awakenings and alterations of sleep stages or depth. The difference between the sound levels of a noise event and background sound levels, rather than the absolute noise level, may determine the reaction probability.

The annoyance due to a given noise source is subjective from person to person, and is also dependent upon many non-acoustic factors such as the prominence of the source, its importance to the listener’s economy (wellbeing), and his or her personal opinion of the source. Increased exposure to noise can have negative effects on individuals, both physiological (influence on communication, productivity and even impaired hearing) and psychological effects (stress, frustration and disturbed sleep). As such, noise impacts need to be understood to mean one or a combination of negative physical, physiological or psychological responses experienced by individuals, whether consciously or unconsciously, caused by exposure to noise.

More technically, noise impacts are defined as the capacity of noise to induce annoyance depending upon its physical characteristics, including the sound pressure level, spectral characteristics and variations of these properties with time. During day-time, individuals may be annoyed at L_{Aeq} levels below 55 dB(A), while very few individuals are moderately annoyed at L_{Aeq} levels below 50 dB(A). Sound levels during the evening and night should be 5 to 10 dB(A) lower than during the day (World Health Organisation, 1999).

Table 3: Typical noise levels

Sound Pressure Level (dB(A))	Typical Source	Subjective Evaluation
130	threshold of pain	intolerable
120	heavy rock concert	extremely noisy
110	grinding on steel	
100	loud car horn at 3 m	very noisy
90	construction site with pneumatic hammering	
80	kerbside of busy street	loud
70	loud radio or television	
60	department store	moderate to quiet
50	general office	
40	inside private office	quiet to very quiet
30	inside bedroom	
20	unoccupied recording studio	almost silent

3.2 NOISE PROPAGATION

Sound is a pressure wave that diminishes with distance from source. Depending on the nature of the noise source, sound propagates at different rates. The three most common categories of noise are point sources (specified single point of noise generation), line sources (multiple linear noise generating points, such as a road) and area sources (specified single area of noise generation). The most important factors affecting noise propagation are:

- The type of source (point, line or area).
- Obstacles such as barriers and buildings.
- Distance from source.
- Atmospheric absorption.
- Ground absorption.
- Reflections.

Research has shown that doubling the distance from a noise source results in a proportional decline in noise level. Sound propagation in air can be compared to ripples on a pond. The ripples spread out uniformly in all directions, decreasing in amplitude as they move further from the source. An acoustically hard site exists where sound travels away from the source over a generally flat, hard surface such as water, concrete, or hard-packed soil. These are examples of reflective ground, where the ground cover provides little or no attenuation. The standard attenuation rate for hard site conditions is 6 dB(A) per doubling of distance for point sources. Thus, if you are at a position one meter from the source and move one meter further away from the source, the sound pressure level will drop by 6 dB(A), moving to 4 meters, the drop will be a further 6 dB(A), and so on. When ground cover or normal unpacked earth (i.e. a soft site) exists between the source and receptor, the ground becomes absorptive to sound energy. Absorptive ground results in an additional noise reduction of approximately 1.5 dB(A) per doubling of distance.

This methodology is only applicable when there are no reflecting or screening objects in the sound path. When an obstacle is in the sound path, part of the sound may be reflected and part absorbed and the remainder may be transmitted through the object. How much sound is reflected, absorbed and/or transmitted depends on many factors, including the properties of the object. When receptor locations are not in the line of sight of the noise source, there may be up to 20 dB(A) attenuation for broadband noise, with a further 10 to 15 dB(A) attenuation when inside the average residence and the windows are open.

3.3 CHARACTERISTICS OF NOISE

The human ear simultaneously receives sound (normal un-weighted sound or Z-weighting dB(Z)) at many frequencies (octave bands) at different amplitudes. The ear then adjusts its sensitivity based on the amplitude of the sound observed. This focuses the sound and makes it audible by adjusting the amplitude of the low, middle and high frequencies. To measure how a person experiences sound, an electronic weighting adjusted to the Z-weighted sound was developed, including three different weighting curves, namely:

- **A-weighting** - This measurement is often noted as dB(A) and this weighting curve attempts to make the noise level meter respond closely to the characteristics of a human ear. It adjusts the frequencies at low and high frequencies. Various national and international standards relate to measurements recorded in the A-weighting of sound pressure levels.
- **B-weighting** - is similar to A-weighting but with less attenuation. The B-weighting is very seldom, if ever, used. The B-weighting follows the C-weighted trend.
- **C-weighting** - is intended to represent how the ear perceives sound at high decibel levels. C-weighted measurements are reported as dB(C).
- **Z-weighting** - this refers to linear, un-weighted noise levels.

The weighting is employed by arithmetically adding a table of values (**Table 4**), listed by octave bands, to the measured linear sound pressure levels for each specific octave band. The resulting octave band measurements

are logarithmically added to provide a single weighted value describing the sound, based on the applied weighting curve (**Figure 6**). Thus, if the A-weighted curve was applied to the sound, the noise level is noted as dB(A).

Table 4: Frequency weighting table for the different weighting curves

Frequency (Hz)	32 Hz	63 Hz	125 Hz	250 Hz	500 Hz	1k Hz	2k Hz	4k Hz	8k Hz
A-weighting	-39.4	-26.2	-16.1	-8.6	-3.2	0	1.2	1	1.1
B-weighting	-17.1	-9.3	-4.2	-1.3	-0.3	0	-0.1	-0.7	-2.9
C-weighting	-3	-0.8	-0.2	0	0	0	-0.2	-0.8	-3
Z-weighting	0	0	0	0	0	0	0	0	0



Figure 6: Weighting curves

4 LEGISLATIVE FRAMEWORK

4.1 SOUTH AFRICAN LEGISLATION

4.1.1 SOUTH AFRICAN NOISE CONTROL REGULATIONS

In South Africa, environmental noise control has been in place for three decades, beginning in the 1980s with codes of practice issued by the South African National Standards (formerly the South African Bureau of Standards, SABS) to address noise pollution in various sectors of the country. Under the previous generation of environmental legislation, specifically the Environmental Conservation Act 73 of 1989 (ECA), provisions were made to control noise from a National level in the form of the Noise Control Regulations (GNR 154 of January 1992). In later years, the ECA was replaced by the National Environmental Management Act 107 of 1998 (NEMA) as amended. The National Environmental Management: Air Quality Act 39 of 2004 (NEMAQA) was published in line with NEMA and contains noise control provisions under Section 34:

“(1) The minister may prescribe essential national standards –
(a) for the control of noise, either in general or by specific machinery or activities or in specified places or areas; or
(b) for determining –
(i) a definition of noise; and
(ii) the maximum levels of noise.
(2) When controlling noise, the provincial and local spheres of government are bound by any prescribed national standards.”

Under NEMAQA, the Noise Control Regulations were updated and are to be applied to all provinces in South Africa. The Noise Control Regulations give all the responsibilities of enforcement to the Local Provincial Authority, where location specific by-laws can be created and applied to the locations with approval of Provincial Government. Where province-specific regulations have not been promulgated, acoustic impact assessments must follow the Noise Control Regulations. These regulations define the following:

- **Ambient Sound Level:** the reading on an integrating impulse sound level meter taken at a measuring point in the absence of any alleged disturbing noise at the end of a total period of at least 10 minutes, after such meter had been put into operation.
- **Zone Sound Level:** a derived dB(A) value determined indirectly by means of a series of measurements, calculations or table readings and designated by a local authority for an area.
- **Disturbing Noise:** a noise level which exceeds the zone sound level or, if no zone sound level has been designated, a noise level which exceeds the ambient sound level at the same measuring point by 7 dB(A) or more.

With the above definitions in mind, regulation 4 of the Noise Control Regulations stipulate that no person shall make, produce or cause a disturbing noise, or allow it to be made, produced or caused by any person, machine, device or apparatus or any combination thereof.

Furthermore, NEMAQA prescribes that the Minister must publish maximum allowable noise levels for different districts and National noise standards. These have not yet been accomplished and as a result all monitoring and assessments are done in accordance with the SANS 10103:2008 and 10328:2008 as discussed in the sections that follow.

4.1.2 SOUTH AFRICAN NATIONAL STANDARDS (SANS)

The SANS 10328:2008 (*Methods for Environmental Noise Impact Assessments*) presently inform environmental acoustic impact assessments in South Africa. This standard defines that the purpose of an Environmental Acoustic Impact Assessment is to determine and quantify the acoustical impact of, or on, a proposed development. It also stipulates the methods used to assess impacts as well as the minimum requirements to be investigated and included in the Environmental Acoustic Impact Assessment report as part of the EIA. These minimum requirements include:

- 1) The purpose of the investigation.
- 2) A brief description of the planned development or the changes that are being considered.
- 3) A brief description of the existing environment including, where relevant, the topography, surface conditions and meteorological conditions during measurements.
- 4) The identified noise sources together with their respective sound pressure levels or sound power levels (or both) and, where applicable, the operating cycles, the nature of sound emission, the spectral composition and the directional characteristics.
- 5) The identified noise sources that were not taken into account and the reasons as to why they were not investigated.
- 6) The identified noise-sensitive developments and the noise impact on them.
- 7) Where applicable, any assumptions, with references, made with regard to any calculations or determination of source and propagation characteristics.
- 8) An explanation, either by a brief description or by reference, of all measuring and calculation procedures that were followed, as well as any possible adjustments to existing measuring methods that had to be made, together with the results of calculations.
- 9) An explanation, either by description or by reference, of all measuring or calculation methods (or both) that were used to determine existing and predicted rating levels, as well as other relevant information, including a statement of how the data were obtained and applied to determine the rating level for the area in question.
- 10) The location of measuring or calculating points in a sketch or on a map.
- 11) Quantification of the noise impact with, where relevant, reference to the literature consulted and the assumptions made.
- 12) Alternatives that were considered and the results of those that were investigated.
- 13) A list of all the interested or affected parties that offered any comments with respect to the environmental noise impact investigation.
- 14) A detailed summary of all the comments received from interested or affected parties as well as the procedures and discussions followed to deal with them.
- 15) Conclusions that were reached.
- 16) Proposed recommendations.
- 17) If remedial measures will provide an acceptable solution which would prevent a significant impact, these remedial measures should be outlined in detail and included in the final record of decision if the approval is obtained from the relevant authority. If the remedial measures deteriorate after time and a follow-up

auditing or maintenance programme (or both) is instituted, this programme should be included in the final recommendations and accepted in the record of decision if the approval is obtained from the relevant authority.

- 18) Any follow-up investigation which should be conducted at completion of the project as well as at regular intervals after the commissioning of the project so as to ensure that the recommendations of this report will be maintained in the future.

The SANS 10103:2008 document (*The measurement and rating of environmental noise with respect to speech communication*) provides methods and guidelines to assess working and living environments with respect to acoustic comfort as well as respect to possible annoyance by noise. As applicable to this assessment, SANS 10103 provides guideline typical rating levels for noise in different districts. These rating levels are presented in **Table 5**.

Table 5: Typical rating levels for noise in districts (adapted from SANS 10103:2008)

Type of District	Classification	Equivalent Continuous Rating level for Noise (L _{Req,T}) (dB(A))	
		Outdoors	
		Day-time (L _{Req,d})	Night-time (L _{Req,n})
a) Rural	A	45	35
b) Suburban (with little road traffic)	B	50	40
c) Urban	C	55	45
d) Urban (with one or more of the following: workshops, business premises and main roads)	D	60	50
e) Central Business Districts	E	65	55
f) Industrial District	F	70	60

* Guidelines highlighted in red are applicable to this assessment

As stipulated in SANS 10103:2008, noise can pose as an annoyance to a community if the increase in average noise levels exceeds the ambient noise by a certain degree. These specified increases together with the relevant estimated community responses are presented in **Table 6**.

Table 6: Categories of community/group response (adapted from SANS 10103:2008)

Excess ($\Delta L_{Req,T}$) ^a dB(A)	Estimated Community or Group Response	
	Category	Description
0 – 10	Little	Sporadic Complaints
5 – 15	Medium	Widespread Complaints
10 – 20	Strong	Threats of community/group action
>15	Very Strong	Vigorous community/group action

Overlapping ranges for the excess values are given because a spread in the community reaction might be anticipated.

^a $\Delta L_{Req,T}$ should be calculated from the appropriate of the following:

- 1) $L_{Req,T}$ = L_{Req,T} of ambient noise under investigation MINUS L_{Req,T} of the residual noise (determined in the absence of the specific noise under investigation);
- 2) $L_{Req,T}$ = L_{Req,T} of ambient noise under investigation MINUS the maximum rating level of the ambient noise given in Table 1 of the code;
- 3) $L_{Req,T}$ = L_{Req,T} of ambient noise under investigation MINUS the typical rating level for the applicable district as determined from Table 2 of the code; or
- 4) $L_{Req,T}$ = Expected increase in L_{Req,T} of ambient noise in the area because of the proposed development under investigation.

4.2 WORLD HEALTH ORGANISATION GUIDELINES FOR COMMUNITY NOISE

The World Health Organisation (WHO) together with the Organisation for Economic Co-operation and Development (OECD) are the main international bodies that have collected data and developed assessments on the effects of exposure to environmental noise. This has provided the following summary of thresholds for noise nuisance in terms of the outdoor day-time equivalent continuous A-weighted sound pressure level (L_{Aeq}) in residential districts:

- At 55 - 60 dB(A) noise creates annoyance.
- At 60 - 65 dB(A) annoyance increases considerably.
- Above 65 dB(A) constrained behaviour patterns, symptomatic of serious damage caused by noise

The WHO therefore recommends a maximum outdoor day-time (07:00 – 22:00) L_{Aeq} of 55 dB(A) in residential areas and schools in order to prevent significant interference with normal activities. It further recommends a maximum night-time (22:00 – 07:00) L_{Aeq} of 45 dB(A) outside dwellings. No distinction is made as to whether the noise originates from road traffic, from industry, or any other noise source.

The WHO guideline for industrial noise is set at 70 dB(A) over a period of 24 hours. Anything above this level would cause hearing impairment, however, a peak noise level of 110 dB(A) is allowable on a fast response measurement.

4.3 INTERNATIONAL FINANCE CORPORATION GUIDELINES

From the International Finance Corporation (IFC) Environmental, Health and Safety (EHS) Guidelines, the impacts of noise beyond the property boundary of a facility are addressed in section 1.7 (IFC, 2007). The noise guidelines stipulated by the IFC are grouped into two categories, namely “Residential; institutional; educational” and “Industrial; commercial” (**Table 7**). Such guidelines are in-line with the WHO guidelines as discussed above and are as such applicable to this assessment. Noise impacts should not exceed these levels or result in a maximum increase in background noise levels of 3 dB(A) at the nearest off site receptor location.

Table 7: IFC Environmental Noise Level Guidelines

Receptor	One-hour L_{Aeq} (dBA)	
	Daytime (07:00 – 22:00)	Night-time (22:00 – 07:00)
Residential; institutional; educational	55	45
Industrial; commercial	70	70

The guideline also states that highly intrusive noise, such as noise from aircraft flyovers and passing trains should not be included when establishing background noise levels.

4.4 THE ASSESSMENT AND RATING OF NOISE FROM WIND FARMS (ETSU)

The ETSU-R-97 report describes the framework for the measurement of noise associated with wind farms and provides indicative noise levels that offer a reasonable degree of protection to communities surrounding wind farm developments, without placing unreasonable restrictions on the wind farm developers. The assessment was developed by a Working Group on Wind Turbine Noise, facilitated by the United Kingdom Department of Trade and Industry. The key findings identified in the assessment include:

- Absolute noise limits applied at all wind speeds are not suited to wind farms. Limits set relative to background noise are more appropriate.
- The L_{A90} descriptor is much more accurate when monitoring and assessing wind turbine noise.
- Limits should be set on noise over a range of wind speeds up to 12 m/s when measured at 10 m height.
- The effects of other wind energy facilities in a specific area should be added to the effect of the proposed wind energy facility in order to determine the cumulative effect.
- Increases in noise levels as a result of a wind energy facility should be restricted to 5 dB(A) above the current ambient noise level at a specified receptor location.
- Noise from wind farms should be limited to a range between 35 and 40 dB(A) (daytime) in a low noise environment. A fixed limit of 43 dB(A) should be implemented during night-time. This should increase to 45 dB(A) (day and night) if the potential receptors have financial investments in the facility.
- For turbines spaced further apart, if noise is limited to an L_{A90} of 35 dB(A) at wind speeds up to 10 m/s (at 10 m height), then this condition alone offers sufficient protection of amenity and background noise surveys would not be necessary.

5 METHODOLOGY

The IFC EHS guidelines for Wind Energy were followed for this assessment, which is primarily based on the ETSU-R-97 report. Such guidance stipulates that a preliminary modelling exercise should be carried out using a simple model which assumes hemispherical propagation of noise from each turbine to determine potential impact on receptors within a 2 km radius of the turbines.

The CadnaA (Computer Aided Noise Abatement) acoustic model was used to calculate noise levels at specific receivers (sensitive receptors). The CadnaA software provides an integrated environment for noise predictions under varying scenarios and calculates the cumulative effects of various sources. The model uses ground elevations in the calculation of the noise levels in a grid and uses standard meteorological parameters that have an effect on the propagation of noise. CadnaA has been utilised in many countries across the globe for the modelling of environmental noise and town planning. It is comprehensive software for three-dimensional calculations, presentation, assessment and prediction of environmental noise emitted from industrial plants, parking lots, roads, railway schemes or entire towns and urbanized areas.

The IFC EHS guidance then indicates that if the model results indicate L_{A90} noise levels at all sensitive receptors are below 35 dB(A) at a wind speed of 10 m/s (at a height of 10 m) during day and night times, this would be sufficient to assess the noise impact of the proposed facility, offering adequate protection of amenity at these receptors. If L_{A90} levels at any receptor location are above 35 dB(A), then impacts at these receptors may be perceived and potential turbine relocations should be considered.

In low noise environments, the ETSU-R-97 report itself, however, stipulates that noise from wind farms should be limited to a range between 35 and 40 dB(A) (daytime). Additionally, a fixed limit of 43 dB(A) should be implemented during night-time. This should increase to 45 dB(A) (day and night) if the potential receptors have financial investments in the facility.

With the Camden I WEF being located within a low noise environment a combination of the IFC and ETSU methodology was followed in this assessment.

6 ASSUMPTIONS AND LIMITATIONS

In this Environmental Acoustic Impact Assessment, various assumptions were made and limitations experienced that may impact on the results obtained. These include:

- The turbine specifications provided are assumed to be representative of what will be installed in reality.
- The turbine locations provided are assumed to be an accurate representation of where these will be located in reality.
- Identification of sensitive receptors is based on a desktop assessment and it is assumed that all key receptors have been included.

7 RESULTS

7.1 CONSTRUCTION PHASE

Unlike general industry, construction activities are not always stationary and in one location. Construction activities at the proposed site will include civil works (including surveying), reinforced concrete works, masonry works, façade works, floor works, general construction activities including mechanical, electrical, and plumbing installation works. Due to the erratic and transient nature of such construction activities as well as the fact that detailed construction phase plans have not yet been developed for the proposed Project, noise impacts from the construction phase of the facility could not be quantified.

During the construction phase of the facility various noise sources will be present onsite including earth-moving equipment (trucks, cranes, scrapers and loaders), compressors and generators, pumps, rotary drills, concrete mixers and materials handling activities among others. All of these sources will generate substantial amounts of noise and may impact on neighbouring sensitive receptors. As such, mitigation interventions are advised during the construction phase. These mitigation recommendations are detailed in the section that follows.

MITIGATION RECOMMENDATIONS

To minimise the acoustic impacts from the construction phase of the proposed Project, various mitigation techniques can be employed. These options include both management and technical options:

- Planning construction activities in consultation with local communities so that activities with the greatest potential to generate noise are planned during periods of the day that will result in least disturbance. Information regarding construction activities should be provided to identified and nearby receptors likely to be affected. Such information includes:
 - Proposed working times.
 - Anticipated duration of activities.
 - Explanations on activities to take place and reasons for activities.
 - Contact details of a responsible person on site should complaints arise.
- When working near a potential sensitive receptor, limit the number of simultaneous activities to a minimum as far as possible.
- Using noise control devices, such as temporary noise barriers and deflectors for high impact activities, and exhaust muffling devices for combustion engines.
- Selecting equipment with the lowest possible sound power levels whilst still being suitable for the specific task.
- Ensuring equipment is well-maintained to avoid additional noise generation.

7.2 OPERATIONAL PHASE

Table 8 presents the predicted noise levels from 37 turbines (with a hub height of 200 m and sound power level of 106.0 dB(A)). The preliminary model was run taking the surrounding terrain into account. Results indicate that predicted L_{A90} noise levels during both day and night are below the 35 dB(A) threshold, as stipulated in the IFC EHS guidance, at four of the twelve receptors. Noise levels at C1_Rec 01, C1_Rec 02, C1_Rec 05, C1_Rec 07, C1_Rec 08, C1_Rec 09, C1_Rec 10 and C1_Rec 12 are predicted to be above the threshold indicating that noise from the turbines could create a nuisance or impact at these locations.

However, being a low noise environment, with reference to the ETSU daytime limit range of 35 – 40 dB(A), L_{A90} noise levels at seven of the twelve receptor locations are below this threshold. Additionally, at night, L_{A90} levels at all receptor locations are below the ETSU 43 dB(A) threshold. It is, however, understood that all of the surrounding receptors have direct interest and are vested in the Project, thus a blanket threshold value of

45 dB(A) (day and night) applies. Predicted noise levels at all receptor locations are below this 45 dB(A) threshold, and complaints are not anticipated.

Table 8: Predicted noise levels at sensitive receptors

ID	Description	Predicted L _{Aeq} noise level	Predicted L _{A90} noise level	L _{A90} below 35 dB(A)	L _{A90} below 45 dB(A)*
C1_Rec 01	Farmhouse	38.7	36.7	No	Yes
C1_Rec 02	Farmhouse	37.4	35.4	No	Yes
C1_Rec 03	Farmhouse	33.6	31.6	Yes	Yes
C1_Rec 04	Farmhouse	31.8	29.8	Yes	Yes
C1_Rec 05	Farmhouse	37.8	35.8	No	Yes
C1_Rec 06	Farmhouse	34.5	32.5	Yes	Yes
C1_Rec 07	Farmhouse	42.6	40.6	No	Yes
C1_Rec 08	Farmhouse	43.8	41.8	No	Yes
C1_Rec 09	Farmhouse	43.4	41.4	No	Yes
C1_Rec 10	Farmhouse	43.1	41.1	No	Yes
C1_Rec 11	Farmhouse	33.9	31.9	Yes	Yes
C1_Rec 12	Farmhouse	43.3	41.3	No	Yes

Note: L_{A90} calculation based on guidance from the ETSU-R-97 report.

* L_{A90} below 45 dB(A) if potential receptors have financial investment in the facility.

7.3 CUMULATIVE ASSESSMENT

The proposed Camden I WEF is located adjacent to the proposed Camden II WEF, with no other WEFs identified in the area. With the nearest wind turbine from the Camden II WEF located ~4 km from the nearest Camden I receptor, cumulative impacts from Camden II are not anticipated.

8 ASSESSMENT OF IMPACTS

The purpose of this Environmental Acoustic Impact Assessment is to identify the potential impacts and associated risks posed by the operation of the proposed Camden I WEF on the noise climate of the area. The outcomes of the impact assessment will provide a basis to identify the key risk drivers and make informed decisions on the way forward in order to ensure that these risks do not result in unacceptable social or environmental risk.

All impacts of the operation of the proposed project were evaluated using a risk matrix, which is a semi-quantitative risk assessment methodology. This system derives an environmental impact level on the basis of the extent, duration, potential intensity and probability of potentially significant impacts. The overall risk level is determined using professional judgement based on a clear understanding of the nature of the impact, potential mitigatory measures that can be implemented and changes in risk profile as a result of implementation of these mitigatory measures. A full description of the risk rating methodology is presented in **Appendix B**. Key localised acoustic impacts associated with the project include:

- 1 Construction phase impacts of noise on sensitive receptors.
- 2 Operational phase impacts of noise on sensitive receptors.

Outcomes of the Environmental Acoustic Impact Assessment are contained within **Table 9** outlining the impact of each parameter and the resulting risk level. It is noted that such an impact assessment is based on the ETSU limits for receptors with a financial interest in the Project, hence the assessment is slightly less stringent than the IFC methodology.

Table 9: Impact assessment of risks associated with the operation of the Camden I WEF

Description	Without Mitigation							With Mitigation						
	Magnitude	Extent	Reversibility	Duration	Probability of Occurrence	Significance	Risk Level	Magnitude	Extent	Reversibility	Duration	Significance	Probability of Occurrence	Risk Level
Construction phase impacts of noise on sensitive receptors	3	2	1	1	3	21	Low	2	2	1	1	2	12	Very Low
Operational phase impacts of noise on sensitive receptors	2	1	1	4	3	24	Low	2	1	1	4	2	16	Low

9 CONCLUSIONS

WSP has been appointed to undertake the ESIA for the for the proposed Camden I WEF. Wind turbines have the potential to generate noise and as such a specialist Environmental Acoustic Impact Assessment is required as part of the ESIA process for the WEF.

Based on the IFC EHS Guidelines for Wind Energy a preliminary modelling exercise was executed using a simple model which assumes hemispherical propagation of noise from each turbine to determine potential impact on receptors within a 2 km radius of the turbines. If L_{A90} noise levels at all sensitive receptors are below 35 dB(A) at a wind speed of 10 m/s (at a height of 10 m) during day and night times, this would be sufficient to assess the noise impact of the proposed facility, offering adequate protection of amenity at these receptors. If L_{A90} levels at any receptor location are above 35 dB(A), then impacts at these receptors may be perceived and potential turbine relocations may need to be considered. In low noise environments, the ETSU-R-97 report itself, however, stipulates that noise from wind farms should be limited to a range between 35 and 40 dB(A) (daytime). Additionally, a fixed limit of 43 dB(A) should be implemented during night-time. This should increase to 45 dB(A) (day and night) if the potential receptors have financial investments in the facility. With the Camden I WEF being located within a low noise environment a combination of the IFC and ETSU methodology was followed in this assessment.

Twelve sensitive receptors (farmhouses) were identified within 2 km of the site. Based on WSP's preliminary model (following the IFC methodology), the following was determined:

- Results indicate that predicted L_{A90} noise levels during both day and night are below the 35 dB(A) threshold, as stipulated in the IFC EHS guidance, at four of the twelve receptors.
- Noise levels at C1_Rec 01, C1_Rec 02, C1_Rec 05, C1_Rec 07, C1_Rec 08, C1_Rec 09, C1_Rec 10 and C1_Rec 12 are predicted to be above the threshold indicating that noise from the turbines could create a nuisance or impact at these locations.
- However, being a low noise environment, with reference to the ETSU daytime limit range of 35 – 40 dB(A), L_{A90} noise levels at seven of the twelve receptor locations are below this threshold. Additionally, at night, L_{A90} levels at all receptor locations are below the ETSU 43 dB(A) threshold.
- It is, however, understood that all of the surrounding receptors have direct interest and are vested in the Project, thus a blanket threshold value of 45 dB(A) (day and night) applies. Predicted noise levels at all receptor locations are below this 45 dB(A) threshold, and complaints are not anticipated.

The resultant environmental acoustic risks associated with the construction phase of the Project are anticipated to be “low” to “very low” with general mitigation options employed. For the operational phase, impacts are anticipated to be “low” as it is understood that the surrounding receptors are all vested in the Project. Ultimately, should no complaints from receptors arise, it is recommended that the Project can be considered for authorisation.

10 REFERENCES

- Bolin, K. Bluhm, G. Eriksson, G. and Nilsson, M.E. (2011): Infrasound and low frequency noise from wind turbines: exposure and health effects. *Environ. Res. Lett* 6 035103.
- Council of Canadian Academics (2015): understanding the Evidence: Wind Turbine Noise. Ottawa (ON): The Expert Panel on Wind Turbine Noise and Human Health, Council of Canadian Academies.
- ETSU (1996): The Assessment and Rating of Wind Farm Noise. The Working Group on Noise from Wind Turbines. ETSU-R-97.
- Hau, E. (2006): Wind Turbines Fundamentals, Technologies, Application, Economics (2nd ed.). New York (NY): Springer.
- International Finance Corporation (IFC) (2007): Environmental, Health and Safety Guidelines: 1.7 Noise, 52 – 53.
- International Finance Corporation (IFC) (2015): Environmental, Health and Safety Guidelines for Wind Energy, 4 – 5.
- Jakobsen, J. (2015): Infrasound emission from wind turbines. *Journal of Low Frequency Noise Vibration and Active Control*. 24: 145-155.
- Leventhall, G. (2006): Infrasound from wind turbines – fact, fiction or deception. *Canadian Acoustics* 34(2):29-36.
- Manwell, J. F., McGowan, J. G., & Rogers, A. L. (2009): Wind Energy Explained: Theory, Design and Application (2nd ed.). Chichester, United Kingdom: John Wiley & Sons Ltd.
- Oerlemans, S. (2011): Chapter 2. Primary Noise Sources. In D. Bowdler & G. Leventhall (Eds.), *Wind Turbine Noise*. Essex, United Kingdom: Multi-Science Publishing Company, Ltd.
- Renewable UK, (2013): Wind Turbine Amplitude Modulation: Research to Improve Understanding as to its Cause and Effect. London, United Kingdom: RenewableUK.
- Siemens Gamesa Renewable Energy (2020): Standard Acoustic Emission, Rev. 0, AM 0 - AM-6, N1 - N7. Rev. 0, AM0-M7. D2359593-001.
- World Health Organisation (WHO) (1999): Guidelines for Community Noise. Available online at: <http://www.who.int/docstore/peh/noise/guidelines2.html>.

APPENDIX

A CURRICULUM VITAE





KIRSTEN COLLETT, M.Sc. (Pr.Sci.Nat)

PRINCIPAL CONSULTANT (AIR QUALITY AND ACOUSTICS), ENVIRONMENT & ENERGY



Years with the firm

10

Years of experience

12

Professional qualification

Pri.Sci.Nat

Areas of expertise

Air Quality Impact Assessments

Air Quality Management

Ambient Air Quality and Acoustic Monitoring

Environmental Acoustic Assessments

CAREER SUMMARY

Kirsten is a Senior Air Quality and Acoustic Consultant with a Master of Science (Atmospheric Sciences) degree obtained from the University of the Witwatersrand. She is currently employed at the Johannesburg branch of WSP Environmental and has worked on various air quality and acoustic impact assessments; air quality management plans; air quality and acoustic monitoring projects; and air quality and acoustic modelling projects for a variety of clients over the past ten years. She has provided consulting support to various client industries including petrochemical, mining, metallurgical, manufacturing and local government bodies among others. She is also a registered Professional Natural Scientist (Pr.Nat.Sci.) with the South African Council for Natural Scientific Professions (SACNASP).

EDUCATION

Master of Science, Atmospheric Sciences, University of Witwatersrand, Johannesburg, South Africa	2009
Bachelor of Science (Honours) Geography and Environmental Studies, University of the Witwatersrand, Johannesburg, South Africa	2006
Bachelor of Science, Geography and Environmental Studies, University of Witwatersrand, Johannesburg, South Africa	2005

ADDITIONAL TRAINING

Business-focussed Project Management	2013
Snake Awareness Training	2016

PROFESSIONAL MEMBERSHIPS

South African Council for Natural Scientific Professions	SACNASP
National Association for Clean Air	NACA

PROFESSIONAL EXPERIENCE

Air Quality

- AQIA for a Proposed Cement Grinding Processing Facility, Umbogintwini, KwaZulu-Natal (2021): WSP was appointed to conduct an AQIA in the form of an Atmospheric Impact Report as part of an Atmospheric Emission Licence (AEL) application for a proposed cement grinding processing facility. The assessment consisted of the compilation of a comprehensive emissions inventory to account for emissions from the facility as well as dispersion modelling using the AERMOD dispersion model to assess the impacts of emissions on any surrounding receptors. Client: Platinum Cement Industries.
- Atmospheric Emission Licence (AEL) Audit, Annual Reporting and NAEIS submission for a Foundry, Isando, Gauteng (2021): Project Manager and Lead Consultant. WSP was appointed to undertake an audit of the facility's current AEL to assess the accuracy of what was represented in the AEL as well as to evaluate compliance with the conditions stipulated in the AEL. Additionally the scope of work included compilation of their Annual Report as well as reporting of emissions onto the National Atmospheric Emissions Inventory System (NAEIS). Kirsten was responsible for conducting the audit, compiling the audit report and annual report and submitting all information onto NAEIS. Client: Weir Minerals.
- AQIA for a Revised Production Rate for a Chemical Producer, Cape Town (2020): Project Manager and Lead Consultant. WSP was appointed to conduct an AQIA

in the form of an Atmospheric Impact Report as part of an Atmospheric Emission Licence (AEL) amendment application for a production rate change at the facility. The assessment consisted of the compilation of a comprehensive emissions inventory to account for emissions from the facility as well as dispersion modelling using the AERMOD dispersion model to assess the impacts of emissions on any surrounding receptors. Client: Protea Chemicals.

- AQIA for a Proposed Independent Power Project, Qatar (2020): Project Manager and Lead Consultant. WSP was contracted to undertake a screening-level air quality impact assessment to determine the suitability of the proposed stack heights in dispersing emission away from sensitive receptors. The project included a baseline assessment, emissions inventory, dispersion modelling using SCREEN3 and comparison of the predicted concentrations against the Qatar ambient air quality standards. Client: WSP Middle East.
- AQIA for a Proposed Expansion to an Iron Ore Loading Port, Saldanha (2019): Project Manager and Lead Consultant. WSP was contracted to undertake an air quality impact assessment to determine the impacts of a proposed increase in iron ore storage and handling capacity at the Saldanha Port. The project included a baseline assessment, compilation of a comprehensive emissions inventory and dispersion modelling using the CALPUFF dispersion model to assess the impacts of emissions on the surrounding communities. Client: Transnet Port Terminals Saldanha Bay.
- Isibonelo Colliery Air Quality Management Plan, Mpumalanga, South Africa (2019-2020): Project Manager and Lead Consultant. Anglo American Coal SA requested the compilation of an Air Quality Management Plan (AQMP) for the Isibonelo Colliery in the Mpumalanga province. The AQMP was aimed at improving air quality at the colliery through the identification of main sources of emissions and recommendations to reduce emissions from these sources. Kirsten was responsible for the compilation of the AQMP which was performed through a baseline assessment of activities at the colliery; identification of key emission sources; compilation of a detailed site specific emissions inventory; determination of the impact of emissions from the colliery on surrounding communities using the AERMOD dispersion modelling software; review of current management and mitigation techniques at the colliery; and development of strategies to minimise any impacts of emissions from the colliery going forward. Client: Anglo American Coal SA.
- Atmospheric Emission Licence (AEL) Audit for a Manganese Multipurpose Terminal, Saldanha (2019): Lead Consultant. WSP was contracted to undertake an audit of the current provisional AEL (PAEL) for the terminal and assist with conversion of the PAEL to a final AEL. The project included a site visit and audit, Client and Authority liaison and assistance with submission of the AEL on the South African Atmospheric Emission Licencing and Inventory Portal (SAAELIP). Client: Transnet Port Terminals Saldanha Bay.
- Air Quality Impact Assessment (AQIA) for a Proposed Waste to Energy Facility, Kuwait (2017-2018): Lead Consultant. WSP was contracted to undertake an air quality impact assessment to determine the impacts of a proposed waste to energy facility in Kuwait. The project included assessment of baseline monitoring data (conducted by a local partner), a baseline assessment, emissions inventory, dispersion modelling using CALPUFF and comparison of the predicted concentrations against the Kuwait and International ambient air quality guidelines/standards. A preliminary screening assessment was undertaken using SCREEN3 to determine the monitoring locations for the baseline monitoring campaign. Client: WSP Middle East.
- Dust Fallout and Particulate Matter Monitoring for nine Collieries, Mpumalanga, South Africa (2016-present): Project Manager. WSP was appointed to manage Anglo American Coal SA's air quality monitoring requirements at nine of their collieries. The contract includes dust fallout monitoring at all nine collieries, while


continuous particulate matter (PM₁₀ and PM_{2.5}) monitoring is conducted at seven collieries using mobile custom-designed solar system trailers. Kirsten is responsible for project management and quality control for the project. Client: Anglo American Coal SA.

Acoustics

- Environmental Acoustic Impact Assessment for a Proposed Manganese Mine, Kanye, Botswana (2021): Project Manager and Lead Consultant. WSP was appointed to undertake an environmental acoustic impact assessment for a proposed manganese mine in Botswana. Kirsten was responsible for conducting the assessment which included a baseline assessment; development of a comprehensive acoustic inventory; and determination of the impact of the proposed project on the surrounding sensitive receptors using the Computer Aided Noise Abatement (CadnaA) acoustic modelling software. Client: Loci Environmental.
- Environmental Acoustic Impact Assessment for the expansion to a refuse transfer station, Cape Town, South Africa (2020): Project Manager and Lead Consultant. WSP was appointed to undertake an environmental acoustic impact assessment for the proposed expansion to the Athlone Refuse Transfer Station in the city of Cape Town. Kirsten was responsible for conducting the assessment which included baseline acoustic monitoring; development of a comprehensive acoustic inventory; and determination of the impact of the proposed project on the surrounding sensitive receptors using the Computer Aided Noise Abatement (CadnaA) acoustic modelling software. Client: Resource Management Services.
- Environmental Acoustic Impact Assessment for the expansion to a tailings storage facility, North West Province, South Africa (2017-2020): Project Manager and Lead Consultant. WSP was appointed to undertake an environmental acoustic impact assessment for the proposed extension of the Kareerand Tailings Storage Facility. Kirsten was responsible for conducting the assessment which included baseline acoustic monitoring; development of a comprehensive acoustic inventory for both the construction and operational phases of the project; and determination of the impact of the proposed project on the surrounding sensitive receptors using the Computer Aided Noise Abatement (CadnaA) acoustic modelling software. Client: AngloGold Ashanti.
- Environmental Acoustic Impact Assessment for three wind energy facilities, Northern and Western Cape, South Africa (2016-2019): Project Manager and Lead Consultant. WSP was appointed to undertake an environmental acoustic impact assessment for three proposed wind energy facilities located between Sutherland and Matjiesfontein in the Northern and Western Cape provinces. Kirsten was responsible for conducting the assessments which included baseline acoustic monitoring; development of a comprehensive acoustic inventory for both the construction and operational phases of the project; and determination of the impact of the proposed wind energy facilities on the surrounding sensitive receptors (farm houses) using the Computer Aided Noise Abatement (CadnaA) acoustic modelling software. Client: BioTherm Energy.
- Environmental Acoustic Impact Assessment for the proposed rehabilitation of the Sekoma-Morwamosu road section, Botswana (2017): Project Manager and Lead Consultant. WSP was appointed to undertake an environmental acoustic impact assessment for the proposed rehabilitation of a section of road within the southern part of Botswana. Kirsten was responsible for conducting the assessment. Current operational noise levels in the vicinity of the road section were determined using an acoustic modelling platform, with current (2017) traffic count data as input. The acoustic impacts of the proposed rehabilitation were determined using attenuation-over-distance calculations (construction phase) and acoustic modelling (operational phase). Changes in noise levels at specific receptor locations were then assessed for each phase and the resultant community responses were evaluated. Client: Loci Environmental.

APPENDIX

B IMPACT ASSESSMENT METHODOLOGY



APPENDIX

ASSESSMENT OF IMPACTS AND MITIGATION

The assessment of impacts and mitigation evaluates the likely extent and significance of the potential impacts on identified receptors and resources against defined assessment criteria, to develop and describe measures that will be taken to avoid, minimise or compensate for any adverse environmental impacts, to enhance positive impacts, and to report the significance of residual impacts that occur following mitigation.

The key objectives of the risk assessment methodology are to identify any additional potential environmental issues and associated impacts likely to arise from the proposed project, and to propose a significance ranking. Issues / aspects will be reviewed and ranked against a series of significance criteria to identify and record interactions between activities and aspects, and resources and receptors to provide a detailed discussion of impacts. The assessment considers direct¹, indirect², secondary³ as well as cumulative⁴ impacts.

A standard risk assessment methodology is used for the ranking of the identified environmental impacts pre-and post-mitigation (i.e. residual impact). The significance of environmental aspects is determined and ranked by considering the criteria⁵ presented in the table below.

Impact Assessment Criteria and Scoring System

CRITERIA	SCORE 1	SCORE 2	SCORE 3	SCORE 4	SCORE 5
Impact Magnitude (M) The degree of alteration of the affected environmental receptor	Very low: No impact on processes	Low: Slight impact on processes	Medium: Processes continue but in a modified way	High: Processes temporarily cease	Very High: Permanent cessation of processes
Impact Extent (E) The geographical extent of the impact on a given environmental receptor	Site: Site only	Local: Inside activity area	Regional: Outside activity area	National: National scope or level	International: Across borders or boundaries
Impact Reversibility (R) The ability of the environmental receptor to rehabilitate or restore after the activity has caused environmental change	Reversible: Recovery without rehabilitation		Recoverable: Recovery with rehabilitation		Irreversible: Not possible despite action
Impact Duration (D) The length of permanence of the impact on the environmental receptor	Immediate: On impact	Short term: 0-5 years	Medium term: 5-15 years	Long term: Project life	Permanent: Indefinite
Probability of Occurrence (P) The likelihood of an impact occurring in the absence of pertinent environmental management measures or mitigation	Improbable	Low Probability	Probable	Highly Probability	Definite
Significance (S) is determined by combining the above criteria in the following formula:	$[S = (E + D + R + M) \times P]$ $Significance = (Extent + Duration + Reversibility + Magnitude) \times Probability$				

¹ Impacts that arise directly from activities that form an integral part of the Project.

² Impacts that arise indirectly from activities not explicitly forming part of the Project.

³ Secondary or induced impacts caused by a change in the Project environment.

⁴ Impacts are those impacts arising from the combination of multiple impacts from existing projects, the Project and/or future projects.

⁵ The definitions given are for guidance only, and not all the definitions will apply to all the environmental receptors and resources being assessed. Impact significance was assessed with and without mitigation measures in place.

APPENDIX

IMPACT SIGNIFICANCE RATING


Total Score	4 to 15	16 to 30	31 to 60	61 to 80	81 to 100
Environmental Significance Rating (Negative (-))	Very low	Low	Moderate	High	Very High
Environmental Significance Rating (Positive (+))	Very low	Low	Moderate	High	Very High

IMPACT MITIGATION

The impact significance without mitigation measures will be assessed with the design controls in place. Impacts without mitigation measures in place are not representative of the proposed development's actual extent of impact and are included to facilitate understanding of how and why mitigation measures were identified. The residual impact is what remains following the application of mitigation and management measures and is thus the final level of impact associated with the development. Residual impacts also serve as the focus of management and monitoring activities during Project implementation to verify that actual impacts are the same as those predicted in this report.

The mitigation measures chosen are based on the mitigation sequence/hierarchy which allows for consideration of five (5) different levels, which include avoid/prevent, minimise, rehabilitate/restore, offset and no-go in that order. The idea is that when project impacts are considered, the first option should be to avoid or prevent the impacts from occurring in the first place if possible, however, this is not always feasible. If this is not attainable, the impacts can be allowed, however they must be minimised as far as possible by considering reducing the footprint of the development for example so that little damage is encountered. If impacts are unavoidable, the next goal is to rehabilitate or restore the areas impacted back to their original form after project completion. Offsets are then considered if all the other measures described above fail to remedy high/significant residual negative impacts. If no offsets can be achieved on a potential impact, which results in full destruction of any ecosystem for example, the no-go option is considered so that another activity or location is considered in place of the original plan.

The mitigation sequence/hierarchy is shown in the figure below.

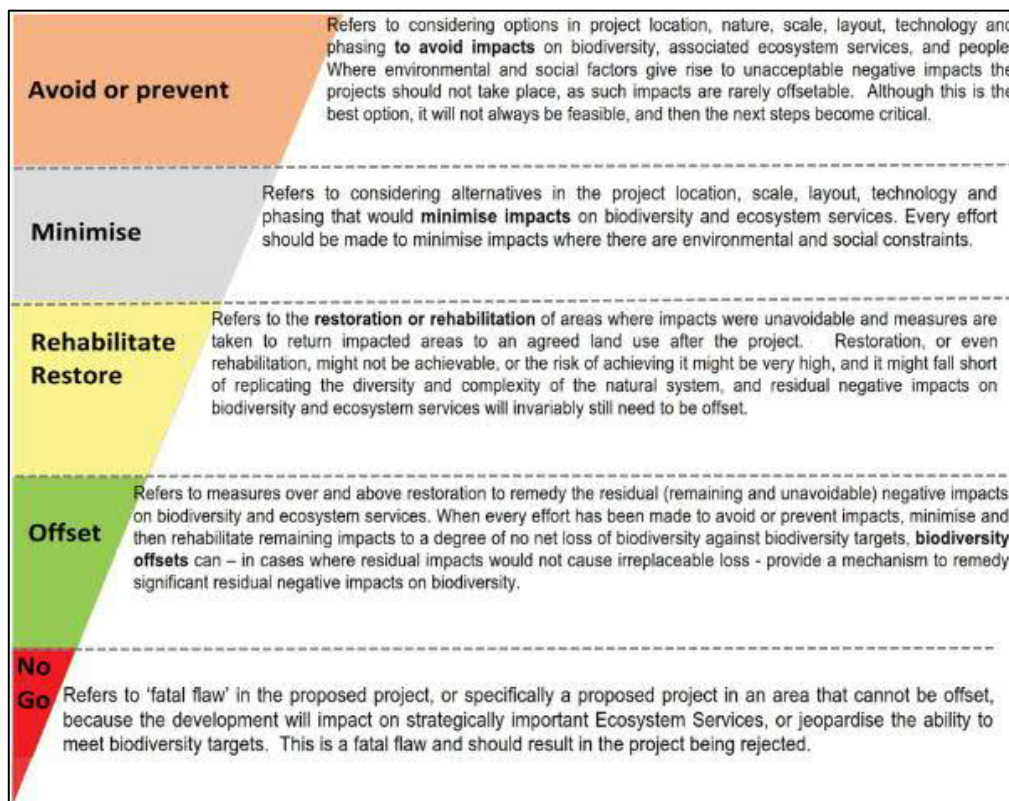

Mitigation Sequence/Hierarchy



ENERTRAG South Africa (Pty) Ltd
Camden
Mpumalanga
South Africa

Our Ref: 41103247

3 October 2022

To whom it may concern,

Re: Addendum to the Environmental Acoustic Impact Assessments for the Camden I & 2 Wind Energy Facilities

WSP Group Africa (Pty) Ltd (WSP) completed the Environmental Acoustic Impact Assessments for the Camden I & II Wind Energy Facilities (WEFs) in August 2022. Cumulative acoustic impacts, taking all surrounding WEFs into account, were evaluated in those assessments. It is noted that since completion of those assessments, an additional WEF (Umbila Emoyeni Renewable Energy Wind Facility) is being proposed in the area.

The proposed Umbila Emoyeni Renewable Energy Wind Facility is located ~30 km west of the proposed Camden I WEF (and > 30 km from the Camden II WEF). As per International Finance Corporation Guidelines, noise impacts from WEFs are only applicable within 2 km of the site. As such, being located at such a great distance from the proposed Camden I and II WEFs, the proposed Umbila Emoyeni Renewable Energy Wind Facility is envisaged to have no impact on the receptors neighbouring the Camden sites.

Kind Regards

Kirsten Collett
Principal Consultant