

1

2

3

4

A

B

C

D

E

F

A


B

C

D

E

F

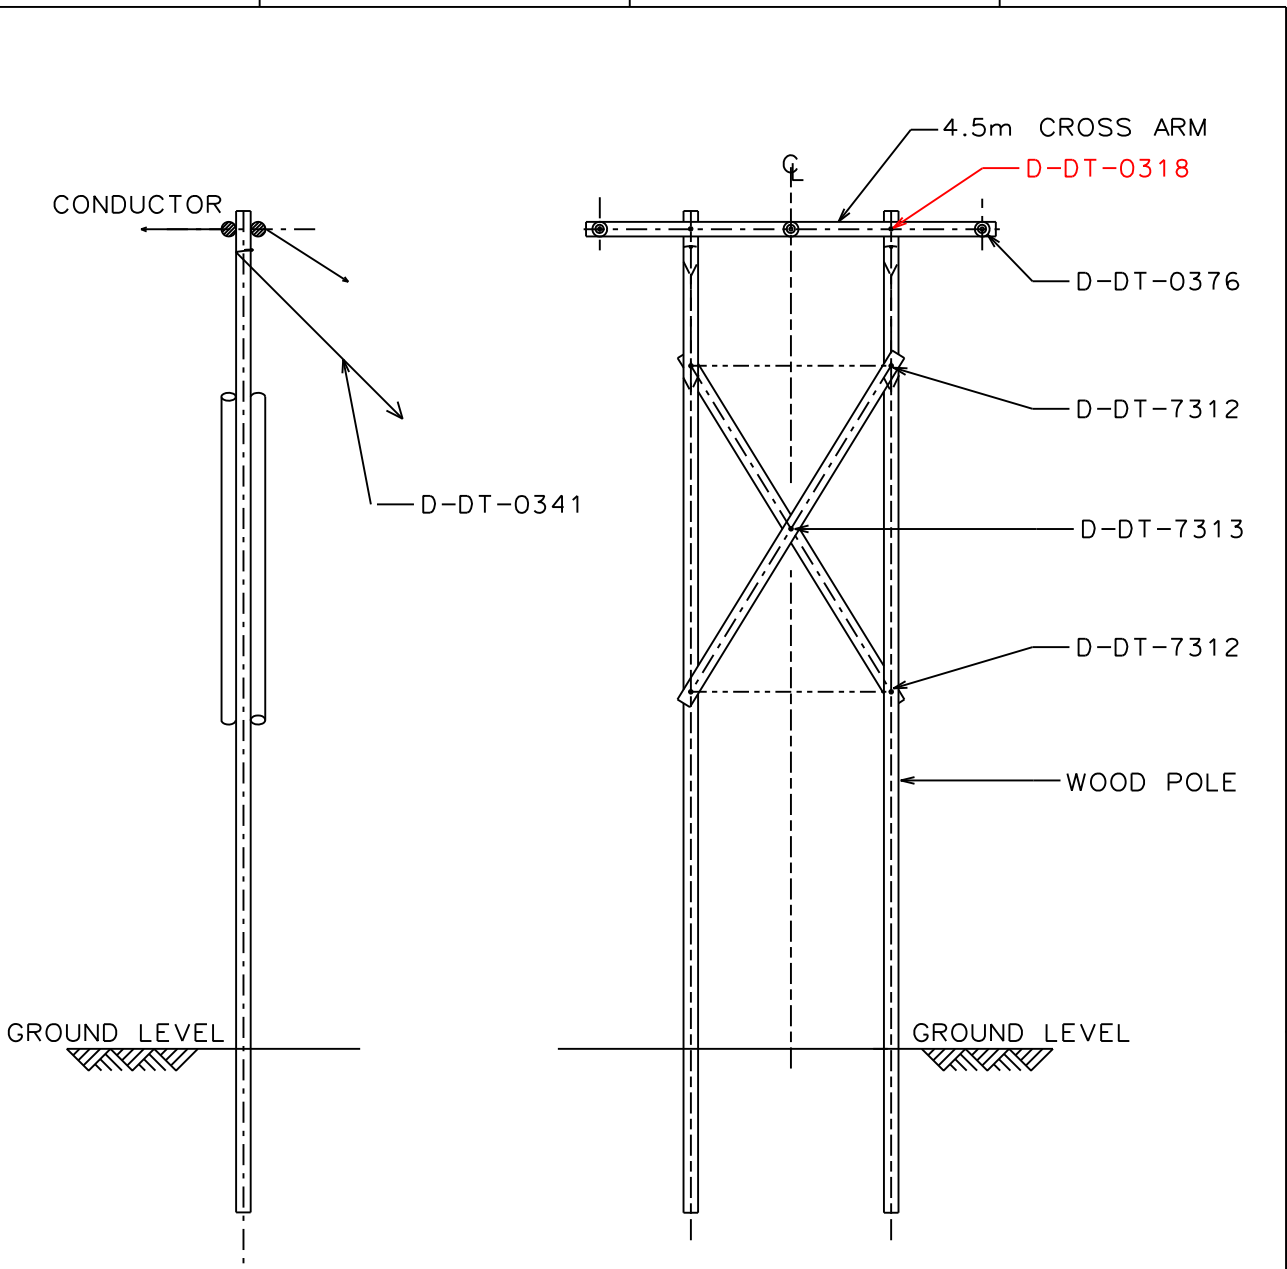

NOTE :

1. NUMBER OF STAYS AS PER DRAWING D-DT-0312.
2. STAYS: USE 19x2.65 STAY WIRE AND M24x2400mm STAY ROD TO D-DT-0341.
3. BONDING ON ONE CROSSARM ONLY T D-DT-0310.
4. STAYS TO BE PLACED AS CLOSE TO CROSSARM AS POSSIBLE.
5. PHASING CONFIGURATION TO D-DT-0311.

1	CROSSARM/POLE CONNECTION DRG. NO. CORRECTED	P.A.T	C.VD MERWE	B.HILL	19.10.2011	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.

<p>Eskom Distribution</p> <p>AUTH: B. HILL</p> <p>DATE: 10.10.2010</p> <p>CHKD: C. VD MERWE</p> <p>DATE: 10.10.2010</p> <p>DRAWN: P.A. TRUBLET</p> <p>DATE: 19.04.2010</p>	<p>MV HEAVY CONDUCTOR</p> <p>22KV H-POLE BRACED TERMINAL STRUCTURE</p> <p>GENERAL ARRANGEMENT</p>		
	D-DT-1796		SET 3
			SHEET 1
			REVISION 1

1

2

3

4

A

A

B

B

C

C

D


D

E

E

F

F

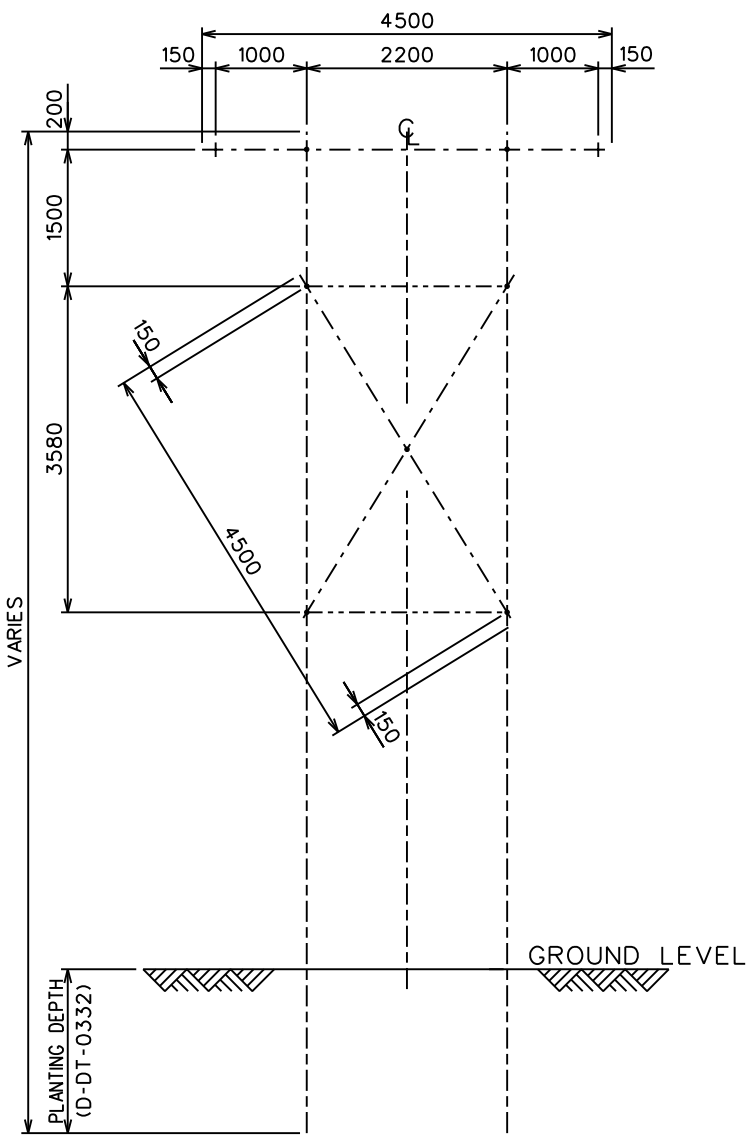

1	CROSSARM/POLE CONNECTION DRG. NO. CORRECTED	P.A.T	C.VDMERWE	B.HILL	19.10.2011	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.

	MV HEAVY CONDUCTOR 22KV H-POLE BRACED TERMINAL STRUCTURE DIMENSION DRAWING			
	AUTH: B. HILL			
	DATE: 10.10.2010			
	CHKD: C. VD MERWE			
	DATE: 10.10.2010			
DRAWN: P.A. TRUBLET		D-DT-1796		
DATE: 19.04.2010		SET	SHEET	REVISION
		3	2	1

1

2

3

4 A4L

1

2

3

4

A

A

B

B

C

C

D

D

E

E

F

F

BRACED TERMINAL

CHICADEE			
POLE LENGTH	WIND	ELEC.SPAN	WEIGHT
11m/200	350	280	600
12m/200	350	280	600
13m/200	240	280	600
14m/220	175	280	600
16m/220			

NOTE :

- * SPANS HAVE BEEN CLIPPED.
- SPANS EXCEEDING THESE VALUES SHALL BE MODELLED IN PLS-CAD.
- MINIMUM TOP DIAMETER OF STRAIN POLES 200mm.

1	CROSSARM/POLE CONNECTION DRG. NO. CORRECTED	P.A.T	C.VDMERWE	B.HILL	19.10.2011	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	PROJECT NO.



AUTH: B. HILL

DATE: 10.10.2010

CHKD: C. VD MERWE

DATE: 10.10.2010

DRAWN: P.A. TRUBLET

DATE: 19.04.2010

MV HEAVY CONDUCTOR
22KV H-POLE BRACED TERMINAL STRUCTURE
WIND / WEIGHT SPAN TABLES

D-DT-1796

3

3

1

1

2

3

4 A4L