


RESTRICTED ABSTRACTION ZONE COORDINATES

POINT	Y	X
1	28947.364	3771951.214
2	28898.652	3771921.341
3	28809.743	3771905.521
4	28848.928	3771880.353
5	28863.026	3771845.266
6	28700.051	3771923.294
7	28576.446	3771753.757
8	28463.839	3771753.757
9	28463.839	3771901.003
10	28611.804	3771903.120
11	28612.793	3771922.273
12	28463.776	3771958.336

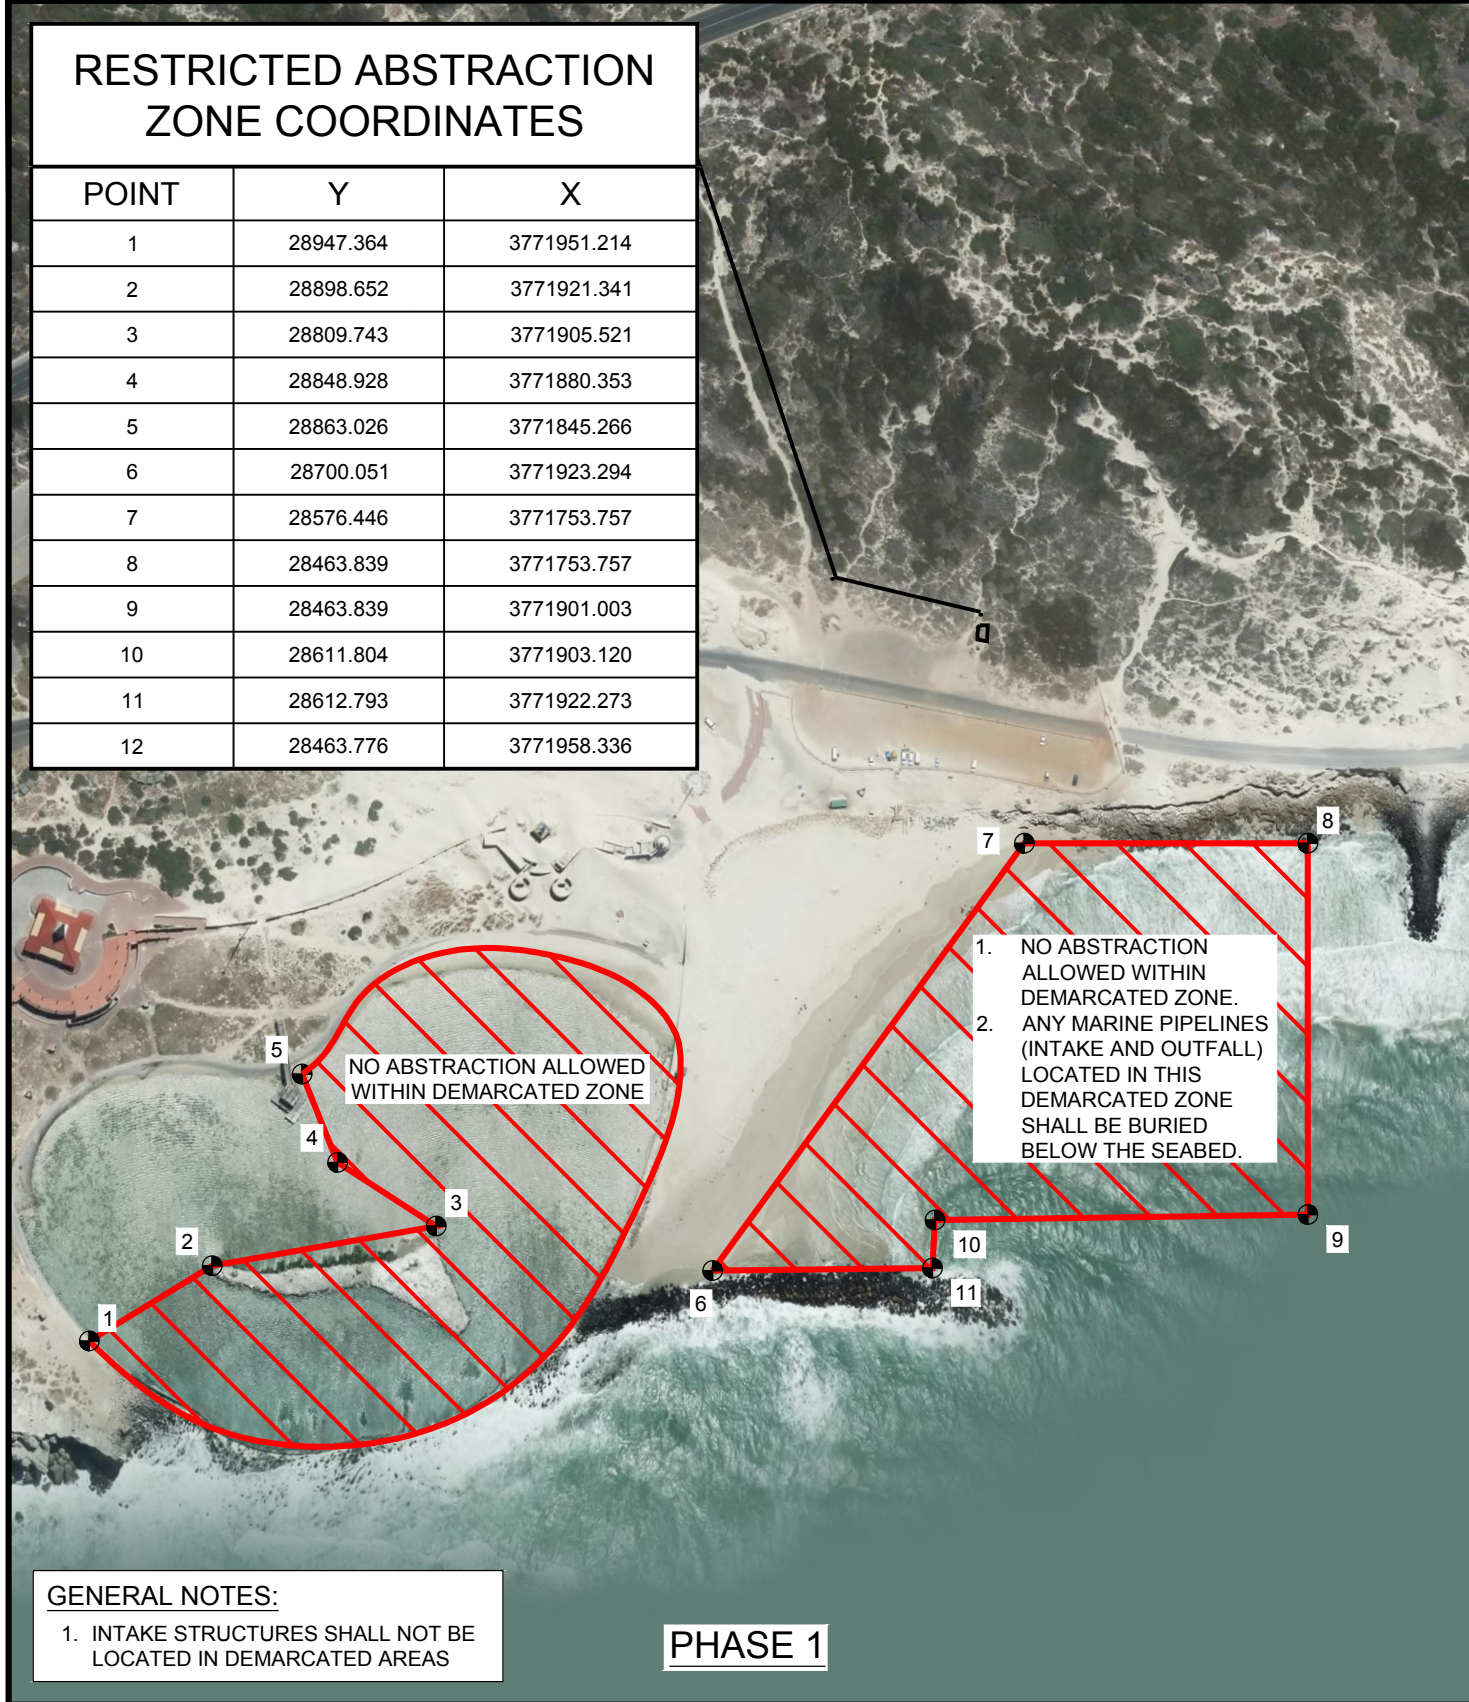

GENERAL NOTES:
1. INTAKE STRUCTURES SHALL NOT BE LOCATED IN DEMARCATED AREAS

PHASE 1

PHASE 2

FOR INFORMATION ONLY	
PRELIMINARY	
FOR APPROVAL	
FOR TENDER PURPOSES	<input checked="" type="checkbox"/>
FOR CONSTRUCTION	
AS BUILT	

REV	DATE	REVISION DESCRIPTION	DRAWN	DESIGNED	REV ENGINEER	CONSULTING ENGINEER
A	11/09/17	FOR TENDER	KL	MLR	MC	WPRSA



CLIENT
CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

PROJECT
WATER RESILIENCE PROJECT

WorleyParsons
resources & energy
P.O.Box 398
BELLVILLE 7535
TEL:+27 21912 3000
FAX:+27 21912 3222
e-mail: capetown.office@worleyparsons.com

DATE: AUGUST 2017
SCALE: (ORIGINAL A3) 1:3000

DRG No. C00686-ZB-MA-DAL-0004-001
REV. A

DRAWING DESCRIPTION
MONWABISI PHASE 1 AND 2 EXCLUSION ZONES FOR ABSTRACTION POINT

"This drawing is prepared solely for the use of the contractual customer of WorleyParsons and WorleyParsons assumes no liability to any other party for any representations contained in this drawing."