


RESTRICTED ABSTRACTION ZONE COORDINATES

POINT	Y	X
1	41231.190	3773611.669
2	40961.747	3773477.114
3	40958.864	3773531.215
4	40963.118	3773561.109
5	41022.108	3773575.371
6	41066.782	3773596.546
7	41111.120	3773629.723
8	41145.401	3773668.564

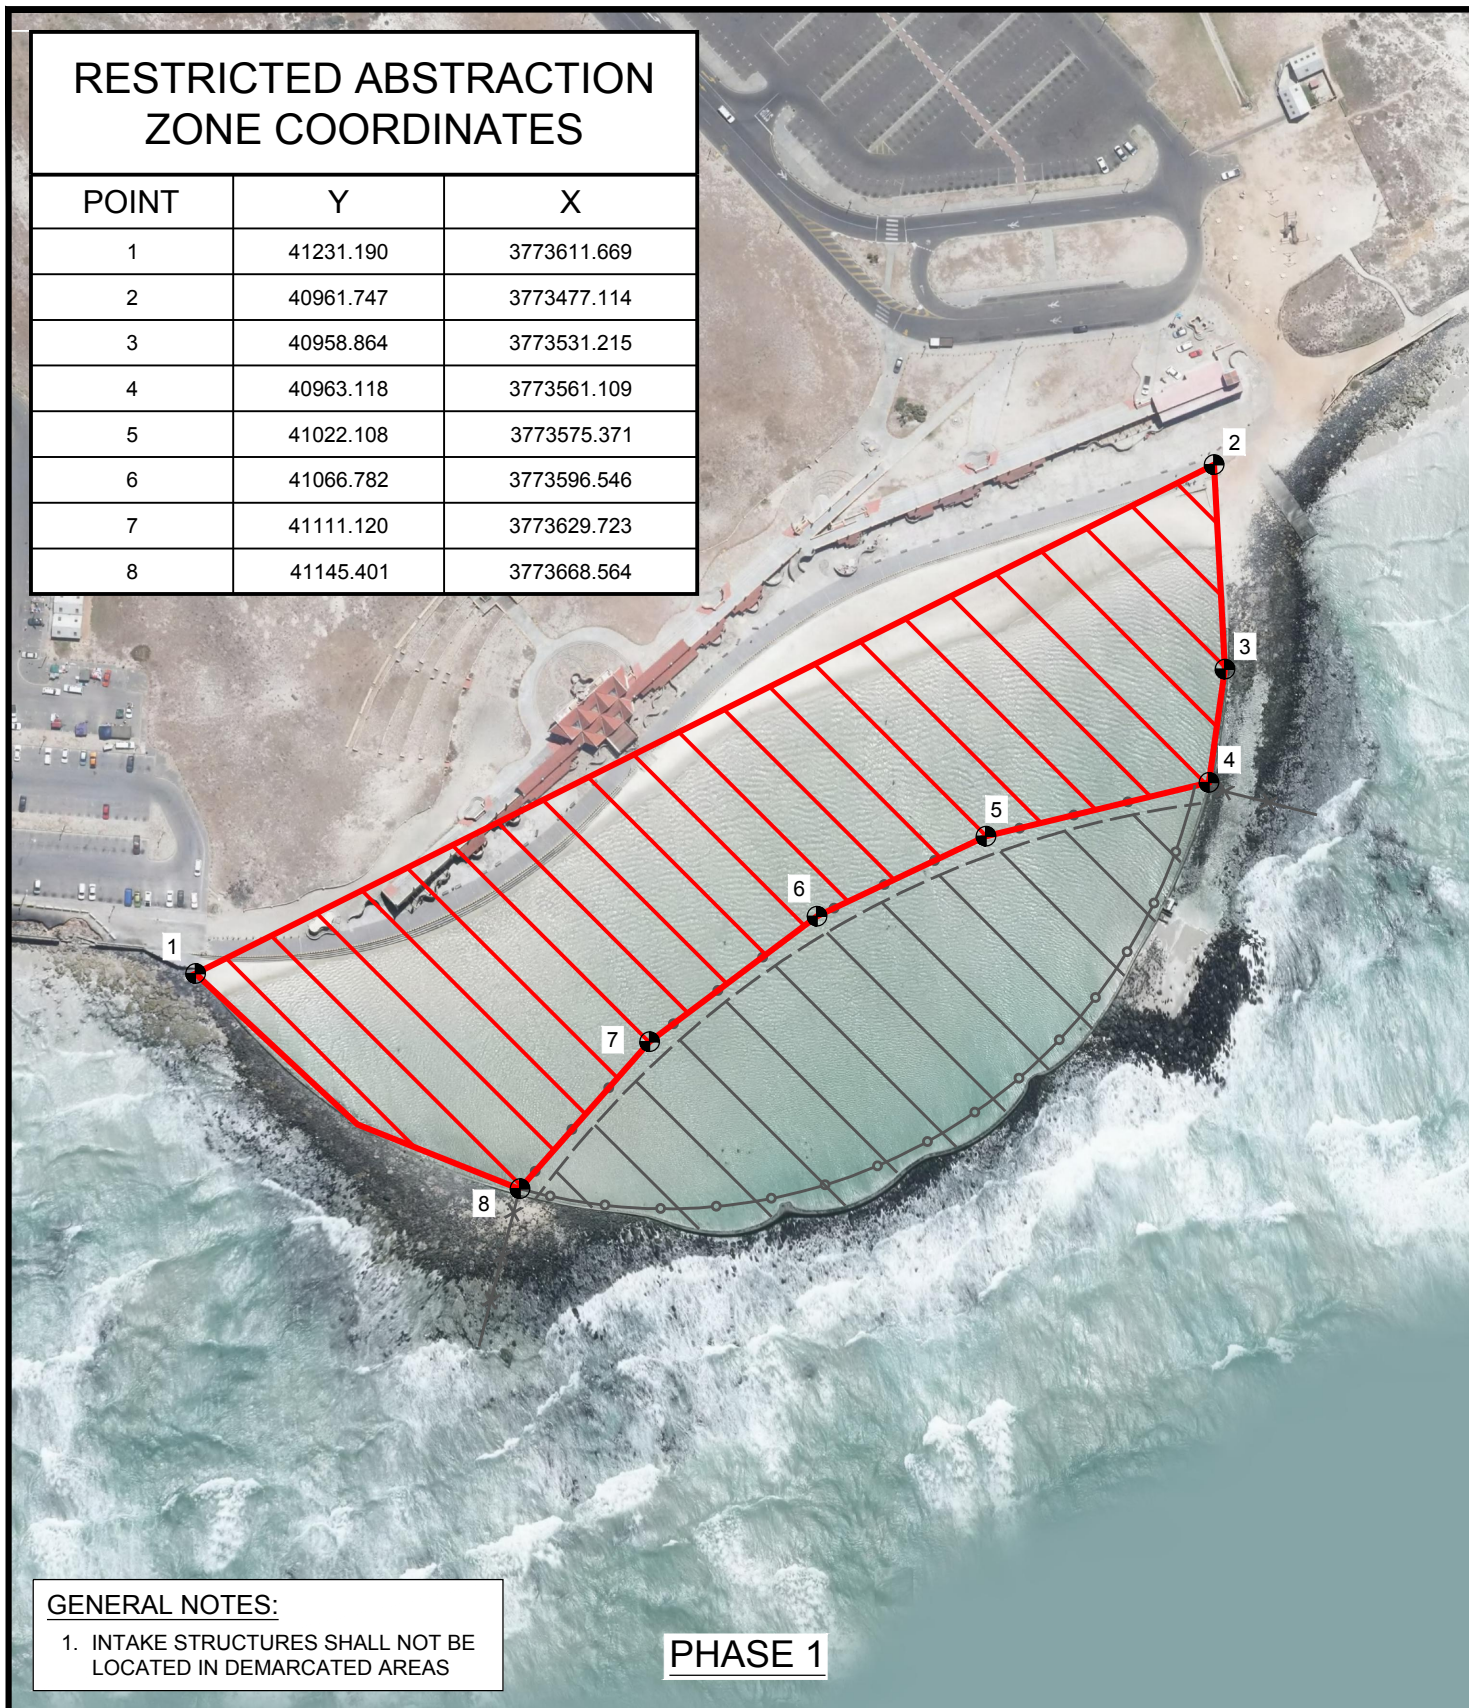

GENERAL NOTES:
1. INTAKE STRUCTURES SHALL NOT BE LOCATED IN DEMARCATED AREAS

PHASE 1

PHASE 2

FOR INFORMATION ONLY	
PRELIMINARY	
FOR APPROVAL	
FOR TENDER PURPOSES	<input checked="" type="checkbox"/>
FOR CONSTRUCTION	
AS BUILT	

REV	DATE	REVISION DESCRIPTION	DRAWN	DESIGNED	REV ENGINEER	CONSULTING ENGINEER
A	11/09/17	FOR TENDER	KL	MLR	MC	WPRSA

OneWay
to zero harm
Copyright ©
WorleyParsons Services Pty Ltd
ABN 61 001 279 812

CLIENT

CITY OF CAPE TOWN
 ISIXEKO SASEKAPA
 STAD KAAPSTAD

PROJECT
WATER RESILIENCE PROJECT

 **WorleyParsons**
 resources & energy
 P.O.Box 398
 BELLVILLE 7535
 TEL:+27 21912 3000
 FAX:+27 21912 3222
 e-mail: capetown.office@worleyparsons.com

DATE: AUGUST 2017
 SCALE: (ORIGINAL A3) 1:2000

DRG No. C00686-ZA-MA-DAL-0005-001
 REV. A

DRAWING DESCRIPTION
STRANDFONTEIN PHASE 1 AND 2 INTAKE STRUCTURES RESTRICTED AREAS

"This drawing is prepared solely for the use of the contractual customer of WorleyParsons and WorleyParsons assumes no liability to any other party for any representations contained in this drawing."