


APPENDIX C2

SITE NOTICES AND NEWSPAPER ADVERTISEMENTS

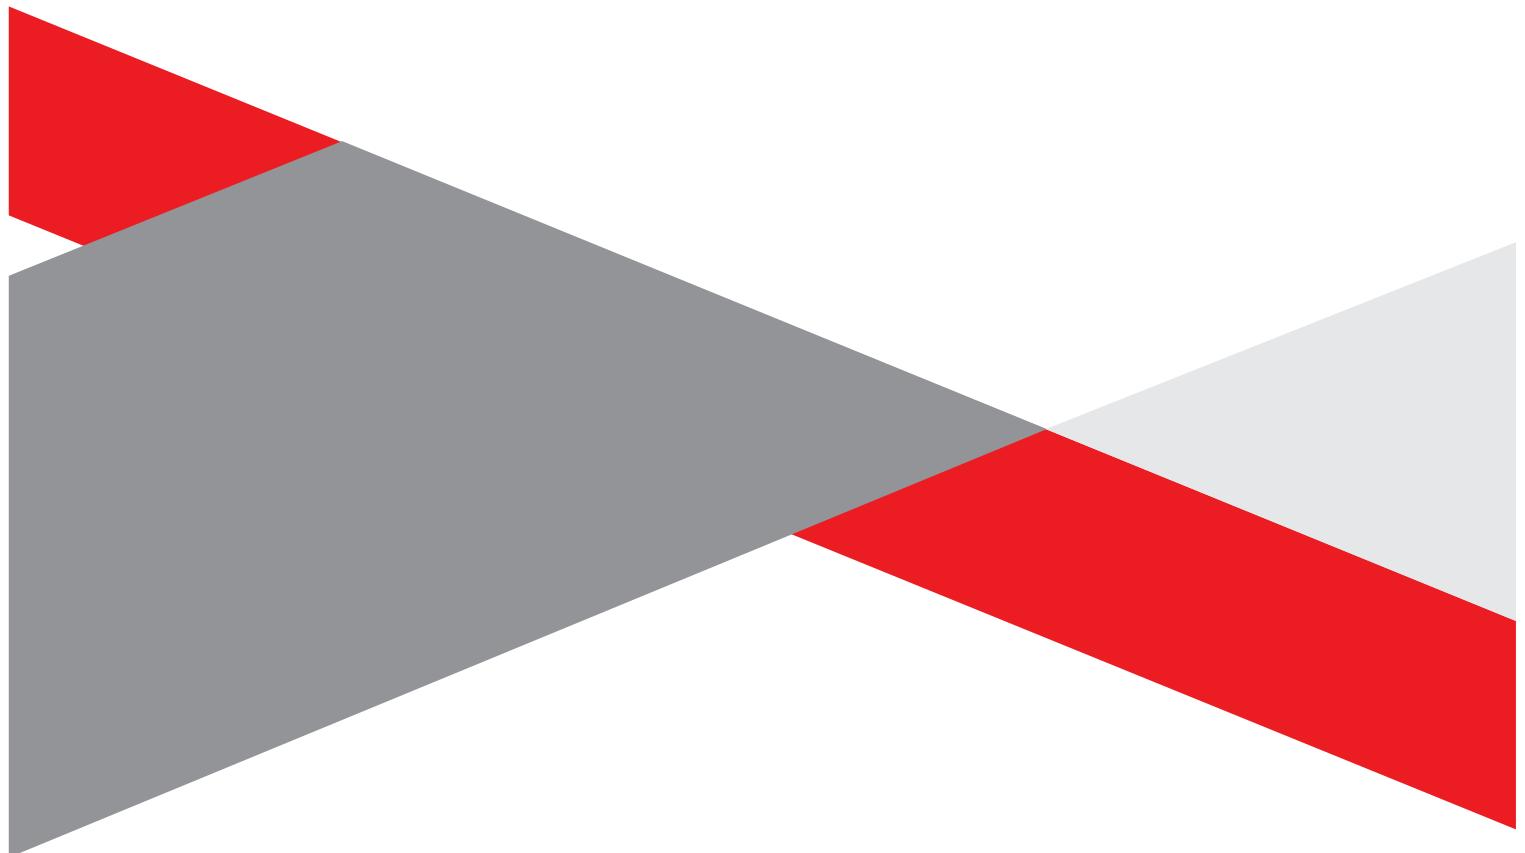

Site Notices

**NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT AND PUBLIC PARTICIPATION
PROCESSES FOR THE PROPOSED DEVELOPMENT OF THE ANGORA WIND FARM NEAR
RICHMOND, NORTHERN CAPE PROVINCE**

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Establishment of the Angora Wind Farm with a contracted capacity of up to 140MW. The project is planned as part of a larger cluster of renewable energy projects. The connection point to the national grid will be the existing Eskom Gamma Substation. Infrastructure associated with the project includes:

- » Wind turbines.
- » Concrete turbine foundations & turbine hardstands.
- » Inverters & transformers.
- » Temporary laydown areas which will accommodate storage & assembly areas.
- » Cabling between the turbines, to be laid underground where practical.
- » A temporary concrete batching plant.
- » 33/132kV onsite facility substation.
- » Underground cabling from the onsite substation to the collector substation.
- » Electrical & auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences, etc.
- » Battery Energy Storage System (BESS).
- » Access roads & internal distribution roads.
- » Site offices & maintenance buildings, including workshop areas for maintenance & storage.

Project Location: The Angora Wind Farm is located approximately 35km South-West of Richmond along the N1 and approximately 80km South-East of Victoria West along the R63 in the Northern Cape Province, within the Ubuntu Local Municipality, and within the greater Pixley Ka Seme District Municipality.

The development area consists of four (4) affected properties, which include:

- Portion 11 of Farm Gegundefontein 53
- Portion 0 of Farm Vogelstruisfontein 84
- Portion 1 of Farm Rondavel 85
- Portion 0 of Farm Rondavel 85

Environmental Impact Assessment (EIA) Process: In terms of Sections 24 and 24D of the National Environmental Management Act (No 107 of 1998), as read with the EIA Regulations (2014), as amended on 07 April 2017, of GN R324 to GN R327, a Scoping and EIA is required to be undertaken for the proposed project. The Scoping Report was accepted in January 2022 and the application subsequently lapsed. The Applicant has resubmitted the application to continue at the initiation of the Environmental Impact Assessment Phase, in accordance with Regulation 21(2)(a) of the EIA Regulations 2014, as amended, since the findings of the scoping report remain valid and the environmental context has not changed.

To obtain further information & register on the project database, please submit your name, contact information & interest in the project to the contact person below.

Nicolene Venter at Savannah Environmental
P.O. Box 148, Sunninghill, 2157
Tel: 011 656 3237 / Fax: 086 684 0547
Mobile: 060 978 8396 (including please call me)
Email: publicprocess@savannahsa.com
Website: www.savannahsa.com

savannah
environmental

July 2023

Proof of Site Notice to be included in the Final
Scoping Report

ADVERTISEMENTS

**NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT AND PUBLIC PARTICIPATION PROCESSES
FOR THE PROPOSED DEVELOPMENT OF THE ANGORA WIND FARM NEAR RICHMOND,
NORTHERN CAPE PROVINCE**

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Establishment of the Angora Wind Farm with a contracted capacity of up to 140MW. The project is planned as part of a larger cluster of renewable energy projects. The connection point to the national grid will be the existing Eskom Gamma Substation. Infrastructure associated with the project includes:

- » Wind turbines.
- » Concrete turbine foundations & turbine hardstands.
- » Inverters & transformers.
- » Temporary laydown areas which will accommodate storage & assembly areas.
- » Cabling between the turbines, to be laid underground where practical.
- » A temporary concrete batching plant.
- » 33/132kV onsite facility substation.
- » Underground cabling from the onsite substation to the collector substation.
- » Electrical & auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences, etc.
- » Battery Energy Storage System (BESS).
- » Access roads & internal distribution roads.
- » Site offices & maintenance buildings, including workshop areas for maintenance & storage.

Project Location: The Angora Wind Farm is located approximately 35km South-West of Richmond along the N1 and approximately 80km South-East of Victoria West along the R63 in the Northern Cape Province, within the Ubuntu Local Municipality, and within the greater Pixley Ka Seme District Municipality.

The development area consists of four (4) affected properties, which include:

- Portion 11 of Farm Gegundefontein 53
- Portion 0 of Farm Vogelstruisfontein 84
- Portion 1 of Farm Rondavel 85
- Portion 0 of Farm Rondavel 85

Environmental Impact Assessment (EIA) Process: In terms of Sections 24 and 24D of the National Environmental Management Act (No 107 of 1998), as read with the EIA Regulations (2014), as amended on 07 April 2017, of GN R324 to GN R327, a Scoping and EIA is required to be undertaken for the proposed project. The Scoping Report was accepted in January 2022 and the application subsequently lapsed. The Applicant has resubmitted the application to continue at the initiation of the Environmental Impact Assessment Phase, in accordance with Regulation 21(2)(a) of the EIA Regulations 2014, as amended, since the findings of the scoping report remain valid and the environmental context has not changed.

Scoping Report available for review & comment: The Scoping Report for the Angora Wind Farm is available for download, review, & comment on the Savannah Environmental website (<https://savannahsa.com/public-documents/energy-generation/>). The 30-day review & comment period of the Scoping Report is from **Friday, 28 July 2023** until **Monday, 28 August 2023**. The last day to submit written comments is **Monday, 28 August 2023**.

To obtain further information & register on the project database, please submit your name, contact information & interest in the project to the contact person below.

Nicolene Venter at Savannah Environmental
P.O. Box 148, Sunninghill, 2157
Tel: 011 656 3237 / Fax: 086 684 0547
Mobile: 060 978 8396 (including please call me)
Email: publicprocess@savannahsa.com
Website: www.savannahsa.com

savannah
environmental

SMALLS/GEKLASSIFISEERD

Notice of Births, Marriages, Deaths, Thanks, Wanted, To Let, For Sale, etc, will be grouped as Classified Smalls at a minimum of R45,00 cash for the first 20 words and thereafter 30c per word. Consecutive repeats less 10%. On existing accounts a surcharge of R5,00 extra will be charged. Kennisgewing van Geboortes, Huwelike, Doodsberigte, Dankbetuigings, Benodig, Te Huur, Te Koop, ens, sal groep vir as Geklassifiseerde Advertensies teen 'n minimum van R45,00 kontant vir die eerste 20 woorde en 30c per word daarna. Agtereenvolgende herhalings min 10%. Op bestaande rekening sal 'n ekstra R5,00 gehef word.

AMMUNISIE EN VUURWAPENS

JAGGEWERE, teleskope, pistole, rewolwers, ammunisie, toebehore en geweerkulis se beskikbaar by Karel J Kerling Wapen en Ammunition Handelaars, Hoofstraat 17, Telefoon (053) 631-2422, De Aar. 335 t/c

GESONDHEID EN MEDISYNE

HOMEOPATIESE en Gesondheidsmiddels. Selfgenesing tuis. Gratis advies. De Aar Aptek, Hoofstraat 17, Telefoon (053) 631-2422, De Aar. 323 M9 t/c

ATTENTION

MERCEDES BENZ motor vehicle. Reg. No: DN-W863EC. Vin No: WD-C2030462R163545. This vehicle was left here a few years ago and the storage is now more than the vehicle's worth. The vehicle will be taken to cover some of the storage cost. Botha Motors, 5 Market Street, CRADOCK 5880. Cell: 082 829 9477. C100 Jy14-Jy28

AANDAG

BENODIG u'n fotograaf? Ek kan u help met kinderpartyjies, verjaarsdae, verlovings, troues, jaareindfunksies of enige geleenthed waar 'n fotograaf benodig word teen bekostigbare prys. Kontak gerus Jacqueline Goss op 076 813 9136, De Aar. 000 N16 t/c

JACK OF ALL TRADES: Vir alle bouwerk, aanbouwings, loodgieter waterdigting, verstoppe pype, verf, teel en staalwerke. Jy noem dit ek doen dit. Omliggende dorpe word ook bedien. Kontak Sakkie op 082 570 1881 of tel/faks: (053) 631-0192, De Aar. 1256 O24, O31 t/c

JACK VERVOER: Vervoer van stene, sand, kliplvir bouwerke, vervoer ook bourommel en tuinvullis. Kontak Sakkie op 082 570 1881, De Aar. 734 M23 t/c

KAROO Verkoeling, herstel yskaste, vrieskaste, lugversorgers, opong van koelkamers, vrieskamers. Diens van lugversorgers. Kontak André (053) 631-4500 of 083 269 5970, De Aar. 1477 N16 t/c

MERCEDES BENZ motorvoertuig. Reg. Nr: DN-W863EC. Vin No: WD-C2030462R163545. Die voertuig is 'n paar jaar gelede hier gelos en die stoorkoste is nou meer as wat die voertuig werd. Die voertuig sal geneem word om van die bergingskoste te dek. Botha Motors, Marktstraat 5, CRADOCK 5880. Sel: 082 829 9477. C100 Jy14-Jy28

Transkaroo Vervoer: Beste Plaaslike vervoer: Tipper vragmotors en laai-grawe altyd beskikbaar. Skakel 082 801 5708 of 082 855 0596. 177 EOM J10 t/c

TO LET

Offices to let: Situated in CBD. Air conditioning, alarm. Contact t: 082 784 1972. **Kantore te huur:** Geleë in sakekern. Lugversorging, alarm. Kontak: 082 784 1972. 127 A12 t/c

Kennisgewing

BOEDEL

In die boedel van wyle GEORGE LOUIS STEYTLER (ID Nr. 360618 5008 084), oorlede Woensdag, 12 Mei 2021 van DE AAR.

Boedel Nr. 02193/2021.

Die Eerste en Finale Likwidiasie- en Distribusierekening in bogehoemed boedel sal ter insae lê in die kantoor van die Meester van die Hoogereghof te KIMBERLEY en 'n afskrif daarvan in die Landdroskantoor te DE AAR, Noord-Kaap, vir 'n tydperk van 21 (een-en-twintig) dae gerekken vanaf **Vrydag, 28 Julie 2023.**

TRUTER & VORSTER
(Agent vir die Eksekuteurs)

Posbus 35
DE AAR
7000
Tel: (053) 631-2166
E-pos: jasmin@trutervorster.co.za
533 Jy28

METHODIST CHURCH


DE AAR CIRCUIT NO SERVICES


AGS IMMANUEL DE AAR
Hoek van Du Toit- en Rossouwstraat

SONDAGOGGEND om 10:00
SONDAGMIDDAG 505 "Celebration"
KONTAK:
Pastoor Dave
083 388 0500

DE AAR DRUKKERS
POSBUS 44, DE AAR
Telefoon (053) 631-2851
VIR SPOEDIGE DRUKWERK VAN HOË GEHALTE

MIDLAND NUUS
POSBUS 224, CRADOCK
TELEFOON (048) 881-5330

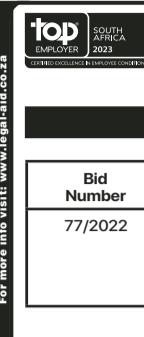

CANCELLATION OF TENDER.

Bid Number	Description	Newspaper and Date
77/2022	Provision of Office Accommodation for the De Aar Satellite Office period of Five (5) Years.	De Aar Echo, 10/03/2023

We apologise for any inconvenience caused.

For more info visit: www.basadzi.id.co.za

DE AAR DRUKKERS

POSBUS 44, DE AAR
Telefoon (053) 631-2851

VIR SPOEDIGE DRUKWERK VAN HOË GEHALTE

MIDLAND NUUS

POSBUS 224, CRADOCK
TELEFOON (048) 881-5330

Kennisgewing

BOEDEL

In die boedel van wyle NELISWA BOOI (ID Nr. 770811 0031 086) van Alidastraat 57, DE AAR 7000. Getroud binne gemeenskap van goedere met MON-GEZI DAVID BOOI (ID Nr. 730425 5739 087).

Boedel Nr. 1135/2018. Noord-Kaap.

Ingevolge Artikel 35(5) van Administrasie van Boedelswet, Nr. 66 van 1965, word hierby kennis gegee dat duplike van die Eerste en Finale Likwidiasie- en Distribusierekening in bovermelde boedel in die kantore van die Meester van die Hoogereghof KIMBERLEY en Landdroskantoor PHILIPSTOWN gedurende 'n tydperk van 21 dae vanaf datum van publikasie hiervan ter insae lê vir alle persone wat daarby belang het.

In Pred 10 vers 1 lees ons hierdie woorde: "Dooie vlieë laat die apteker se self stink" (ou vertaling). 'n Bietjie dwaasheid doen meer kwaad, as wat wysheid en eer goed doen."

Ek wil net so 'n paar vlieë vir u noem:

(a) **Die lewe bederf deur die vlieg van begeerlikheid:** Ons lees van verskillende voorvalle van mense wat ander se goed begeer het. Dit is direk teen die gebod. Ahab het die wingerd van Nabot begeer en 'n moord laat pleeg om dit te kry. Dawid het die vrou van Uriah begeer en hom laat vermoor. 'n Slegte begeerte kan 'n mooi lewe verwoes.

In dien binne genoemde tydperk geen besware daarteen by die betrokke Meesters ingedien word nie, gaan die eksekuteurs oor tot die uitbetaling ingevolge gemelde rekenings.

JOSEPH EN VAN RENSBURG

Kerkstraat 41
DE AAR
7000
Tel: (053) 631-2163
E-pos: joren2@adsactive.com
532 Jy28

Kennisgewing

BOEDEL

In die boedel van wyle DAVIN FRANCIS (ID Nr. 890519 5175 080), gebore op 19 Mei 1989 en oorlede op 5 April 2023. Laaste adres: Cawoodstraat 94, CRADOCK 5880. Getroud binne gemeenskap van goedere met MADELEIN FRANCIS (ID Nr. 920630 0035 080), gebore 30 Junie 1992.

Boedel Nr. 1483/2023 Oos-Kaap.

Alle persone met vorderinge teen bovermelde boedel moet dit binne 30 dae vanaf datum van publikasie hiervan by die betrokke Eksekuteur inlewer.

COETZEE & VENTER INGELYF
68 Adderleystraat
CRADOCK
5880
Tel: (048) 881-3007
E-pos: ruanda@coetzeenter.co.za
C107 Jy28

Kyk maar wat in ons land aangaan. Maar bowe alles is daar ook geen eerbied meer vir God of Sy huis nie. Pred 4 vers 17 sê: "Wees versigtig as jy na die huis van die Here gaan." So kan ons aanhou om nog vele vlieë op te noem wat ons mooi lewens kan ontsier, waak daarteen, maak hulle dood.

Oomblik van Stilte

Die self van die apteker

Mev SM Laubscher †

NET 'n klein soutjie kan 'n hele skildery bederf. Deur die natatigheid van een enkele mens kan 'n hele groot onderneming misluk. 'n Mooi stuk borduurwerk kan soms geheel ontsier word deur 'n paar verkeerde steke. So kan 'n mooi lewe soms verwoes word deur een enkele sonde wat in swakheid gedoen word.

In Pred 10 vers 1 lees ons hierdie woorde: "Dooie vlieë laat die apteker se self stink" (ou vertaling). 'n Bietjie dwaasheid doen meer kwaad, as wat wysheid en eer goed doen."

Ek wil net so 'n paar vlieë vir u noem:

(a) **Die lewe bederf deur die vlieg van begeerlikheid:** Ons lees van verskillende voorvalle van mense wat ander se goed begeer het. Dit is direk teen die gebod. Ahab het die wingerd van Nabot begeer en 'n moord laat pleeg om dit te kry. Dawid het die vrou van Uriah begeer en hom laat vermoor. 'n Slegte begeerte kan 'n mooi lewe verwoes.

In dien binne genoemde tydperk geen besware daarteen by die betrokke Meesters ingedien word nie, gaan die eksekuteurs oor tot die uitbetaling ingevolge gemelde rekenings.

(b) **Die lewe bederf deur die vlieg van hoogmoed:** Koning Nebukadneser het gesê: "Kyk net hoe groot is Babel: Deur my groot mag het ek daarvan 'n koningstad gemaak tot my eer en roem." (Dan 4 vers 30). Sy woorde was nog nie koud nie toe beveel die Here dat hy uit sy koningskap onthel gaan word.

Die spreekwoord sê eie roem stink. Spreuke 27 sê: "Laat dit aan 'n ander oor om jou te prys, moet dit nie self doen nie." In Spr 8 vers 13 lees ons: "Hoogmoed en trotsheid haat ek."

(c) **Die lewe bederf deur die vlieg van 'n slegte humeur:** Spreuke 16 vers 32 sê: "'n Geduldige mens het meer waarde as 'n bedrewe vegter, 'n mens met selfbeheersing meer as iemand wat 'n stad inneem." So baie Christene se lewens word ontsier deur hierdie vlieg.

Ons kan 'n slegte humeur net oorwin deur gebed. Selfbeheersing is seker 'n besondere groot gawe van God, wees bly as u dit besit.

(d) **Die lewe bederf deur die vlieg van oneerbiedigheid:** Hierdie ewel kom so baie voor, nie net onder kinders nie, maar ook onder volwassenes. Kinders erken nie meer die gesag van 'n ouer of onderwyser nie. Baie duisende mense erken nie meer die gesag van die staat of wet nie.

Kyk maar wat in ons land aangaan. Maar bowe alles is daar ook geen eerbied meer vir God of Sy huis nie. Pred 4 vers 17 sê: "Wees versigtig as jy na die huis van die Here gaan." So kan ons aanhou om nog vele vlieë op te noem wat ons mooi lewens kan ontsier, waak daarteen, maak hulle dood.



We've moved to 71 Main Street
Tel: (053) 631-3751 • Willie: 082 822 9404
• Warno: 0823077983

- Electrical repair & installations
- Air con repair & installations
- Geyser - COC • 1phase COC
 - 3phase COC
- Solar system installation



Supply of RO³ water and juice
As well as refill of RO³ water and juice.
Reward card on refills:
5liter, 10liter, 20liter, 25liter
Buy 10 refills 11th refill free.
71 Main Street, DE AAR
TEL: (053) 631-3751
• Warno: 082 307 7983 • Willie: 082 822 9404

Skenk BLOED en red 'n LEWE!


PREVIOUS SCOPING PHASE PROCESS

Site Notices

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT, BASIC ASSESSMENT AND PUBLIC PARTICIPATION PROCESSES FOR THE PROPOSED DEVELOPMENT OF THE GREAT KAROO CLUSTER OF RENEWABLE ENERGY FACILITIES AND GRID CONNECTION INFRASTRUCTURE, NEAR RICHMOND, NORTHERN CAPE PROVINCE

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Great Karoo Renewable Energy (Pty) Ltd proposes the development of a cluster of renewable energy facilities and associated infrastructure, including Electrical Grid Infrastructure (EGI), ~35km South-West of the town of Richmond along the N1 and 80km South-East of Victoria West along the R63 in the Northern Cape Province. The cluster consists of three (3) 100MW solar photovoltaic (PV) energy facilities, and two (2) 140MW energy facilities. The grid connection infrastructure for all projects will include one central collector 132kV substation and a double circuit 132kV power line to the existing Eskom Gamma Substation.

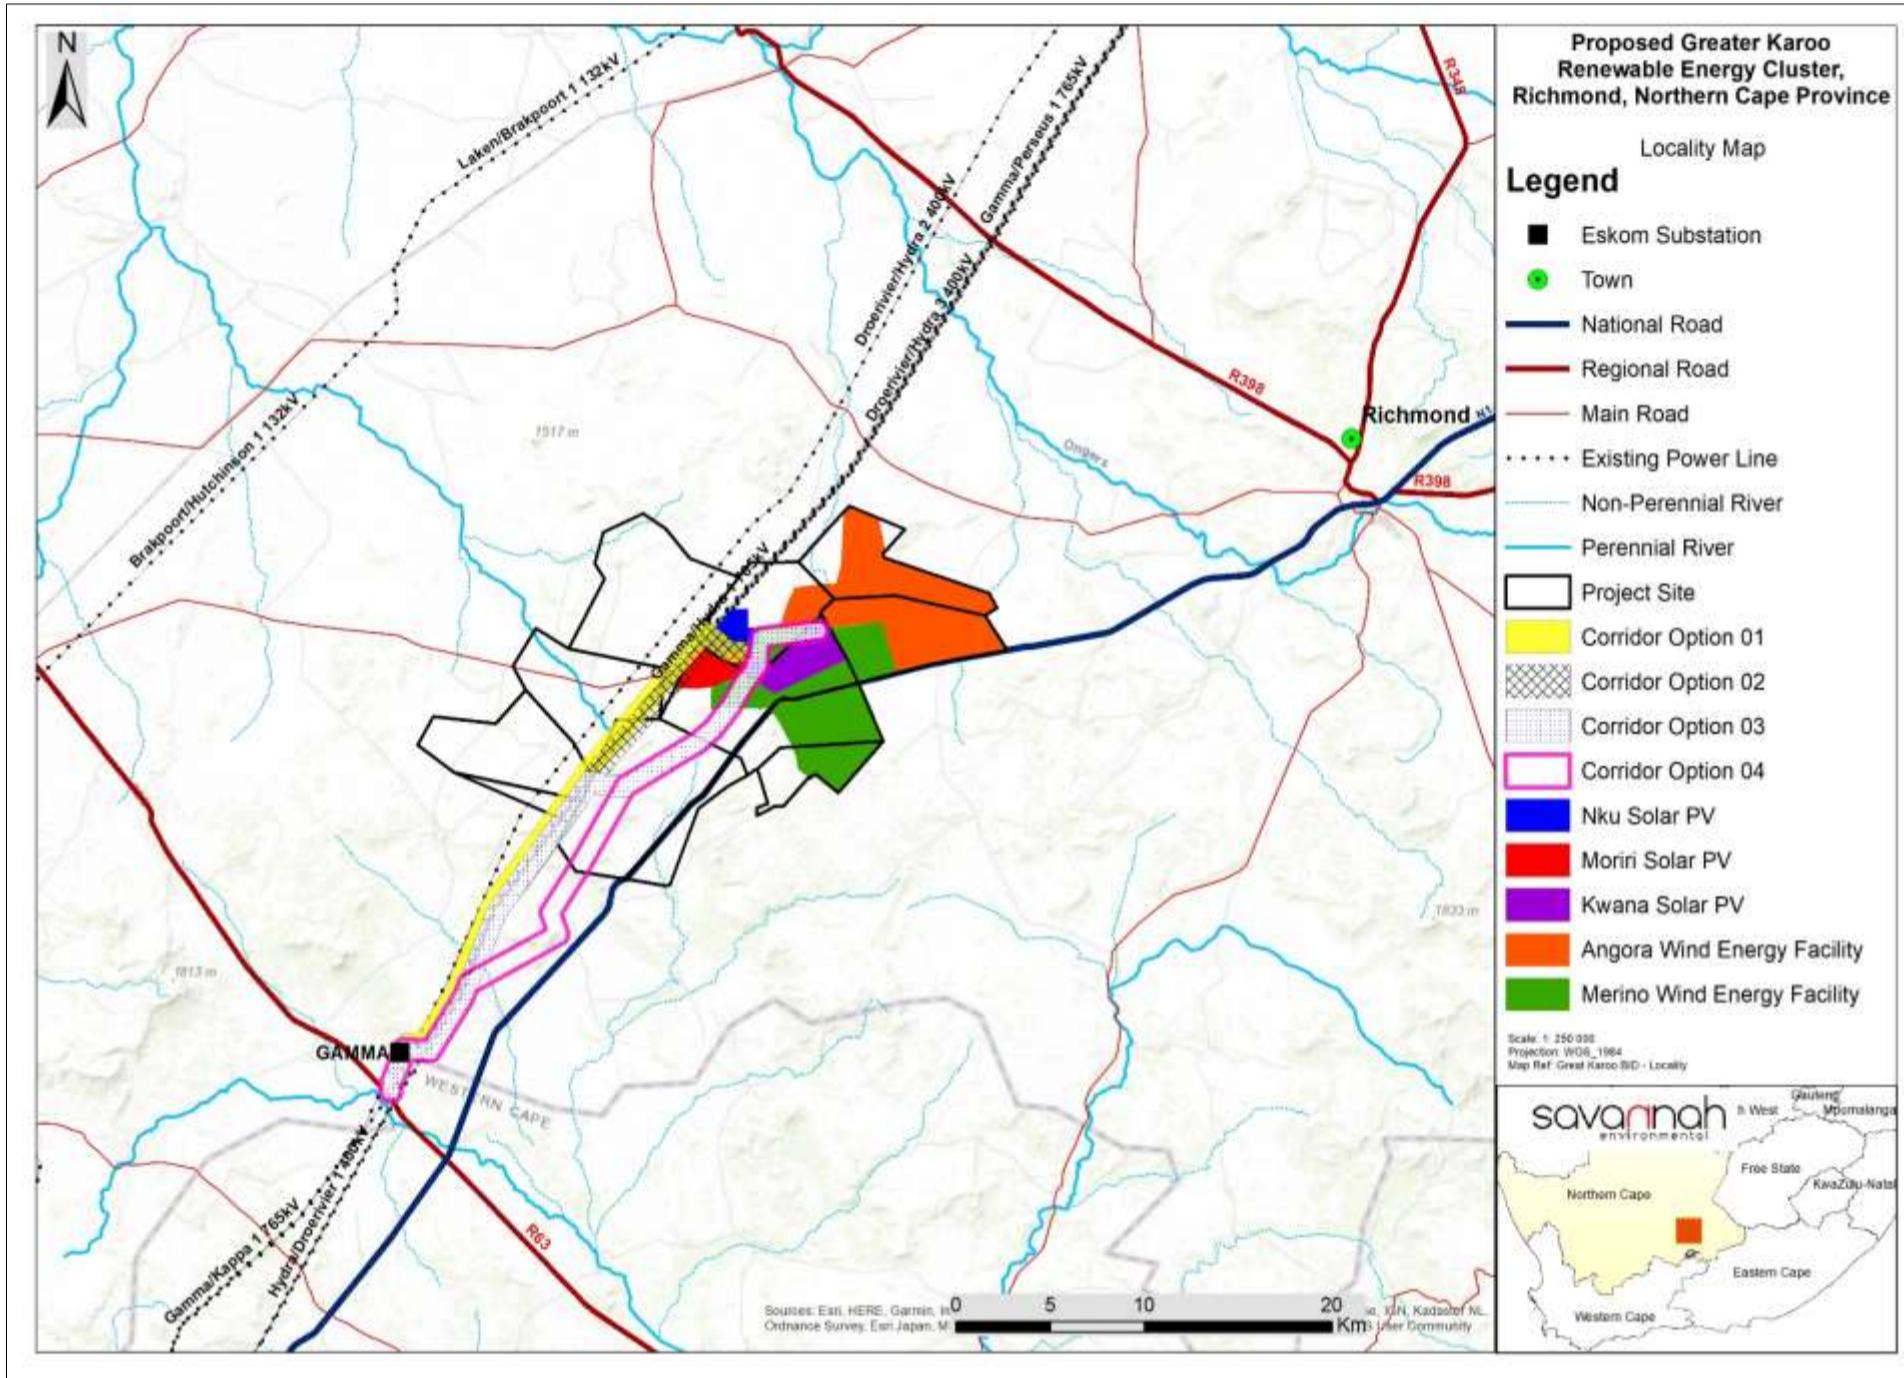

Infrastructure associated with each Solar PV Facility will include:

- » Solar PV array comprising PV modules and mounting structures.
- » Inverters and transformers.
- » Cabling between the panels.
- » 33/132kV onsite facility substation.
- » Cabling from the onsite substation to the collector substation (either underground or overhead).
- » Electrical and auxiliary equipment required at the collector substation that serves that solar energy facility, including switchyard/bay, control building, fences etc.
- » Battery Energy Storage System (BESS).
- » Site offices and maintenance buildings, including workshop areas for maintenance and storage.
- » Laydown areas.
- » Access roads and internal distribution roads.

Infrastructure associated with each Wind Energy Facility will include:

- » Wind turbines
- » Concrete turbine foundations and turbine hardstands.
- » Inverters and transformers.
- » Temporary laydown areas which will accommodate storage and assembly areas.
- » Cabling between the turbines, to be laid underground where practical.
- » A temporary concrete batching plant.
- » 33/132kV onsite facility substation.
- » Underground cabling from the onsite substation to the collector substation.
- » Electrical and auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences etc.
- » Battery Energy Storage System (BESS).
- » Access roads and internal distribution roads.
- » Site offices and maintenance buildings, including workshop areas for maintenance and storage.

The grid connection infrastructure for all projects will include:

- » Central collector substation which consists of:
 - 33/132kV collector substation.
 - Associated equipment, infrastructure and buildings.
 - Temporary and permanent laydown areas.
- » Distribution Line:
 - * A double-circuit 132kV distribution line to connect the central collector 132kV substation to the existing Eskom Gamma Substation will be constructed.

The details for the respective projects are as follows:

Project Name	Generating capacity	Farm Name and No.	Portion No.
Nku Solar PV Facility	100MW	Rondavel 85	0 & 1
Moriri Solar PV Facility	100MW	Rondavel 85	0 & 1
Kwana Solar PV Facility	100MW	Rondavel 85	0 & 1
Angora Wind Energy Facility	140MW	Gegundefontein 53	11
		Vogelstruisfontein 84	0
		Rondavel 85	0 & 1
Merino Wind Energy Facility	140MW	Rondavel 85	0 & 1
		Bult & Rietfontein 96	9
		Vogelstruisfontein 84	0

Electrical Grid Infrastructure (EGI)	Capacity	Farm Name and Portion	Infrastructure components
Collector EGI	132kV	<ul style="list-style-type: none"> » Portion 0 of Farm Annex Rondavel 86 » Portion 1 of Farm Annex Rondavel 86 » Portion 1 of Farm Uit Vlugt Fontein 265 » Portion 0 of Farm Wynandsfontein 91 » Portion 1 of Farm Wynandsfontein 91 » Portion 3 of Farm Vlekfontein 90 » Portion 0 of Farm Burgersfontein 92 » Portion 1 of Farm Nieuwe Fontein 89 » Portion 0 of Farm Rondavel 85 » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Kleinfontein 93 » Portion 8 of Farm Jan Boysens Onder Plaats 94 » Portion 1 of Farm Bult & Rietfontein 96 » Remaining extent of Farm 3 	<ul style="list-style-type: none"> » 132kV collector substation and associated 132kV power line

Applications for Environmental Authorisation: Each renewable energy facility will be constructed as a separate stand-alone project and therefore, separate Scoping and Environmental Impact Assessment (S&EIA) processes will be undertaken for each facility. Similarly, the grid connection solution will be subjected to a separate Basic Assessment (BA) process which will consider feasible alternatives for the power line corridors. Each respective renewable facility project and the grid connection infrastructure require applications for Environmental Authorisation (EA) in terms of the National Environmental Management Act (No. 107 of 1998) (NEMA) and 2014 EIA Regulations (GNR 326), which are required to be supported by S&EIA processes for each renewable energy facility and a BA process for the grid connection infrastructure.

Public Participation Process: Savannah Environmental (Pty) Ltd has been appointed as the environmental consultant responsible for undertaking the respective S&EIA, BA and Public Participation processes in support of the applications for EA. Due to the proximity of the renewable energy facilities and grid connection solution to one another, the EIA processes and public participation processes for the projects will be undertaken concurrently, providing the public with an opportunity to understand the full extent of the development proposed and comment on each of the projects. **To obtain further information on the projects and to register on the project databases, please submit your name, contact information and interest in the project, in writing, to:**


Nicolene Venter at Savannah Environmental
 P.O. Box 148, Sunninghill, 2157
 Tel: 011 656 3237
 Fax: 086 684 0547
 Email: publicprocess@savannahsa.com
 Website: www.savannahsa.com



KENNISGEWING VAN OMGEWINGSIMPAKEVALUERING, BASIESE EVALUERING EN OPENBARE DEELNAMEPROSESSE VIR DIE BEOOGDE ONTWIKKELING VAN DIE GROOT KAROO GROEP HERNUBARE KRAGAANLEGTE EN ROOSTERKONNEKSIE-INFRASTRUKTUUR NABY RICHMOND, NOORD-KAAPPROVINSIE

Applicant: Great Karoo Renewable Energy (Edms.) Bpk.

Beoogde aktiwiteit: Great Karoo Renewable Energy (Edms.) Bpk. beoog die ontwikkeling van 'n groep hernubare kragaanlegte en verwante infrastruktuur, met insluiting van Elektriese Kragnetinfrastruktuur (EKI), ~ 35 km suidwes van die dorp Richmond met die N1 langs en 80 km suidoos van Victoria-Wes met die R63 langs in die Noord-Kaapprovincie. Die groep bestaan uit drie (3) fotovoltaïese (FV) sonkragaanlegte van 100 MW en twee (2) windkragaanlegte van 140 MW. Die roosterkonneksie-infrastruktuur vir al die projekte sal een sentrale kollektorsubstasie van 132 kV en 'n dubbelkring kraglyn van 132 kV tot by Eskom se bestaande Gamma-substasie insluit.

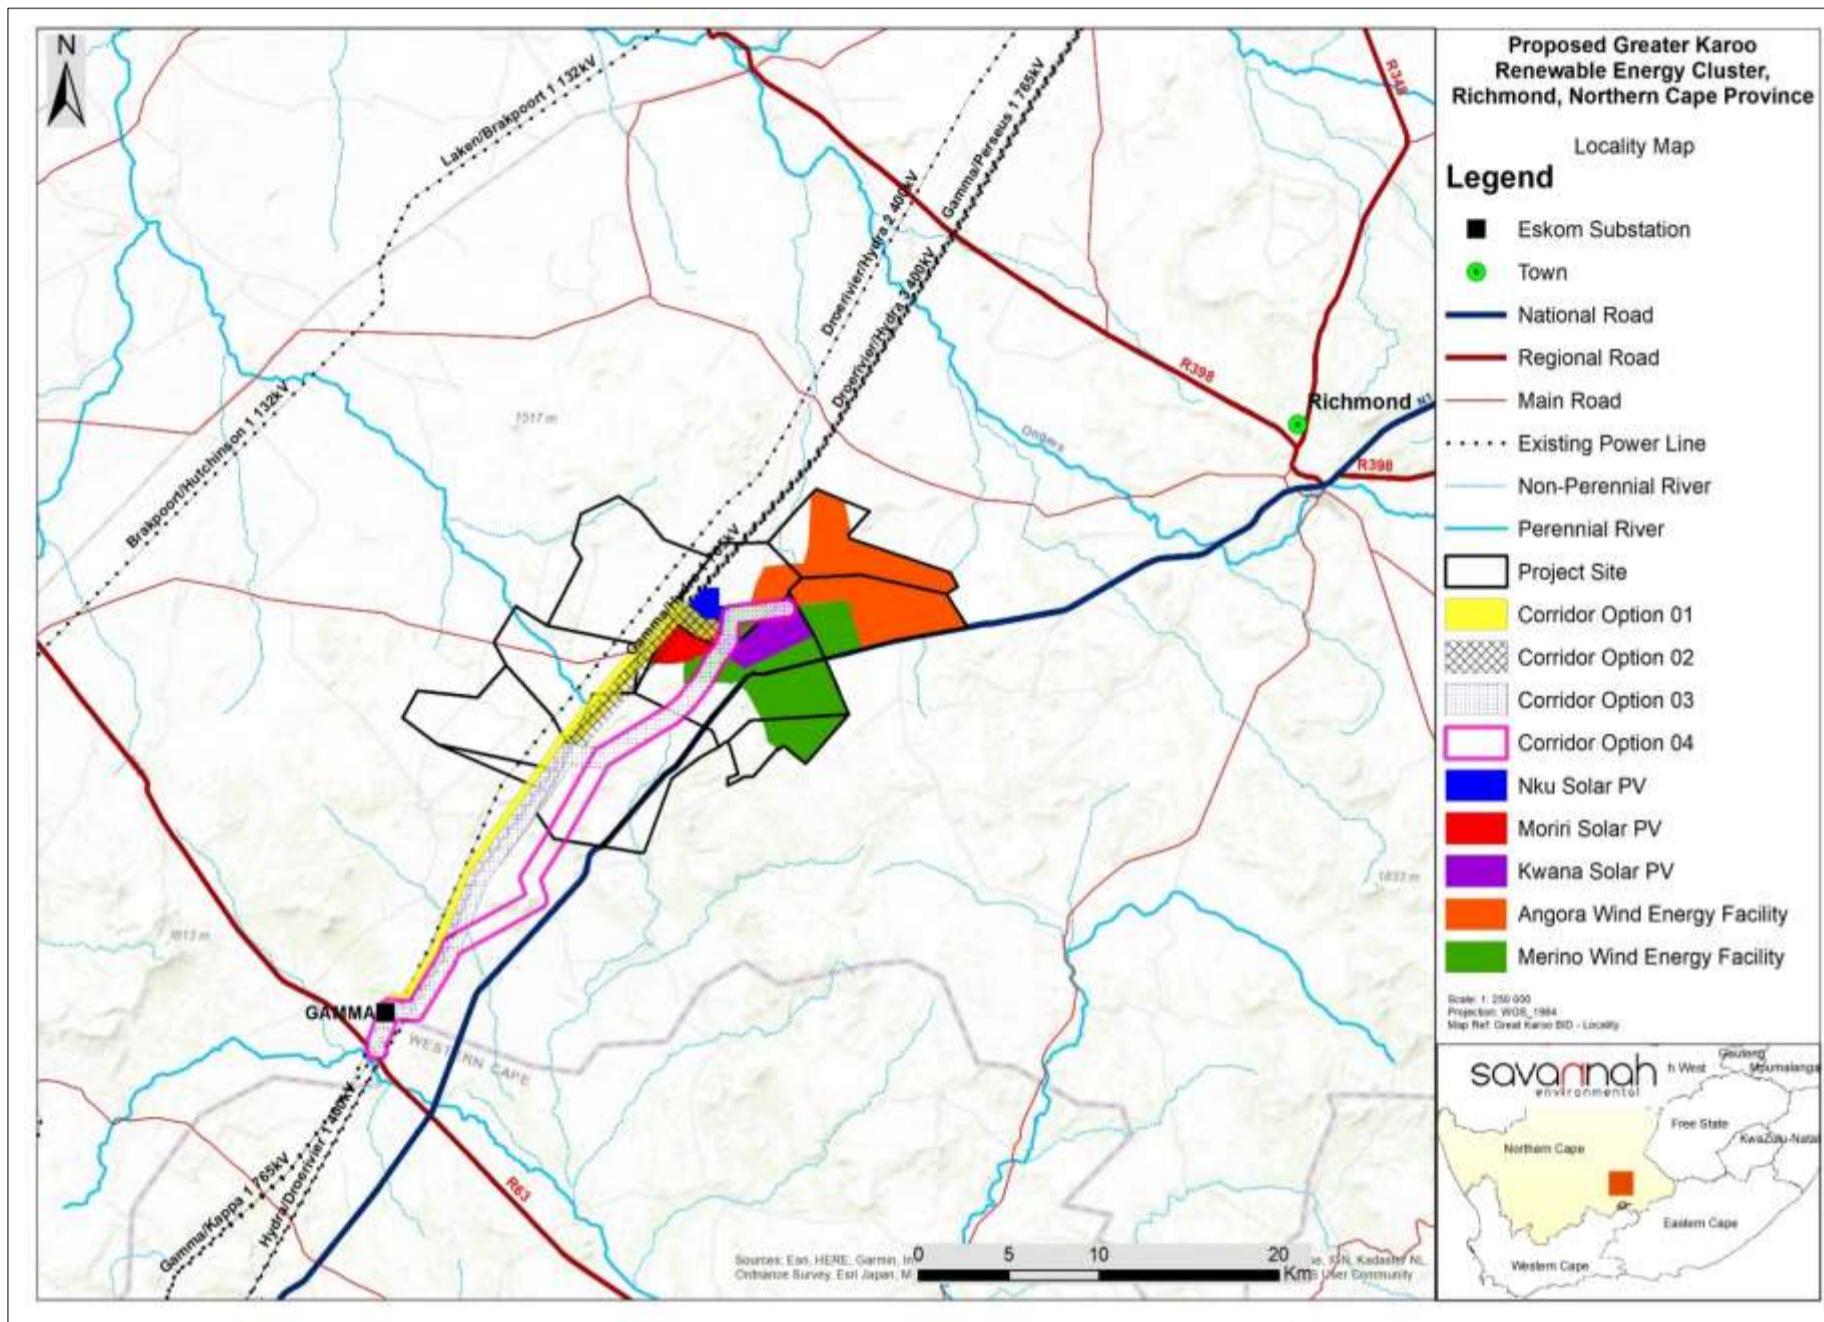

Infrastruktuur wat met elk van die FV-sonkragaanlegte verband hou, sal insluit:

- » FV-sonkragreeks bestaande uit FV-modules en monteerstrukture;
- » wisselrigters en transformators;
- » kabels tussen die panele;
- » 33/132 kV interne aanlegsubstasie;
- » kabels van die interne substasie af tot by die kollektorsubstasie (hetso ondergronds of oorhoofs);
- » elektriese en hulptoerusting wat by die kollektorsubstasie benodig word wat daardie sonkragaanleg bedien, met insluiting van 'n skakelwerf-/vak, beheergebou, heidings, ens.
- » 'n batterykragbergingstelsel (BESS);
- » terreinkantore en instandhoudingsgeboue, met insluiting van werkswinkelgebiede vir instandhouding en bering;
- » stapelwerwe; en
- » toegangspaaie en interne distribusiepaaie.

Infrastruktuur wat met elke Windkragaanleg verband hou, sal insluit:

- » windturbines;
- » betonfondasies en vaste blaai vir turbines;
- » wisselrigters en transformators;
- » tydelike stapelwerwe wat die bergings- en monteergebiede sal huisves;
- » kabels tussen die turbines, wat ondergronds gelê moet word waar dit prakties moontlik is;
- » 'n tydelike beton lotaanleg;
- » 33/132 kV interne aanlegsubstasie;
- » ondergrondse kabels van die interne substasie af tot by die kollektorsubstasie;
- » elektiese en hulptoerusting wat by die kollektorsubstasie benodig word wat daardie windkragaanleg bedien, met insluiting van 'n skakelwerf-/vak, beheergebou, heidings, ens.
- » 'n batterykragbergingstelsel (BESS);
- » toegangspaaie en interne distribusiepaaie;
- » terreinkantore en instandhoudingsgeboue, met insluiting van werkswinkelgebiede vir instandhouding en bering.

Die roosterkonneksie-infrastruktuur vir alle projekte sal insluit:

- » Sentrale kollektorsubstasie bestaande uit:
 - 33/132 KV kollektorsubstasie;
 - verwante toerusting, infrastruktuur en geboue;
 - tydeike en permanente stapelwerfgebiede;
- » Distribusielyn:
 - * 'n Dubbelkring 132 kV distribusielyn sal opgerig word om die sentrale 132 kV distribusiesubstasie met Eskom se bestaande Gamma-substasie te verbind.

Die besonderhede vir die onderskeie projekte is soos volg:

Projeknaam	Opwekkingsvermoë	Plaasnaam en -no.	Gedeelteno.
Nku FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Moriri FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Kwana FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Angora Windkragaanleg	140 MW	Gegundefontein 53	11
		Vogelstruisfontein 84	0
		Rondavel 85	0 & 1
Merino Windkragaanleg	140 MW	Rondavel 85	0 & 1
		Bult & Rietfontein 96	9
		Vogelstruisfontein 84	0

Elektriese kragnetinfrastruktuur (EKI)	Vermoë	Plaasnaam en -gedeelte	Infrastruktuurkomponente
Kollektor-EKI	132 kV	<ul style="list-style-type: none"> » Gedeelte 0 van die plaas Annex Rondavel 86 » Gedeelte 1 van die plaas Annex Rondavel 86 » Gedeelte 1 van die plaas Uit Vlugt Fontein 265 » Gedeelte 0 van die plaas Wynandsfontein 91 » Gedeelte 1 van die plaas Wynandsfontein 91 » Gedeelte 3 van die plaas Vlekfontein 90 » Gedeelte 0 van die plaas Burgersfontein 92 » Gedeelte 1 van die plaas Nieuwe Fontein 89 » Gedeelte 0 van die plaas Rondavel 85 » Gedeelte 1 van die plaas Rondavel 85 » Gedeelte 0 van die plaas Kleinfontein 93 » Gedeelte 8 van die plaas Jan Booyens Onder Plaats 94 » Gedeelte 1 van die plaas Bult & Rietfontein 96 » Restant van Plaas 3 	<ul style="list-style-type: none"> » 132 kV kollektorsubstasie en verwante 132 kV kraglyn

Aansoeke om Omgewingsmagtiging: Elke hernubare kragaanleg sal as 'n aparte losstaande projek opgerig word, gevvolglik sal aparte Bestekopname- en Omgewingsimpakevalueringsprosesse (B- & OIE-prosesse) vir elke aanleg onderneem word. Eweneens sal die roosterkonneksie-oplossing onderwerp word aan 'n aparte Basiese Evalueringssproses (BE-proses), wat oorweging aan bedryfbare alternatiewe vir die kraglynkorridors sal skenk. Elke onderskeie hernubare aanlegprojek en die roosterkonneksie-infrastruktuur vereis aansoeke om Omgewingsmagtiging (OM) ingevolge die Nasionale Wet op Omgewingsbestuur (Wet 107 van 1998) (NEMA) en die 2014 OIE-regulasies (Staatskennisgewing R326), wat deur B&OIE-prosesse vir elke hernubare kragaanleg en 'n BE-proses vir die roosterkonneksie-infrastruktuur ondersteun moet word.

Openbare Deelnameproses: Savannah Environmental (Edms.) Bpk. is aangestel as die omgewingskonsultant wat verantwoordelik is om die onderskeie B&OIE-, BE- en Openbare Deelnameprosesse ter stawing van die aansoeke om OM te onderneem. Weens die nabyheid van die hernubare kragaanlegte en die kragnetkonneksie-oplossings aan mekaar, sal die OIE-prosesse en openbare deelnameprosesse vir die projekte gelyklopend onderneem word, wat die publiek 'n geleentheid sal bied om die volle omvang van die beoogde ontwikkelings te verstaan en op elkeen van die projekte kommentaar te lewer. **Om meer inligting te bekom en om op die projekte se databasisse te registreer, verstrek asseblief u naam, kontakbesonderhede en belang by die projek skriftelik aan:**

Nicolene Venter by Savannah Environmental
Posbus 148, Sunninghill, 2157
Tel: 011 656 3237
Faks: 086 684 0547
E-pos: publicprocess@savannahsa.com
Webwerf: www.savannahsa.com



PROOF OF SITE NOTICES (Date placed: Wednesday, 29 September 2021)



Process Notices

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT, BASIC ASSESSMENT AND PUBLIC PARTICIPATION PROCESSES FOR THE PROPOSED DEVELOPMENT OF THE GREAT KAROO CLUSTER OF RENEWABLE ENERGY FACILITIES AND GRID CONNECTION INFRASTRUCTURE, NEAR RICHMOND, NORTHERN CAPE PROVINCE

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Great Karoo Renewable Energy (Pty) Ltd proposes the development of a cluster of renewable energy facilities and associated infrastructure, including Electrical Grid Infrastructure (EGI), ~35km South-West of the town of Richmond along the N1 and 80km South-East of Victoria West along the R63 in the Northern Cape Province. The cluster consists of three (3) 100MW solar photovoltaic (PV) energy facilities, and two (2) 140MW energy facilities. The grid connection infrastructure for all projects will include one central collector 132kV substation and a double circuit 132kV power line to the existing Eskom Gamma Substation.

Infrastructure associated with each Solar PV Facility will include:

- » Solar PV array comprising PV modules and mounting structures.
- » Inverters and transformers.
- » Cabling between the panels.
- » 33/132kV onsite facility substation.
- » Cabling from the onsite substation to the collector substation (either underground or overhead).
- » Electrical and auxiliary equipment required at the collector substation that serves that solar energy facility, including switchyard/bay, control building, fences etc.
- » Battery Energy Storage System (BESS).
- » Site offices and maintenance buildings, including workshop areas for maintenance and storage.
- » Laydown areas.
- » Access roads and internal distribution roads.

Infrastructure associated with each Wind Energy Facility will include:

- » Wind turbines
- » Concrete turbine foundations and turbine hardstands.
- » Inverters and transformers.
- » Temporary laydown areas which will accommodate storage and assembly areas.
- » Cabling between the turbines, to be laid underground where practical.
- » A temporary concrete batching plant.
- » 33/132kV onsite facility substation.
- » Underground cabling from the onsite substation to the collector substation.
- » Electrical and auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences etc.
- » Battery Energy Storage System (BESS).
- » Access roads and internal distribution roads.
- » Site offices and maintenance buildings, including workshop areas for maintenance and storage.

The grid connection infrastructure for all projects will include:

- » Central collector substation which consists of:
 - 33/132kV collector substation.
 - Associated equipment, infrastructure and buildings.
 - Temporary and permanent laydown areas.
- » Distribution Line:
 - * A double-circuit 132kV distribution line to connect the central collector 132kV substation to the existing Eskom Gamma Substation will be constructed.

The details for the respective projects are as follows:

Project Name	Generating capacity	Farm Name and No.	Portion No.
Nku Solar PV Facility	100MW	Rondavel 85	0 & 1
Moriri Solar PV Facility	100MW	Rondavel 85	0 & 1
Kwana Solar PV Facility	100MW	Rondavel 85	0 & 1
Angora Wind Energy Facility	140MW	Gegundefontein 53	11
		Vogelstruisfontein 84	0
		Rondavel 85	0 & 1
Merino Wind Energy Facility	140MW	Rondavel 85	0 & 1
		Bult & Rietfontein 96	9
		Vogelstruisfontein 84	0

Electrical Grid Infrastructure (EGI)	Capacity	Farm Name and Portion	Infrastructure components
Collector EGI	132kV	<ul style="list-style-type: none">» Portion 0 of Farm Annex Rondavel 86» Portion 1 of Farm Annex Rondavel 86» Portion 1 of Farm Uit Vlugt Fontein 265» Portion 0 of Farm Wynandsfontein 91» Portion 1 of Farm Wynandsfontein 91» Portion 3 of Farm Vlekfontein 90» Portion 0 of Farm Burgersfontein 92» Portion 1 of Farm Nieuwe Fontein 89» Portion 0 of Farm Rondavel 85» Portion 1 of Farm Rondavel 85» Portion 0 of Farm Kleinfontein 93» Portion 8 of Farm Jan Boysens Onder Plaats 94» Portion 1 of Farm Bult & Rietfontein 96» Remaining extent of Farm 3	<ul style="list-style-type: none">» 132kV collector substation and associated 132kV power line

Applications for Environmental Authorisation: Each renewable energy facility will be constructed as a separate stand-alone project and therefore, separate Scoping and Environmental Impact Assessment (S&EIA) processes will be undertaken for each facility. Similarly, the grid connection solution will be subjected to a separate Basic Assessment (BA) process which will consider feasible alternatives for the power line corridors. Each respective renewable facility project and the grid connection infrastructure require applications for Environmental Authorisation (EA) in terms of the National Environmental Management Act (No. 107 of 1998) (NEMA) and 2014 EIA Regulations (GNR 326), which are required to be supported by S&EIA processes for each renewable energy facility and a BA process for the grid connection infrastructure.

Public Participation Process: Savannah Environmental (Pty) Ltd has been appointed as the environmental consultant responsible for undertaking the respective S&EIA, BA and Public Participation processes in support of the applications for EA. Due to the proximity of the renewable energy facilities and grid connection solution to one another, the EIA processes and public participation processes for the projects will be undertaken concurrently, providing the public with an opportunity to understand the full extent of the development proposed and comment on each of the projects. **To obtain further information on the projects and to register on the project databases, please submit your name, contact information and interest in the project, in writing, to:**

Nicolene Venter at Savannah Environmental

P.O. Box 148, Sunninghill, 2157

Email: publicprocess@savannahsa.com

Tel: 011 656 3237 / Fax: 086 684 0547

Website: www.savannahsa.com

savannah
environmental

KENNISGEWING VAN OMGEWINGSIMPAKEVALUERING, BASIESE EVALUERING EN OPENBARE DEELNAMEPROSESSE VIR DIE BEOOGDE ONTWIKKELING VAN DIE GROOT KAROO GROEP HERNUBARE KRAGAANLEGTE EN ROOSTERKONNEKSIE-INFRASTRUKTUUR NABY RICHMOND, NOORD-KAAPROVINSIE

Applicant: Great Karoo Renewable Energy (Edms.) Bpk.

Beoogde aktiwiteit: Great Karoo Renewable Energy (Edms.) Bpk. beoog die ontwikkeling van 'n groep hernubare kragaanlegte en verwante infrastruktuur, met insluiting van Elektriese Kragnetinfrastruktur (EKI), ~ 35 km suidwes van die dorp Richmond met die N1 langs en 80 km suidoos van Victoria-Wes met die R63 langs in die Noord-Kaaprovincie. Die groep bestaan uit drie (3) fotovoltaïese (FV) sonkragaanlegte van 100 MW en twee (2) windkragaanlegte van 140 MW. Die roosterkonneksie-infrastruktur vir al die projekte sal een sentrale kollektorsubstasie van 132 kV en 'n dubbelkring kraglyn van 132 kV tot by Eskom se bestaande Gamma-substasie insluit.

Infrastruktuur wat met elk van die FV-sonkragaanlegte verband hou, sal insluit:

- » FV-sonkragreeks bestaande uit FV-modules en monteerstrukture;
- » wisselrigters en transformators;
- » kabels tussen die panele;
- » 33/132 kV interne aanlegsubstasie;
- » kabels van die interne substasie af tot by die kollektorsubstasie (hetso ondergronds of oorhoofs);
- » elektriese en hulptoerusting wat by die kollektorsubstasie benodig word wat daardie sonkragaanleg bedien, met insluiting van 'n skakelwerf-/vak, beheergebou, heidings, ens.
- » 'n batterykragbergingstelsel (BESS);
- » terreinkantore en instandhoudingsgeboue, met insluiting van werkswinkelgebiede vir instandhouding en bering;
- » stapelwerwe; en
- » toegangspaaie en interne distribusiepaaie.

Infrastruktuur wat met elke Windkragaanleg verband hou, sal insluit:

- » windturbines;
- » betonfondasies en vaste blaai vir turbines;
- » wisselrigters en transformators;
- » tydelike stapelwerwe wat die bergings- en monteergebiede sal huisves;
- » kabels tussen die turbines, wat ondergronds gelê moet word waar dit prakties moontlik is;
- » 'n tydelike beton lotaanleg;
- » 33/132 kV interne aanlegsubstasie;
- » ondergrondse kabels van die interne substasie af tot by die kollektorsubstasie;
- » elektiese en hulptoerusting wat by die kollektorubstasie benodig word wat daardie windkragaanleg bedien, met insluiting van 'n skakelwerf-/vak, beheergebou, heidings, ens.
- » 'n batterykragbergingstelsel (BESS);
- » toegangspaaie en interne distribusiepaaie;
- » terreinkantore en instandhoudingsgeboue, met insluiting van werkswinkelgebiede vir instandhouding en bering.

Die roosterkonneksie-infrastruktur vir alle projekte sal insluit:

- » Sentrale kollektorsubstasie bestaande uit:
 - 33/132 kV kollektorsubstasie;
 - verwante toerusting, infrastruktuur en geboue;
 - tydeike en permanente stapelwerfgebiede;
- » Distribusielyn:
 - * 'n Dubbelkring 132 kV distribusielyn sal opgerig word om die sentrale 132 kV distribusiesubstasie met Eskom se bestaande Gamma-substasie te verbind.

Die besonderhede vir die onderskeie projekte is soos volg:

Projeknaam	Opwekkingsvermoë	Plaasnaam en -no.	Gedeelteno.
Nku FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Moriri FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Kwana FV-sonkragaanleg	100 MW	Rondavel 85	0 & 1
Angora Windkragaanleg	140 MW	Gegundefontein 53 Ptn 11 / Vogelstruisfontein 84 Ptn 0 / Rondavel 85 Ptns 0 & 1	11
Merino Windkragaanleg	140 MW	Rondavel 85 Ptns 0 & 1 / Bult & Rietfontein 96 Ptn 9 / Vogelstruisfontein 84 Ptn 0	0 & 1

Elektriese kragnetinfrastruktur (EKI)	Vermoë	Plaasnaam en -gedeelte	Infrastruktuurkomponente
Kollektor-EKI	132 kV	<ul style="list-style-type: none">» Gedeelte 0 van die plaas Annex Rondavel 86» Gedeelte 1 van die plaas Annex Rondavel 86» Gedeelte 1 van die plaas Uit Vlugt Fontein 265» Gedeelte 0 van die plaas Wynandsfontein 91» Gedeelte 1 van die plaas Wynandsfontein 91» Gedeelte 3 van die plaas Vlekfontein 90» Gedeelte 0 van die plaas Burgersfontein 92» Gedeelte 1 van die plaas Nieuwe Fontein 89» Gedeelte 0 van die plaas Rondavel 85» Gedeelte 1 van die plaas Rondavel 85» Gedeelte 0 van die plaas Kleinfontein 93» Gedeelte 8 van die plaas Jan Boysens Onder Plaats 94» Gedeelte 1 van die plaas Bult & Rietfontein 96» Restant van Plaas 3	<ul style="list-style-type: none">» 132 kV kollektorsubstasie en verwante 132 kV kraglyn

Aansoeke om Omgewingsmagtiging: Elke hernubare kragaanleg sal as 'n aparte losstaande projek opgerig word, gevvolglik sal aparte Bestekopname- en Omgewingsimpakevalueringssprosesse (B- & OIE-prosesse) vir elke aanleg onderneem word. Eweneens sal die roosterkonneksie-oplossing onderwerp word aan 'n aparte Basiese Evaluatingsproses (BE-proses), wat oorweging aan bedryfbare alternatiewe vir die kraglynkorridors sal skenk. Elke onderskeie hernubare aanlegprojek en die roosterkonneksie-infrastruktur vereis aansoeke om Omgewingsmagtiging (OM) ingevolge die Nasionale Wet op Omgewingsbestuur (Wet 107 van 1998) (NEMA) en die 2014 OIE-regulasies (Staatskennisgewing R326), wat deur B&OIE-prosesse vir elke hernubare kragaanleg en 'n BE-proses vir die roosterkonneksie-infrastruktur ondersteun moet word.

Openbare Deelnameproses: Savannah Environmental (Edms.) Bpk. is aangestel as die omgewingskonsultant wat verantwoordelik is om die onderskeie B&OIE-, BE- en Openbare Deelnameprosesse ter stawing van die aansoeke om OM te onderneem. Weens die nabyheid van die hernubare kragaanlegte en die kragnetkonneksie-oplossings aan mekaar, sal die OIE-prosesse en openbare deelnameprosesse vir die projekte gelyklopend onderneem word, wat die publiek 'n geleentheid sal bied om die volle omvang van die beoogde ontwikkelings te verstaan en op elkeen van die projekte kommentaar te lewer. **Om meer inligting te bekom en om op die projekte se databasisse te registreer, verstrek asseblief u naam, kontakbesonderhede en belang by die projek skriftelik aan:**

Nicolene Venter by Savannah Environmental

Posbus 148, Sunninghill, 2157

E-pos: publicprocess@savannahsa.com

Tel: 011 656 3237 / Faks: 086 684 0547



Webwerf: www.savannahsa.com

savannah
environmental

PROOF OF PROCESS NOTICES (Date placed: Wednesday, 29 September 2021 – Richmond)

CALTAX SERVICE STATION



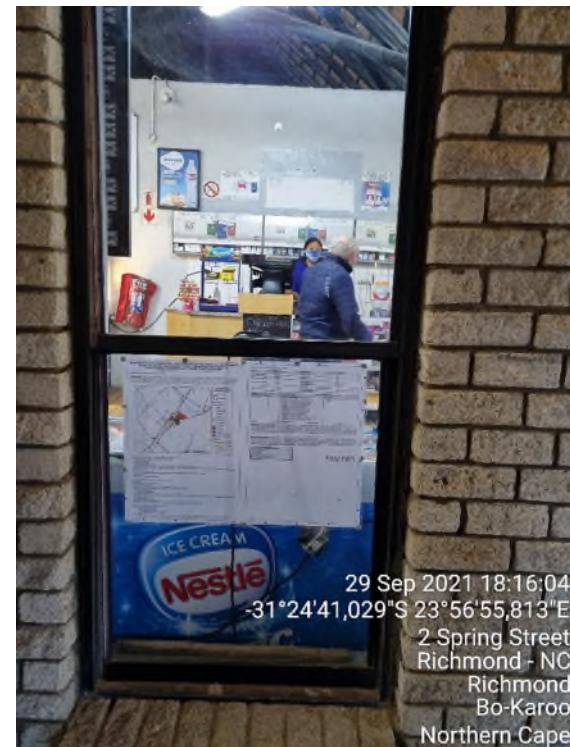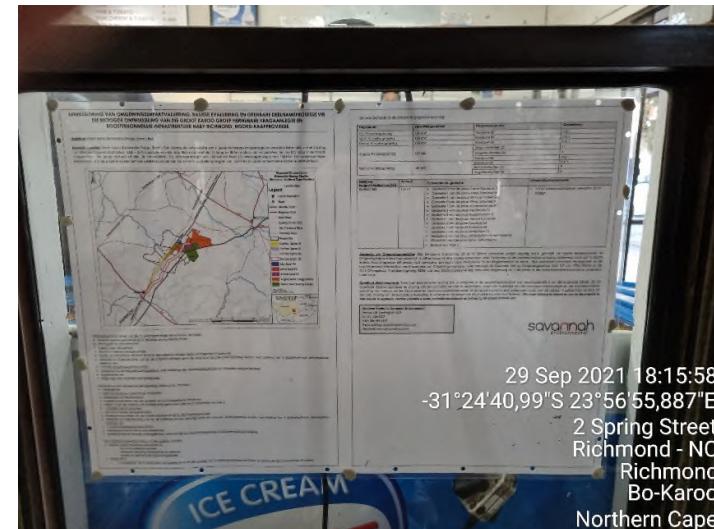

AL-AMIN SUPERMARK



NTSIKELELO TIDA COMMUNITY LIBRARY






PEP STORE





UBUNTU MUNICIPALITY OFFICES

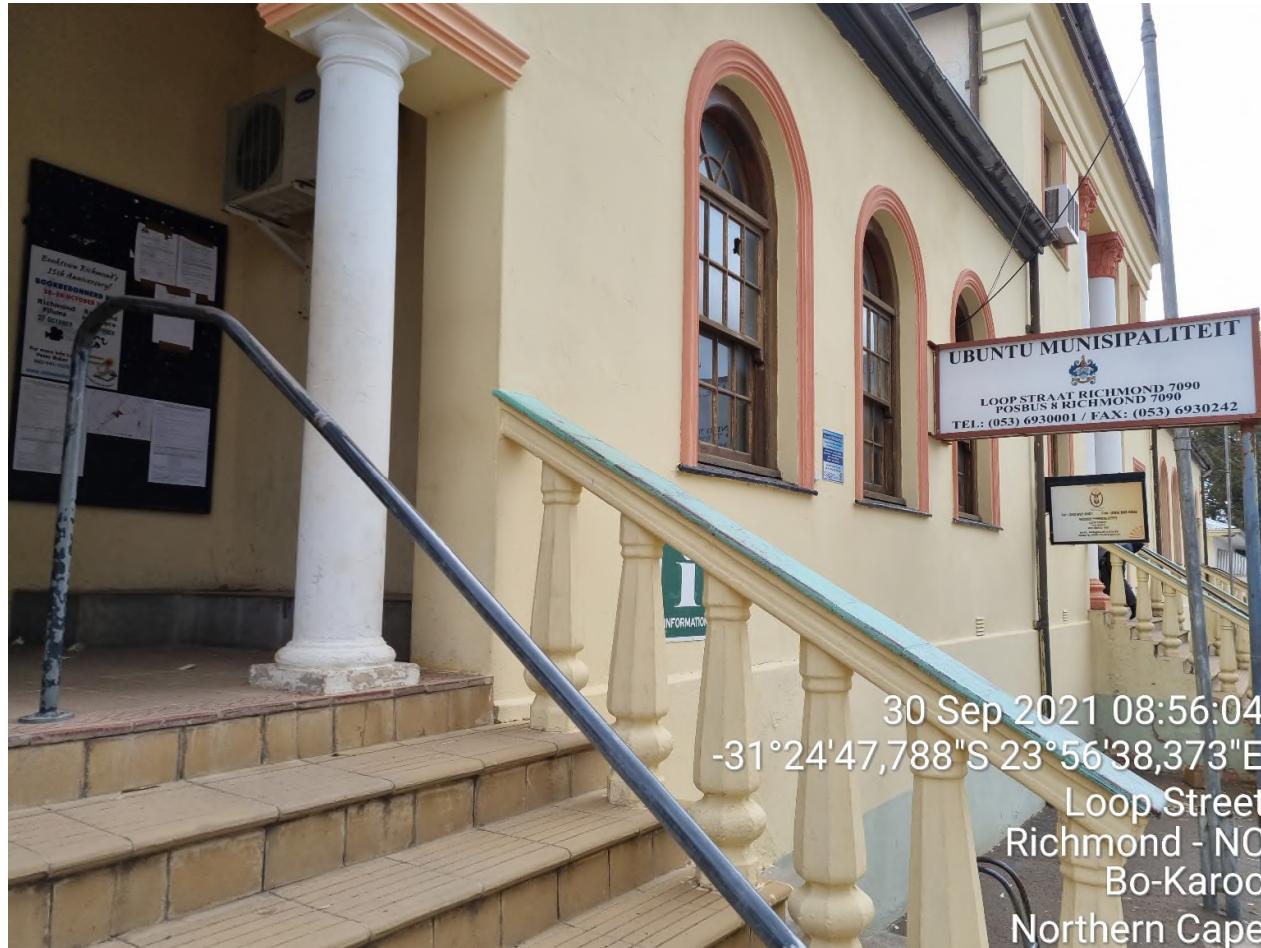




SPAR – VICTORIA WEST



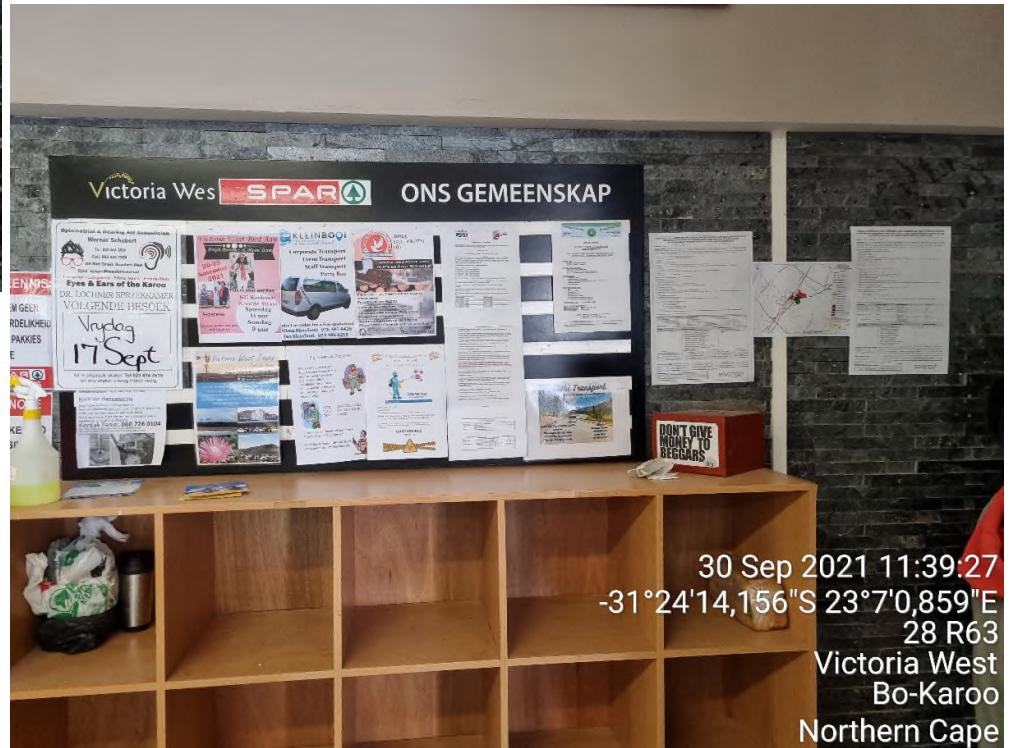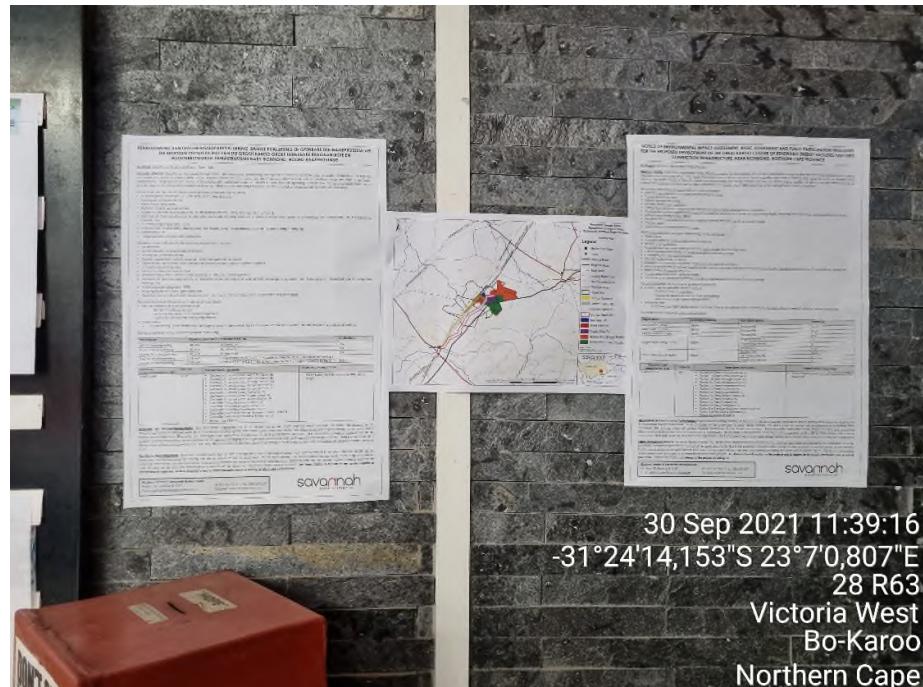

CLINIC – VICTORIA WEST



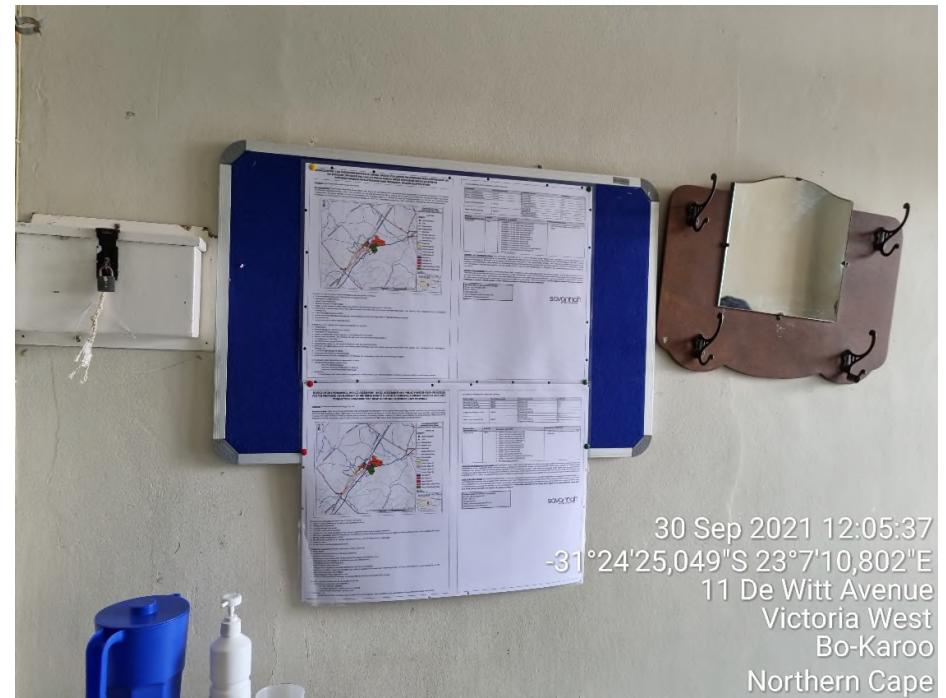

Advertisements

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT, BASIC ASSESSMENT & PUBLIC PARTICIPATION PROCESSES FOR THE PROPOSED DEVELOPMENT OF THE GREAT KAROO CLUSTER OF RENEWABLE ENERGY FACILITIES & GRID CONNECTION INFRASTRUCTURE, NEAR RICHMOND, NORTHERN CAPE PROVINCE

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Establishment of three (3) Solar Photovoltaic (PV) Energy Facilities, two (2) Wind Energy Facilities & grid connection infrastructure comprising a 132kV central collector substation & a 132kV power line to enable the connection of five (5) renewable energy facilities to the national grid for the evacuation of the generated electricity. The connection point to the national grid will be the existing Eskom Gamma Substation. Infrastructure associated with each project includes:

Solar Energy Facilities	Wind Energy Facilities	Grid Connection Infrastructure
<ul style="list-style-type: none"> » Solar PV array comprising PV modules & mounting structures. » Inverters & transformers. » Cabling between the panels. » 33/132kV onsite facility substation. » Cabling from the onsite substation to the collector substation (either underground or overhead). » Electrical & auxiliary equipment required at the collector substation that serves that solar energy facility, including switchyard/bay, control building, fences, etc. » Battery Energy Storage System (BESS). » Site offices & maintenance buildings, including workshop areas for maintenance & storage. » Laydown areas. » Access roads & internal distribution roads. 	<ul style="list-style-type: none"> » Wind turbines. » Concrete turbine foundations & turbine hardstands. » Inverters & transformers. » Temporary laydown areas which will accommodate storage & assembly areas. » Cabling between the turbines, to be laid underground where practical. » A temporary concrete batching plant. » 33/132kV onsite facility substation. » Underground cabling from the onsite substation to the collector substation. » Electrical & auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences, etc. » Battery Energy Storage System (BESS). » Access roads & internal distribution roads. » Site offices & maintenance buildings, including workshop areas for maintenance & storage. 	<ul style="list-style-type: none"> » Central collector substation which consists of: <ul style="list-style-type: none"> * 33/132kV collector substation. * Associated equipment, infrastructure, & buildings. * Temporary & permanent laydown areas. » Distribution Line: <ul style="list-style-type: none"> * A double-circuit 132kV distribution line to connect the central collector 132kV substation to the existing Eskom Gamma Substation will be constructed.

Project Location: The five (5) proposed renewable energy facilities, along with their associated grid connection infrastructure, are located approximately 35km South-West of Richmond along the N1 & approximately 80km South-East of Victoria West along the R63 in the Northern Cape Province, within the Ubuntu Local Municipality, & the Pixley Ka Seme District Municipality. A portion (approximately 2km) of the 132kV power line that will connect the 132kV central collector substation to the Eskom Gamma Substation falls within the Beaufort West Local Municipality which forms part of the greater Cape Winelands District Municipality in the Western Cape Province.

Solar Energy Facilities 100MW		Wind Energy Facilities 140MW	
Project	Property	Project	Properties
Nku Solar PV Facility			
Moriri Solar PV Facility	» Farm Rondavel 85 (Portion 0 & 1)	Angora Wind Energy Facility	<ul style="list-style-type: none"> » Portion 11 of Farm Gegundefontein 53 » Portion 0 of Farm Vogelstruisfontein 84 » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Rondavel 85
Kwana Solar PV Facility		Merino Wind Energy Facility	<ul style="list-style-type: none"> » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Rondavel 85 » Portion 9 of Farm Bult & Rietfontein 96
Savannah Environmental website: https://savannahsa.com/public-documents/energy-generation/the-great-karoo-cluster-of-renewable-energy-facilities/			

Collector Electrical Grid Infrastructure (EGI)	
Project	Properties
Collector EGI (132kV)	<ul style="list-style-type: none"> » Portion 0 of Farm Annex Rondavel 86 » Portion 1 of Farm Annex Rondavel 86 » Portion 1 of Farm Uit Vlugt Fontein 265 » Portion 0 of Farm Wynandsfontein 91 » Portion 1 of Farm Wynandsfontein 91 » Portion 3 of Farm Vlekfontein 90 » Portion 0 of Farm Burgersfontein 92 » Portion 1 of Farm Nieuwe Fontein 89 » Portion 0 of Farm Rondavel 85 » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Kleinfontein 93 » Portion 8 of Farm Jan Boysens Onder Plaats 94 » Portion 1 of Farm Bult & Rietfontein 96 » Remaining extent of Farm 3

Savannah Environmental website: <https://savannahsa.com/public-documents/grid-infrastructure/the-great-karoo-cluster-grid-connection-infrastructure/>

Scoping & Environmental Impact Assessment (S&EIA) & Basic Assessment (BA) Processes: In terms of Sections 24 & 24D of the National Environmental Management Act (No 107 of 1998), as read with Government Notice R324 – R327, as amended, a S&EIA process is required for each renewable energy facility. Similarly, a BA process is required for the grid connection infrastructure. Savannah Environmental is undertaking the required S&EIA, BA, & public participation processes for these projects.

Scoping Reports & BA Report available for review & comment: The Scoping & Reports for each of the renewable energy facilities are available for download, review, & comment on the Savannah Environmental website (see applicable link in table above). The 30-day review & comment period of the Scoping Reports is from **Friday, 12 November 2021 until Monday, 13 December 2021**. The availability of the BA Report for the grid connection infrastructure for a 30-day review and comment period will be communicated in due course.

Information Session: Interested and affected parties (I&APs) are invited to attend the Information Session (poster display) which will take place at the Richmond Show Grounds on **Thursday, 2 December 2021 at 14:00**. The Information Session will take place in compliance with COVID-19 protocols, and attendees are limited to 12 persons at a time in the Hall. Please contact Nicolene Venter or Tumelo Mathulwe (details below) to register your attendance.

To obtain further information & register on the project database, please submit your name, contact information & interest in the project to the contact person below.

Nicolene Venter or Tumelo Mathulwe at Savannah Environmental
P.O. Box 148, Sunninghill, 2157
Tel: 011 656 3237
Fax: 086 684 0547
Mobile: 060 978 8396 (including please call me)
Email: publicprocess@savannahsa.com
Website: www.savannahsa.com

AGS Saamstaan Kontrei winkel weereens 'n sukses

DE AAR – Die afgelope Saterdag, 6 November het die AGS kerk in Du Toitstraat hulle tweede Saamstaan Kontrei Winkel aangebied.

Reeds vroegoggend het die vure hoog gebrand om die wors en sosaties gereed te kry vir die besoekers. Uitstallers het hulle produkte gereed gekry en besoekers het opgedaag om die oggend in die ope lug te geniet. Hierdie keer is daar ook 'n kinderkompetisie aangebied en daar is in verskillende ouderdomsgroepe meegeding. Die wenners was asvolg: Baba katagorie - Twinkle Star: Eerste: Liame en tweede Juan-Rie. 1 - 2 Jaar - Busy Bee: Eerste: Payton, tweede: Arabellah en derde Anna-Mae. 3 - 4 Jaar - Full of Joy: Eerste: Elin-Rie en tweede Cloé. Baie geluk aan hierdie kleuters.

Daar was 'n groot getal uitstallers en beslis iets vir een en almal se smaak. Heerlike basaarpoeing, worsrolle, sosaties, tuisgebak, lekkergoed, koeldrank, diereprodukte, vetplante, handgemaakte items en vele meer. Daar was ook gesigverf, donkiekarritte en 'n springkasteel vir die kleinspan. Besoekers het beslis heerlik saam gekuier onder die koelte bome.

Hierdie was weereens 'n suksesvolle kontrei winkel en die organiseerders is dankbaar teenoor elke borg en besoeker wat die dag moontlik gemaak het. Daar word reeds 'n volgende Kontrei winkel vir Februarie 2022 beplan. Daar word ook 'n veiling beplan en indien u enige goedere het wat u wil laat opveel of selfs wil uitstal is u welkom om yir Antonette Bisset by 074 579 7658 te skakel vir verdere inligting.



Daar is weereens heerlik saamgekuier by die AGS Kerk se Saamstaan Kontrei winkel.



Die wenner van die Baba Katagorie - Twinkle Star - Liamé.



Tweede Plek van ons Baba Katagorie - Twinkle Star - Juan-Rie



Tweede Plek van ons 1-2 jaar Katagorie - Busy Bee - Arabellah



Derde Plek van ons 1-2 jaar Katagorie - Busy Bee - Anna-Mae.



Die wenner van die 3-4 jaar Katagorie - Full of Joy - Elin-Rie.



Tweede Plek van ons 3-4 jaar Katagorie - Full of Joy - Cloé



Reeds vroegoggend is daar vuur aangestek wat gesorg het vir n heerlike atmosfeer.

Taxpayers reminded to file returns ahead of deadline

THE South African Revenue Service (SARS) has urged individual non-provisional taxpayers to file their income tax returns on or before the deadline of 23 November 2021.

In a statement, the revenue collector warned that penalties would be levied on taxpayers who fail to submit their income tax returns by this deadline. "Taxpayers must note that according to changes in legislation, SARS will levy penalties from 1 December 2021 where one or more returns are outstanding. "Before the change in the legislation, SARS could only levy penalties where two or more returns were outstanding. This older rule will remain in place for one more year for 2020 and earlier returns," said the revenue service in a statement. SARS Commissioner Edward Kieswetter said the filing of a tax return is a legal obligation for those taxpayers who are required to file and contributes towards a culture of voluntary compliance. "But beyond the legal requirement to file a return, taxpayers who do the right thing are enabling government to meet the basic service needs of the poor and vulnerable by providing social grants and health care, amongst others," he said.

He said SARS had put in place a number of upgraded digital channels that are available 24/7. "This will help provide clarity and make it easy for taxpayers to meet the deadline of 23 November without any difficulty. These channels include amongst others, SARS eFiling, SARS MobiApp and an SMS service. More details are available on the SARS website," he said. Provisional taxpayers have until 31 January 2022 to fulfil all their filing obligations.

Kerssangdiens vind plaas

BRITSTOWN – Die jaar is amper om, en die NG Kerk Britstown is baie opgewonde oor die Feesseisoen wat vir voorlê!

NG Kerk Britstown bied volgende week die 21ste November, in Samewerking met DJ Muller 'n onvergetlike Kerssangdiens aan. Die diens beloof om 'n belewenis te wees! Tydens die diens sal daar ook Nagmaal bedien word en die nuutste lidmate sal verwelkom word. Die verrigtinge begin om 09:00 en daar sal na die tyd verversings wees om lekker saam te kuier in die Kerksaal.

Sien jou daar! Bring u hele gesin en geniet die Kerssangdiens saam met die gemeente.

Briewe aan die Redakteur

Ek wil graag my misnoë uitspreek teenoor die swak dienslewing van ons plaaslike hospitaal.

Jy moet wag tot tot vyf ure voordat jy gehelp word, maar as jy geken word dan sal jy voorkeur kry. Daar is min personeel aan diens en die wat aan diens is gaan op tee of ete, terwyl jy wag om gehelp te word. Hulle gee net nie om oor jou toestand nie. 'n Mens kan nie glo dat so groot hospitaal so swak diens het nie, die ou hospitaal was baie beter. Daar sal beslis daadwerklik opgetree moet word.

Baie Dankie, Heinrich Louw, 071 173 3746.



Three learners from St John's Primary School represented the school at a Mathematics competition at Kareeville Primary School. The learners did very well and got the school two second places and one third place. The school is proud of these learners. F.l.t.r: Tamaryn Perry (Grade 5 - Second place), Asikelele Nothula (Grade 5 - Second place) and Keisha Grenville (Grade 4 - Third place).

Die grootmense het ook nie terug gestaan nie en deel uitgemaak van die pret.

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT, BASIC ASSESSMENT & PUBLIC PARTICIPATION PROCESSES FOR THE PROPOSED DEVELOPMENT OF THE GREAT KAROO CLUSTER OF RENEWABLE ENERGY FACILITIES & GRID CONNECTION INFRASTRUCTURE, NEAR RICHMOND, NORTHERN CAPE PROVINCE

Applicant: Great Karoo Renewable Energy (Pty) Ltd.

Proposed Activity: Establishment of three (3) Solar Photovoltaic (PV) Energy Facilities, two (2) Wind Energy Facilities & grid connection infrastructure comprising a 132kV central collector substation & a 132kV power line to enable the connection of five (5) renewable energy facilities to the national grid for the evacuation of the generated electricity. The connection point to the national grid will be the existing Eskom Gamma Substation. Infrastructure associated with each project includes:

Solar Energy Facilities	Wind Energy Facilities	Grid Connection Infrastructure
<ul style="list-style-type: none"> » Solar PV array comprising PV modules & mounting structures. » Inverters & transformers. » Cabling between the panels. » Cabling from the onsite substation to the collector substation (either underground or overhead). » Electrical & auxiliary equipment required at the collector substation that serves that solar energy facility, including switchyard/bay, control building, fences, etc. » Battery Energy Storage System (BESS). » Site offices & maintenance buildings, including workshop areas for maintenance & storage. » Laydown areas. » Access roads & internal distribution roads. 	<ul style="list-style-type: none"> » Wind turbines. » Concrete turbine foundations & turbine hardstands. » Inverters & transformers. » Temporary laydown areas which will accommodate storage & assembly areas. » Cabling between the turbines, to be laid underground where practical. » A temporary concrete batching plant. » Underground cabling from the onsite substation to the collector substation. » Electrical & auxiliary equipment required at the collector substation that serves that wind energy facility, including switchyard/bay, control building, fences, etc. » Battery Energy Storage System (BESS). » Access roads & internal distribution roads. » Site offices & maintenance buildings, including workshop areas for maintenance & storage. 	<ul style="list-style-type: none"> » Central collector substation which consists of: <ul style="list-style-type: none"> • 33/132kV collector substation. • Associated equipment, infrastructure, & buildings. • Temporary & permanent laydown areas. » Distribution Line: <ul style="list-style-type: none"> • A double-circuit 132kV distribution line to connect the central collector 132kV substation to the existing Eskom Gamma Substation will be constructed.

Project Location: The five (5) proposed renewable energy facilities, along with their associated grid connection infrastructure, are located approximately 35km South-West of Richmond along the N1 & approximately 80km South-East of Victoria West along the R63 in the Northern Cape Province, within the Ubuntu Local Municipality, & the Pixley ka Seme District Municipality. A portion (approximately 2km) of the 132kV power line will connect the 132kV central collector substation to the Eskom Gamma Substation in the Western Cape Province.

Solar Energy Facilities 100MW		Wind Energy Facilities 140MW	
Project	Property	Project	Properties
Nku Solar PV Facility		Angora Wind Energy Facility	<ul style="list-style-type: none"> » Portion 11 of Farm Gugundfontein 53 » Portion 0 of Farm Vogelstruisfontein 84 » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Rondavel 85
Moriri Solar PV Facility	» Farm Rondavel 85 (Portion 0 & 1)	Merino Wind Energy Facility	<ul style="list-style-type: none"> » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Rondavel 85 » Portion 9 of Farm Butt & Riefontein 96

Savannah Environmental website: <https://savannahsa.com/public-documents/energy-generation/the-great-karoo-cluster-of-renewable-energy-facilities/>

Collector Electrical Grid Infrastructure (EGI)		Properties	
Project			
Collector EGI (132kV)	<ul style="list-style-type: none"> » Portion 0 of Farm Annex Rondavel 86 » Portion 1 of Farm Annex Rondavel 86 » Portion 1 of Farm Ult Vlugt Fontein 265 » Portion 0 of Farm Wynandsfontein 91 » Portion 3 of Farm Vleekontein 90 » Portion 0 of Farm Burgersfontein 92 	<ul style="list-style-type: none"> » Portion 1 of Farm Nieuwe Fontein 89 » Portion 0 of Farm Rondavel 85 » Portion 1 of Farm Rondavel 85 » Portion 0 of Farm Kleinfontein 93 » Portion 8 of Farm Jan Bosmans Onder Plaats 94 » Portion 1 of Farm Butt & Riefontein 96 » Remaining extent of Farm 3 	

Scoping & Environmental Impact Assessment (S&EIA) & Basic Assessment (BA) Processes: In terms of Sections 24 & 24D of the National Environmental Management Act (No 107 of 1998), as read with Government Notice R324 - R327, as amended, a S&EIA process is required for each renewable energy facility. Similarly, a BA process is required for the grid connection infrastructure. Savannah Environmental is undertaking the required S&EIA, BA, & public participation processes for these projects.

Scoping Reports & BA Report available for review & comment: The Scoping & Reports for each of the renewable energy facilities are available for download, review, & comment on the Savannah Environmental website (see applicable link in table above). The 30-day review & comment period of the Scoping Reports is from **Friday, 12 November 2021 until Monday, 13 December 2021**. The availability of the BA Report for the grid connection infrastructure for a 30-day review and comment period will be communicated in due course.

Information Session: Interested and affected parties (I&APs) are invited to attend the Information Session (poster display) which will take place at the Richmond Show Grounds on **Thursday, 2 December 2021 at 14:00**. The Information Session will take place in compliance with COVID-19 protocols, and attendees are limited to 12 persons at a time in the Hall. Please contact Nicolene Venter or Tumelo Mathulwe (details below) to register your attendance.

To obtain further information & register on the project database, please submit your name, contact information & interest in the project to the contact person below.

Nicolene Venter or Tumelo Mathulwe at Savannah Environmental
P.O. Box 148, Sunninghill, 2327
Tel: 011 656 3237
Fax: 086 484 0547
Mobile: 060 978 8396 (including please call me)
Email: publicprocess@savannahsa.com

savannah
environmental