



Figure 1: Area where the power line will traverse



Figure 2: More area that will be traversed by the power line



Figure 3: Power line that will have to be crossed by the proposed 400kV power line



Figure 4: Area where the substation is proposed



Figure 5: Structures (houses) located approximately 100 metres from the proposed substation area



Figure 6: Site notice placed along the area where the power line is proposed

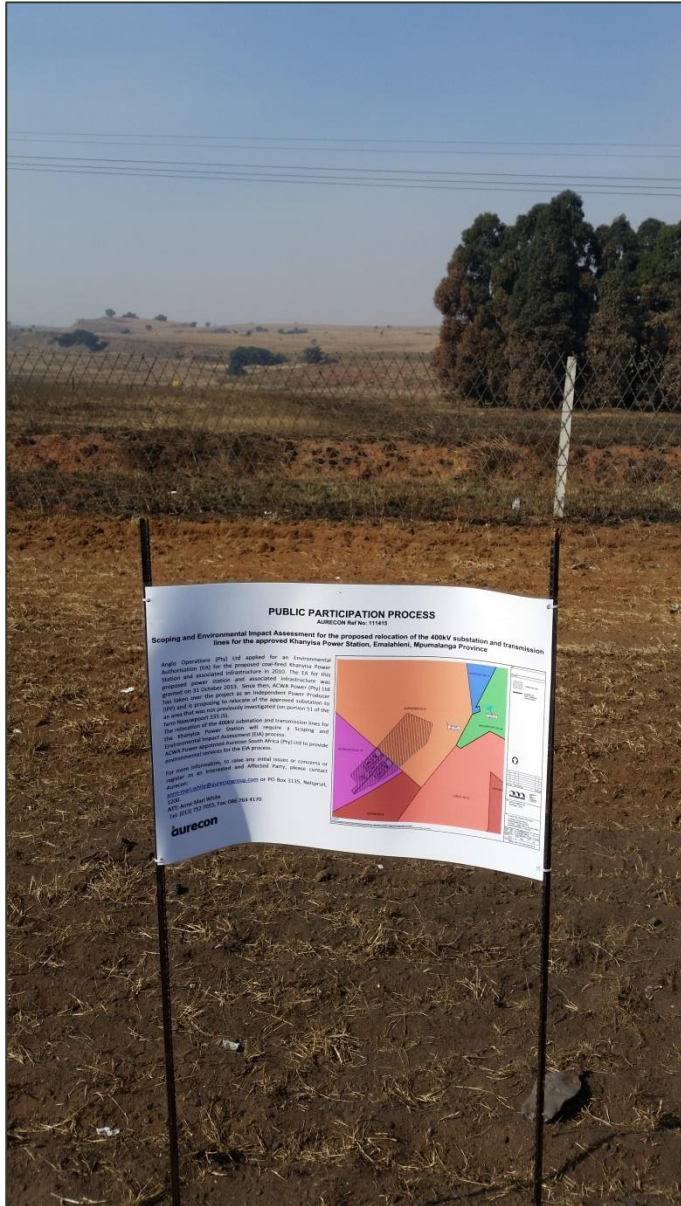


Figure 7: Site notice placed in front of the area where the substation is proposed