

APPENIDX E
PUBLIC PARTICIPATION

APPENDIX E1

**PROOF OF ONSITE NOTICE,
NEWSPAPER AND POSTERS**

ADVERTISEMENT IN THE LOCAL NEWSPAPERS

The proposed Bulk Water Pipeline project was advertised in two publications, namely; The Weekly and the Senekal Kourant. NSVT Consultants' advertisement was published in The Weekly on the 8th March 2019 and in the Senekal Kourant on the 21st March 2019, however, only a few have registered as I&APs thus far.

Advertisements placed in The Weekly as well as the Senekal Kourant is shown in *Figure 1 & 2* below.



Community helps police nab robber

Community members in Thaba Moleane have been commended after they helped police nab a robber who was being chased through a residential area. The suspect was arrested with a pistol and a stolen motor vehicle nearby from the neighbourhood.

A 30-year-old man was arrested after he was spotted holding a pistol in a residential area. The suspect was arrested with a pistol and a stolen motor vehicle nearby from the neighbourhood.



NOTICE OF BASIC ASSESSMENT PROCESS AND WATER USE LICENSE APPLICATION

Notice is hereby given in terms of the National Environmental Management Act (Act No. 107 of 1998) as amended and the 2014 Environmental Impact Assessment Regulation as amended on 07 April 2017 published under Government Notice 327 in Gazette no 40772 and National Water Act (Act 36 of 1998) of the intent to carry out a basic assessment process and Water Use License Application for the following activity:

The proponent, **Nketoana Local Municipality**, intends to construct a 19.4km long uPVC raw water pipeline from the Lindley Water Treatment Plant to Leratswana Reservoir, in order to meet the water demand in the Arlington/Leratswana area. The bulk water pipeline will have watercourse crossings.

This activity is regulated by the 2014 Environmental Impact Assessment Regulations as amended on 07 April 2017 published in the Government Notice 327, Listing Notice 1

Activity 19: The infilling or depositing of any material of more than 10 cubic metres into, or the dredging, excavation, removal or moving of soil, sand, shells, shell grit, pebbles or rock of more than 10 cubic metres from a watercourse; but excluding where such infilling, depositing, dredging, excavation, removal or moving—

- will occur behind a development setback;
- is for maintenance purposes undertaken in accordance with a maintenance management plan;
- falls within the ambit of activity 21 in this Notice, in which case that activity applies;
- occurs within existing ports or harbours that will not increase the development footprint of the port or harbour; or
- where such development is related to the development of a port or harbour, in which case activity 26 in Listing Notice 2 of 2014 applies.


An application for a Water Use License will be submitted to the Free State Department of Water and Sanitation for activities listed in Section (c) and (i) of the National Water Act (Act 26 of 1998) as the pipeline has watercourse crossings.

Section 21(c) - Impeding or diverting the flow of water in a water course.

Section 21(i) - Altering the bed, banks, course or characteristics of a water course

The Environmental Consultant is **NSVT Consultants**, PO Box 42452, Heuwelsig, 9332, or contact **Ms. Lorato Tigedi Pr. Sci. Nat.** (Tel) (051) 430 1041/2, (Fax) (088) 239 9133, email: lorato@nsvt.co.za


In order to ensure that you are identified as an interested and/or affected party, please submit your name, contact information and interest in the matter to the contact person given above within 30 days of publication of this advertisement.



Coligny sunflower killers sent to prison

Coligny sunflower killers have been sentenced to prison. The court found the two men guilty of killing sunflowers in April 2017 by putting lime out of a tractor into their crop's field.

Two men were sentenced to 18 months in prison for each for killing sunflowers in their crop's field in Coligny.



Man arrested for attempted rape

A 23-year-old man was arrested for attempted rape of a 19-year-old woman at Mags Luusburg. The woman reported the incident to the police.

The man was arrested after the woman reported the incident to the police. The woman reported the incident to the police.

FIGURE 1: NEWSPAPER ADVERT



Ambagsman beskikbaar vir projekte.
Frans Masupa is geregistreer by die Dept van Arbeid vir:
 Pleister, Bou, Plaveisel, Verf en die slaan van plafonne.
 Hy is in besit van 'n Kode 10 bestuurslisensie.
 Hy is bereid om 'n betrekking te aanvaar by 'n bestaande kontrakteur.
 Kontak hom by 063 450 0148

Publieke Veiling

'n **GROOT OPRUIMINGS VEILING**,
 word beplan vir Saterdag 30 Maart 2019
 om 11h00 by
SENEKAL SKOUGRONDE.

NB Hierdie is 'n opruimingsveiling en alles moet verkoop word!!

Baie items beskikbaar o.a.:
 Baie gereedskap, insluitende spanners,
 Bench grinder en ander los gereedskap.
 Oregon pine kassies,
 Ysterbeddens,
 Kerkbankie,
 Antieke bolglasrame,
 Hout botterkaring,
 Kaasvompie,
 Antieke albasterbottel,
 'Ball bearings'

Artikels mag voor en tydens die veiling onttrek of bygevoeg word.
 Verdere artikels sal selektief ontvang word.
 Persone wat belangstel om sodanige artikels in te skryf moet Marcel de Kock kontak nie later as Dinsdag 26 Maart 2019.

Let wel, tensy anders vooraf gereël, moet alle goedere na die veiling verwyder word.

Skakel Marcel de Kock by 083 980 7232

NOTICE OF BASIC ASSESSMENT PROCESS AND WATER USE LICENSE APPLICATION

Notice is hereby given in terms of the National Environmental Management Act (Act No. 107 of 1998) as amended and the 2014 Environmental Impact Assessment Regulation as amended on 07 April 2017 published under Government Notice 327 in Gazette no 40772 and National Water Act (Act 36 of 1998) of the intent to carry out a basic assessment process and Water Use License Application for the following activity:

The proponent, **Nketoana Local Municipality**, intends to construct a 19.4km long uPVC raw water pipeline from the Lindley Water Treatment Plant to Leratswana Reservoir, in order to meet the water demand in the Arlington/Leratswana area. The bulk water pipeline will have watercourse crossings. The pipeline runs in the Western side of R707 provincial road.

This activity is regulated by the 2014 Environmental Impact Assessment Regulations as amended on 07 April 2017 published in the Government Notice 327, Listing Notice 1-

Activity 19: The infilling or depositing of any material of more than 10 cubic metres into, or the dredging, excavation, removal or moving of soil, sand, shells, shell grit, pebbles or rock of more than 10 cubic metres from a watercourse; but excluding where such infilling, depositing, dredging, excavation, removal or moving

(a) will occur behind a development setback;
 (b) is for maintenance purposes undertaken in accordance with a maintenance management plan;
 (c) falls within the ambit of activity 21 in this Notice, in which case that activity applies;
 (d) occurs within existing ports or harbours that will not increase the development footprint of the port or harbour; or
 (e) where such development is related to the development of a port or harbour, in which case activity 26 in Listing Notice 2 of 2014 applies.

An application for a Water Use License will be submitted to the Free State Department of Water and Sanitation for activities listed in Section (c) and (i) of the National Water Act (Act 36 of 1998) as the pipeline has watercourse crossings.

Section 21(c) - Impeding or diverting the flow of water in a water course.

Section 21(i) - Altering the bed, banks, course or characteristics of a water course

The Environmental Consultant is **NSVT Consultants**, PO Box 42452, Heuwelsig, 9332, or contact **Ms.**

Lorato Tgedi Pr. Sci. Nat. (Tel) (051) 430 1041/2, (Fax) (086) 239 9133, email: lorato@nsvt.co.za.

In order to ensure that you are identified as an interested and/or affected party, please submit your name, contact information and interest in the matter to the contact person given above within 30 days of publication of this advertisement.

FIGURE 2: NEWSPAPER ADVERT

ON-SITE NOTICE AND POSTERS

On-site notices and posters were used to bring the proposed development to the attention of I&APs in and around the proposed area. They were placed on the 13th March 2019 Between the Lindley and Leratswana development area to coincide with the publication of the project Advertisement and provide everyone with an opportunity to register as an I&AP's but no comments have been received thus far, see *Photos* below



PHOTO 1: ON-SITE POSTER AT LINDLEY WATER TREATMENT PLANT

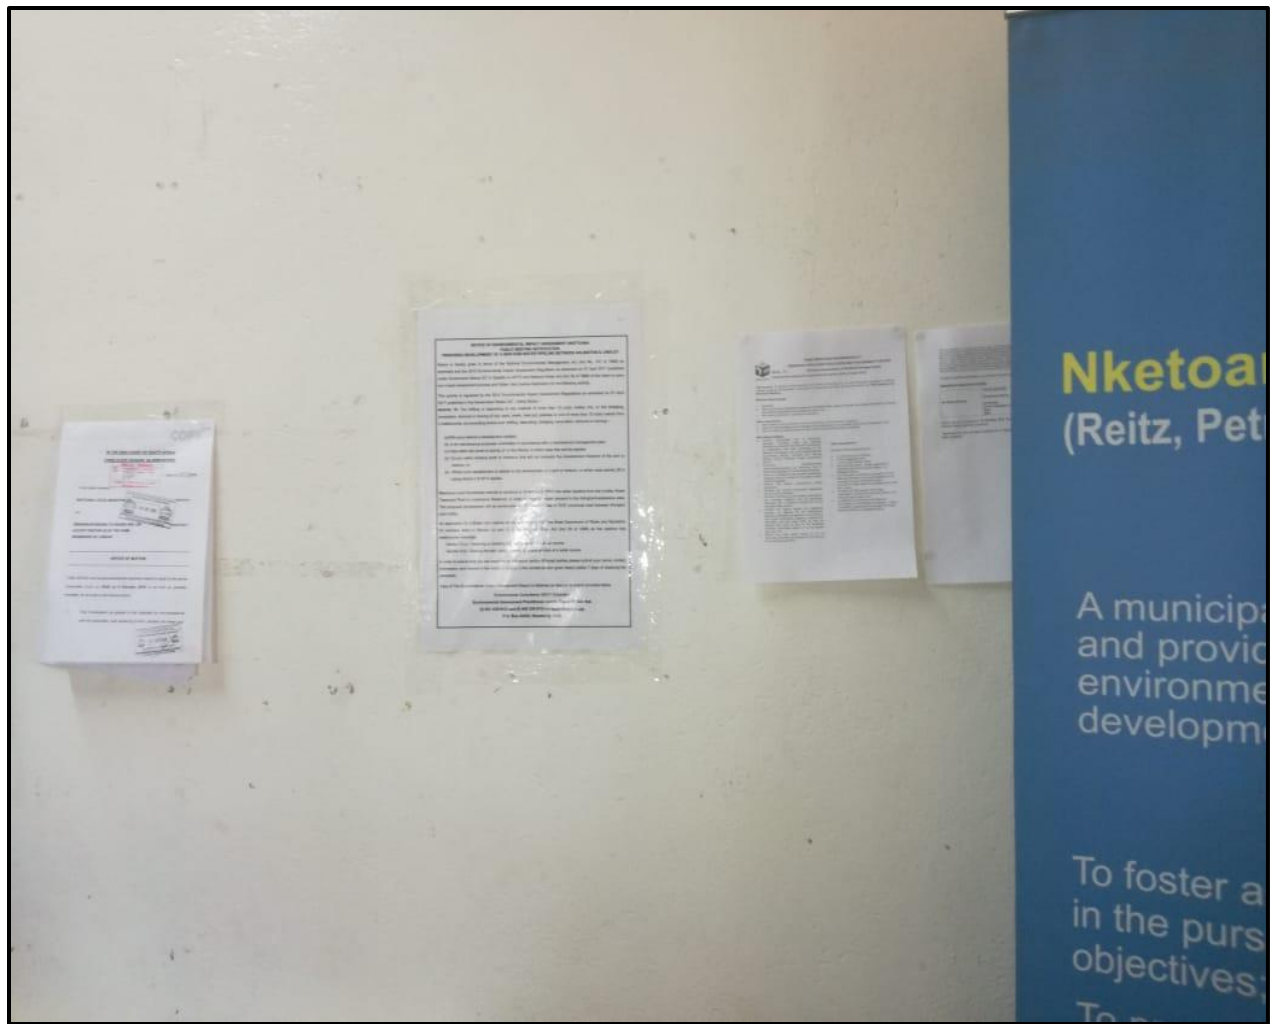


PHOTO 2: ON-SITE POSTER AT LINDLEY MUNICIPAL OFFICE

POSTERS

The posters were placed at prominently accessible places in Arlington and the Leratswana community where the public has full access, such as the Leratswana Public Library situated outside of the Arlington CBD as well as the OVK shopping centre located in the centre of Arlington in order for all to peruse through the Poster.

Posters placed at public entities are shown in *Photo 3, 4* and *5* below.



PHOTO 3: ON-SITE POSTER AT LERATSWANA MUNICIPAL OFFICE

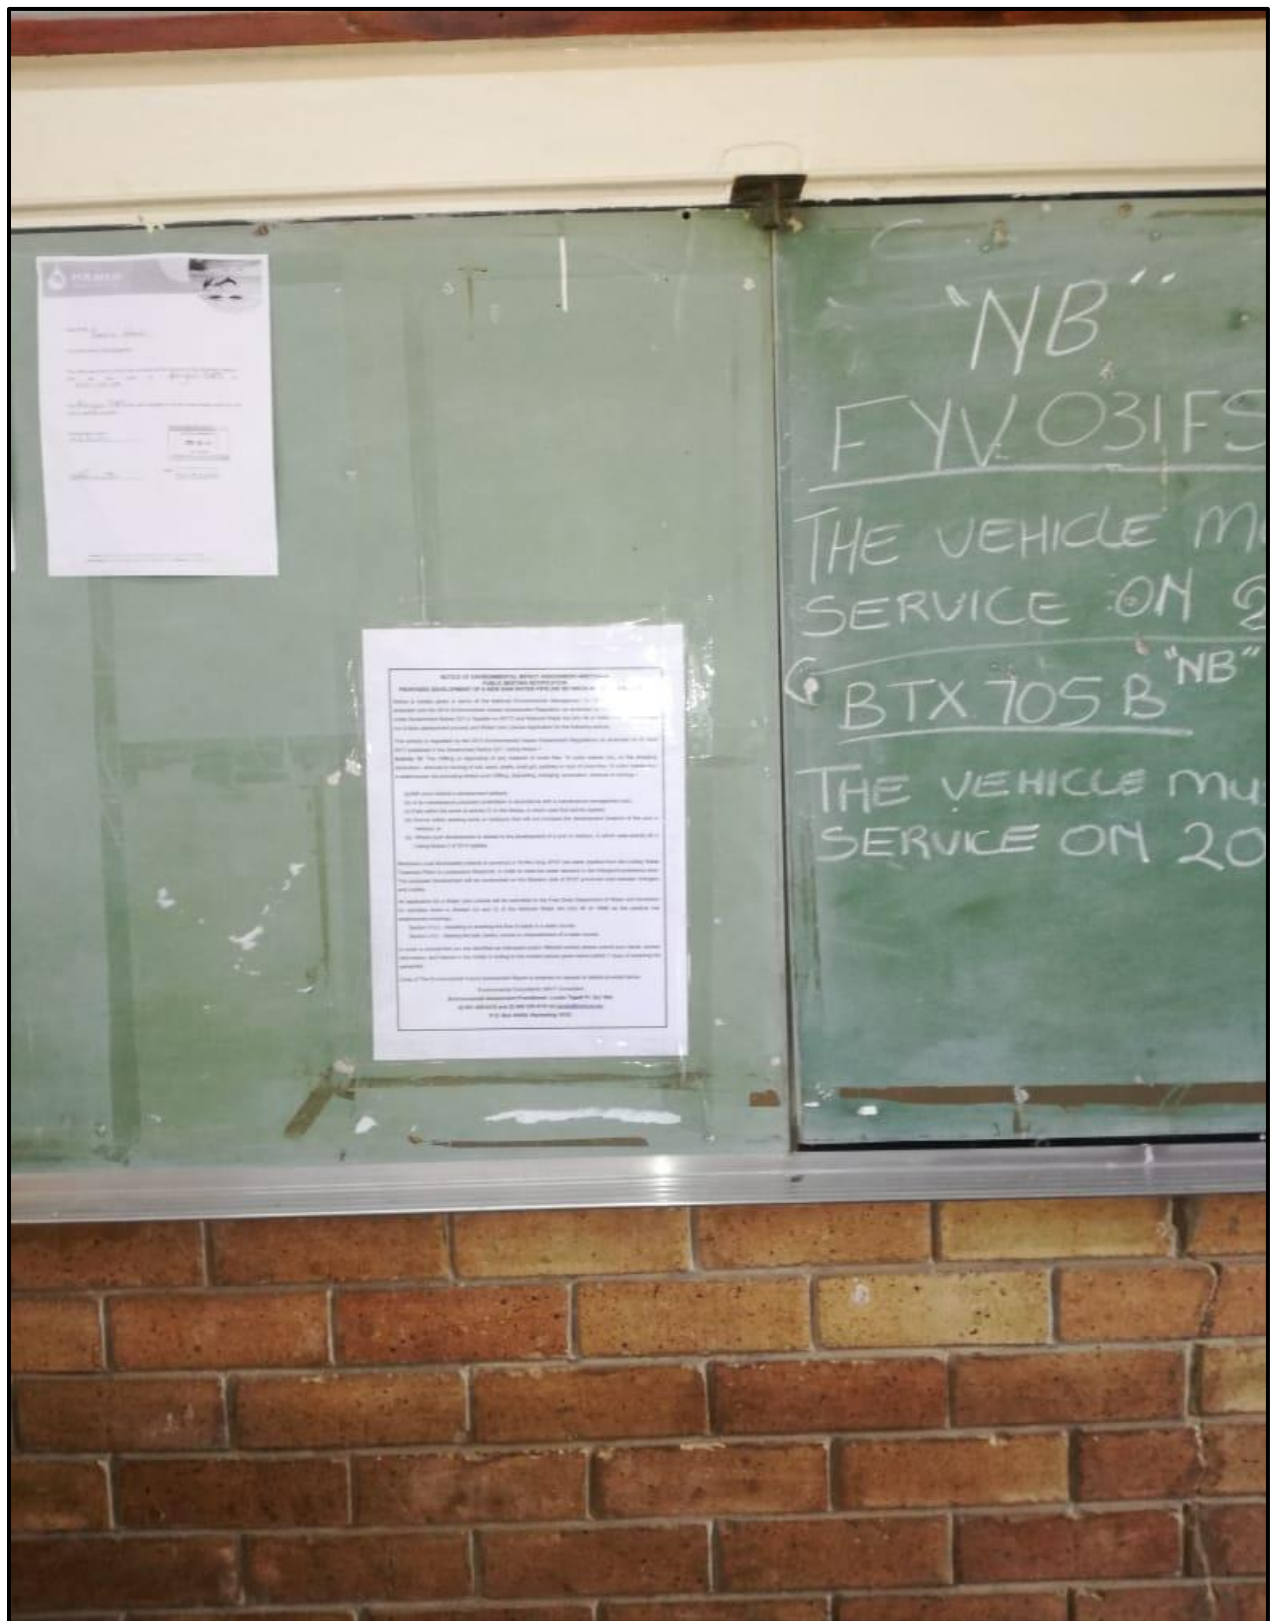


PHOTO 4: ON-SITE POSTER AT ARLINGTON POLICE STATION

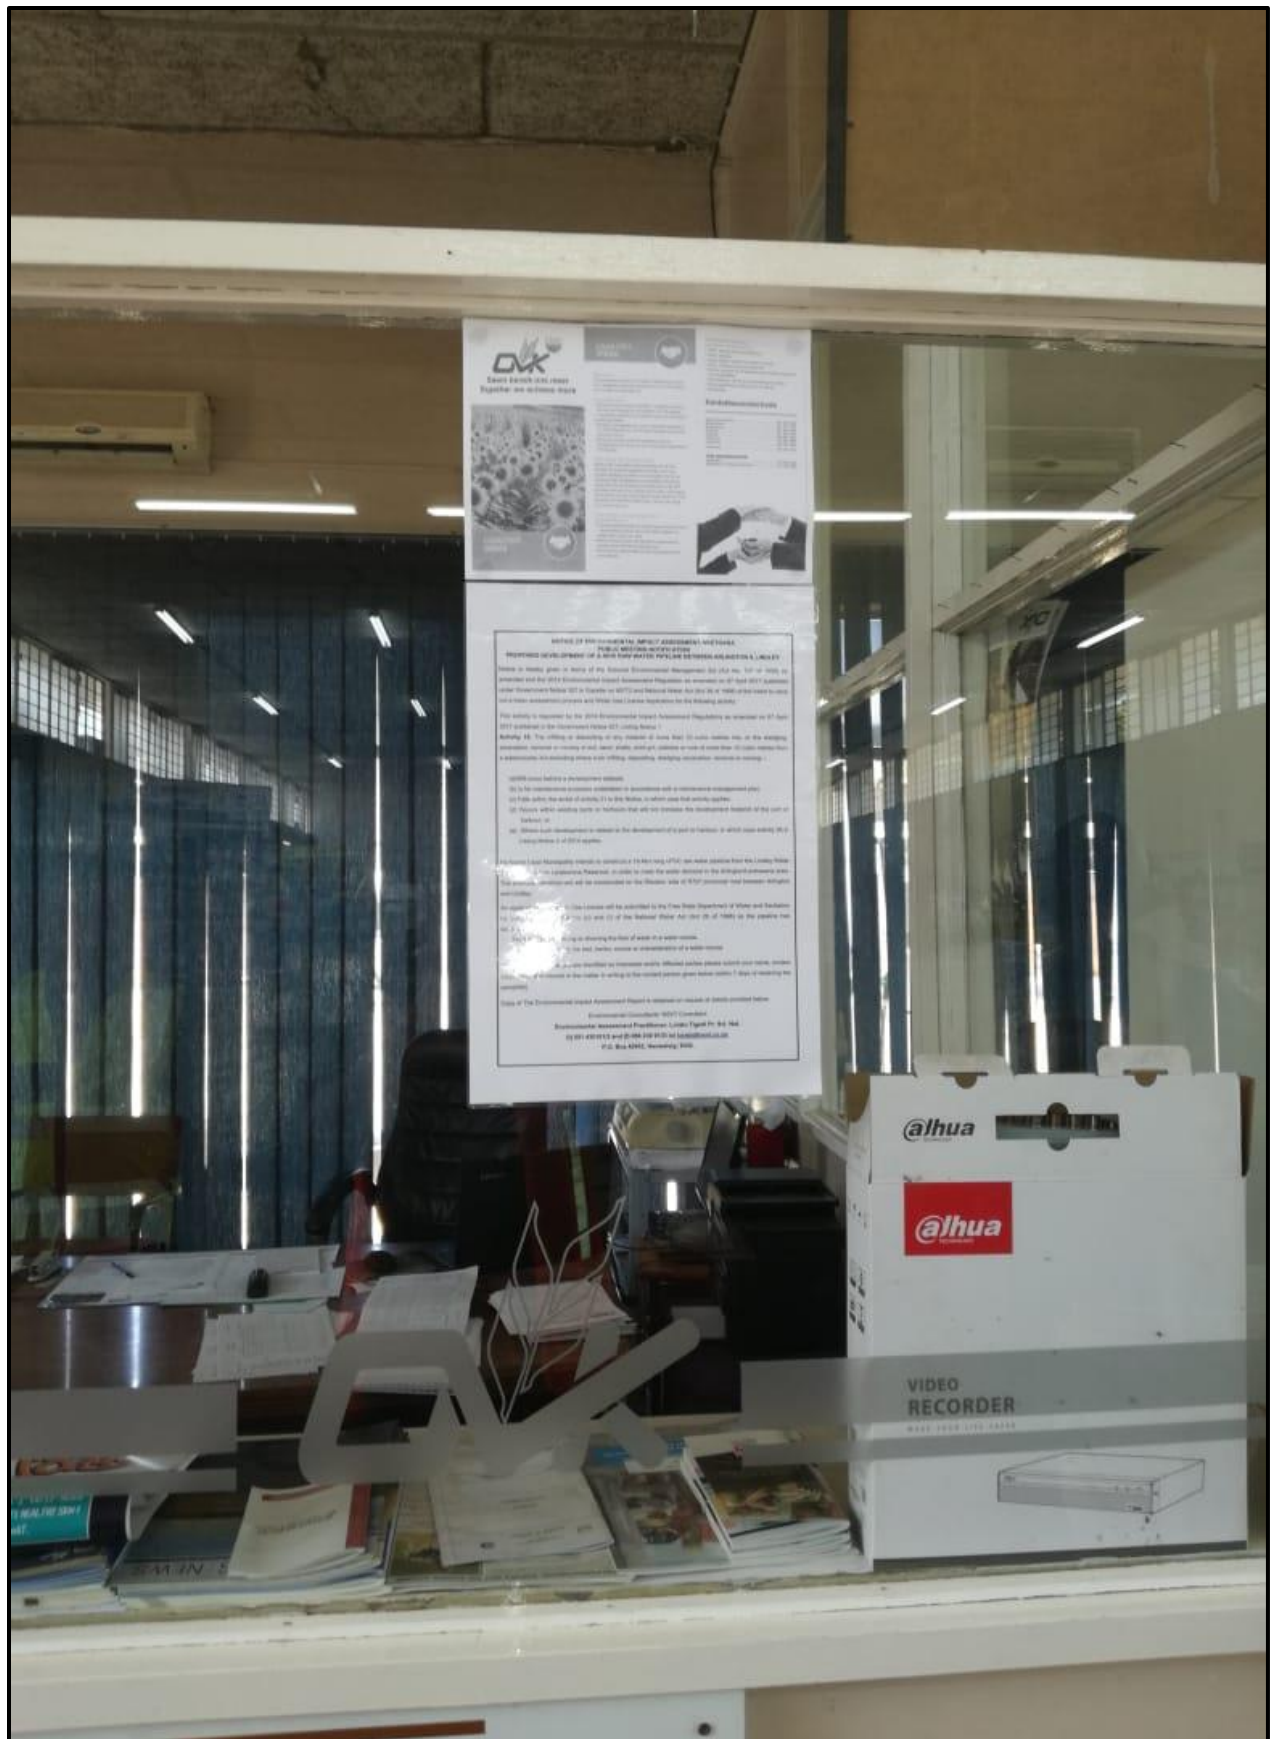


PHOTO 5: ON-SITE POSTER AT THE OVK

APPENDIX E2

PROOF OF RECEIVED NOTIFICATION(I&APs)

THERE IS NO PROOF OF RECEIVED NOTIFICATION ALTHOUGH EMAILS WERE SENT

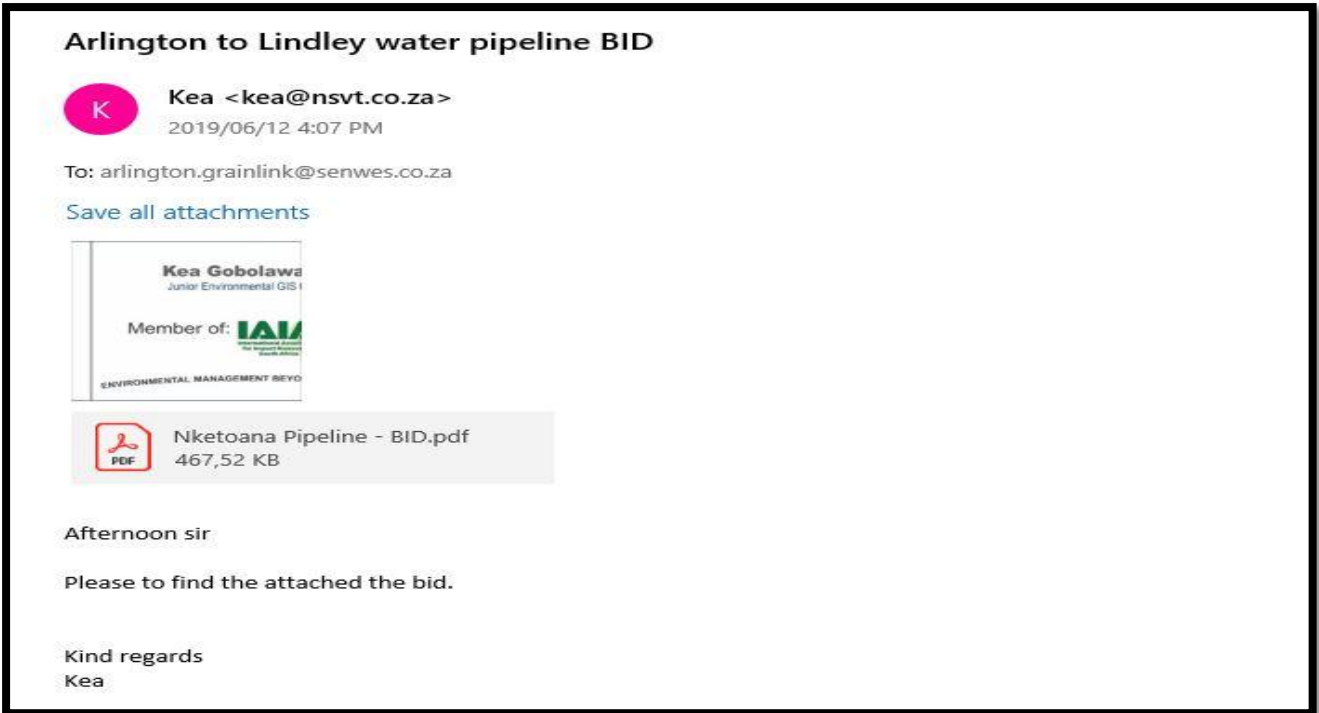


Photo 6- E-mail to SENWES

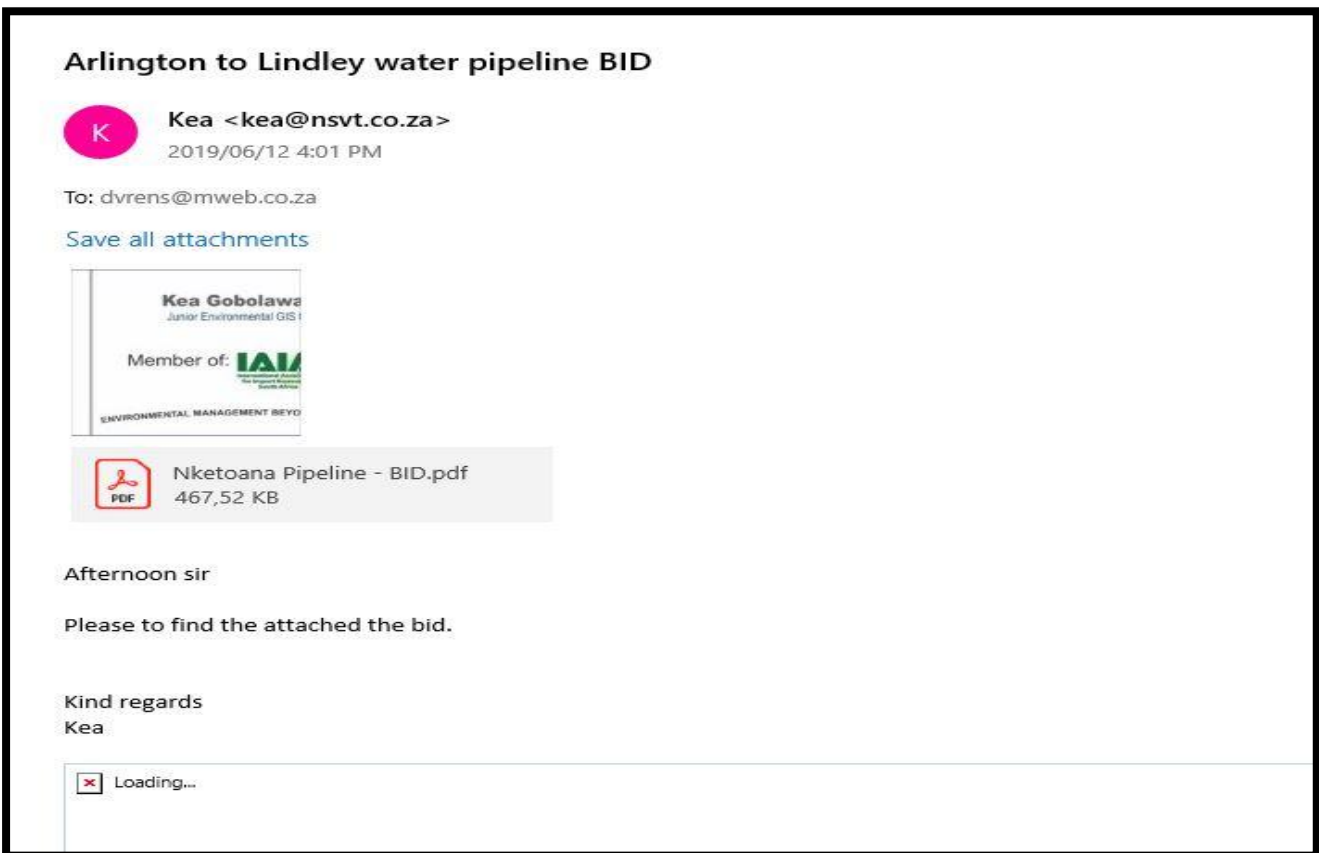


Photo 7- E-mail to Farmer/Landowner Mr Van Rens

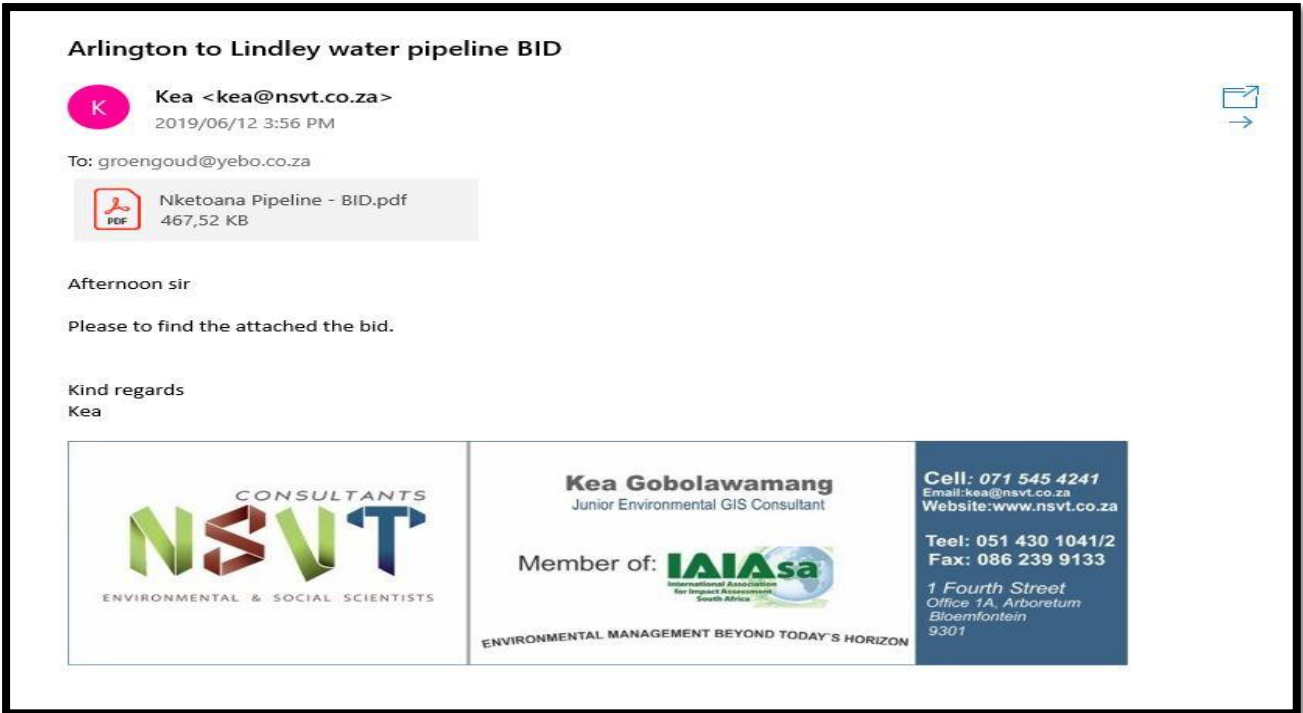


Photo 8 E-mail to a Farmer/ Landowner Mr Touder

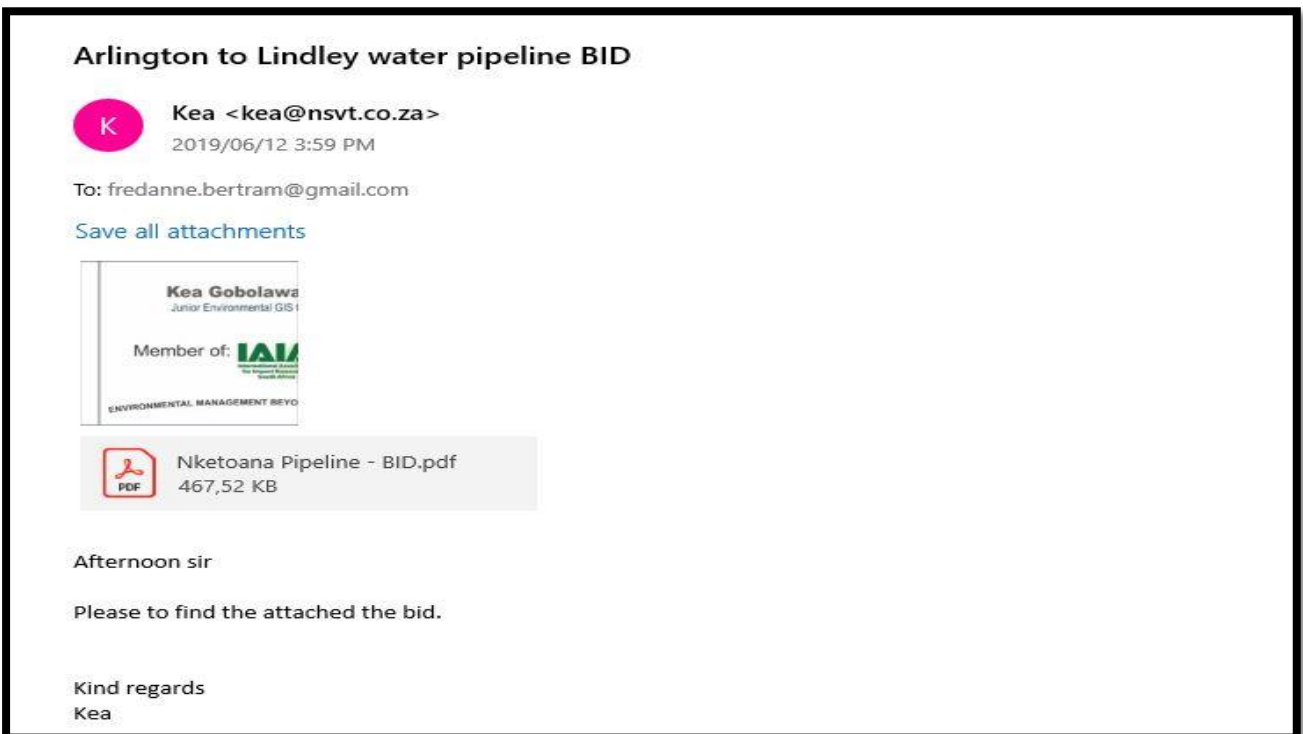


Photo 9 E-mail to Farmer/Landowner Mr Bertram

RE: Register as I&AP



Kea <kea@nsvt.co.za>
2019/03/14 2:19 PM

To: Marelie Botha; rebolang@nsvt.co.za

[Save all attachments](#)



Leratswana Pipeline.kml
4,11 KB



Nketoana Pipeline - BID.pdf
467,52 KB

Afternoon Marelie

Please find the attached files. May i kindly ask which property are located at/ the farm name?

Kind regards
Kea



Kea Gobolawamang
Junior Environmental GIS Consultant



ENVIRONMENTAL MANAGEMENT BEYOND TODAY'S HORIZON

Cell: 071 545 4241
Email: kea@nsvt.co.za
Website: www.nsvt.co.za

Teel: 051 430 1041/2
Fax: 086 239 9133

1 Fourth Street
Office 1A, Arboretum
Bloemfontein
9301

Photo 10 E-mail to Farmer/Landowner- MS Botha

APPENDIX E3
COMMENTS AND RESPONSES
REPORT

**PROPOSED DEVELOPMENT OF A 19.4KM BULK
WATER PIPELINE FROM LINDLEY TO LERATSWANA
RESERVOIR**

COMMENTS AND RESPONSES REPORT

JUNE 2019

**PROPOSED 19.4KM BULK WATER PIPELINE FROM LINDLEY TO LERATSWANA RESERVOIR
COMMENTS AND RESPONSES REPORT**

DOCUMENT INFORMATION

REPORT TITLE: Comments and Responses Report

REPORT STATUS: Draft

PROJECT TITLE: Proposed 19.4 km bulk water pipeline from Lindley to Leratswana Reservoir

DESTEA REFERENCE NUMBER:

APPLICANT: Nketoana Local Municipality

ENVIRONMENTAL CONSULTANTS: NSVT Consultants

COMPILED BY: Keagalaletsa Gobolawamang

JUNE 2019

TABLE OF CONTENTS

1. INTRODUCTION.....	1
2. COMMENTS AND RESPONSES TRAIL	2

LIST OF TABLES

TABLE 1: COMMENTS AND RESPONSES TRAIL	2
---	---

1. INTRODUCTION

A comprehensive public participation process was conducted by NSVT Consultants as part of the Basic Assessment Process. A full record of the measures undertaken during the public participation process is contained in **Appendix E** of the Draft BAR and the comments/input and/or issues raised are contained in *Table 1* herein including the response by the EAP and Applicant.

2. COMMENTS AND RESPONSES TRAIL

The comments and responses trail are tabulated in *Table 1* below.

TABLE 1: COMMENTS AND RESPONSES TRAIL

NEWSPAPER ADVERTISEMENT, ON SITE NOTICE AND POSTERS (DATE)		
NAME	QUESTIONS/COMMENTS	RESPONSE
	No Comments received	
BACKGROUND INFORMATION DOCUMENT		
NAME	QUESTIONS/COMMENTS	RESPONSE
Willie Naude	Further information will be required as the extend of the pipeline determines the position of the pipeline as not to affect the future upgrades on R707.	The draft BAR will be circulated with environmental assessments and technical aspects covered by the engineer.
Marelie Botha	Request to register as I and APs	Noted.
Mothobi Martins	Acknowledge the receipt.	Noted
George Nel	Request to register as I and APs	Noted
CONSULTATION WITH DIRECTLY AFFECTED FARMERS/LANDOWNERS		
NAME	QUESTIONS/COMMENTS	RESPONSE
Mr F.Bertram	Who will put back the fence when the project is complete?	Yes, once the project is complete the contractor has the responsibility to rehabilitate and leave the area as it was found.
Mr Van Rensburg	How deep will the water pipeline will be embedded?	The pipe will be buried in a 1.5 m deep.
COMMENTS ON THE DRAFT BAR		

**PROPOSED 19.4KM BULK WATER PIPELINE FROM LINDLEY TO LERATSWANA RESERVOIR
COMMENTS AND RESPONSES REPORT**

NAME	QUESTIONS/COMMENTS	RESPONSE
	Await Comments (30 Days PPP)	

APPENDIX E4

PROOF OF RECEIVED NOTIFICATION (STAKEHOLDERS)

NO PROOF OF RECEIVED NOTIFICATION ALTHOUGH EMAILS WERE SENT

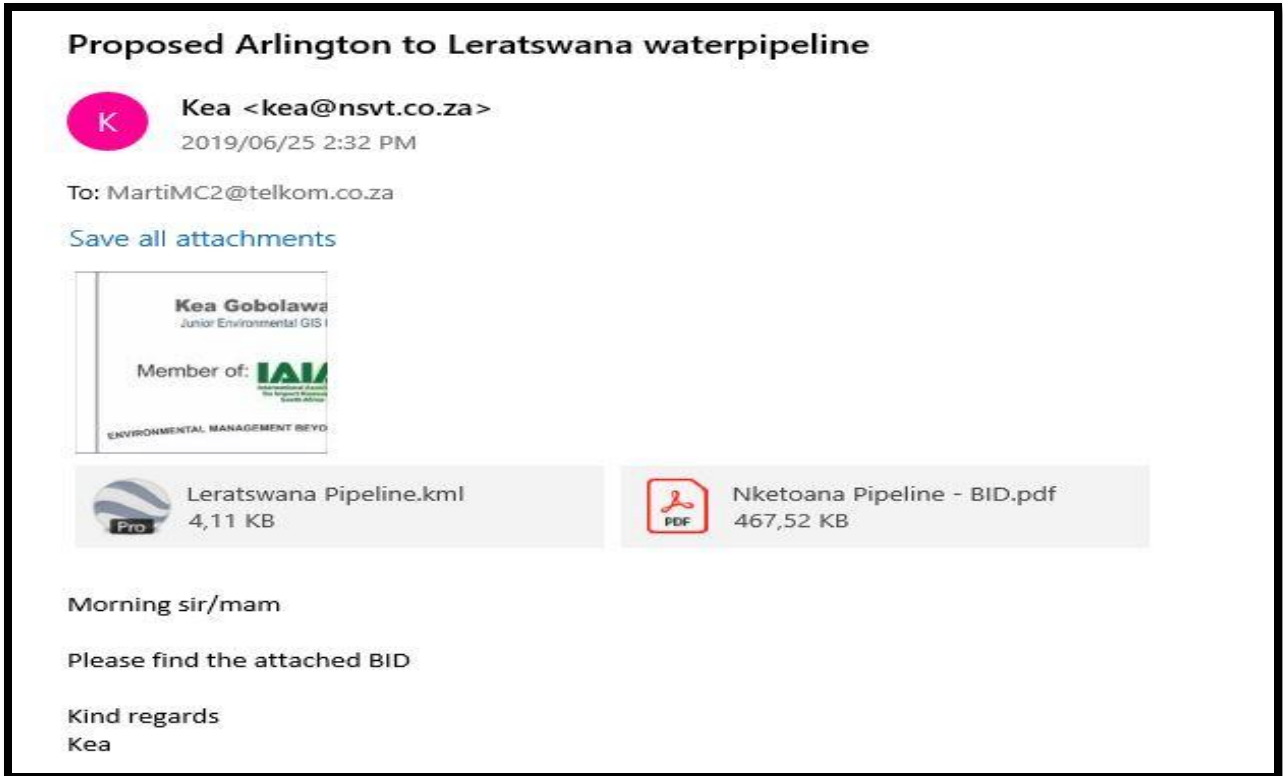


Figure 3 E-mail sent to Telkom- Mr Mothobi

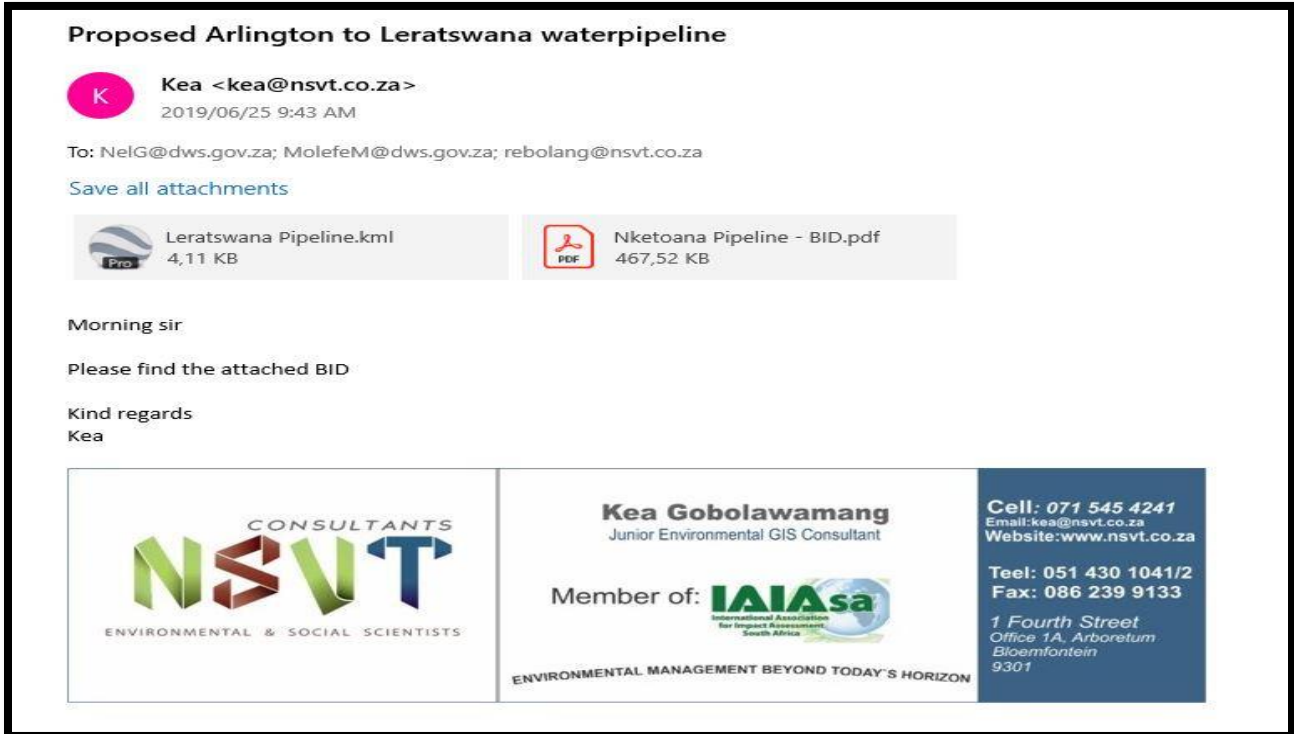


Figure 4 E-mail sent to Department of Water and Sanitation-Mr Nel

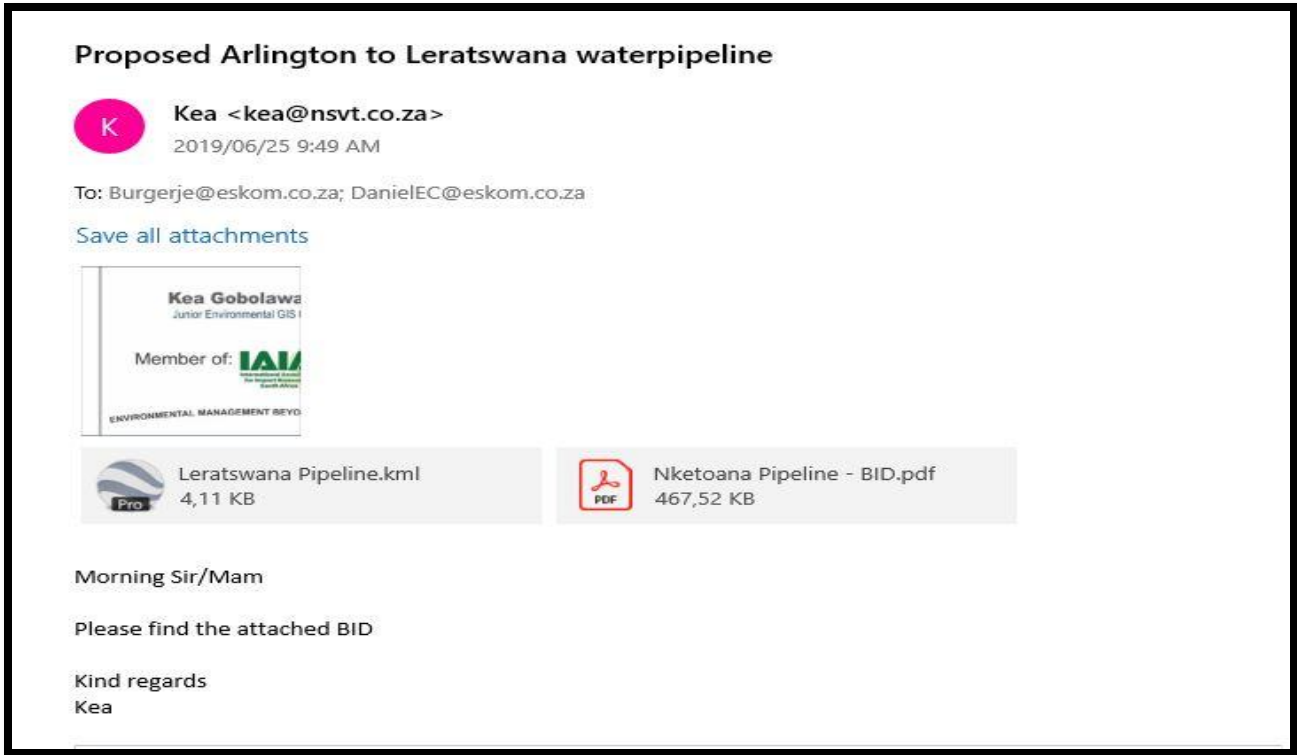


Figure 5 Email sent to Eskom- Ms Burger

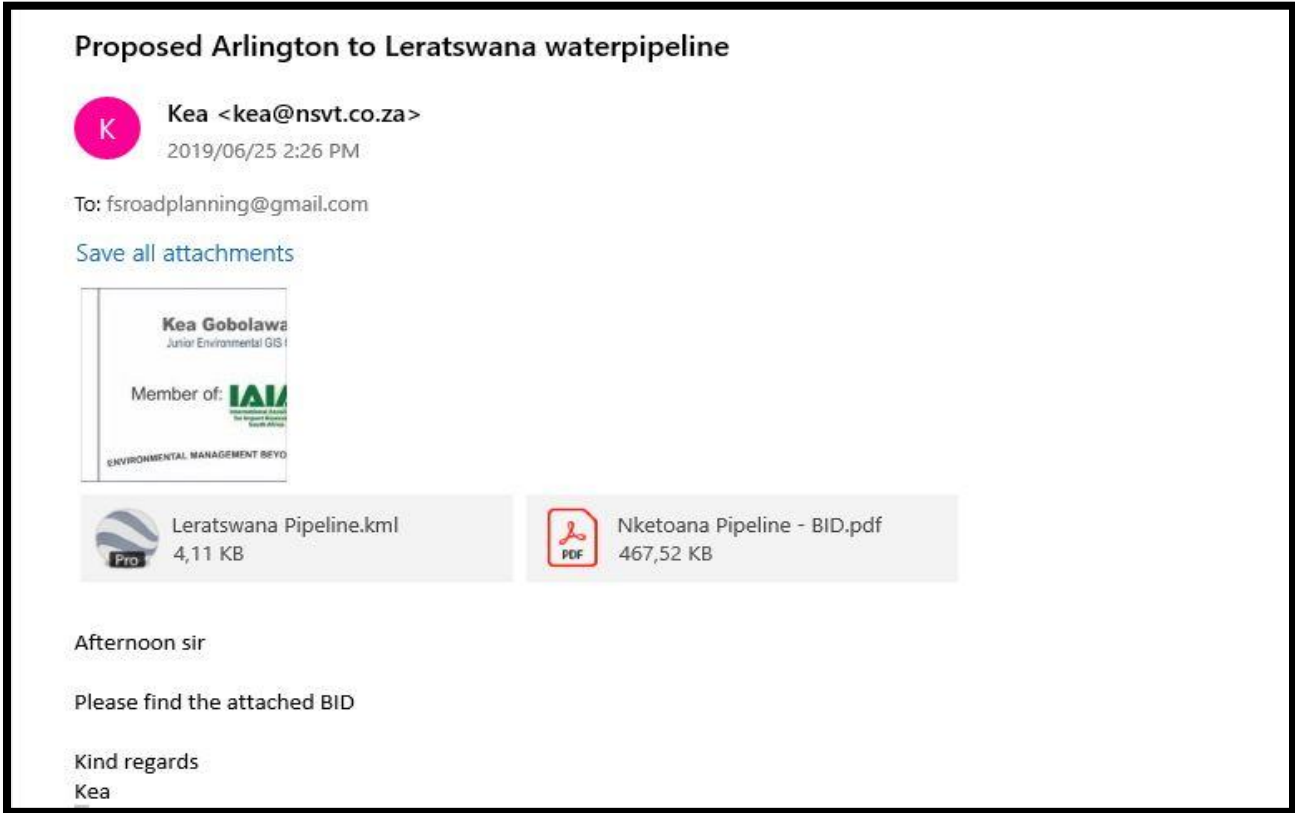


Figure 6 E-mail to Department of Roads and Transport- Mr Naude

Proposed Arlington to Leratswana waterpipeline



Kea <kea@nsvt.co.za>

2019/06/25 2:30 PM

To: tndumo@agric.fs.gov.za

[Save all attachments](#)



Leratswana Pipeline.kml
4,11 KB



Nketoana Pipeline - BID.pdf
467,52 KB

Morning sir/ mam

Please find the attached BID

Kind regards

Figure 7 E-mail to Department of Agriculture- Mr Ndumo

APPENDIX E5

LIST OF REGISTERED I&APs

PROJECT: PROPOSED 19.4KM BULK WATER PIPELINE FROM LINDLEY TO LERATSWANA RESERVOIR

LIST OF INTERESTED AND AFFECTED PARTIES DATABASE

NAME/ INITIAL	SURNAME	ORGANISATION/ DEPARTMENT/ INTEREST	CONTACT DETAILS
George	Nel	Department of Water and Sanitation	051 405 9000
Mothobi	Martins	Telkom	051 861 8747
Mr F	Bertram	Landowner/Farmer	082 920 1953
Willie	Naude	Department of Roads and Transport	082 0599 707
Mr	Van Rens	Landowner/Farmer	082 780 7784
Marelle	Botha	Landowner/Farmer	082 493 5166
Gerhard	Nel	Senwes	079 5999 713
Mr J	Touder	Landowner/Farmer	082 496 2557

Compiled by: K.G. Gobolawamang
Contact Details: 051 430 1041/2

APPENDIX E6
COPIES OF ANY
CORRESPONDENCE AND
MINUTES

PROPOSED BULK WATER PIPELINE FROM LINDLEY TO LERATSWANA RESERVOIR

FOCUS GROUP MINUTES MEETING

WHEN:	11 June 2019
WHERE:	Mr. Van Rensburg's Office-Arlington
TIME:	15h30
MINUTES PREPARED BY:	Lorato Tigedi <i>Pr. Sci. Nat.</i>

1. **WELCOMING** by Dirk Van Rensburg
2. **INTRODUCTIONS**-All
3. **CIRCULATION OF ATTENDANCE REGISTER** attached as **Annexure 1**. However, we had to visit Senwes to give to obtain details of the contact person so that we can send the Background Information Document and we requested Gerhard Nel to sign the attendance register as proof of receiving the consent information.
4. **APOLOGIES**: Councillor Nhlapo, Councillor Mofokeng, Mr. Hennie Botha and Mr. Ferreira
5. **PRESENTATION BY EAP**: Lorato Tigedi-NSVT Consultants
 1. The purpose of the consultation with the affected landowners is regarding the proposed bulk water pipeline from Lindley Water Treatment Plant to the reservoir in Leratswana is to provide more information about the project and obtain consent. The map showing the proposed pipeline was shown to the attendees.
 2. Lindley treatment plant has adequate capacity to supply Leratswana, hence Nketoana Local Municipality propose construction of the pipeline to augment water supply services for the Leratswana/Arlington area.
 3. NSVT Consultants are appointed as independent Environmental Assessment Practitioners to undertake the Basic Assessment Process and Water Use License Application process as there are rivers between Lindley and Arlington, and RTT Consulting are the consulting engineers responsible for the design of the pipeline.
 4. The Basic Assessment Process will take 197 days and specialists studies undertaken as part of the process is the Ecological and Heritage studies.
 5. The Draft Basic Assessment Report will be sent for a 30 days review period, thereafter comments received will be incorporated in the final report, which will be submitted to DESTEA for review and decision-making.

6. QUESTIONS AND ANSWERS

NAME	QUESTIONS/COMMENTS	RESPONSE
Mr. Van Rensburg	Will we be able to connect to the pipeline as we need water for our livestock?	We will direct your question to the Consulting Engineers and Municipality to respond but it was indicated that there will be connections to supply water to the farm workers.
Mr. Van Tonder	What is the width and depth of the pipeline?	The diameter of the pipeline is 250mm and the average depth will be 1500mm, but it will vary depending on the type of soil and the area of excavation with a 900mm width.
	Will we be able to plant after the pipe is laid?	Yes, planting will be possible after the pipe has been laid.
Mr. Bertram	Will they fix the damaged fences?	Yes, all the fences that are removed for accessibility and construction activities will be repaired before the contractor leaves the site.

7. WAY FORWARD

NSVT provided the landowners with consent and a form that needs to be and completed then emailed back to the EAP. A Background Information Document will also be sent so that the information can be shared with other affected farmers who couldn't attend the meeting. The request for water connections to the proposed pipeline for livestock will be escalated to the consulting engineers and Nketoana Local Municipality. Mr. Van Rensburg will send the information to the farmers, who couldn't make it.

8. MEETING ADJOURNED AT 16H00

ANNEXURE 1

ATTENDANCE REGISTER



ENVIRONMENTAL & SOCIAL SCIENTISTS

ATTENDANCE REGISTER

FOR

MEETING HELD ON THE 11/06/19
PUBLIC PARTICIPATION MEETING:

Name	Organisation/ Company/ Department	Tel. & Fax No.	E-mail	Signature
JUAN TONDS	Green Gold (Pty) Ltd	0826962557	greengold@yepo.co.za	
F. Bertram	Pauc. Water Bd	0214201953	frédanne.bertram@gmail.com	
D. van Rensburg	Pauc. Water Bd	0827807780	d.v.rens@pauc.co.za	
Malefetsane Mkwana	Nkomo Municipality	0732329229	malefetsane8@gmail.com	
Gerhard Nel	Senwes	0765999713	curlington.grainlink@senwes.co.za	
Reagabetsa Gokhwaning	NSVT Env Consultants	051 430 1042	Rea@nsvt.co.za	
LORATO TIGRAY	NSVT	051 430 1042	lorato@nsvt.co.za	

ANNEXURE 2

PHOTOGRAPHIC HISTORY

