

NOTICE OF BASIC ASSESSMENT AND WATER USE LICENCE PROCESSES

PUBLIC PARTICIPATION PROCESS

NEW 132/11kV OLIFANTSHOEK SUBSTATION AND POWER LINE, NORTHERN CAPE PROVINCE

Project Name: Olifantshoek Substation and Power line, Northern Cape Province

Applicant: Eskom Holdings SOC Limited

Proposed Activity: This project will consist of the following activities and infrastructure:

- » Construction and Operation of the new 10MVA Olifantshoek 132/11kV substation (approximately 100m x 100m) and Ancillaries (including a metering station, control building, admin building, workshop and associated infrastructure).
- » The construction of a new 132kV double circuit loop-in-loop-out (LILO) overhead power line (31km long in a 32m wide servitude) from the new Olifantshoek Substation to the Emil Switching Station, and Ancillaries (including access tracks/roads, laydown areas, operational and maintenance facilities).
- » Decommissioning of the existing 22/11kV 2.5MVA Olifantshoek Substation including all site rehabilitation and preservation.

Location: There are a number of farm properties affected by the development including: Lanham 539, Fritz 540, Wright 538, Bredenkamp 567, Brooks 568, Beaumont 569, Murray II 570, Cox 571, Hartley 573, Neylan 766, Neylan 574. The project site is located within both the Gamagara Local Municipality of the John Taolo Gaetsewe district area, and the Tatsebane Local Municipality of the ZF Mgcauw district area.

Basic Assessment Process: In terms of sections 24 and 24D of the National Environmental Management Act (No 107 of 1998), as read with the EIA Regulations of GN R982, GN R983 and R985, a Basic Assessment process will be required for the project.

Public Involvement Process: Savannah Environmental is undertaking the required environmental assessment and public participation process. To obtain further information and register on the project database, please submit your name, contact information and interest in the project, in writing, to Savannah Environmental:

Gabriele Wood of Savannah Environmental

Post: PO Box 148, Sunninghill, 2157 Johannesburg
Tel: 011 656 3237
Fax: 086 684 0547
Email: gabriele@savannahsa.com
www.savannahsa.com



KENNISGEWING VAN BASIESE EVALUERINGS- EN WATERGEBRUIKLISENSIEPROSES

OPENBARE DEELNAMEPROSES

NUWE 132/11 kV OLIFANTSHOEK SUBSTASIE EN KRAGLYN, NOORD-KAAPROVINSIE

Projeknaam: Olifantshoek Substasie en Kraglyn, Noord-Kaapprovinsie

Applikant: Eskom Beherend MSB Beperk

Beoogde Aktiwiteit: Hierdie projek sal uit die volgende aktiwiteite en infrastruktuur bestaan:

- » Die oprigting en bedryf van die nuwe 10 MVA Olifantshoek 132/11 kV Substasie (sowat 100 m x 100 m) en bybehorende uitrusting (insluitend 'n meetstasie, beheergebou, admingebou, werkswinkel en gepaardgaande infrastruktuur).
- » Die oprigting van 'n nuwe 132 kV dubbelkring inlus-uitlus (LILO) oorhoofse kraglyn (oor 31 km in 'n serwituutwydte van 32 m) vanaf die nuwe Olifantshoek Substasie tot by die Emil Skakelstasie, en bybehorende uitrusting (insluitend toegangspaadjies/paaië, neerleggingsgebiede, bedryfs- en instandhoudingsaanlegte).
- » Die uitbedryfstelling van die bestaande 22/11 kV 2,5 MVA Olifantshoek Substasie, insluitend alle terreinrehabilitasies en -bewing.

Ligging: 'n Aantal plaasgedeeltes word deur die ontwikkeling geraak, insluitend: Lanham 539, Fritz 540, Wright 538, Bredenkamp 567, Brooks 568, Beaumont 569, Murray II 570, Cox 571, Hartley 573, Neylan 766 en Neylan 574. Die projekterrein is in beide die Gamagara Plaaslike Munisipaliteit van die John Taolo Gaetsewe distriksgebied sowel as in die Tatsebane Plaaslike Munisipaliteit van die ZF Mgcauw distriksgebied.

Basiese Evalueringsproses: Ingevolge Artikel 24 en 24D van die Nasionale Wet op Omgewingsbestuur (Wet 107 van 1998), saamgelees met die OIE-regulasies van Staatskennisgewing R982, R983 en R985, sal 'n Basiese Evalueringsproses vir die projek benodig word.

Openbare Deelnameproses: Savannah Environmental onderneem die nodige omgewingsevaluering en openbare deelnameproses. Ten einde meer inligting te bekom en om op die projek se databasis te registreer, verstrek asseblief u naam, kontakbesonderhede en belang by die projek skriftelik aan Savannah Environmental:

Gabriele Wood van **Savannah Environmental**

Posadres: Posbus 148, Sunninghill, 2157 Johannesburg

Tel: 011 656 3237

Faks: 086 684 0547

E-pos: gabriele@savannahsa.com

www.savannahsa.com

savannah
environmental

Site Notices Placed at the Existing Olifantshoek Substation

27°56'10.13"S and 22°44'23.59"E



Site Notices Placed at the Existing Olifantshoek Substation

27°56'10.13"S and 22°44'23.59"E




Site Notices Placed at the Existing Olifantshoek Substation

27°56'9.34"S and 22°44'21.96"E



Site Notices Placed at the Emil Switching Station

27°44'10.28"S and 22°55'12.22"E

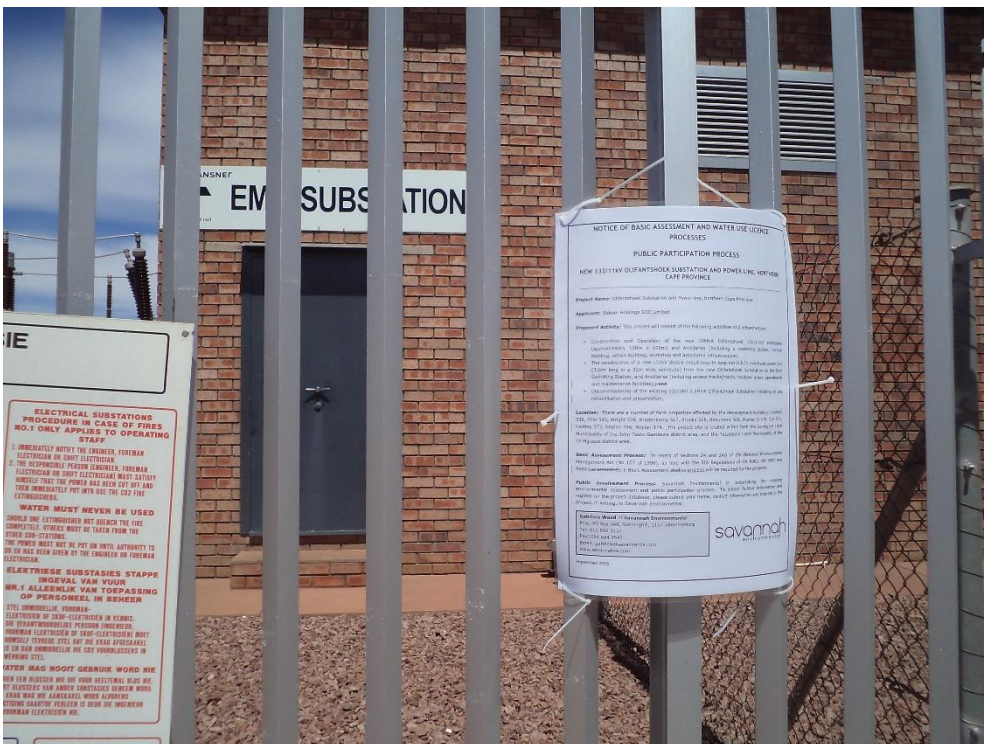

Site Notices Placed at the Emil Switching Station

27°44'10.28"S and 22°55'12.22"E



NOTICE OF BASIC ASSESSMENT AND WATER USE LICENCE PROCESSES

PUBLIC PARTICIPATION PROCESS

132/11kV OLIFANTSHOEK SUBSTATION AND POWER LINE, NORTHERN CAPE PROVINCE

Project Name: Olifantshoek Substation and Power line, Northern Cape Province

Applicant: Eskom Holdings SOC Limited

Proposed Activity: This project will consist of the following activities and infrastructure:

- » The new 10MVA Olifantshoek 132/11kV substation (approximately 100m x 100m in extent) and ancillaries (including a metering station, control building, admin building, workshop and associated infrastructure).
- » The construction of a new 132kV single circuit overhead power line (31km long within a 32m wide servitude) from the new Olifantshoek Substation to the Emil Switching Station, and ancillaries (including access tracks/roads, laydown areas, operational and maintenance facilities).
- » Decommissioning of the existing 22/11kV 2.5MVA Olifantshoek Substation including all site rehabilitation and preservation.

Location: There are a number of farm properties affected by the development including: Lanham 539, Fritz 540, Wright 538, Bredenkamp 567, Brooks 568, Beaumont 569, Murray II 570, Cox 571, Hartley 573, Neylan 766, Neylan 574. The project site is located within Ward 3, 4 and 5 of the Gamagara Local Municipality in the John Taolo Gaetsewe district area.

Basic Assessment and Water Use License Application Process: In terms of sections 24 and 24D of the National Environmental Management Act (No 107 of 1998), as read with the amended EIA Regulations of GN R327, GN R325 and R324, a Basic Assessment process is being undertaken for the project. In terms of the National Water Act (Act No 36 of 1998), a Water Use License is required for watercourse crossings along the power line route.

DRAFT BASIC ASSESSMENT REPORT AVAILABLE FOR REVIEW

The report has been made available from **30 May 2017 – 30 June 2017** at the following location:

- » Olifantshoek Public Library, Van Riebeeck Street, Olifantshoek
- » www.savannahSA.com

To obtain further information and register on the project database, please submit your name, contact information and interest in the project, in writing, to Savannah Environmental:

Gabriele Stein of Savannah Environmental
Post: PO Box 148, Sunninghill, 2157 Johannesburg
Tel: 011 656 3237
Fax: 086 684 0547
Email: gabriele@savannahsa.com
www.savannahsa.com

savannah
environmental