

**Appendix F6**  
**Comments Recieved**

The bottom of the page features a decorative graphic consisting of several overlapping geometric shapes. On the left, a red triangle points downwards. A large grey trapezoidal shape overlaps this and extends towards the center. On the right, a light grey trapezoidal shape overlaps the grey one. At the bottom right, a red triangle points upwards, overlapping the light grey shape.

## Nicolene Venter

---

**From:** Savannah Public Process  
**Sent:** Wednesday, 13 July 2022 06:52  
**To:** Ria Barkhuizen (NR)  
**Subject:** RE: SE3406: PROJECT ANNOUNCEMENT FOR THE VAAL RIVER SOLAR PV FACILITIES, SUBSTATION AND 132kV POWER, NEAR ORKNEY NORTH WEST PROVINCE  
**Attachments:** 15. Appendix H - Maps.pdf; VRS 1- Original EA and Amended EAS.pdf

Good day,

Please find attached the maps as requested and the original application form which should have the coordinates too.

Should you require anything else please let us know.

Kind regards,



t: +27 (0)11 656 3237  
f: +27 (0) 86 684 0547

### Nondumiso Bulunga

Lead Consultant: Social, Stakeholder  
Engagement & GIS

e: [nondumiso@savannahsa.com](mailto:nondumiso@savannahsa.com)  
c: +27 (0) 79 458 0862

SAWEA Award for Leading Environmental Consultant on Wind Projects in 2013 & 2015

#### Processing of personal information / POPIA compliance

We respect your privacy and acknowledge that this e-mail will contain Personal Information, which may belong to you, others and/or to your organization and which we will process. The processing of your personal information by Savannah Environmental may be included in reports submitted to governmental departments or on our public platforms, which processing will be done in accordance with our processing notice housed on our website - <https://savannahsa.com/privacy-policy-privacy-policy-page/>. By sending and/or receiving this message, you hereby consent to the lawful processing of personal information for the intended purposes, as described by the Protection of Personal Information Act, 2013 (Act No 4 of 2013).

This email has been scanned for viruses and malware, and automatically archived by **Mimecast SA (Pty) Ltd**, and is believed to be clean.

---

**From:** Ria Barkhuizen (NR) <[Barkhuizenr@nra.co.za](mailto:Barkhuizenr@nra.co.za)>  
**Sent:** Tuesday, 12 July 2022 07:38  
**To:** Savannah Public Process <[publicprocess@savannahsa.com](mailto:publicprocess@savannahsa.com)>  
**Subject:** RE: SE3406: PROJECT ANNOUNCEMENT FOR THE VAAL RIVER SOLAR PV FACILITIES, SUBSTATION AND 132kV POWER, NEAR ORKNEY NORTH WEST PROVINCE  
**Importance:** High

Good day

Please supply SANRAL with an A4 locality map as well as GPS co-ordinates for your application.

Please send requested information together with whole application to [nrstat@nra.co.za](mailto:nrstat@nra.co.za) as this email will be deleted as it is incomplete.

Kind regards

Ria



## public works & roads

Department:  
Public Works and Roads  
North West Provincial Government  
**REPUBLIC OF SOUTH AFRICA**

Modiri Molema Road  
Old Parliament Complex  
Mmabatho, 2735  
Private Bag X 2080, Mmabatho,

### CHIEF DIRECTORATE: TRANSPORT INFRASTRUCTURE

Tel.: +27 (18) 388 1398  
Email: [Sitase@nwp.gov.za](mailto:Sitase@nwp.gov.za)  
Enq: K A Sitase

### DIRECTORATE: PLANNING AND DESIGN

Ref: R33\_11-1-1-3-1\_SE3406\_Vaal River PV Facilities

#### SAVANNAH ENVIRONMENTAL (PTY) LTD

Savannah Environmental (Pty) Ltd

PO Box 148

Sunninghill

2157

For attention: **Nondumiso Bulunga**

**COMMENTS/ CONSENT IN TERMS OF ACT NO 21 OF 1940 AND ROADS ORDINANCE NO 22 OF 1957 AS AMENDED: NOTICE FOR THE DEVELOPMENT OF THE VAAL RIVIER SOLAR PHOTOVOLTAIC (PV) ENERGY FACILITIES, SUBSTATION AND 132 kV POWERLINE ON PORTIONS 3 OF FARM VAALKOP 439 IP, PORTION 200 OF THE FARM NOOITGEDACHT 434 IP, AND PORTION 4 OF THE FARM MODDERFONTEIN 441 IP, MATLOSANA LOCAL MUNICIPALITY, NORTH WEST PROVINCE**

**AFFECTED PROVINCIAL ROAD (S) :** P137/1\_030 (R502)

**MUNICIPALITY :** MATLOSANA LOCAL MUNICIPALITY

**TOWN/ TOWNSHIP/ FARM :** PTN 3-VAALKOM 439 IP, PTN 200-NOOITGEDACHT 434 IP, PTN 4-MODDERFONTEIN 441 IP

**REGISTRATION NUMBERS :** DFFEB NO 12/12/20/2513/1, 12/12/20/2513/2, 12/12/20/2513/3 AND 12/12/20/2513/4

**CLIENT(S)/ APPLICANT :** BUFFELSPOORT SOLAR PROJECT (PTY) LTD


Your communication dated **05 July 2022** has reference. This consent is issued in terms of the **Advertising on Roads and Ribbon Development Act No 21 of 1940** and **Roads Ordinance No 22 of 1957** as amended.

There is no objection to the proposed development, subject to the strict adherence of the attached **Specific and Special Conditions** and should form part of the proposed planning/ development, also that the conditions/requirements listed below are imposed and met in all respects by the applicant:



**NOTE :** A written confirmation of acceptance of the attached conditions is required. In the event of not receiving a written acceptance of conditions, the approval is withdrawn and this approval is cancelled.

Yours faithfully

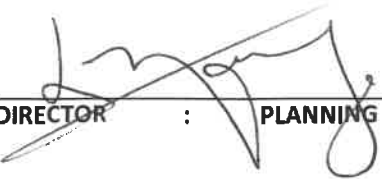  
\_\_\_\_\_  
DIRECTOR : PLANNING AND DESIGN

LA MAFUNE

20/07/2022  
\_\_\_\_\_  
DATE

cc. : Robert Logtenberg, Tel. No.076 501 0088/ 018-293 7660, Private Bag X 928, Potchefstroom, 2520; [RLogtenberg@nwpg.gov.za](mailto:RLogtenberg@nwpg.gov.za)

Attached : Locality Map\_SE3406\_Vaal River Solar PV Facilities, Substations and 132kV Powerline and Google\_SE3406\_Vaal River PV Facilities



## **A SPECIFIC AND SPECIAL CONDITIONS: PROPOSE ACCESS (ES)**

**NB :** This comments is granted in favour of **VAAL RIVIER SOLAR 1, 2 & 3 (PTY) LTD** and **KABI SOLAR (PTY) LTD** as stipulated in the application.

### **1. ILLEGAL/ INFORMAL ACCESS (ES)**

**1.1** If there is any existing informal access (es) to the Provincial Road **P137/1\_030 (R502)** in the radius of less than 650 m from the approved/ existing/ proposed access (es) will be illegal therefore should be closed along the affected Provincial road(s), and the traffic should be directed to the approved access (es).

**1.2** No additional access (es) will be allowed to Provincial Road(s) **P137/1\_030 (R502)** at all, without the written approval of the Controlling Authority (Department of Public Works and Roads).

### **2. ACCESS TO THE PROPOSED DEVELOPMENT**

The existing access(es) to the affected land i.e. **Locality Map\_SE3406\_Vaal River Solar PV Facilities, Substations and 132kV Powerline** will be used for the above-mentioned development(s).

No additional access (es) will be allowed to Provincial Road(s) **P137/1\_030 (R502)** at all, without the written approval of the Controlling Authority (Department of Public Works and Roads).

### **3 LINES OF NO ACCESS**

**3.1** No ingress to or egress from the existing Road(s) **P137/1\_030 (R502)** to the above-mentioned proposed development other than the one mentioned in **paragraph 2** will be allowed, without the written approval of the Controlling Authority (Department of Public Works and Roads).

### **4. ADDITIONAL STRUCTURES**

No structures will be allowed inside the road reserve of Road(s) **P137/1\_030 (R502)** without the written approval of the Controlling Authority (Provincial Department of Public Works and Roads)



## **B GENERAL/ CONDITIONS FOR PROPOSED DEVELOPMENT**

**NB** : This Comments is granted in favour of **VAAL RIVIER SOLAR 1, 2 & 3 (PTY) LTD** and **KABI SOLAR (PTY) LTD** as stipulated in the application.

### **5 MINIMUM REQUIREMENTS OF JUNCTION(S) ON A PROVINCIAL ROAD(S)**

**5.1** The minimum requirements of Intersection on a Provincial Road, as illustrated by the attached Typical Plan No: **NWP 3/6** for standard accesses on provincial roads.

**5.2** **Layout plans** – Tapers, Acceleration and Deceleration Lanes, are a must for any access. A separate **Left-turn lane(s)**, with a **Slip-Lane(s)**, and dedicated **Right-Turning Lane(s)** from both directions shall be provided if more than **250 vehicles per hour** in any hour of a day are turning left out of the main road, as illustrated by the attached Typical Plan No: **Typical Plan\_NWP 3-4**, (*but less than 250 vehicles per hour* then Typical Plan No: **Typical Plan\_NWP 3-3** is applicable) for standard accesses on provincial roads.

**Note:** Should the need arise, the applicant shall build the above-mentioned development at own cost under the supervision of a Professional Civil Engineer to the satisfaction of the **Deputy Director General: Department of Public Works and Roads**

**5.3** Provision must be made for **15 x 45 m** road reserve splays or as determined by the Director-Roads/ Engineer. These road reserve splays must be fenced by the applicant/owner at his/her cost.

**Note:** The longest distance is measured parallel to the main road. Attached please find Typical Plans: **NWP 5-1** indicating the required road reserve splays and relevant type of access.

### **6. BUILDING LINE**

The above mentioned Provincial Road(s), have a **95m Standard Building Line**.

**6.1** Building restriction areas in compliance with the requirements of Executive Committee Resolution 1112 of 26 June 1978 is as per paragraph 4.1 (Road Ordinance): The **standard building line** applicable is **95 m** measured from the centre of these roads.



## 6.2 ROAD RESERVE WIDTHS OF THE AFFECTED PROVINCIAL ROADS

Provision must be made for the following road reserves/ streets and must be excluded from the proposed development:

- i) Road P137/1\_030 (R502) with the road reserve width of about 48 m

## 6.3 BUILDING LINE RELAXATION

The *Department of Public Works and Roads (DPWR)* is hereby grant the **minimum relaxation of the building line** from the **Standard 95m** as stated by **Clause 4: Standard Building Line** above as follows.

Also see the attached *Sketch Plans Road Reserve Widths*.

- i. **Road Reserve Width of 48 m** : The Building Line Relaxation is **45 m** from the centre of the Road Reserve; *(i.e. 29 m from road reserve boundary)*.

## 7. ABNORMAL TRUCKS/ EQUIPMENTS

Department of Public Works and Roads should also be notified with any of the intention of transporting abnormal trucks/ equipments on any of the above stated provincial road(s).

## 8. BLASTING/ EXPLOSIVE OF ROCKS

Any unstable conditions encountered or any rock requiring blasting to be reported directly and immediately to the *Departmental Roads Engineer/ Manager*.

Blasting to be done in accordance with the current applicable Explosives Regulations (e.g. Act No 26 of 1956) and possible damage to the road must be excluded as far as possible.

Any damage to the road caused by unstable soil conditions (subsidence, etc.) or blasting must be repaired to the satisfaction of the: *Departmental Roads Engineer/ Manager*.



## 9. DAMAGED/ REMOVAL OF PROPERTIES

No trees, shrubs, cultivated grass, gates or road fencing must be removed or damaged within the Road Reserve of the affected(s). If such plants or fenced were removed or damaged you will have to replace it to the entire satisfaction of the *Departmental Roads Engineer/ Manager*.

## 10. NOTIFICATION TO THE DEPARTMENT: WAYLEAVE APPLICATIONS

Based on the above-mentioned provincial road(s), the department should be notified (with appropriate detailed plans) about any intention or planning and before the commencement of the following: -

- Change of Land Utilisation (*e.g. From Agriculture to Business/ Settlements, etc*).
- Construction of any structures (*e.g. Buildings*) along the affected road(s).
- Construction of Permanent or Temporary Access (es) from the said provincial road(s).
- Erection and or construction of Overhead and or Underground Services (*e.g. Water & Sewerage pipe lines, Electrical and Telephone Cable Lines*) across or parallel to the affected road(s).
- Closing and or Deviation of part or section(s) of the above stated provincial road(s).
- Advertisement along the affected road(s).
- Working inside the road reserves of any of the affected road(s).
- Temporary or Permanent Closure of Traffic on either of the above stated provincial road(s).

## 11. GEOMETRIC DESIGN AND SPECIFICATIONS OF THE NEW ACCESS

**11.1** For the construction of the access (es) the applicant (whoever is responsible for the construction thereof) shall submit to the Deputy Director General: Department of Public Works and Roads, for his approval, a geometric layout plan(s) to a scale of 1: 500, prepared and signed by a Professional Civil Engineer.

**11.2** For the construction of the access (es) the applicant (whoever is responsible for the construction thereof) shall submit to the Deputy Director General: Department of Public Works and Roads, for his approval, a specifications, for the building thereof.





## **12. RESPONSIBILITY OF THE CONSTRUCTION OF THE ACCESS**

- 12.1** After the plans and specifications stated in paragraph **11.1** and **11.2** above, have been approved by the Deputy Director General: Department of Public Works and Roads, the applicant shall build the access(es) **at own cost** under the supervision of a Professional Civil Engineer to the satisfaction of the Deputy Director General: Department of Public Works and Roads.
- 12.2** On completion of the work, the Professional Civil Engineer shall certify, that work has been carried out in accordance with the approved plan(s) and specifications.
- 12.3** The certificate of completion shall be handed over to the Deputy Director General: Department of Public Works and Roads, with the copy to the Deputy Director General: Relevant Authority of Agriculture, Conservation and Environment Affairs.

## **13 PERMISSION TO WORK INSIDE THE ROAD RESERVE**

The applicant shall not commence with work inside the road reserve until he has obtain written approval from the Deputy Director General: Department of Public Works and Roads to do so.

## **14 INDEMNITY OF THE PREMIER AGAINST CLAIMS**

- 14.1** You indemnify the **PREMIER OF NORTH WEST** and exempt him from any claim or damage which may be instituted or suffered by any person, including legal costs, as a result of the laying or erection of any service or any other works caused or erected by you, or as a result of negligence on your part to protect or maintain the service or other works caused by any other person unless you can prove negligence on the part of Department of Public Works, Roads and Transport or its officials.
- 14.2** The Department of Public Works and Roads will not be liable for any damage suffered by the applicant as a result of operations carried out on road construction or road maintenance or any other operations whatsoever, unless negligence on the part of Department of Public Works, Roads and Transport or its officials can be proved.



**14.3** The applicant shall indemnify the Department of Public Works and Roads or its officials and workers against any claims arising out of any death of or injuries to any person or damage to any property whatsoever (including services such as water pipes, telephone and or electric cables, etc,) caused by or resulting from the activities of the applicant in the road reserve.

**14.4** **Where someone other than the state**, applicant is responsible for the construction of the access (es), the applicant shall take out a policy covering him to the amount to be stipulated by the Controlling Authority (Department of Public Works and Roads).

This is necessary to enable the applicant to comply with the above requirements. Before any work is done in the road reserve, the applicant shall deliver proof that the policy has been taken out and all costs of it have been paid.

## **15 LAND USE ALONG THE ROAD(S)**

**15.1** Land use of even build on the lines of no access shall be in accordance with the requirements of Executive Committee Resolution 1112 of 26 June 1978.

**15.2** The applicant shall not erect/ built either permanent or temporarily structures, and or any informal structures along the above-mentioned provincial roads inside the road reserve until he has obtain written approval from the Deputy Director General: Department of Public Works and Roads to do so

## **16 RESPONSIBILITY FOR THE COST OF (ACOUSTIC SCREEING) NOISE BARRIER**

The applicant shall be responsible for any costs involved in the erection of Acoustic Screening (Noise Barrier).

## **17 ACCEPTANCE AND DISPOSAL OF STORM WATER**


**17.1** In terms of Section 84 of the road Ordinance, 1957, the applicant shall arrange the drainage of the proposed development(s) in such way that it fit in with the drainage of the provincial Road(s)**P137/1\_030 (R502)**, taking into account the capacity of the system.



- 17.2** The applicant/ local authority or whoever responsible for the drainage of the proposed development(s) shall receive and dispose all the storm water running from the road or being diverted from the road.
- 17.3** The state or the Provincial Administration will not be responsible for any damage caused by arising from such storm water.
- 17.4** Where, in the opinion of the Deputy Director General: Department of Public Works and Roads, the system for the above-mentioned road(s) is too small to cope with any increased volume of the storm as a result of the establishment or proposed development(s), the applicant/ local authority (whoever responsible for the drainage) shall be responsible for the cost of installing a larger drainage system for the provincial Road(s) **P137/1\_030 (R502)**.
- 17.5** The applicant/ local authority or whoever responsible for the drainage of the proposed development(s) shall built/ construct the drainage scheme at own cost simultaneously with the construction of the access (es).

**It will be appreciated if you would kindly ensure that all the above conditions are included in the proposed and intended developments.** Should you have any question and or clarification in regard to the above-mentioned, please do not hesitate to contact this Department.

Yours faithfully

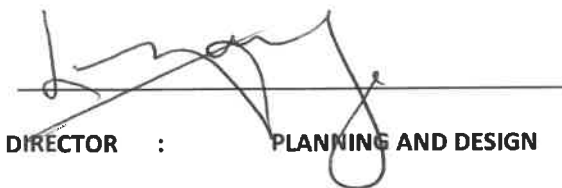  
DIRECTOR : PLANNING AND DESIGN

**L A MAFUNE**

20/07/2022

DATE

**ATTACHED** : Typical Plan No: **NWP 3/3; 3/4 & 5 /1**


: : Locality Map\_SE3406\_Vaal River Solar PV Facilities, Substations and 132kV Powerline and **Google\_SE3406\_Vaal River PV Facilities**

: **Sketch Plan\_48m Rd Reserve\_Building Line Relax\_Buildings**



# MINIMUM BUILDING LINE RELAXATION

## FILLING STATION ALONG PROVINCIAL ROAD

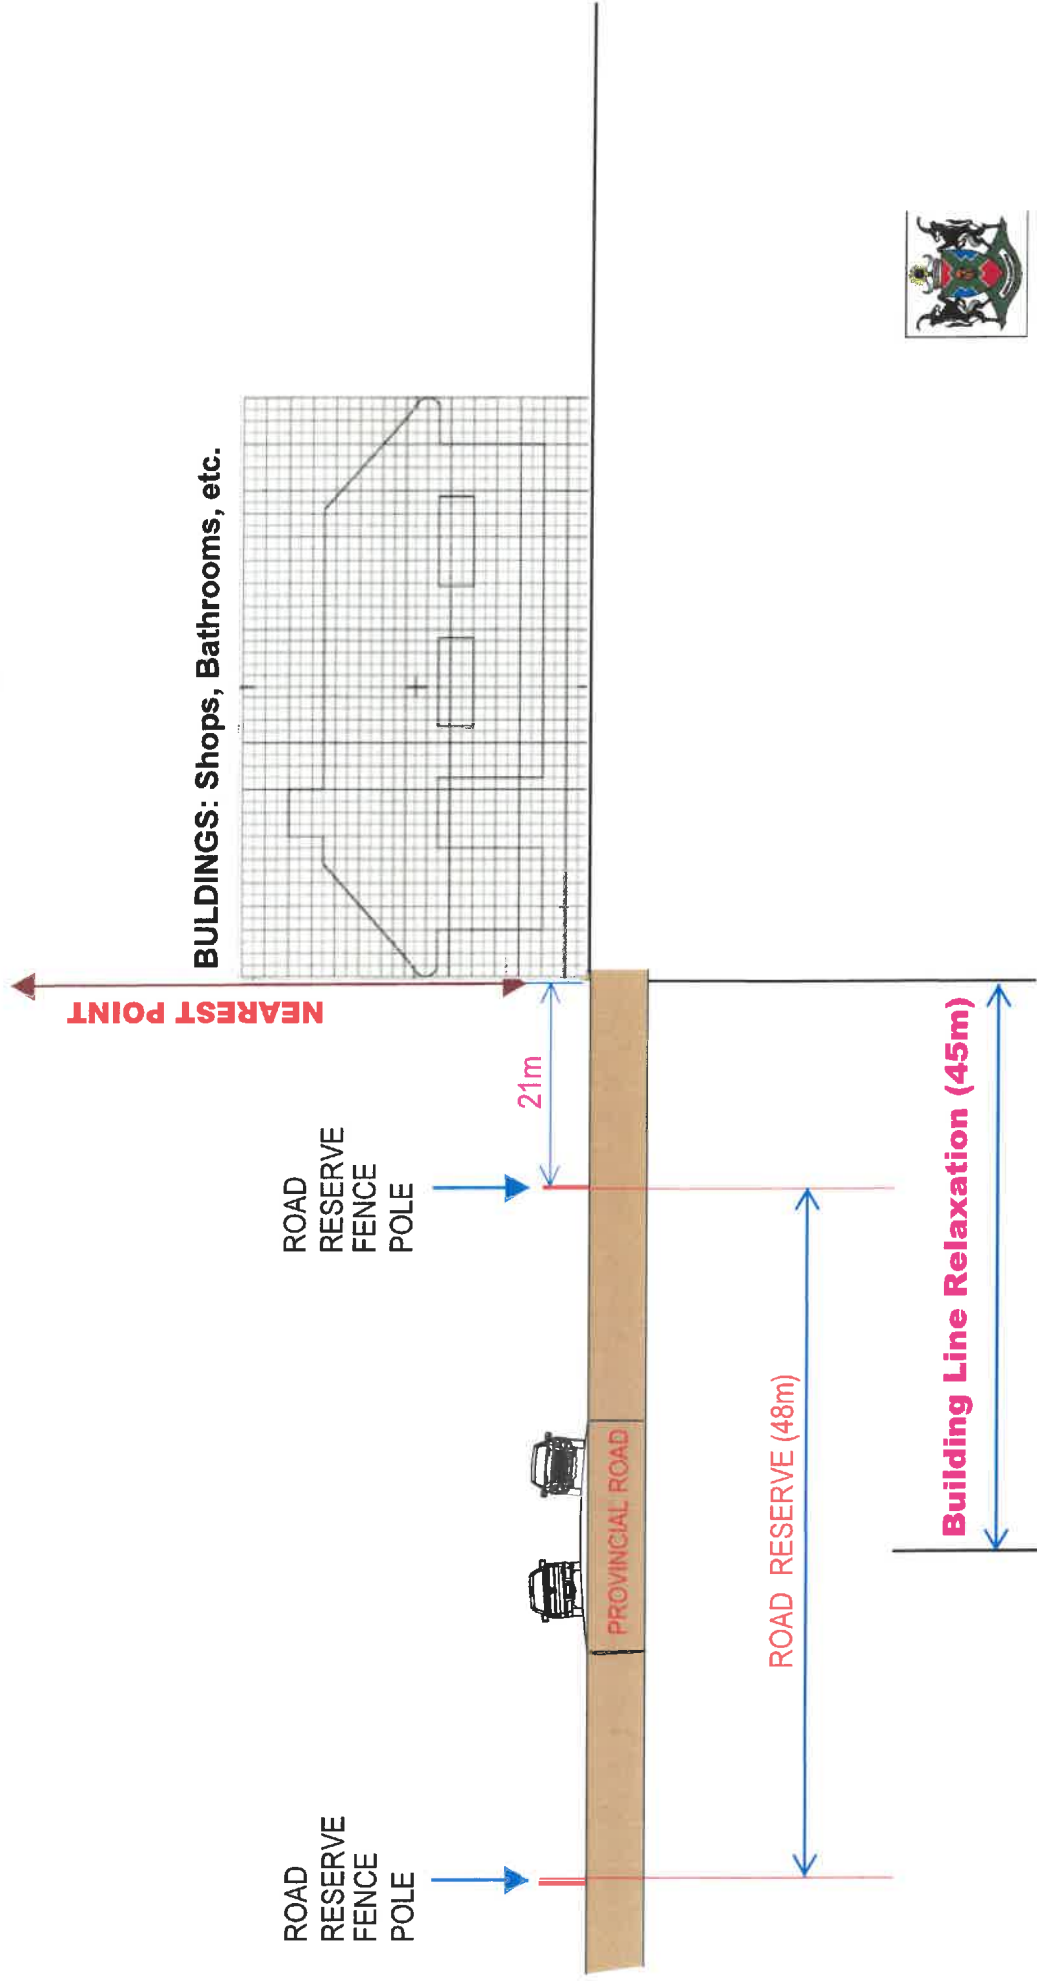


# Google\_SE3406\_Vaal River PV Facilities


Write a description for your map.

## Legend

- 132 KV Powelines
- Cardell DS Substations
- Farm Portion Boundary
- Gravel
- Hermes Eskom Substations
- National Road
- Paved Road
- Vaal River Solar 1 PV Facility
- Vaal River Solar 2 PV Facility
- Vaal River Solar 3 PV Facility

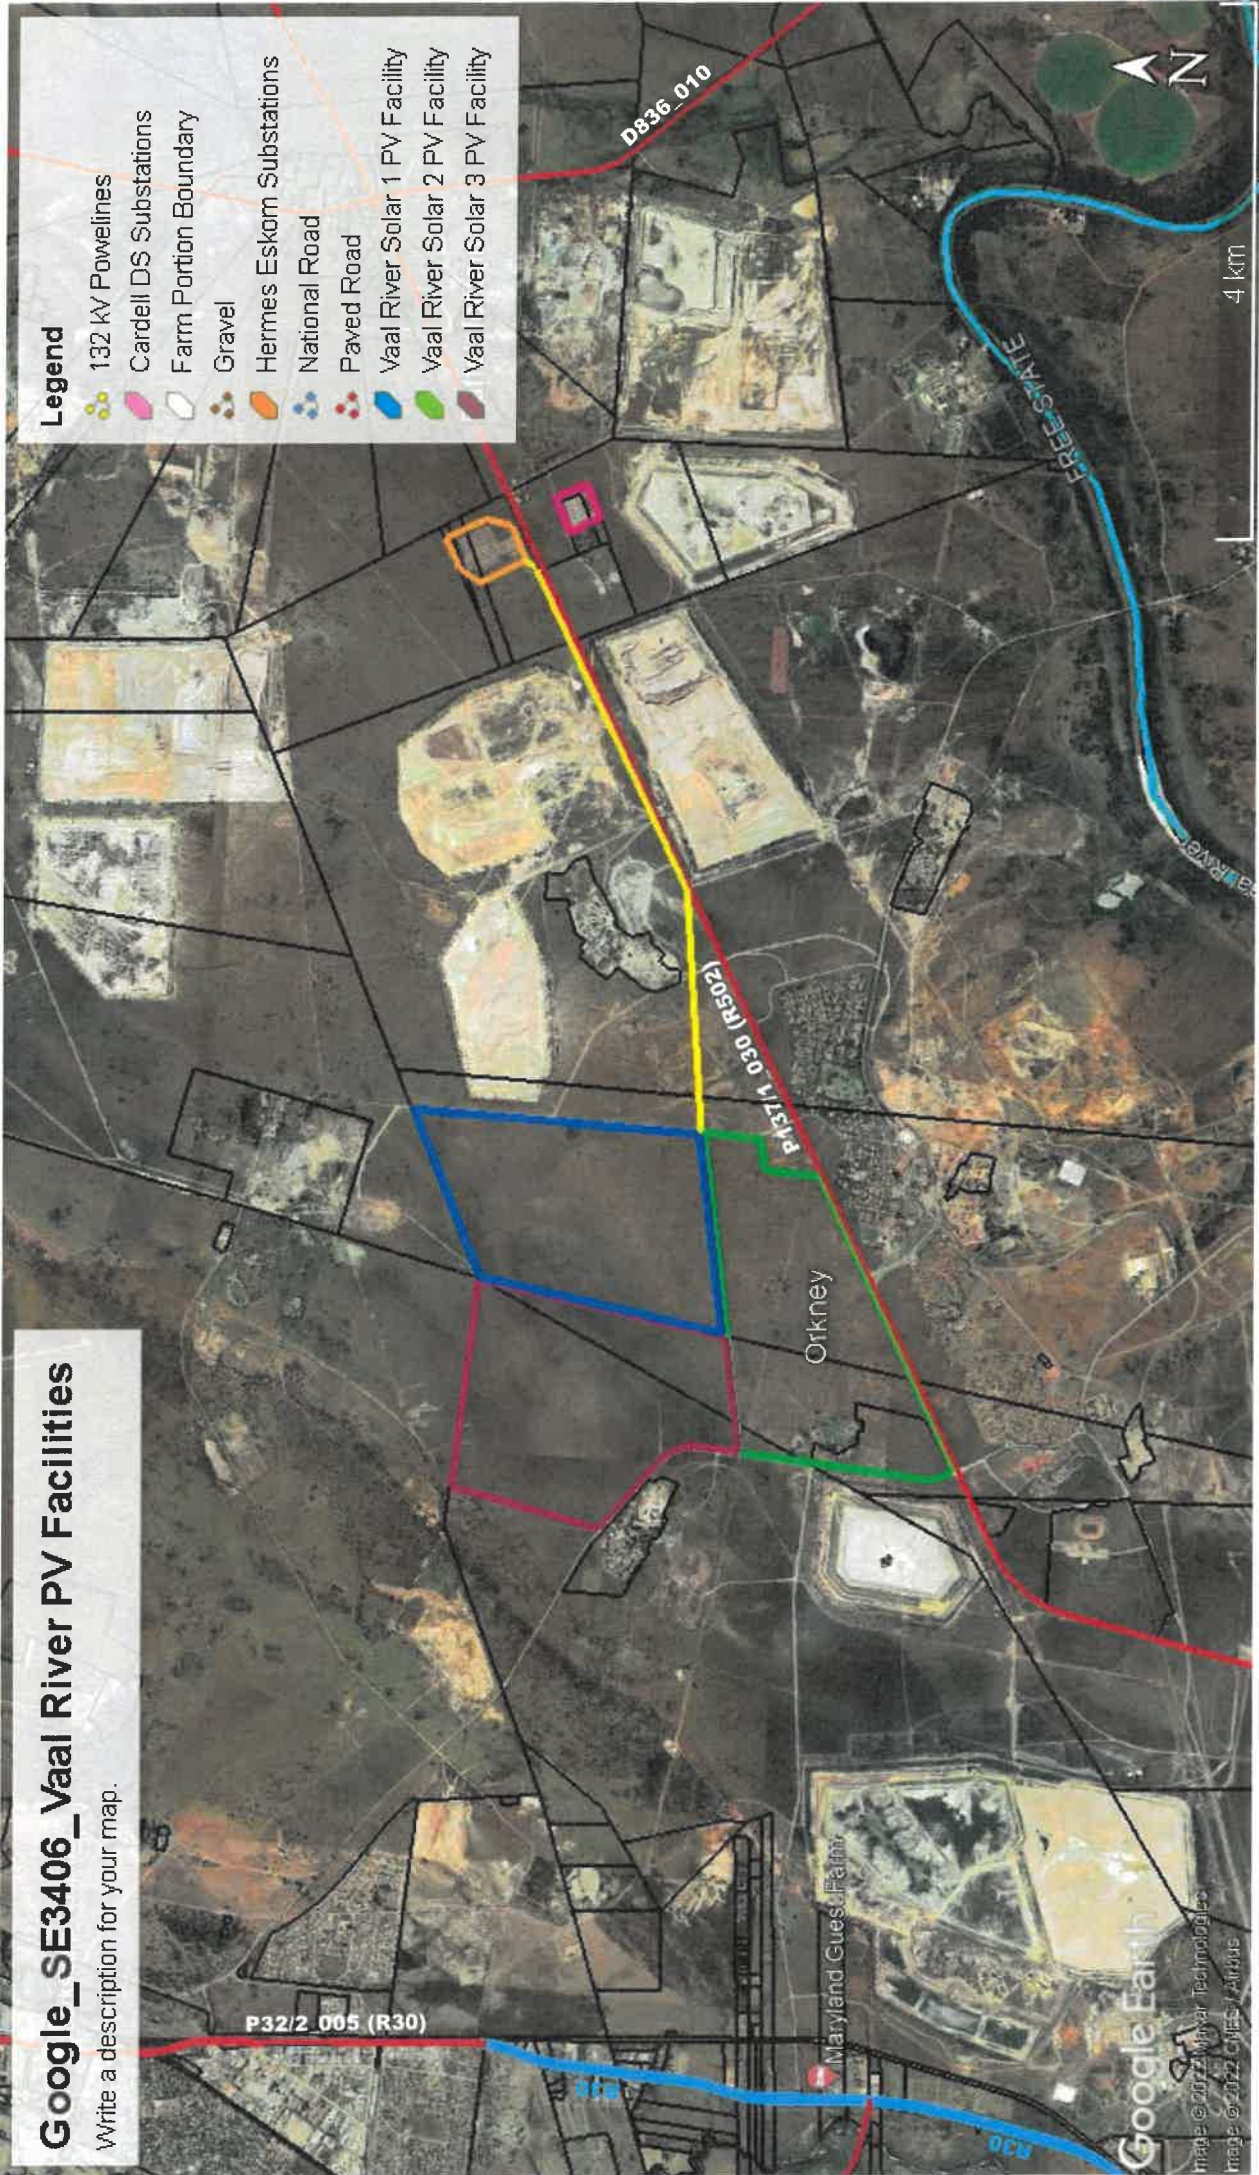

**Locality Map\_SE3406\_Vaal River Solar PV Facilities, Substations and 132kV Powerline**

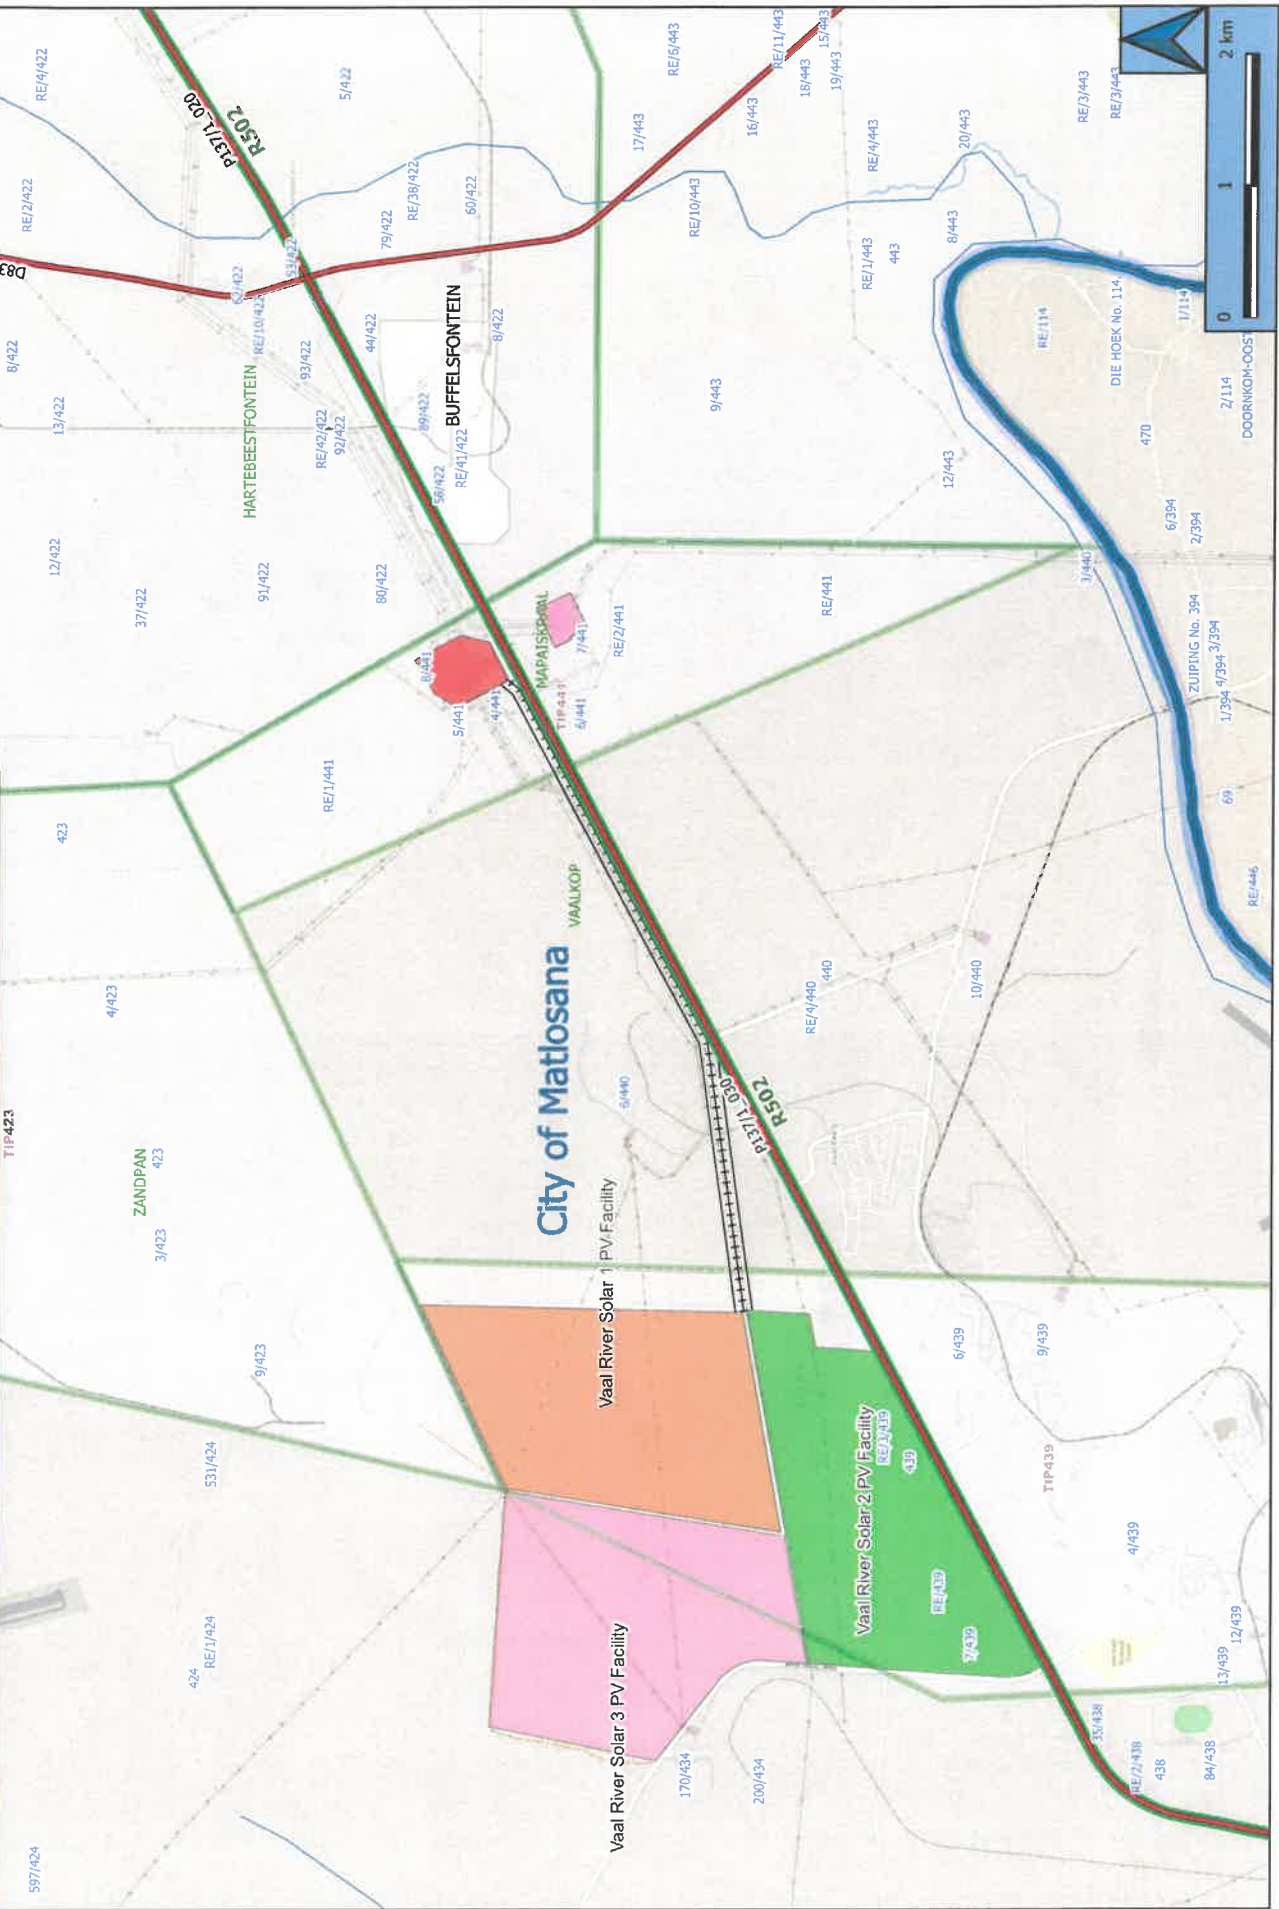



# forestry, fisheries & the environment

Department:  
Forestry, Fisheries and the Environment  
REPUBLIC OF SOUTH AFRICA

Private Bag X 447 · PRETORIA · 0001 · Environment House · 473 Steve Biko Road, Arcadia, · PRETORIA

**DFFE Reference:** 12/12/20/2513/1/AM6

**Enquiries:** Ms Samkelisiwe Dlamini

**Telephone:** (012) 399 9379 **E-mail:** [SDlamini@dfpe.gov.za](mailto:SDlamini@dfpe.gov.za)

Ms Karen Jodas  
Savannah Environmental (Pty) Ltd  
PO Box 148  
**SUNNINGHILL**  
2157

**Telephone Number:** 011 656 3237  
**Email Address:** [karen@savannahsa.com](mailto:karen@savannahsa.com)

## PER MAIL / EMAIL

Dear Ms Jodas

### COMMENTS ON THE DRAFT REPORT FOR THE APPLICATION FOR AMENDMENT OF THE ENVIRONMENTAL AUTHORISATION ISSUED ON 10 OCTOBER 2012 FOR THE VAAL RIVER SOLAR 2 PV FACILITY NEAR ORKNEY IN THE NORTH WEST PROVINCE

The Environmental Authorisation (EA) for the above-mentioned project dated 10 October 2012, the application for amendment of the EA and the amended draft amendment report received by the Department on 6 July 2022, refer.

The Department has the following comments on the abovementioned amendment application:

#### (a) Public participation

- (i) Please ensure that comments from all relevant stakeholders are submitted to the Department with the final report.
- (ii) A Comments and Response trail report (C&R) must be submitted with the final report. The C&R report must incorporate all comments for this application. The C&R report must be a separate document from the main report and the format must be in the table format. Please refrain from summarising comments made by I&APs. All comments from I&APs must be copied verbatim and responded to clearly. Please note that a response such as "noted" is not regarded as an adequate response to I&AP's comments.
- (iii) Please ensure that all issues raised and comments received during the circulation of the draft report from registered I&APs and organs of state which have jurisdiction in respect of the proposed activity are adequately addressed in the final report. Proof of correspondence with the various stakeholders must be included in the final report. Should you be unable to obtain comments, proof should be submitted to the Department of the attempts that were made to obtain comments. The Public Participation Process must be conducted in terms of Regulation 39, 40, 41, 42, 43 & 44 of the EIA Regulations 2014 as amended.
- (iv) The final report must also indicate that this draft report has been subjected to a public participation process.

MEM


**(b) Specialist assessments**

- (i) Please make sure that all the specialist studies undertaken have:
- A review of all specialist studies undertaken, and a detailed assessment, including a site verification report providing an indication of the status of the receiving environment (by the relative specialist, if applicable).
  - The terms of reference for the specialist reports and declaration of interest of each specialist must be provided.
  - The report mentioned above, must indicate if the impact rating as provided in the initial assessment remains valid; if the mitigation measures provided in the initial assessment are still applicable; or if there are any new mitigation measures which need to be included into the EA, should the request to extend the commencement period be granted by the Department.

**(c) General**

- (i) Please ensure that all mitigation recommendations are in line with applicable and most recent guidelines.

Yours faithfully



**Ms Milicent Solomons**

**Acting Chief Director: Integrated Environmental Authorisations**

**Department of Forestry, Fisheries and the Environment**

**Signed by: Ms Masina Morudu**

**Designation: Control Environmental Officer: National Infrastructure Authorisation**

**Date: 01/08/2022.**

cc:	Mr. Mike Levington	Vaal River Solar 2 (Pty) Ltd	Email: <a href="mailto:mike.levington@kabisolar.co.za">mike.levington@kabisolar.co.za</a>
-----	--------------------	------------------------------	---



Our Ref:



an agency of the  
Department of Arts and Culture

T: +27 21 462 4502 | F: +27 21 462 4509 | E: [info@sahra.org.za](mailto:info@sahra.org.za)  
South African Heritage Resources Agency | 111 Harrington Street | Cape Town  
P.O. Box 4637 | Cape Town | 8001  
[www.sahra.org.za](http://www.sahra.org.za)

Enquiries: Elijah Dumisani Katsetse

Tel: 0214624502

Email: [ekatsetse@sahra.org.za](mailto:ekatsetse@sahra.org.za)

CaseID: 19003

Date: Friday July 29, 2022

Page No: 1

## Final Comment

**In terms of Section 38(4), 38(8) of the National Heritage Resources Act (Act 25 of 1999)**

Attention: Savannah Environmental (Pty) Ltd

PO Box 148  
Sunninghill  
2157

**The proposed development of the Vaal River Solar PV Facilities, consisting of 3 PV Facilities developments and associated grid and powerline infrastructure, received Environmental Authorisation (EA) for a site near Orkney in the North West Province (see the table below) on 27 June 2012. The Environmental Authorisation for the Vaal River Solar PV Facility projects lapses on 10 October 2022. In this regard a Part 1 Amendment Application is being undertaken to extend the validity of the Environmental Authorisation. The Applicant is requesting the following Amendments for the PV: To amend the authorised solar PV capacity with no adjustment to the PV panel height and development footprint of the facility from that as authorised. Inclusion of BESS into the project description. An extension of the validity of the Environmental Authorisation. The Applicant is requesting the following Amendments for the grid connection: An extension of the validity of the Environmental Authorisation.**

Savannah Environmental has been appointed by the Vaal River Solar 1 (Pty) Ltd to conduct an Environmental Authorisation (EA) Amendment Application for the extension of the Authorised Kabi Vaalkop PV 2513 (now Vaal River Solar 1, 2, & 3 PV Facilities) issued in 2012 for a further 10 year period on Portion 3 of the Farm Vaalkop near Orkney, City of Matlosana Local Municipality, Dr. Kenneth Kaunda District Municipality, North West Province.

A Verification and Motivation Report (VMR) has been submitted in terms of the National Environmental Management Act, no 107 of 1998 (NEMA) and the NEMA Environmental Impact Assessment (EIA) Regulations. The scope of work entails a part one amendment application which includes a request to amend the authorised Solar PV capacity with no adjustment to the PV panel height and the development footprint of the facility from that as authorised, an extension of the validity of the Environmental Authorisation, and amendment for the grid connection as follows, inclusion of a Battery Energy Solar System (BESS) into the project description.

This application relates to the Kabi Vaalkop PV 2513 (<https://sahris.sahra.org.za/cases/kabi-vaalkop-pv-2513>).



an agency of the  
Department of Arts and Culture

T: +27 21 462 4502 | F: +27 21 462 4509 | E: [info@sahra.org.za](mailto:info@sahra.org.za)  
South African Heritage Resources Agency | 111 Harrington Street | Cape Town  
P.O. Box 4637 | Cape Town | 8001  
[www.sahra.org.za](http://www.sahra.org.za)

In 2012 Coetzee, F.P. and Prof. M Bamford were appointed to provide heritage specialist input as part of the EIA process as required by section 24(4)b(iii) of NEMA and section 38(3) and 38(8) of the National Heritage Resources Act, Act 25 of 1999 (NHRA).

Coetzee, FP. April 2012. *Cultural Heritage Survey of the Proposed Kabi Vaalkop PV Facility near Orkney, Dr Kenneth Kaunda District, North West Province.*

The archaeologist conducted a background study and a site visit. The background study revealed that archaeological traces from the Early, Middle and Later Stone Age might be expected, as well as from the Early and Late Iron Age. Historically, the nearby town of Klerksdorp was settled in 1837. Several important battles were fought in the area during the South African War and four blockhouse lines converge on the area. Gold mining has taken place in the area since 1885. The site visit did not identify any Stone Age, Iron Age or Colonial Period remains and located no graves. The foundations of two square brick and cement structures (5m x 5m and 5m x 8m) were identified, but these were deemed to be less than 60 years old.

Bamford, M. May 2012. *Palaeontological Impact Assessment for Kabi Vaalkop Solar PV Facility.*

The palaeontological assessment showed that the area is located within the Malmani Subgroup of the Chuniesport Group (Transvaal Sequence), represented by dolomites and cherts that are too old to contain fossils, beyond possible unicellular algal tracefossils in the dolomite.

A Letter of Exemption has been submitted by CTS Heritage for the EA amendment process to provide heritage specialist input as part of the EIA process as required by section 24(4)b(iii) of NEMA and section 38(3) and 38(8) of the National Heritage Resources Act, Act 25 of 1999 (NHRA).

Levin, J. June 2022. *Letter of Exemption: The Extension of Validity to the EA: Vall River Solar 1, 2, 3, and 4 PV Facilities and Grid Connection Infrastructure (as amended) on a Site Near Orkney, North West Province (previously called the proposed Vaalkop Solar PV Facility).*

The specialist undertook both a desktop and field assessment of the large and project area. A site verification field inspection was undertaken by Dr. Presnyakova in June 2022 to determine if the landscape has been subject to any changes that may impact the findings outlined in Coetzee (2012), such as the exposure of new sensitive subsurface sediments/deposits that were not visible during the original survey. Dr. Presnyakova determined that no archaeologically relevant changes are evident based on the verification survey that was

Our Ref:



an agency of the  
Department of Arts and Culture

T: +27 21 462 4502 | F: +27 21 462 4509 | E: [info@sahra.org.za](mailto:info@sahra.org.za)  
South African Heritage Resources Agency | 111 Harrington Street | Cape Town  
P.O. Box 4637 | Cape Town | 8001  
[www.sahra.org.za](http://www.sahra.org.za)

Enquiries: Elijah Dumisani Katsetse

Tel: 0214624502

Email: [ekatsetse@sahra.org.za](mailto:ekatsetse@sahra.org.za)

CaseID: 19003

Date: Friday July 29, 2022

Page No: 3

undertaken, and that it is unlikely that previously unidentified heritage resources will now be evident within the area proposed for development. The track path and site photographs resulting from this site verification are included as figure 1 to 12. The submitted letter makes the same conclusion for palaeontological heritage and argue that the overall palaeontological sensitivity of the development area as assessed by Bamford (2012) remains applicable. And a Chance Fossil Find Protocol is recommended for inclusion in the EMP.

In light of the above, there is no heritage objection to granting the extension to the validity to develop the Vaal River Solar PV Project 1, 2, 3, and 4 based on the current site conditions on the condition that the relevant recommendations in the previous heritage assessments concluded are implemented, including a walkdown assessment of the final layout and that the attached Chance Fossil Finds Procedure (Appendix 1) is added to the EMP.

## Final Comment

The SAHRA's APM Unit has received the Verification and Motivation Report (VMR) as part of the Environmental Authorisation Amendment process, attached to the VMR is a Letter of Exemption for heritage specialist studies. SAHRA supports the recommendations made in the Letter by the specialist and has no objections to the project.

SAHRA inserts the following comments as a requirement in terms of section 3(4) of the NEMA Regulations and section 38(8) of the NHRA in the format provided in section 38(4) of the NHRA and must be included in the Final VMR and EMP:

- 38(4)a – The SAHRA Archaeology, Palaeontology and Meteorites (APM) Unit has no objections to the proposed expansion;
- 38(4)b – The recommendations of the specialists are supported and must be adhered to. Further additional specific conditions are provided for the development;
- Both an Archaeological and Palaeontological walkdowns must be undertaken for the final layout prior construction. A report on the outcomes of the walkdown must be submitted to SAHRA for comment, construction may not commence without feedback from SAHRA on the report.
- 38(4)c(i) – If any evidence of archaeological sites or remains (e.g. remnants of stone-made structures, indigenous ceramics, bones, stone artefacts, ostrich eggshell fragments, charcoal and ash concentrations), fossils or other categories of heritage resources are found during the proposed development, SAHRA APM Unit (Elijah Katsetse/Phillip Hine 021 462 4502) must be alerted as per

Our Ref:



an agency of the  
Department of Arts and Culture

T: +27 21 462 4502 | F: +27 21 462 4509 | E: info@sahra.org.za  
South African Heritage Resources Agency | 111 Harrington Street | Cape Town  
P.O. Box 4637 | Cape Town | 8001  
www.sahra.org.za

Enquiries: Elijah Dumisani Katsetse

Tel: 0214624502

Email: ekatsetse@sahra.org.za

CaseID: 19003

Date: Friday July 29, 2022

Page No: 4

section 35(3) of the NHRA. Non-compliance with section of the NHRA is an offense in terms of section 51(1)e of the NHRA and item 5 of the Schedule;

- 38(4)c(ii) – If unmarked human burials are uncovered, the SAHRA Burial Grounds and Graves (BGG) Unit (Thingahangwi Tshivhase/Ngqalabutho Madida 012 320 8490), must be alerted immediately as per section 36(6) of the NHRA. Non-compliance with section of the NHRA is an offense in terms of section 51(1)e of the NHRA and item 5 of the Schedule;
- 38(4)d – See section 51(1) of the NHRA;
- 38(4)e – The following conditions apply with regards to the appointment of specialists:
  - i) If heritage resources are uncovered during the course of the development, a professional archaeologist or palaeontologist, depending on the nature of the finds, must be contracted as soon as possible to inspect the heritage resource. If the newly discovered heritage resources prove to be of archaeological or palaeontological significance, a Phase 2 rescue operation may be required subject to permits issued by SAHRA;
  - The Final VMR and EMPr must be submitted to SAHRA for record purposes;
  - The decision regarding the EA Application must be communicated to SAHRA and uploaded to the SAHRIS Case.

Should you have any further queries, please contact the designated official using the case number quoted above in the case header.

Yours faithfully

---

Elijah Dumisani Katsetse  
Heritage Officer  
South African Heritage Resources Agency

Our Ref:



an agency of the  
Department of Arts and Culture

T: +27 21 462 4502 | F: +27 21 462 4509 | E: [info@sahra.org.za](mailto:info@sahra.org.za)  
South African Heritage Resources Agency | 111 Harrington Street | Cape Town  
P.O. Box 4637 | Cape Town | 8001  
[www.sahra.org.za](http://www.sahra.org.za)

Enquiries: Elijah Dumisani Katsetse

Tel: 0214624502

Email: [ekatsetse@sahra.org.za](mailto:ekatsetse@sahra.org.za)

CaseID: 19003

Date: Friday July 29, 2022

Page No: 5

---

Phillip Hine

Manager: Archaeology, Palaeontology and Meteorites Unit  
South African Heritage Resources Agency

---

**ADMIN:**

Direct URL to case: <https://sahris.sahra.org.za/node/600584>

**Terms & Conditions:**

1. This approval does not exonerate the applicant from obtaining local authority approval or any other necessary approval for proposed work.
2. If any heritage resources, including graves or human remains, are encountered they must be reported to SAHRA immediately.
3. SAHRA reserves the right to request additional information as required.

## Savannah Public Process

---

**From:** Ria Barkhuizen (NR) <Barkhuizenr@nra.co.za>  
**Sent:** Friday, 29 July 2022 10:21  
**To:** Savannah Public Process  
**Subject:** RE: SE3406: PROJECT ANNOUNCEMENT FOR THE VAAL RIVER SOLAR PV FACILITIES, SUBSTATION AND 132kV POWER, NEAR ORKNEY NORTH WEST PROVINCE

Good day

This email is an acknowledgement of receipt for your enquiry.

Please note that in line with requirements of Section 29 of the Spatial Planning and Land Use Management Act (Act No 16 of 2013) read with Section 3 of the Promotion of Administrative Justice Act (Act No 3 of 2000) SANRAL have 30 days to acknowledge receipt of your application and 90 days to evaluate and provide response.

Should you not receive any response within 120 days, kindly follow up on the enquiry by responding to Jan Oliver who will be dealing with it and will convert back to you. He can be contacted on (012) 426-6242 / Cell 081 010 6403.

Tx and Regards

Ria