


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	
Bushclearing required (m)	

RIEFONTEIN 863 LS

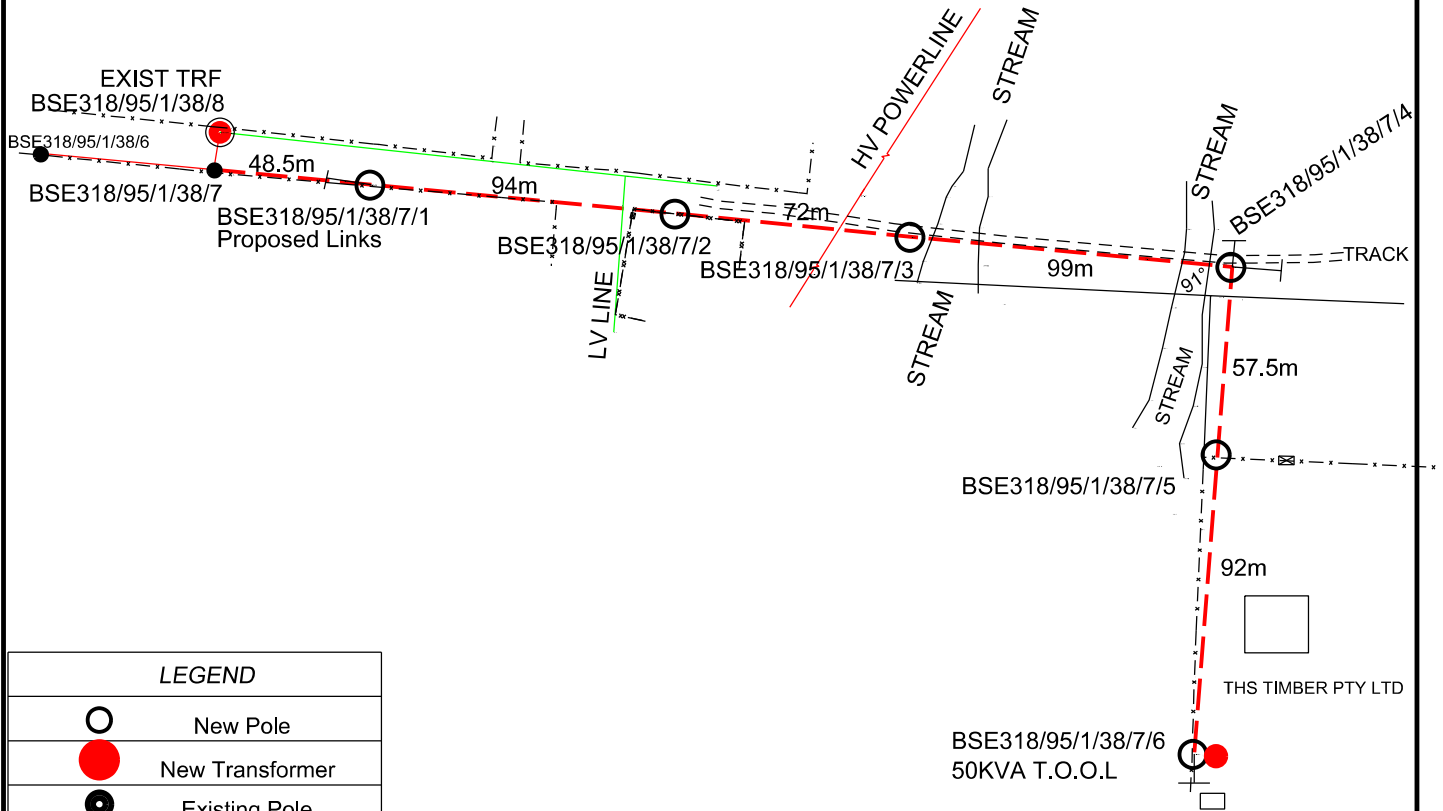

LEGEND		
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	LV LINE	
	3	
	2	
	1	
ZM MATHIBA	0	[10/03/2021]
SURVEYOR	REV	SURVEY DATE

FEEDER:	BSE 22KV	CUSTOMER:	THS TIMBER PTY LTD
PROJECT NO:	BOT400842035	PROPERTY:	RIEFONTEIN 863 LS
CONDUCTOR:	FOX	LENGTH OF LINE:	463.5m
SURVEYOR:	Z.M MATHIBA	CONTACT DETAILS	
DRAUGHTSPERSON:	Z.M MATHIBA	SCALE:	[1:2 500]
		PAGE:	[1] of [1]



THIS DRAWING IS THE PROPERTY OF Eskom
Disclaimer: Eskom is not responsible for any errors displayed on this drawing