


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	6
Bushclearing required (m)	

ZOEKMAKAAR 778 LS

TWO PROJECTS GOES TOGETHER
 BOT493655274 & BOT492514114
 CAPRICORN DISTRICT MUNICIPALITY

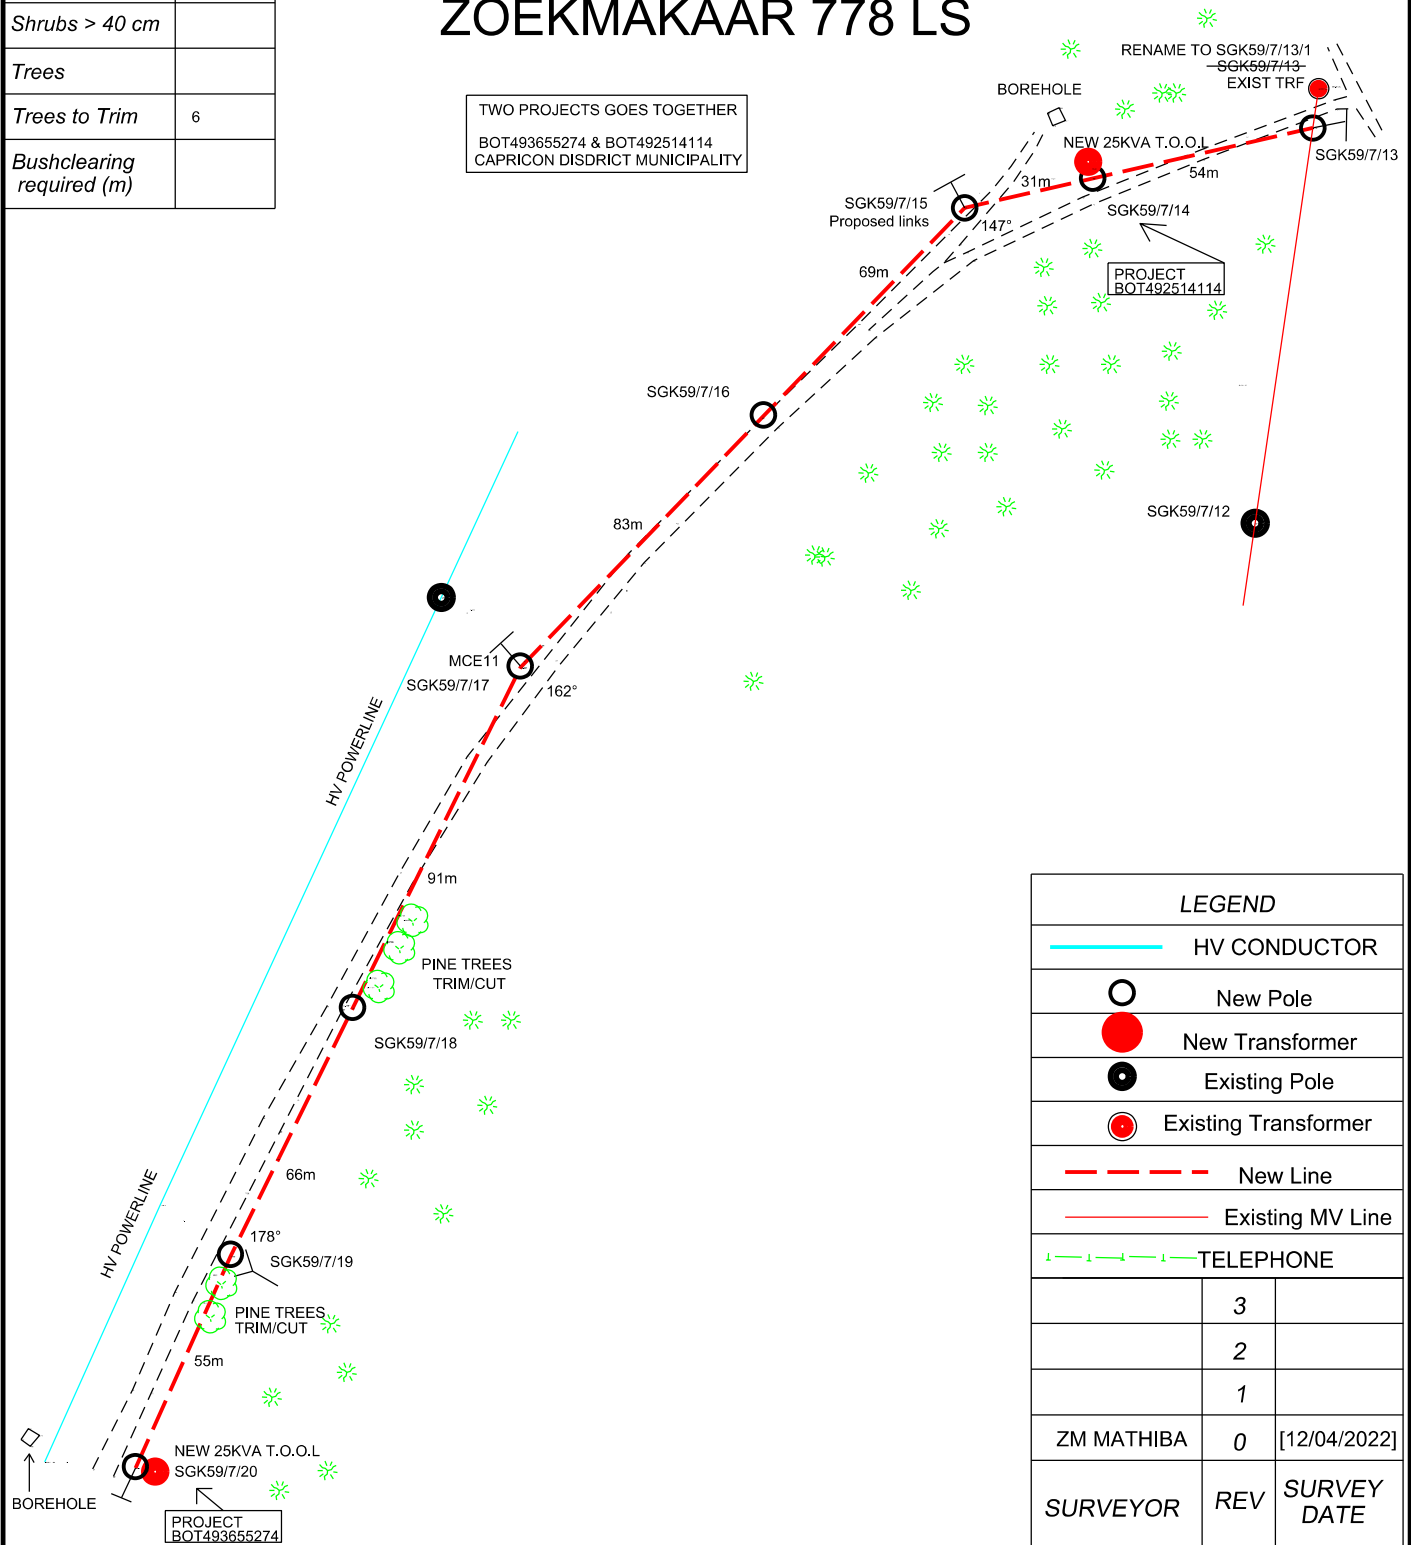

LEGEND		
	HV CONDUCTOR	
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	TELEPHONE	
	3	
	2	
	1	
ZM MATHIBA	0	[12/04/2022]
SURVEYOR	REV	SURVEY DATE

FEEDER:	SOEKMEKAAR GELUK 22KV	CUSTOMER:	CAPRICORN DISTRICT MUNICIPALITY
PROJECT NO:	BOT493655274 & BOT492514114	PROPERTY:	ZOEKMAKAAR 778 LS
CONDUCTOR:	FOX		
LENGTH OF LINE:	450m		
SURVEYOR:	Z.M MATHIBA	CONTACT DETAILS	[1] of [1]
DRAUGHTSPERSON:	Z.M MATHIBA	SCALE:	[1:2 500]
		PAGE:	

THIS DRAWING IS THE PROPERTY OF Eskom
 Disclaimer: Eskom is not responsible for any errors displayed on this drawing