


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Trees	
Trees to Trim	
Bushclearing required (m)	

THAKGALANE VILLAGE

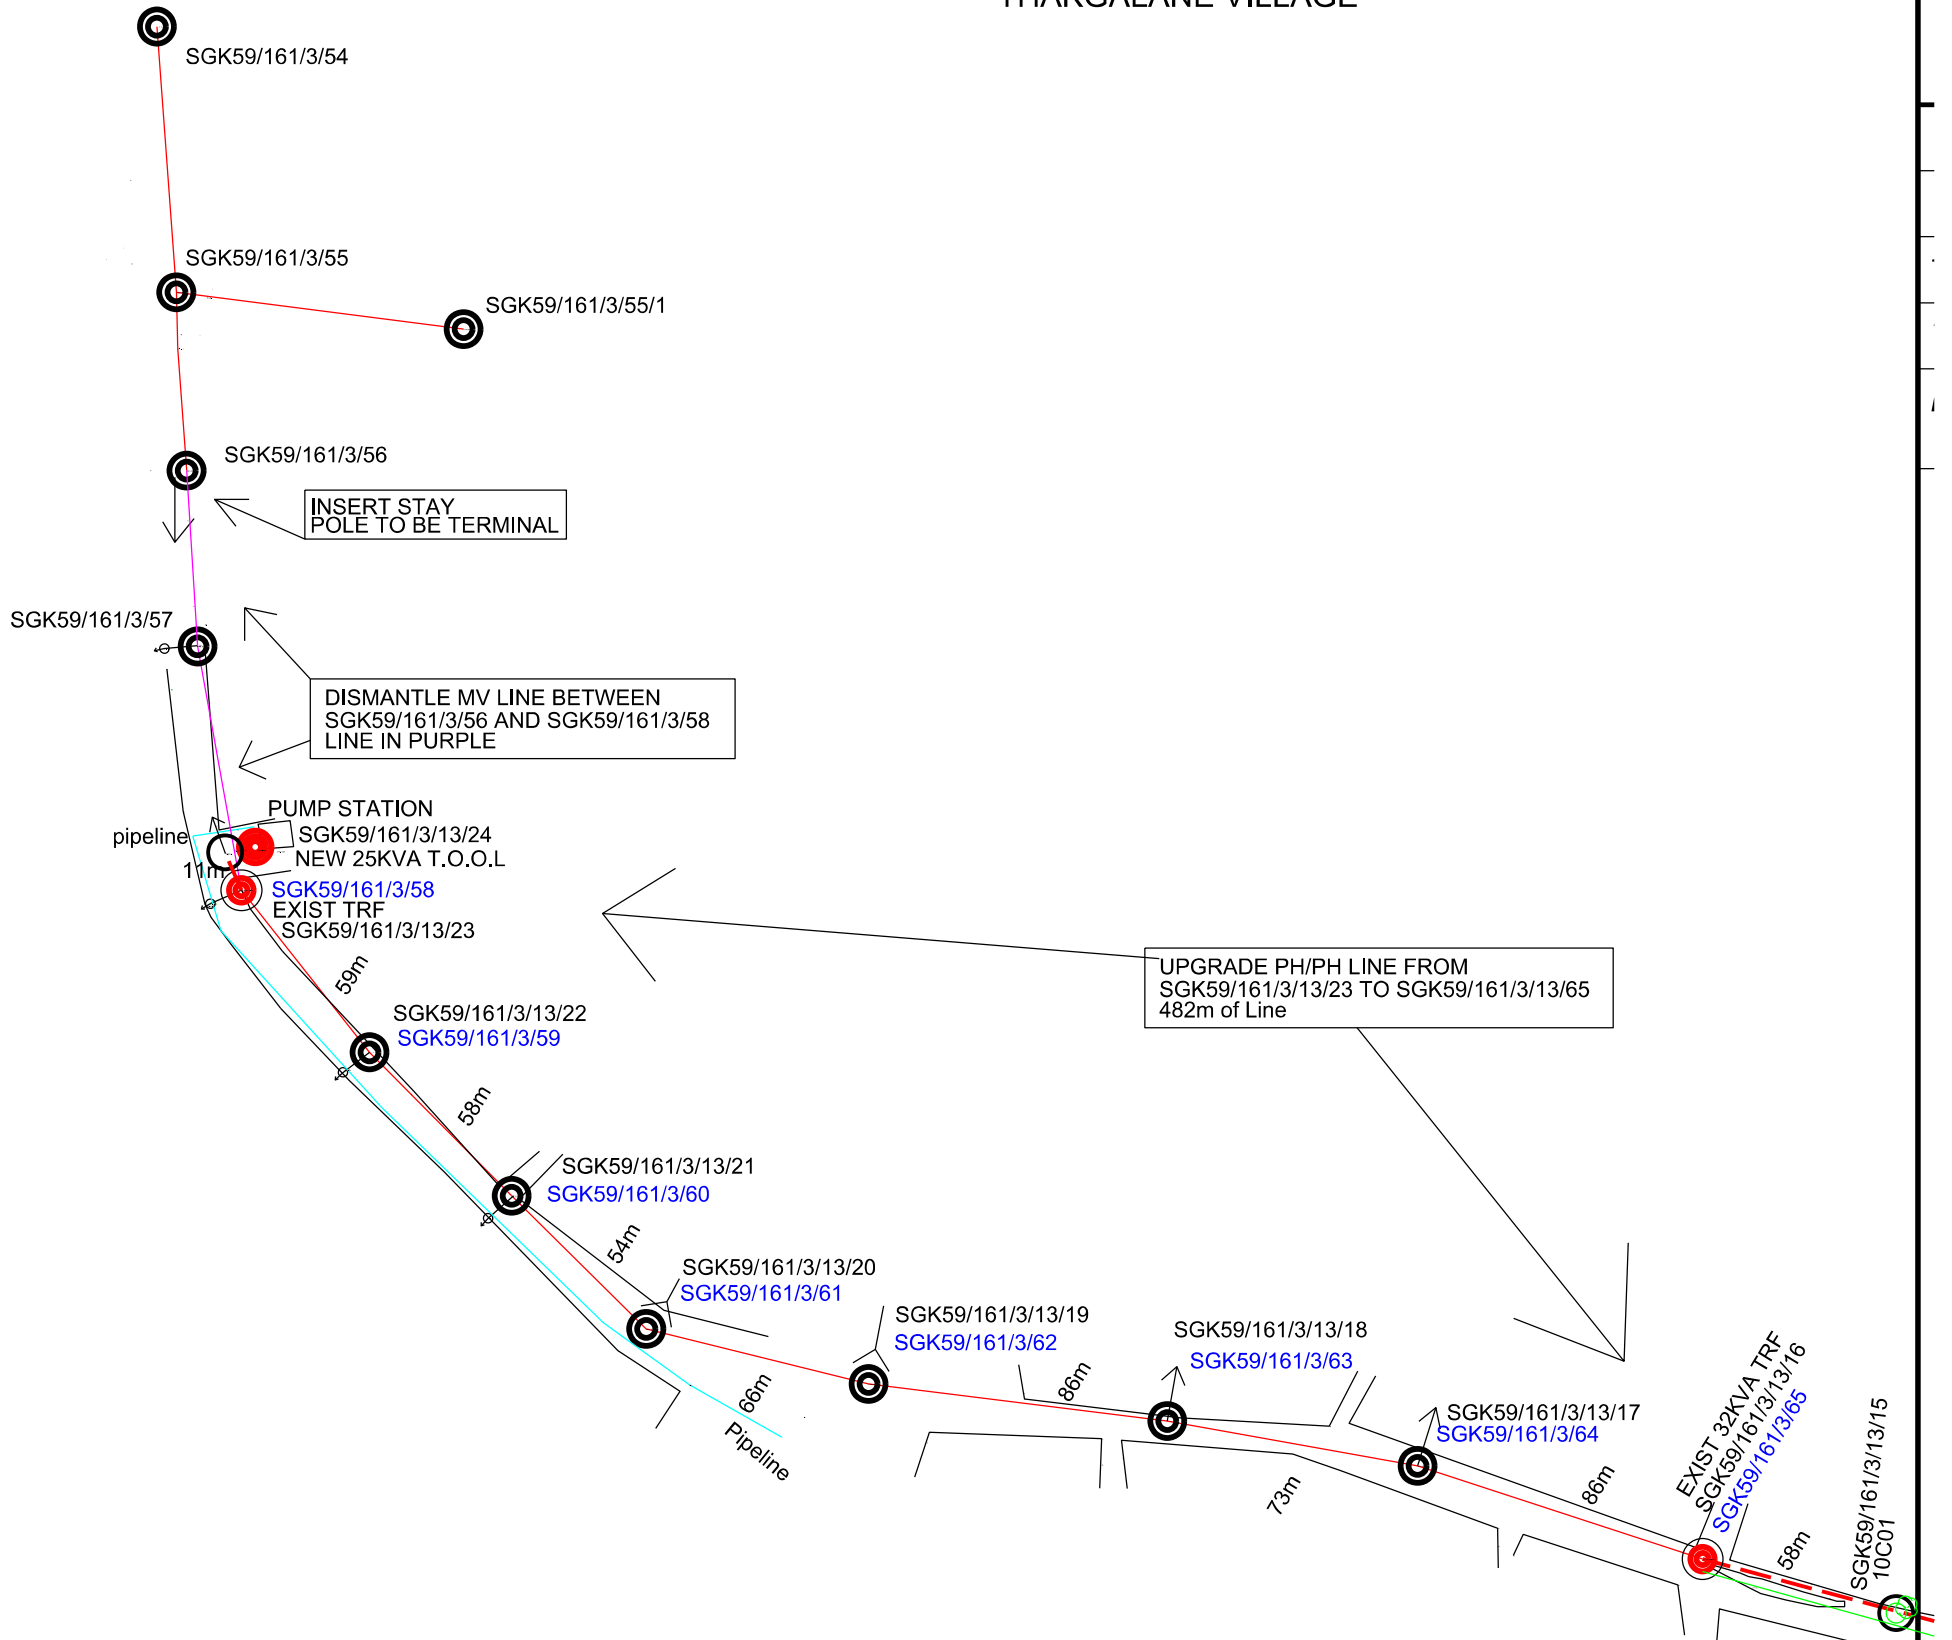

NOTES: BLUE NAME IS EXISTING PH/PH TO BE RENAMED
 PURPLE LINE TO BE DISMANTLED

FEEDER: SGK 22KV	CUSTOMER: MOPANI DISTRICT MUNICIPALITY	
PROJECT NO: BOT653913609	PROPERTY: BOSCHBOKHOEK 170 LT	
CONDUCTOR: -	CONTACT DETAILS	
LENGTH OF LINE: New MV line=1122m Upgrade PH/PH=537m	SCALE: [1:2 500] PAGE: [3] of [3]	
SURVEYOR: MORUDU A		Disclaimer: Eskom is not responsible for any errors displayed on this drawing
DRAUGHTSPERSON: MORUDU A		