Eskom Belfast-Sunbury-Paarde 0.08km 132kV Loop-in Loop-out Project

Environmental Impact Assessment Process: Basic Assessment

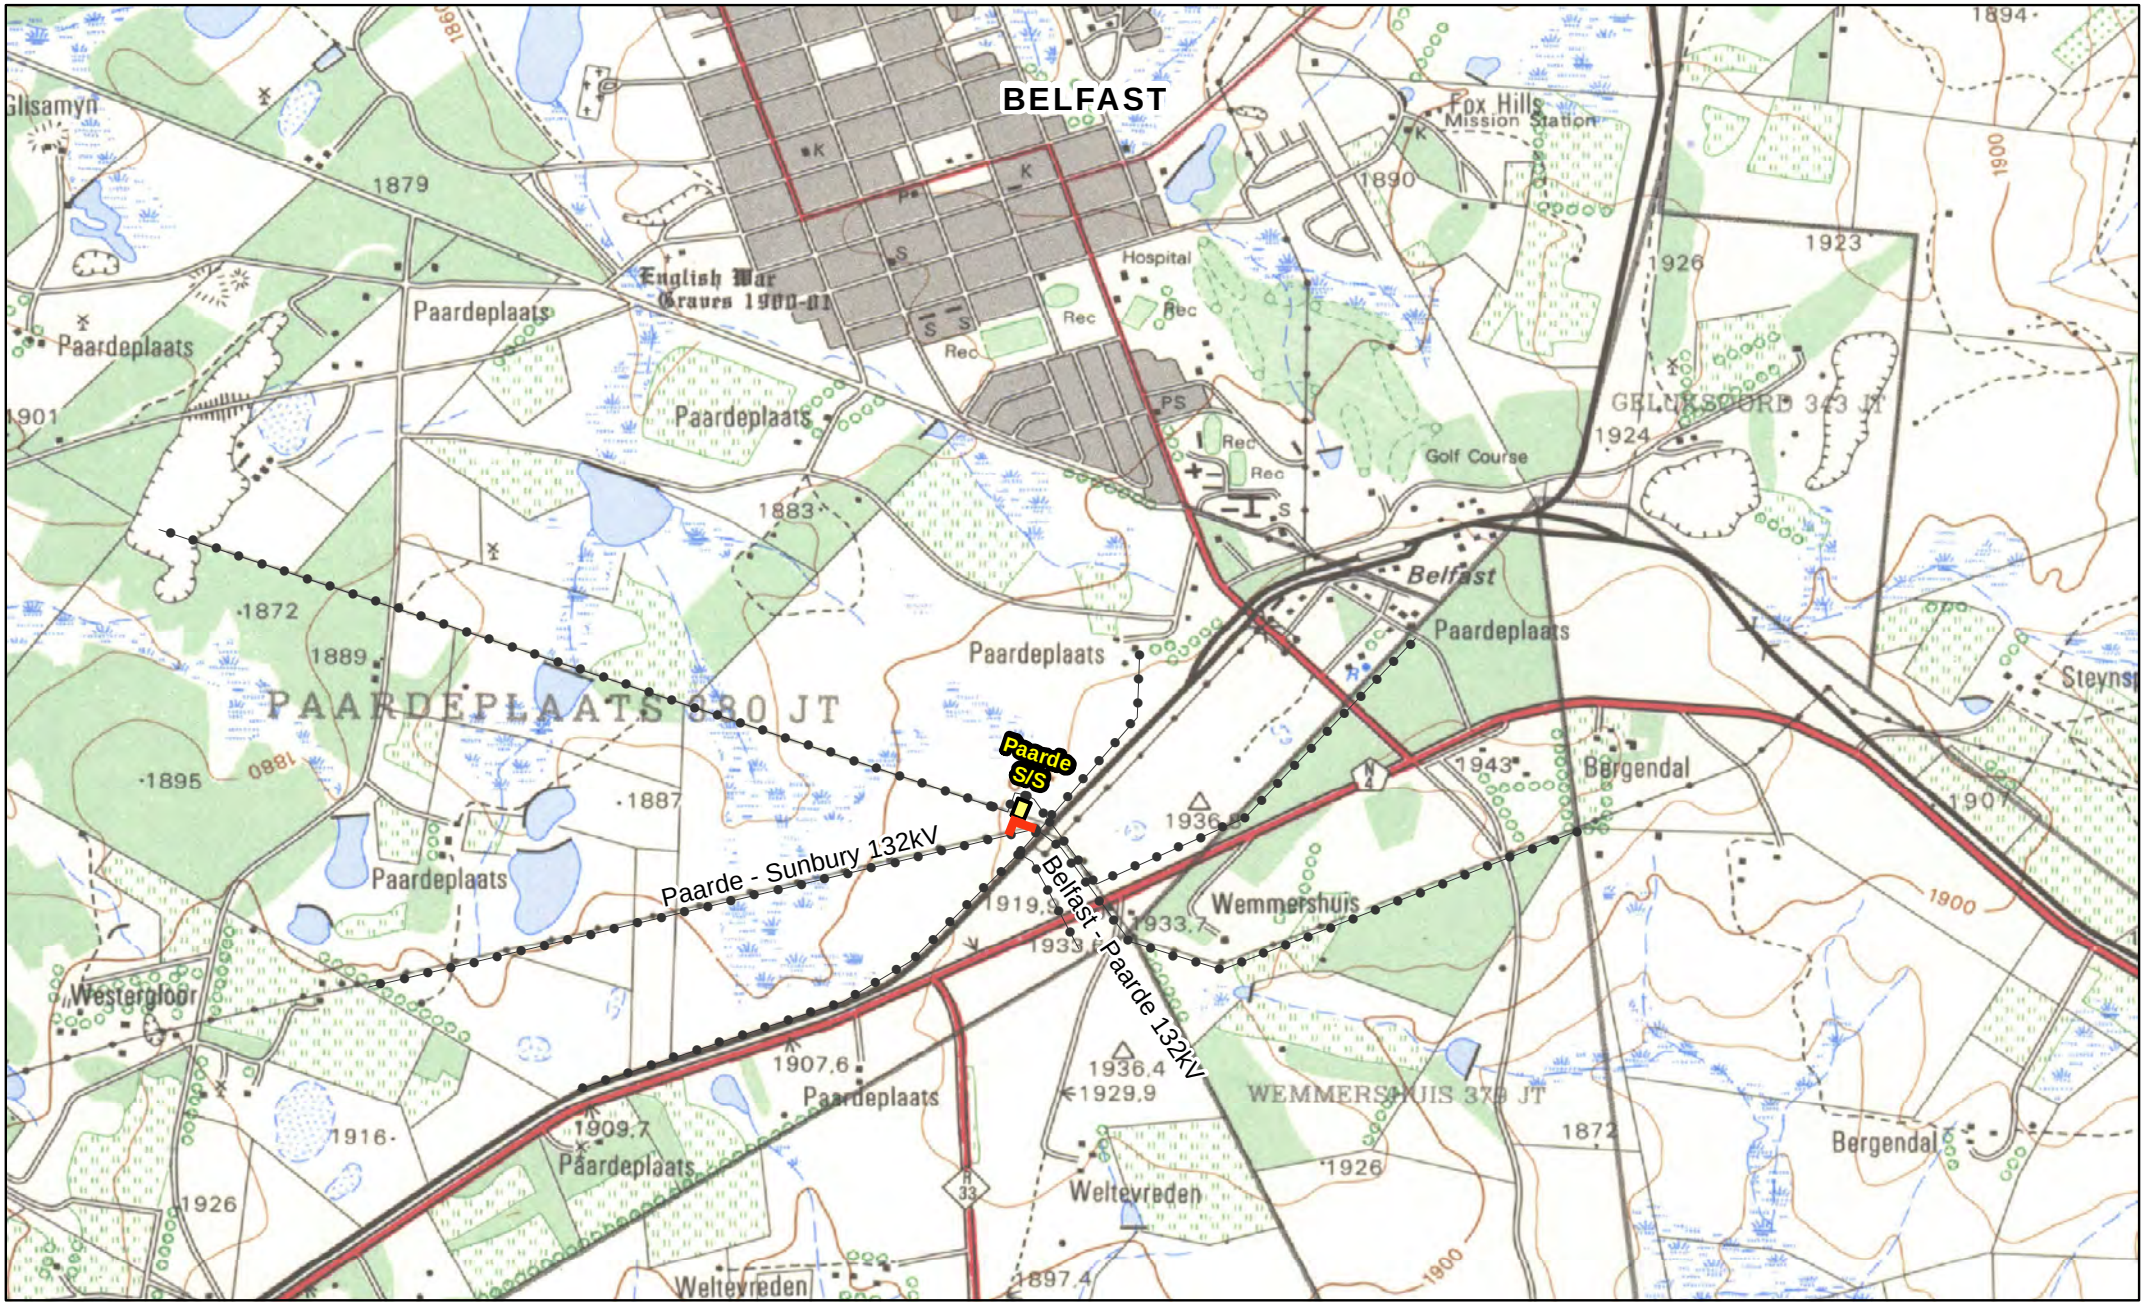

Proposed 132kV loop in loop out Belfast Sunbury Paarde

Paarde substation

Existing powerlines

0 0.25 0.5 1 1.5 2 Kilometers

1:50 000 Topographical base map: 2530CA

Eskom Belfast-Sunbury-Paarde 0,08km 132kV Loop-in Loop-out Project

© A. Froneman - 22 August 2012