

REPORT N° 47579-R01

FRESHWATER HABITAT IDENTIFICATION: MARALLA LINEAR TRANSMISSION INTEGRATION

BIO THERM ENERGY
(PTY) LTD

PUBLIC

MARCH 2017

FRESHWATER HABITAT IDENTIFICATION: MARALLA LINEAR TRANSMISSION INTEGRATION

BIO THERM ENERGY
(PTY) LTD




**Draft
Public**

Project no: 47579
Date: March 2017

WSP | Parsons Brinckerhoff
WSP House, Bryanston Place,
199 Bryanston Drive,
Bryanston, 2191

Tel: +27 (0) 11 300 6085
Fax: +27 (0) 11 361 1381
www.wspgroup.com
www.pbworld.com

QUALITY MANAGEMENT

ISSUE/REVISION	FIRST ISSUE	REVISION 1	REVISION 2	REVISION 3
Remarks				
Date	09/03/2017			
Prepared by	Bruce Wickham			
Signature				
Checked by	Colin Holmes			
Signature				
Authorised by	Greg Matthews			
Signature				
Project number	47579			
Report number	R01			
File reference	47579_R01-Maralla Linear Transmission Integration-Freshwater Habitat Identification - Final Report-20170309.docx			

PRODUCTION TEAM

CLIENT

Senior Associate	Michael Barnes
Environmental Manager	Mohammed Junaid Yusuf

WSP | PARSONS BRINCKERHOFF

Author	Bruce Wickham
Reviewer	Colin Holmes
Authorisation	Greg Matthews

TABLE OF CONTENTS

FRESHWATER HABITAT IDENTIFICATION: MARALLA LINEAR TRANSMISSION INTEGRATION	1
PUBLIC JANUARY 2017	1
1 INTRODUCTION.....	1
1.1 OBJECTIVES OF THE REPORT	1
1.2 STUDY APPROACH AND METHODOLOGY	1
FRESHWATER HABITAT IDENTIFICATION.....	2
DELINEATION OF FRESHWATER HABITATS.....	2
IMPACT METHODOLOGICAL FRAMEWORK	3
1.3 ASSUMPTIONS AND LIMITATIONS	6
1.4 DECLARATION OF INDEPENDENCE.....	6
2 DESCRIPTION OF THE PROJECT.....	7
3 DESCRIPTION OF THE AFFECTED ENVIRONMENT	12
3.1 HYDROLOGY.....	12
3.2 VEGETATION AND LAND USE	15
3.3 SOILS AND GEOLOGY	15
4 FINDINGS – POWERLINES AND SUBSTATIONS.....	20
5 ASSESSMENT OF IMPACTS	22
5.1 CONSTRUCTION PHASE	22
5.2 OPERATIONAL PHASE	22
5.3 DECOMMISSIONING PHASE	23
5.4 CUMULATIVE IMPACTS	23
5.5 OPTIONS ANALYSIS	26

6	MITIGATION AND MANAGEMENT MEASURES	26
7	STAKEHOLDER CONSULTATION	27
7.1	STAKEHOLDER CONSULTATION PROCESS	27
7.2	STAKEHOLDER COMMENTS AND RESPONSE	27
8	CONCLUSION	35
9	PLATES	36
10	REFERENCES.....	37

TABLES

TABLE 1:	NATURE OR TYPE OF IMPACT	4
TABLE 2:	PHYSICAL EXTENT OF IMPACT	4
TABLE 3:	DURATION OF IMPACT	4
TABLE 4:	MAGNITUDE OF IMPACT ON ECOLOGICAL PROCESSES	4
TABLE 5:	IMPACT PROBABILITY OF OCCURRENCE	5
TABLE 6:	SIGNIFICANCE WEIGHTINGS FOR EACH IMPACT	5
TABLE 7:	QUATERNARY J11A AND J11D CATCHMENTS' HYDROLOGICAL CHARACTERISTICS	12
TABLE 8:	CONSTRUCTION PHASE IMPACTS	22
TABLE 9:	OPERATIONAL PHASE IMPACTS	22
TABLE 10:	DE-COMMISSIONING PHASE IMPACTS.....	23
TABLE 11:	NEIGHBOURING RENEWABLE ENERGY PROJECTS COMPARISON.....	24
TABLE 12:	MITIGATION AND MANAGEMENT MEASURES FOR POTENTIAL IMPACTS	28
TABLE 13:	STAKEHOLDER COMMENTS AND QUERIES AND THE ASSOCIATED RESPONSES	29

FIGURES

FIGURE 1:	REGIONAL SETTING OF THE LINEAR TRANSMISSION INTEGRATION SITES IN RELATION TO THE ENTIRE BIOTHERM PROJECT	9
FIGURE 2:	PROPOSED POWERLINE AND SUBSTATION OPTIONS RELATING TO THE MARALLA LINEAR TRANSMISSION INTEGRATION PROJECT.....	10

FIGURE 3:	PROPOSED NEIGHBOURING RENEWABLE ENERGY PROJECTS, REDZ AND EGI	11
FIGURE 4:	LOCATION OF BIOTHERM SITES IN RELATION TO NEW WMA13	
FIGURE 5:	LOCAL HYDROLOGY AND TOPOGRAPHY	14
FIGURE 6:	LOCAL NATURAL VEGETATION	16
FIGURE 7:	LOCAL LAND COVER (LAND USE)	17
FIGURE 8:	LOCAL SOIL LAND TYPE AND SOIL SAMPLING LOCATIONS...	18
FIGURE 9:	LOCAL GENERAL GEOLOGY	19
FIGURE 10:	SENSITIVE AREAS FOR PROPOSED POWERLINES AND SUBSTATIONS.....	21

APPENDICES

A P P E N D I X	A	ENVIRONMENTAL SIGNIFICANCE FOR EACH IMPACT
A P P E N D I X	B	CUMULATIVE IMPACT ASSESSMENT

1 INTRODUCTION

BioTherm Energy (Pty) Ltd (BioTherm) have proposed the development for three renewable energy complexes within the Western Cape Province. As part of the application process for Environmental Authorisation, WSP Environmental (Pty) Ltd (WSP | Parsons Brinckerhoff) was appointed by BioTherm to undertake a Social and Environmental Impact Assessment (SEIA).

The SEIA is divided into two phases, the Scoping Phase and the Environmental Impact Assessment (EIA) Phase. This report will follow from the scoping phase, addressing the freshwater habitat systems (i.e. wetlands and watercourses) located within the project footprint, and providing a high-level assessment of the potential environmental impacts associated with the proposed development.

1.1 OBJECTIVES OF THE REPORT

The objective associated with the assessments include the following:

- Describe the background of the project and contextualise it in the natural environment. This will include identification of freshwater habitat systems located within the project footprint;
- List and assess the potential environmental impacts associated with the proposed project to the environs identified; and
- Conclude the finding of the report, highlighting any significant impacts and their corresponding mitigation and management measures, which should be considered as conditions in the authorisation.

1.2 STUDY APPROACH AND METHODOLOGY

The scope of work covered within this report, which entails freshwater habitat identification, forms part of the process required for BioTherm to apply for an environmental authorisation from the Department of Environmental Affairs (DEA). The study therefore focuses on the identification and assessment of sensitive environments that may be impacted on by the proposed project.

The purpose of this report was to conduct a high level study that identified freshwater habitat systems in the area of the proposed powerline and substation options for the Maralla Linear Transmission Integration project. The potential impacts to the land and freshwater habitat systems were defined at a generic and high level. This entailed a desktop review and site visit from which an initial the scoping report was developed. The desktop review utilised available information at the time, including the following spatial information resources:

- Google Earth Pro;
- Agricultural Geo-Referenced Information System (AGIS);
- National Freshwater Ecosystem Priority Areas (NFEPA);
- The U.S. Geological Survey (USGS);
- The Soil Maps of Africa: European Digital Archive of Soil Maps (EuDASM);
- Hydrological features including rivers and, catchments and water management areas, and
- Existing maps and detailed project information provided by BioTherm which were available at the onset of the project.

Preliminary maps and figures were developed to use during the site visit to verify the information collected during the desktop review, through a ground-truthing exercise.

The site investigation comprised of a three-day site visit conducted between the 1st and 3rd of March 2016. The site assessments entailed a drive through of the properties on which the proposed BioTherm sites viz. Esizayo, Maralla East and Maralla West are located. No in-field investigation occurred in the section of land in between the sites, where the proposed powerline options run. The area covered during the site visit was the operational footprint of the proposed project as well as a 500m boundary buffer. The following tasks were undertaken as part of the site investigation:

- Verification of desktop review information;
- Wetland and riparian zone identification and delineation; and,
- Soil profile characterisation and sample collection, including:
 - Soil depth and profile description (i.e. subjective moisture estimation, effective rooting depth, presence of mottling, gleying, pedocretes and soil structure);
 - Classification of soil form and family based on the Taxonomic Soil Classification System for South Africa (Macvicar, 1991);
 - Permeability based on in-situ estimation and texture properties;
 - Underlying lithology.

A handheld Global Positioning System (GPS) and camera were used in conjunction with the maps produced in the desktop review, to conduct the ground-truthing exercise. The GPS was used to delineate areas as well as verify and mark all relevant points with exact co-ordinates. Representative soil samples were collected using a hand-operated auger, where holes were drilled until the parent material/refusal was reached.

FRESHWATER HABITAT IDENTIFICATION

The freshwater habitat identification for the proposed Maralla Linear Transmission Integration project entailed the following tasks described below:

- Desktop review to establish the baseline environmental conditions and location of wetlands marked in the National Land Cover GIS database for South Africa (SANBI – BGIS) and the National Freshwater Ecosystem Priority Areas (NFEPA);
- Identification of wetlands, based on the Department of Water Affairs and Forestry (DWAF) publication *Updated Manual for the Identification and Delineation of Wetlands and Riparian Areas* (DWAF, 2008); and
- High-level description of the potential impacts on the identified freshwater habitats located within a 500m radius of the proposed Maralla Linear Transmission Integration project footprint.

DELINEATION OF FRESHWATER HABITATS

The identification and delineation of wetland habitat within 500m of the proposed Maralla Linear Transmission Integration project site boundaries initially was undertaken at a desktop level utilising available information, including amongst others topographical maps, current and historical aerial imagery, existing coverages and contour data.

In-field identification of all watercourses (freshwater habitats) in relation to the proposed site was conducted in accordance with the methods contained in the Department of Water and Sanitation's (previously DWAF) manual 'A Practical Field Procedure for Identification and Delineation of Wetland and Riparian Areas'. The freshwater habitats were also classified in accordance with the,

'National Wetland Classification System for Wetlands and other Aquatic Ecosystems in South Africa' document developed by Ollis *et al.* (2013).

There are specific indicators utilised to determine the outer edge of a wetland during the infield investigation: position in landscape, vegetation and soil wetness (determined through soil sampling with a soil auger and the examining the degree of mottling). According to the wetland definition used in the National Water Act, vegetation is the primary indicator, which must be present under normal circumstances. However, in practice the soil wetness indicator tends to be the most important, and the other three indicators are used in a confirmatory role. Like wetlands, riparian areas can be identified using a set of indicators. The indicators for riparian areas are: landscape position; alluvial soils and recently deposited material; topography associated with riparian areas; and vegetation associated with riparian areas.

During the infield investigation, the delineation of the any identified wetlands (on a desktop level) were based on the presence of redoxymorphic soil features, soil form classification and wetland vegetation. The soils were investigated through the use of a hand auger, where the soil was drill to 0.5m or until the parent material/refusal was reached. The assessment of these indicators is described in the section below

IMPACT METHODOLOGICAL FRAMEWORK

The impact valuation uses a methodological framework used by WSP | Parsons Brinckerhoff to meet the combined requirements of international best practice and NEMA, Environmental Impact Assessment Regulations, 2014 (GN No. 982) (the "EIA Regulations"). As required by the EIA Regulations (2014), the determination and assessment of impacts will be based on the following criteria:

- Nature of the Impact;
- Significance of the Impact;
- Consequence of the Impact;
- Extent of the impact;
- Duration of the Impact;
- Probability if the impact;
- Degree to which the impact:
 - can be reversed;
 - may cause irreplaceable loss of resources; and
 - can be avoided, managed or mitigated.

Following international best practice, additional criteria have been included to determine the significant effects. These include the consideration of the following:

- **Magnitude** to what extent environmental resources are going to be affected;
- **Sensitivity** of the resource or receptor (rated as high, medium and low) by considering the importance of the receiving environment (international, national, regional, district and local), rarity of the receiving environment, benefits or services provided by the environmental resources and perception of the resource or receptor); and
- **Severity** of the impact, measured by the importance of the consequences of change (high, medium, low, negligible) by considering inter alia magnitude, duration, intensity, likelihood, frequency and reversibility of the change.

It should be noted that the definitions given are for guidance only, and not all the definitions will apply to all of the environmental receptors and resources being assessed. Impact significance was assessed with and without mitigation measures in place.

Impacts are assessed in terms of the following criteria:

- The nature, a description of what causes the effect, what will be affected and how it will be affected (**Table 1**);
- The physical extent, wherein it is indicated whether the impact is limited to a local scale or a broader scale (**Table 2**);
- The duration, wherein it is indicated whether the lifetime of the impact will be (**Table 3**);
- The magnitude of impact on ecological processes, quantified on a scale from 0-10, where a score is assigned (**Table 4**); and
- The probability of occurrence, which describes the likelihood of the impact actually occurring. Probability is estimated on a scale where (**Table 5**):

Table 1: Nature or Type of Impact

NATURE OR TYPE OF IMPACT	DEFINITION
Beneficial / Positive	An impact that is considered to represent an improvement on the baseline or introduces a positive change.
Adverse / Negative	An impact that is considered to represent an adverse change from the baseline, or introduces a new undesirable factor.
Direct	Impacts that arise directly from activities that form an integral part of the Project (e.g. new infrastructure).
Indirect	Impacts that arise indirectly from activities not explicitly forming part of the Project (e.g. noise changes due to changes in road or rail traffic resulting from the operation of Project).
Secondary	Secondary or induced impacts caused by a change in the Project environment (e.g. employment opportunities created by the supply chain requirements).
Cumulative	Impacts are those impacts arising from the combination of multiple impacts from existing projects, the Project and/or future projects.

Table 2: Physical Extent of Impact

SCORE	DESCRIPTION
1	The impact will be limited to the site.
2	The impact will be limited to the local area.
3	The impact will be limited to the region.
4	The impact will be national.
5	The impact will be international.

Table 3: Duration of Impact

SCORE	DESCRIPTION
1	A very short duration (0 to 1 years).
2	A short duration (2 to 5 years).
3	A medium term (5–15 years).
4	A long term (> 15 years).
5	Permanent.

Table 4: Magnitude of Impact on Ecological Processes

SCORE	DESCRIPTION
0	Small and will have no effect on the environment.

2	Minor and will not result in an impact on processes.
4	Low and will cause a slight impact on processes.
6	Moderate and will result in processes continuing but in a modified way.
8	High (processes are altered to the extent that they temporarily cease).
10	Very high and results in complete destruction of patterns and permanent cessation of processes.

Table 5: Impact Probability of Occurrence

SCORE	DESCRIPTION
1	very improbable (probably will not happen).
2	improbable (some possibility, but low likelihood).
3	probable (distinct possibility).
4	highly probable (most likely).
5	definite (impact will occur regardless of any prevention measures).

- The significance, which is determined through a synthesis of the characteristics described above (refer formula below) and can be assessed as low, medium or high;
- The status, which is described as either positive, negative or neutral;
- The degree to which the impact can be reversed;
- The degree to which the impact may cause irreplaceable loss of resources; and
- The degree to which the impact can be mitigated.

The significance is determined by combining the criteria in the following formula:

$$S = (E + D + M) \times P$$

S = Significance weighting;

E = Extent;

D = Duration;

M = Magnitude, and

P = Probability.

The significance weightings for each potential impact are as follows (**Table 6**):

Table 6: Significance Weightings for Each Impact

OVERALL SCORE	SIGNIFICANCE RATING	DESCRIPTION
< 30 points	Low	where this impact would not have a direct influence on the decision to develop in the area
31-60 points	Medium	where the impact could influence the decision to develop in the area unless it is effectively mitigated
> 60 points	High	where the impact must have an influence on the decision process to develop in the area

The impact significance without mitigation measures will be assessed with the design controls in place. Impacts without mitigation measures in place are not representative of the Project's actual extent of impact, and are included to facilitate understanding of how and why mitigation measures were identified. The residual impact is what remains following the application of mitigation and management measures, and is thus the final level of impact associated with the development of the Project. Residual impacts also serve as the focus of management and monitoring activities during Project implementation to verify that actual impacts are the same as those predicted in this EIA Report.

1.3 ASSUMPTIONS AND LIMITATIONS

The following assumptions and limitations were identified as part of the assessment:

- The various published data sources (i.e. aerial imagery, mapping and previous reports) have been assumed to be accurate at the time of use.
- At the time of the site investigation, the final layout routes of the powerlines and substations was not made available, and as such could not be investigated as part of the site assessment.
- Identification of freshwater habitats in the region of the proposed Maralla Linear Transmission Integration project, was limited to a high level desktop exercise.
- Owing to the extent of the site and accessibility constraints, groundtruthing was only possible in certain areas of the site. Conditions of freshwater habitat in inaccessible areas were therefore inferred based on site observations of accessible habitats.
- The site visit was limited to a 500m radius around the farm properties of the BioTherm sites viz. Esizayo, Maralla East and Maralla West. As such, only the freshwater habitats identified within the 500m radius of the farm property that were accessible by vehicle at the time of the site visit, were investigated.
- The site visit was conducted during the dry season for the region, making it difficult to identify and distinguish any freshwater habitats in the area due to arid nature of the region.

1.4 DECLARATION OF INDEPENDENCE

Bruce Wickham is a Hydrologist with an MSc from the University of KwaZulu-Natal in 2015. He joined WSP | Parsons Brinckerhoff in 2015 and has worked on various soil and wetland related projects. He is registered as a Candidate Natural Scientist – Water Resources Science with the South African Council for Natural Scientific Professions (SACNASP).

Colin Holmes is a Senior Environmental Consultant at WSP | Parsons Brinckerhoff with an MSc in Applied Environmental Science. He has also completed wetland management courses with the University of Free State. He has completed and managed numerous projects relating to wetland and riparian delineations, Present Ecological State and Ecological Importance and Sensitivity assessments, and the compilation of IWWMPs. He is registered with the South African Council for Scientific Professions – Professional Natural Scientist (Environmental Scientist) and is a SETA accredited Carbon Footprint Analyst.

Greg Matthews has 17 years of professional experience and is registered with the South African Council for Scientific Professions – Professional Natural Scientist (Environmental Scientist and Hydrological Scientist). He has been involved in numerous projects associated with the assessment of activities on both soil and water resources.

WSP | Parsons Brinckerhoff has no financial or other interest in the proposed development and will derive no benefits other than fair remuneration for consulting services provided.

I, Greg Matthews, declare that –

- I act as the independent specialist in this application;
- I will perform the work relating to the application in an objective manner, even if this results in views and findings that are not favourable to the applicant;
- I declare that there are no circumstances that may compromise my objectivity in performing such work;

- I have expertise in conducting the specialist report relevant to this application, including knowledge of the Act, regulations and any guidelines that have relevance to the proposed activity;
- I will comply with the Act, regulations and all other applicable legislation;
- I have no, and will not engage in, conflicting interests in undertaking of the activity;
- I undertake to disclose to the applicant and the competent authority all material information in my possession that reasonably has or may have potential of influencing – any decision to be taken with respect to the application by the competent authority; and – the objectivity of any report, plan or document to be prepared by myself for submission to the competent authority;
- All the particulars furnished by me in this form are true and correct; and
- I realise that a false declaration is an offense in terms of regulation 71 and is punishable in terms of section 24F of the Act.

Name: Greg Matthews

Sign:



Date: 09/03/2017

2

DESCRIPTION OF THE PROJECT

The proposed Maralla Linear Transmission Integration project is located within the Western Cape Province, approximately 28 km north-west of the town of Laingsburg (**Figure 1**). Other nearby towns include Matjiesfontein and Sutherland. The sites fall within the Central Karoo District Municipality DC5 and stretches over several farms, occupying a total area of 155km². The Komsberg-Kareendoringkraal” district road off the R354 serves as the primary access route to the Maralla sites (**Figure 1**).

There are two substation location options, one each for Maralla West and East. These substations require to be connected to an Eskom Common Substation (ECS); with the ECS having two locational options. Therefore, there are two powerline options connecting the respective substations to the ECS (**Figure 2**). The proposed powerline and substation options are depicted in **Figure 2**.

This report is primarily focused towards potential activities and impacts associated with the powerlines and substation option proposed for the Maralla Linear Transmission Integration project. The activities and impacts associated with the Maralla sites has been assessed in separate reports. The layout of the proposed powerline and substations for the Maralla Linear Transmission Integration sites is described below.

The electrical energy generated from wind turbines at the Maralla sites (i.e. East and West) will be transferred to an onsite Independent Power producer (IPP) substations via a network of medium voltage cables. There are two alternative on-site IPP substation locations for each site (**Figure 2**). The IPP substation will transfer electrical energy to Eskom’s Komsberg substation via a via a double circuit of 132 kV powerlines (**Figure 2**).

In addition to the proposed BioTherm development, there are several potential wind energy developments earmarked in the surrounding area (**Figure 3**). This area falls within the Komsberg Wind Renewable Energy Development Zone (REDZ). These zones were identified throughout South Africa in a Strategic Environmental Assessment (SEA), as part of the Department of Environmental Affairs Strategic Integrated Project National Infrastructure Plan.

In a separate SEA - Electrical Grid Infrastructure (EGI), national power corridors were delineated for the efficient and effective expansion of the transmission infrastructure throughout South Africa. The location of the BioTherm development, as well as the proposed neighbouring renewable energy projects, are strategically placed to overlap with the REDZs and EGI demarcated zones (**Figure 3**). The neighbouring developments will be factored into the EIA as part of the cumulative impact assessment. These renewable energy developer entities include:

- Mainstream Renewable Power SA (Pty) Ltd;
- Networx Renewables (Pty) Ltd;
- African Clean Energy Developments (Pty) Ltd; and
- G7 Renewable Energies (Pty) Ltd.

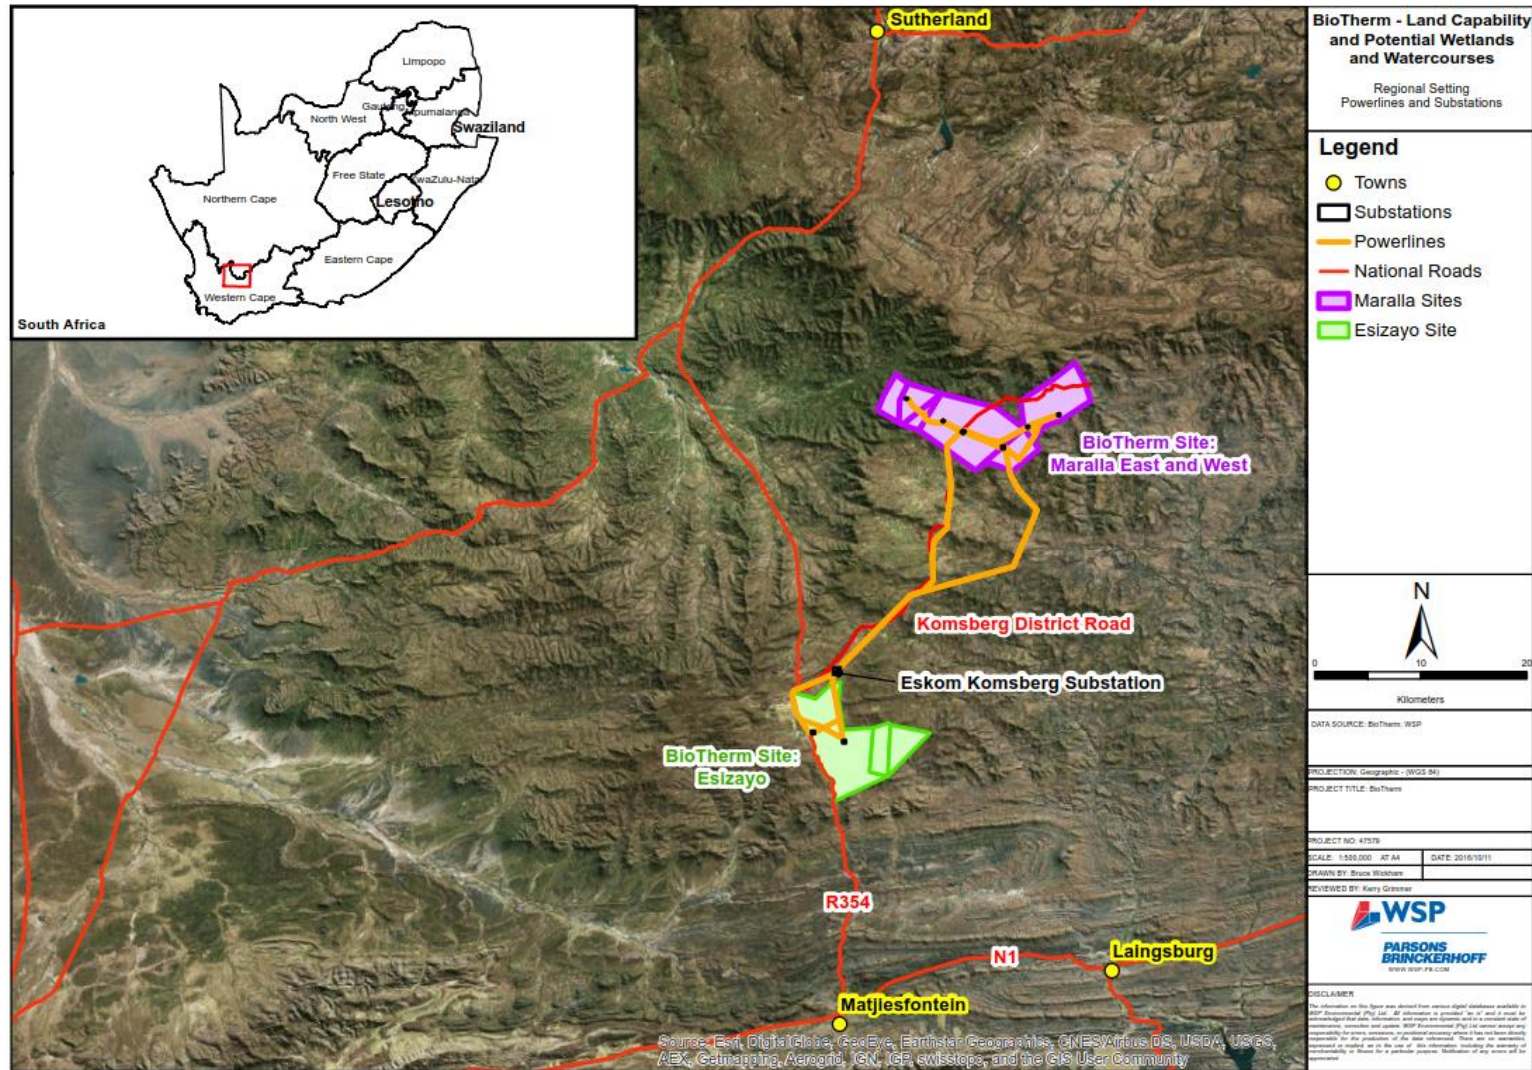


Figure 1: Regional Setting of the Linear Transmission Integration Sites in relation to the entire BioTherm Project

Freshwater Habitat Identification: Maralla Linear Transmission Integration
BioTherm Energy (Pty) Ltd
Public

WSP | Parsons Brinckerhoff
Project No 47579
March 2017

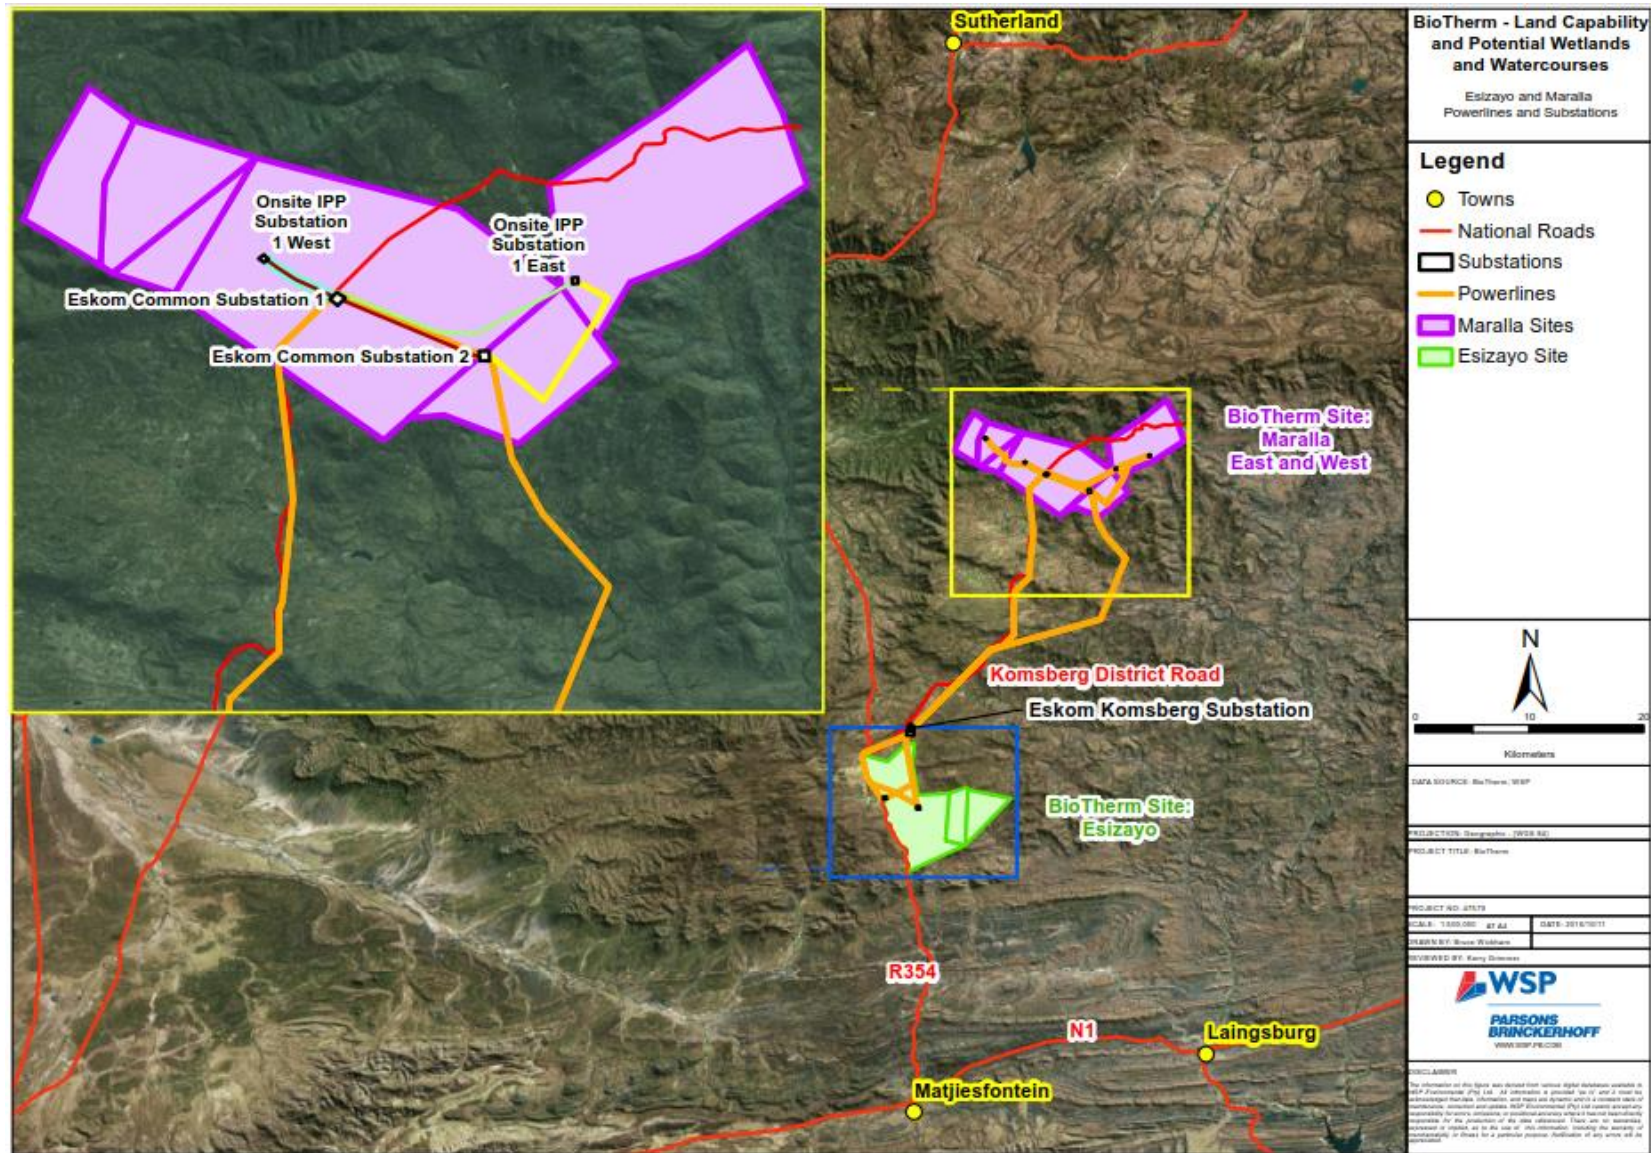


Figure 2: Proposed Powerline and Substation Options relating to the Maralla Linear Transmission Integration Project

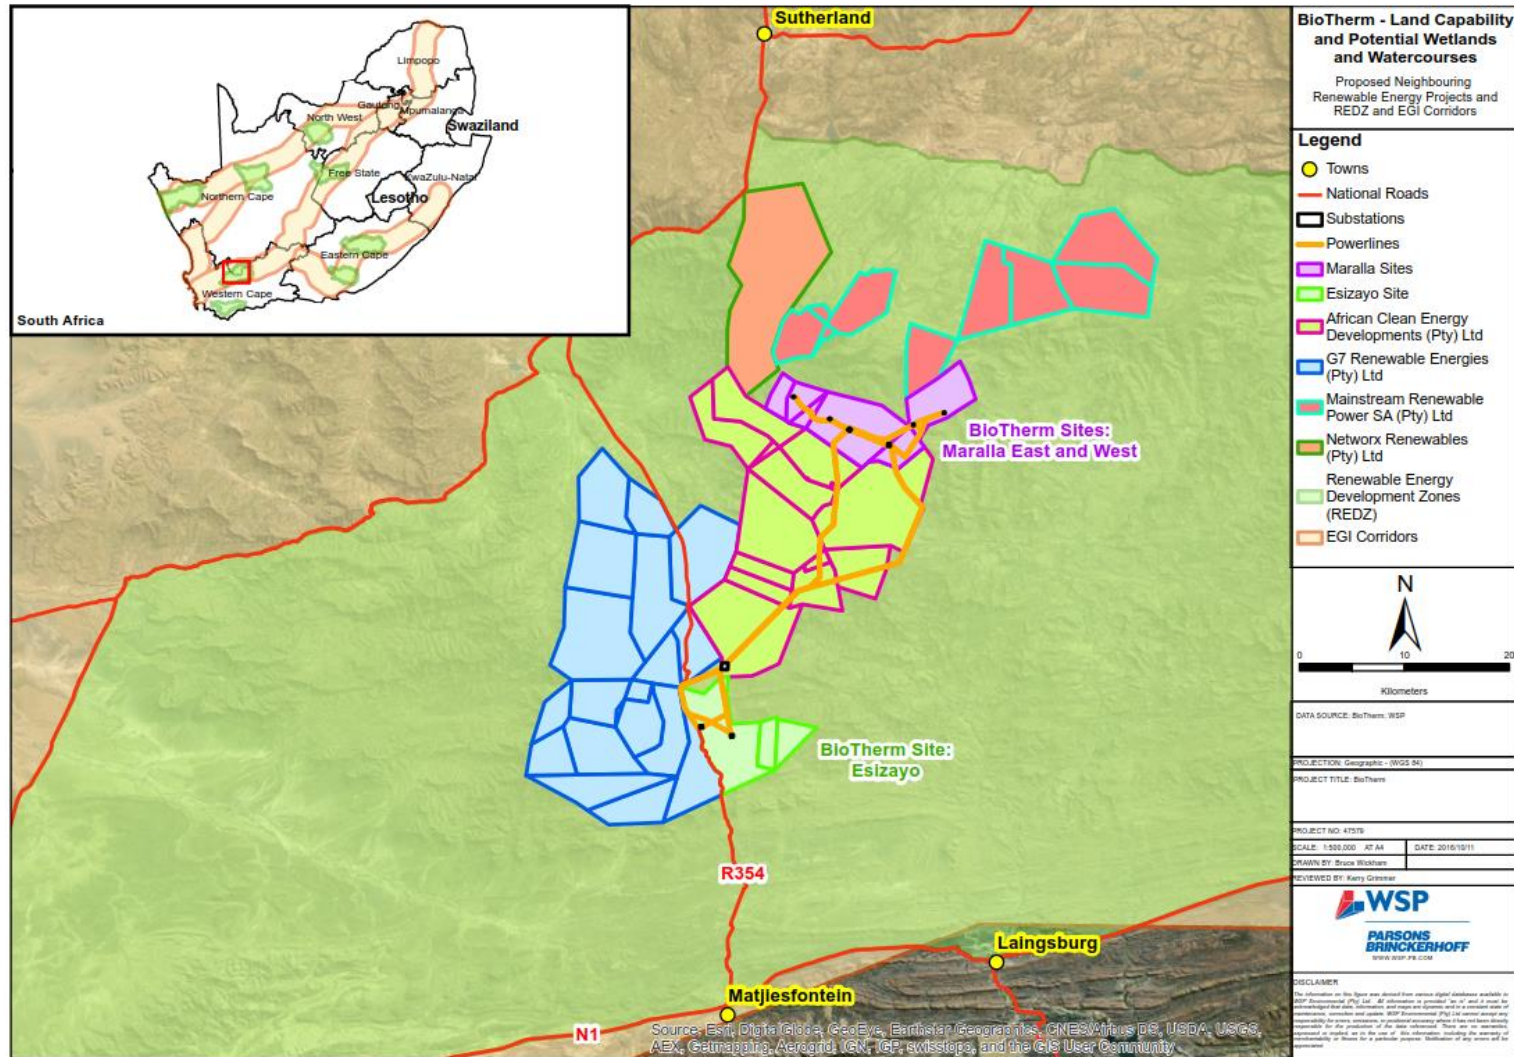


Figure 3: Proposed Neighbouring Renewable Energy Projects, REDZ and EGI

3 DESCRIPTION OF THE AFFECTED ENVIRONMENT

The local natural environment within which the proposed Maralla Linear Transmission Integration project is located is summarised in the following section. This will include the local hydrology, natural vegetation and land use, soil type and characterisation, and a simple geological description. This will serve as basic description of the present natural conditions in the area of the proposed Maralla Linear Transmission Integration project.

3.1 HYDROLOGY

South Africa is divided into nine Water Management Areas (WMAs), where the proposed Maralla Linear Transmission Integration project is situated in the Breede-Gouritz WMA 6 (**Figure 4**). The topography of the area comprises of mountainous hillslopes (part of the Roggeveld Mountain Range) with small patches of open rocky ground in between, and numerous watercourses and drainage channels. The hillslopes have an average gradient of 34.1 % and 1.2% on the open flat ground (**Figure 5**).

The proposed powerlines and substations lie within tertiary catchment J11, quaternary catchments J11A and J11D (**Figure 5**). The J11A and J11D quaternary hydrological characteristics are summarised in **Table 7**, including catchment area, Mean Annual Precipitation (MAP), Mean Annual Evaporation (MAE) and Mean Annual Runoff (MAR). The MAE largely exceeds the MAP, reinforcing the arid conditions of the region.

Table 7: Quaternary J11A and J11D Catchments' Hydrological Characteristics

QUATERNARY	CATCHMENT AREA (km ²)	MAP (mm)	MAE (mm)	MAR (million m ³ /a)
J11A	438	295	1965	5.86
J11D	801	240	2000	5.58

Source: WRC/DWA, 2012

Upon the site visit, there were several watercourses/drainage channels present within the Maralla Linear Transmission Integration site, the main river being the Kamberg which runs through the site (**Figure 5**). However, a majority of the watercourses that were visited within the sites were dry and only the Kamberg River exhibited small pools of water at intermittent section along the watercourse (**Plate 1**). Given the arid climatic condition of the region, majority of the watercourses within the site where the proposed powerline and substation are located, are ephemeral and are likely to only convey water during infrequent high rainfall events.



Figure 4: Location of BioTherm Sites In Relation to New WMA

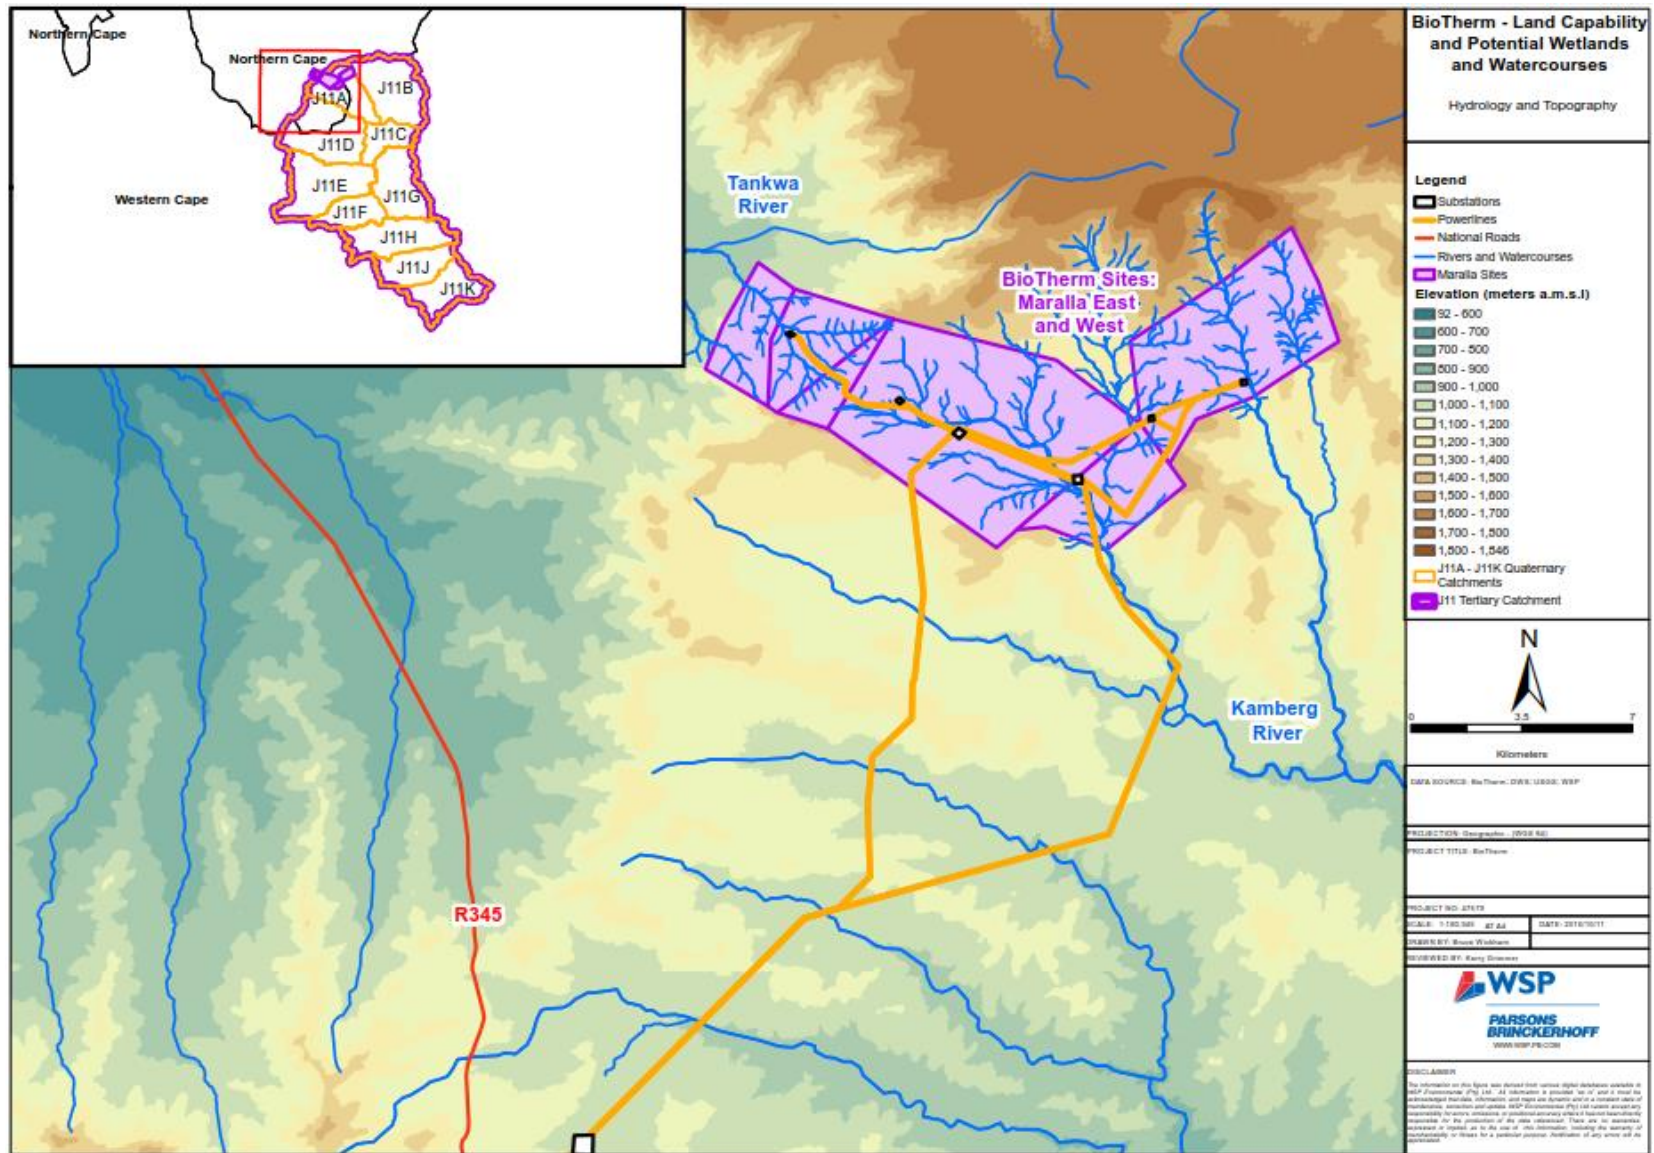


Figure 5: Local Hydrology and Topography

Freshwater Habitat Identification: Maralla Linear Transmission Integration
BioTherm Energy (Pty) Ltd
Public

WSP | Parsons Brinckerhoff
Project No 47579
March 2017

3.2 VEGETATION AND LAND USE

Based on the Mucina and Rutherford (2006) natural vegetation classification map, the majority of the Maralla Linear Transmission Integration site is located within the Central Mountain Shale Renosterveld (**Figure 6**).

The Department of Agriculture, Forestry and Fisheries (DAFF) define the land use in the area, as predominantly Shrubland and Low Fynbos (DAFF, 2012) (**Figure 7**). As shown in **Figure 7**, there are ten (10) freshwater habitats located within a 500 m radius of the proposed powerlines and substations.

Upon the site visit, the vegetation was identified as mostly shrub-like vegetation and Fynbos (**Plate 2**), which is primarily used for sheep grazing. Indigenous antelope (Springbok) were also present in the region.

A portion of the 10 freshwater habitats which are located within the Maralla Sites, most were confirmed to be cultivated (irrigated or dryland) areas and small earth-walled farm dams (**Plate 3** and **Plate 4**) upon the site visit. Furthermore, there were several Depressional Pans which were identified during the site visit for the Esizayo and Maralla Sites (discussed in separate reports), but no pans beyond the site boundaries were identified in field.

Additional land use activities in the region identified during the site walkover included, sheep and small scale crop farming.

3.3 SOILS AND GEOLOGY

Based on the information included in the land type maps of South Africa (AGIS, 2007) the soils in the region of the Maralla Linear Transmission Integration project are mostly as “Glenrosa and/or Misphe forms with lime generally present in the landscape” and “miscellaneous land classes, rocky areas with miscellaneous soils” (**Figure 8**).

The general geological description of the area is based on the 1:1 000 000 geological map for Northern Cape Province, published by the Trigonometrical Survey Office in 1970 (Schifano *et al.*, 1970). The Maralla Linear Transmission Integration project is nested in the Roggeveld Mountains range, in the Larger Cape Fold belt system. The site is located on the Beaufort Series which forms part of the Karoo system (**Figure 8**). The rock type for the series comprises of shale, mudstone, sandstone and limestone (Schifano *et al.*, 1970). Upon the site visit, it was observed that shale and mudstone were the dominant rock type for the area.

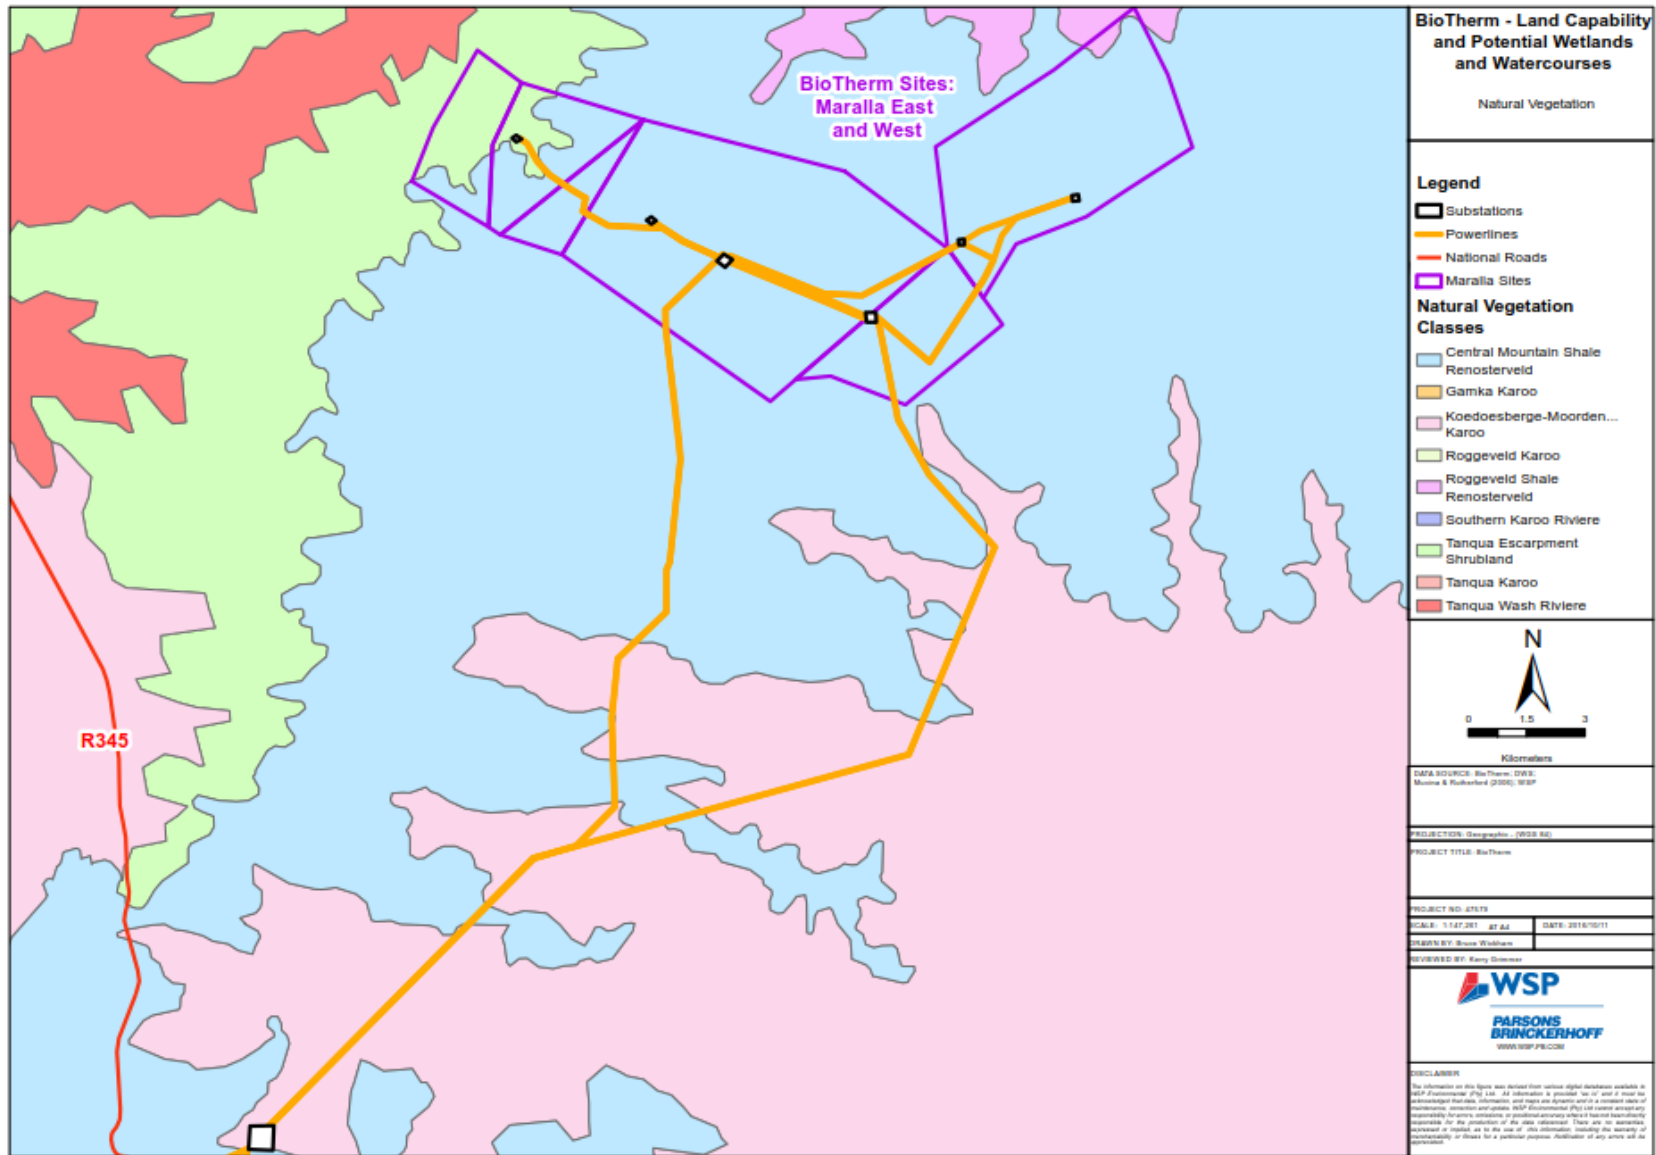


Figure 6: Local Natural Vegetation

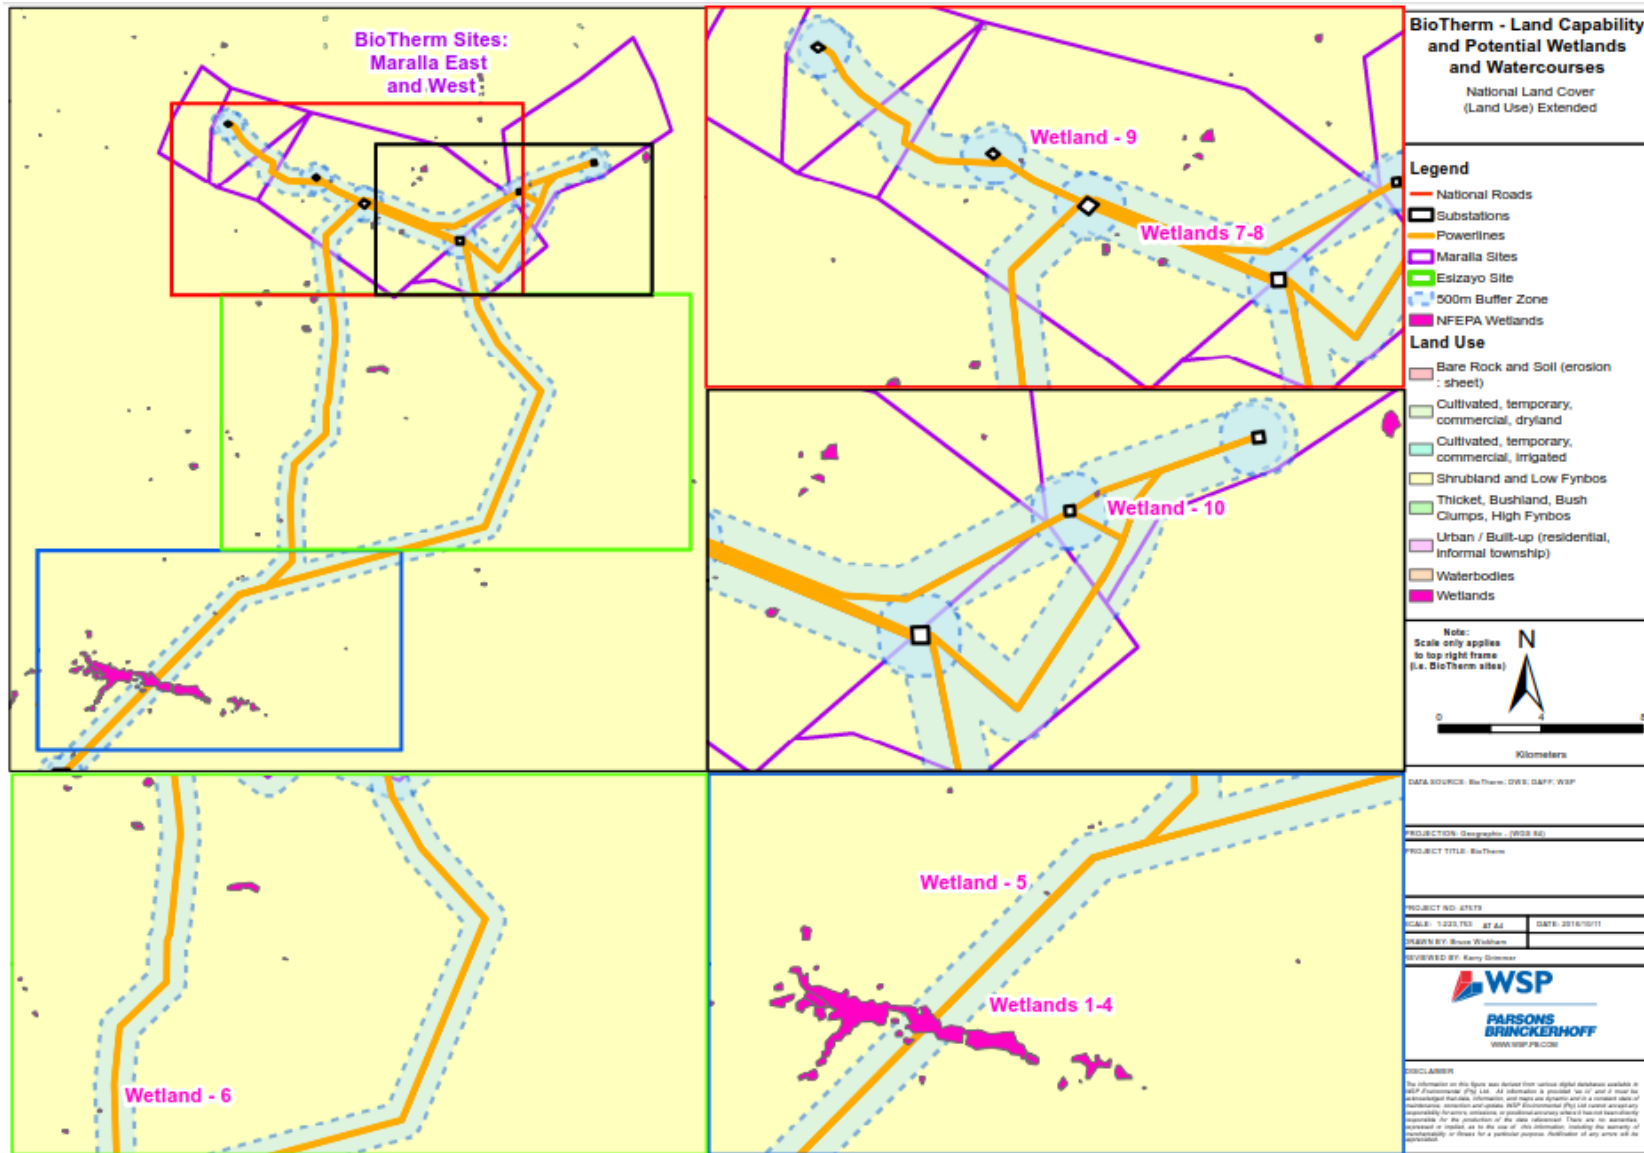


Figure 7: Local Land Cover (Land Use)

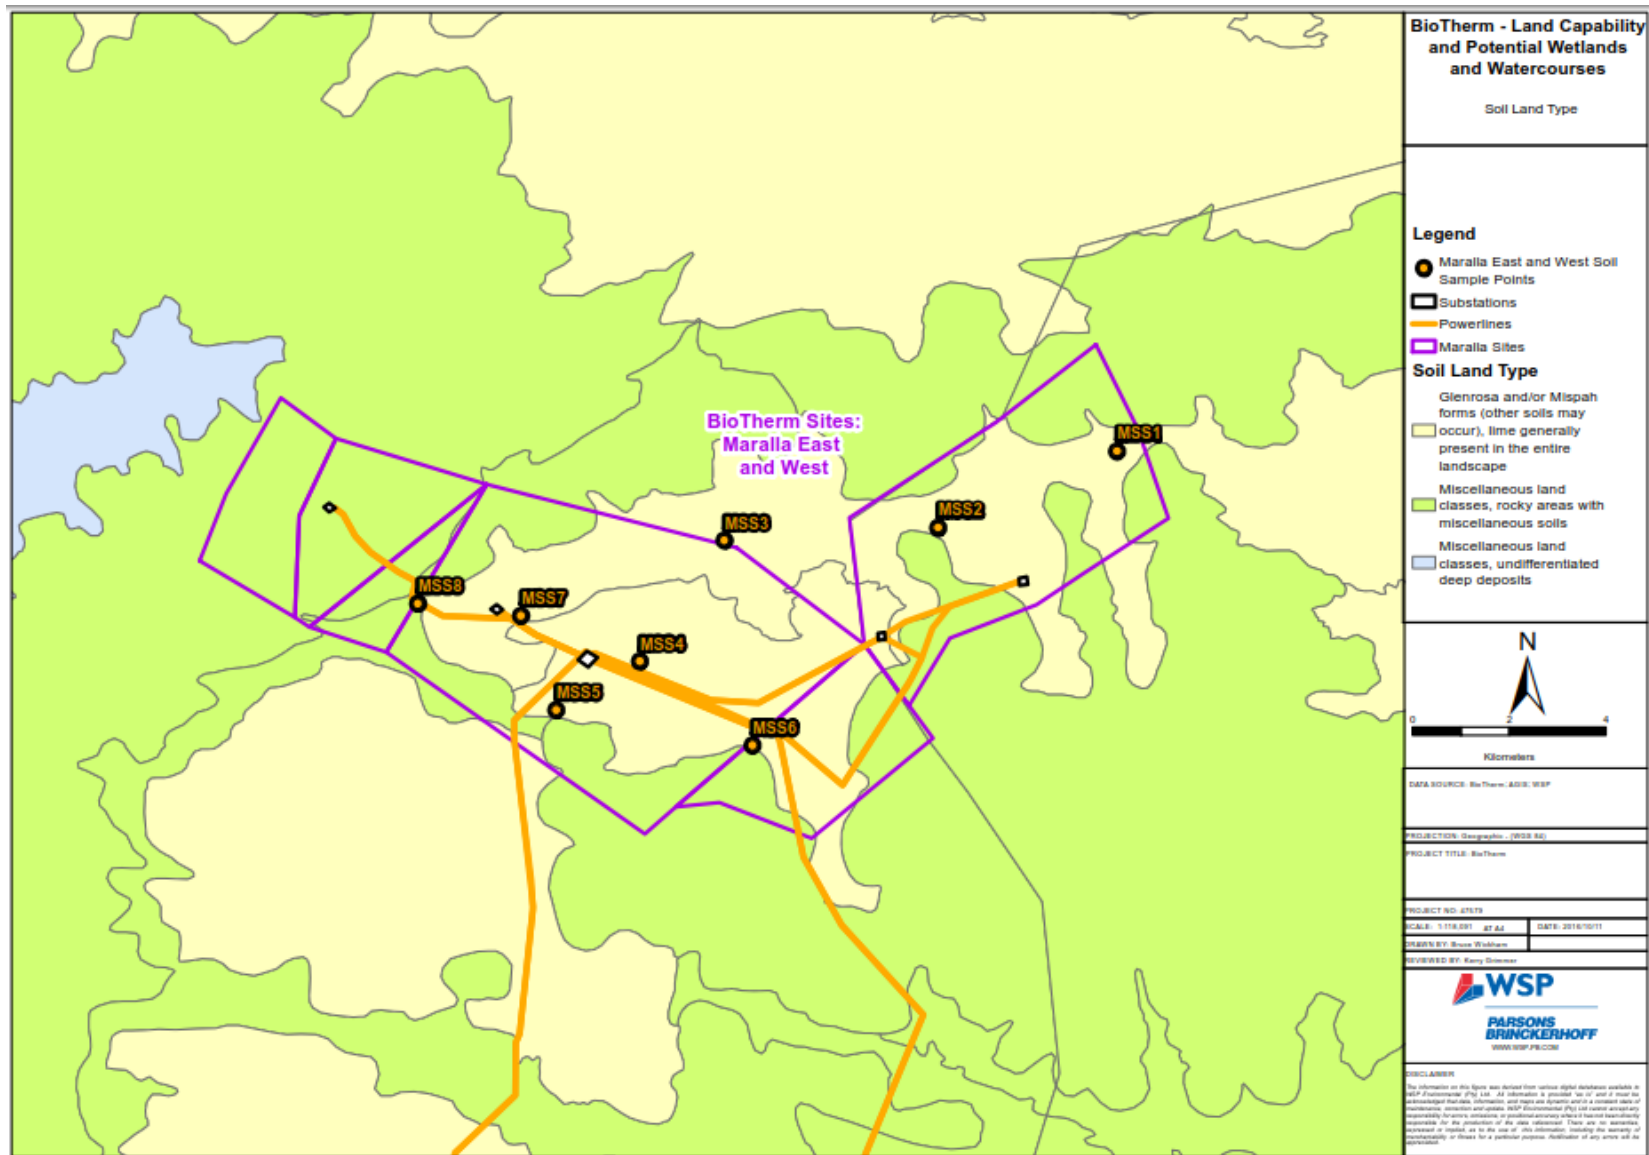


Figure 8: Local Soil land Type and Soil Sampling Locations

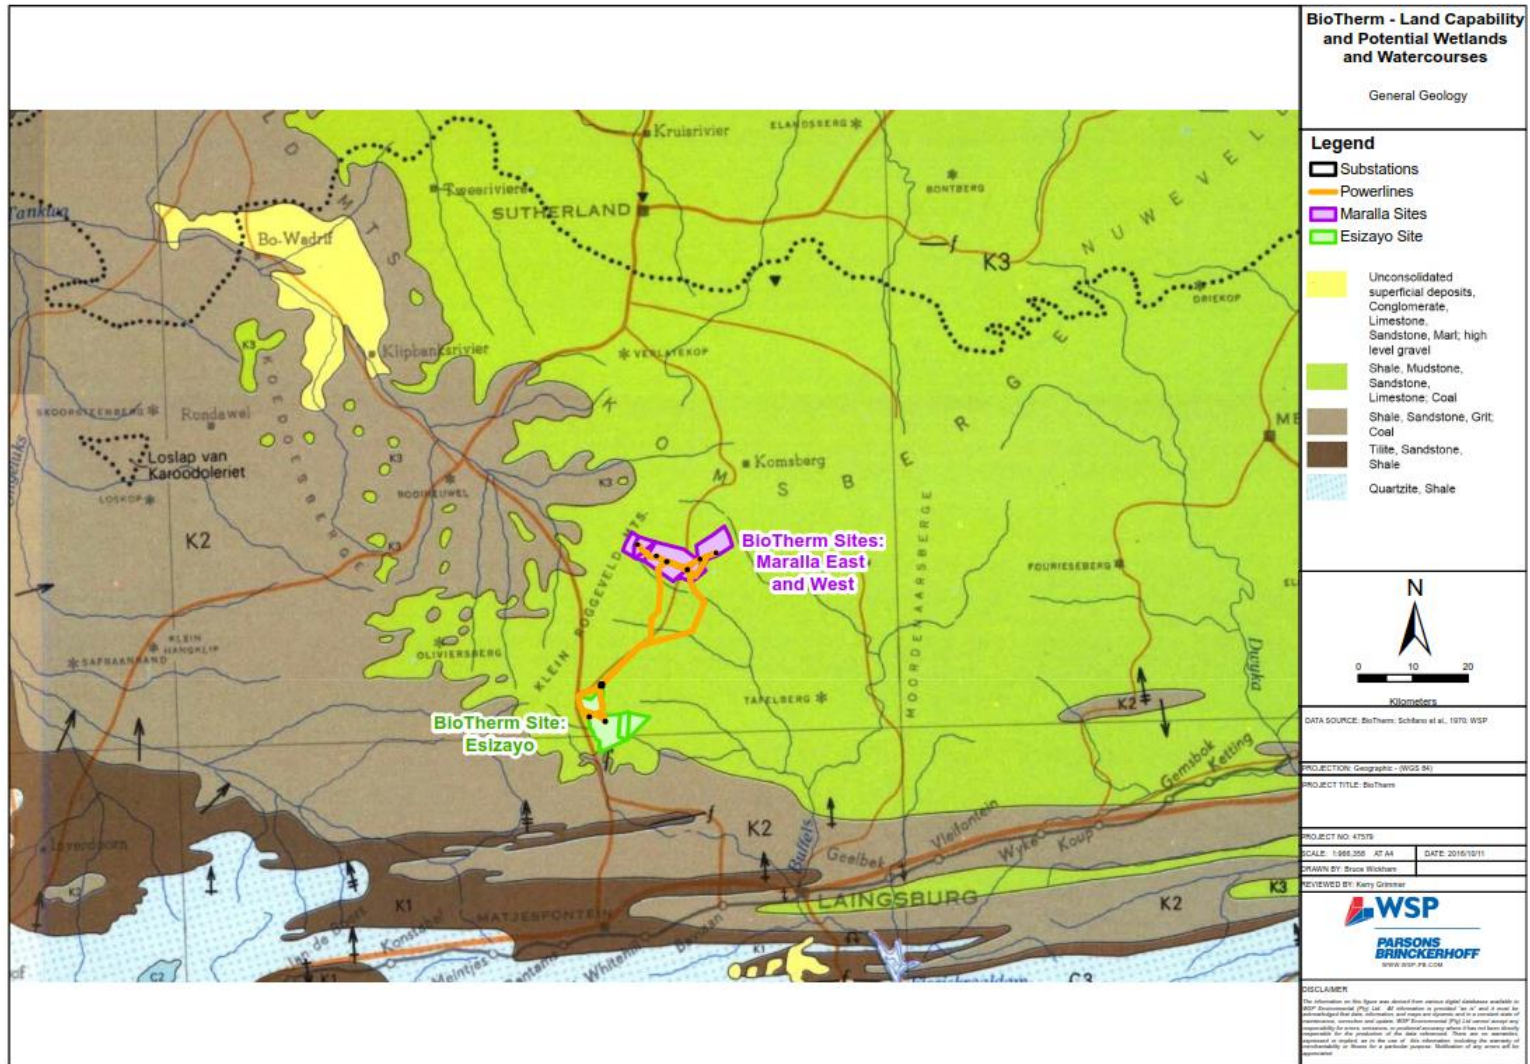


Figure 9: Local General Geology

Freshwater Habitat Identification: Maralla Linear Transmission Integration
 BioTherm Energy (Pty) Ltd
 Public

4 FINDINGS – POWERLINES AND SUBSTATIONS

A wetland is defined as land which is transitional between terrestrial and aquatic systems where the water table is usually at or near the surface, or the land is periodically covered with shallow water, and which land in normal circumstances supports or would support vegetation typically adapted to life in saturated soil (National Water Act, Act 36 of 1998). Riparian habitat includes the physical structure and associated vegetation of the areas associated with a watercourse which are commonly characterised by alluvial soils, and which are inundated or flooded to an extent and with a frequency sufficient to support vegetation of species with a composition and physical structure distinct from those of adjacent land areas.

No infield investigations were performed in the area of land existing in-between the Esizayo and Maralla sites, where the proposed powerline and substation options lie. As such no freshwater habitats can be confirmed at this point in time, other than those which are within the Esizayo and Maralla Wind Turbine sites (these pans are discussed in separate reports). At a desktop level, there are 10 freshwater habitats identified within 500m radius of the proposed Maralla Linear Transmission Integration site (**Figure 10**).

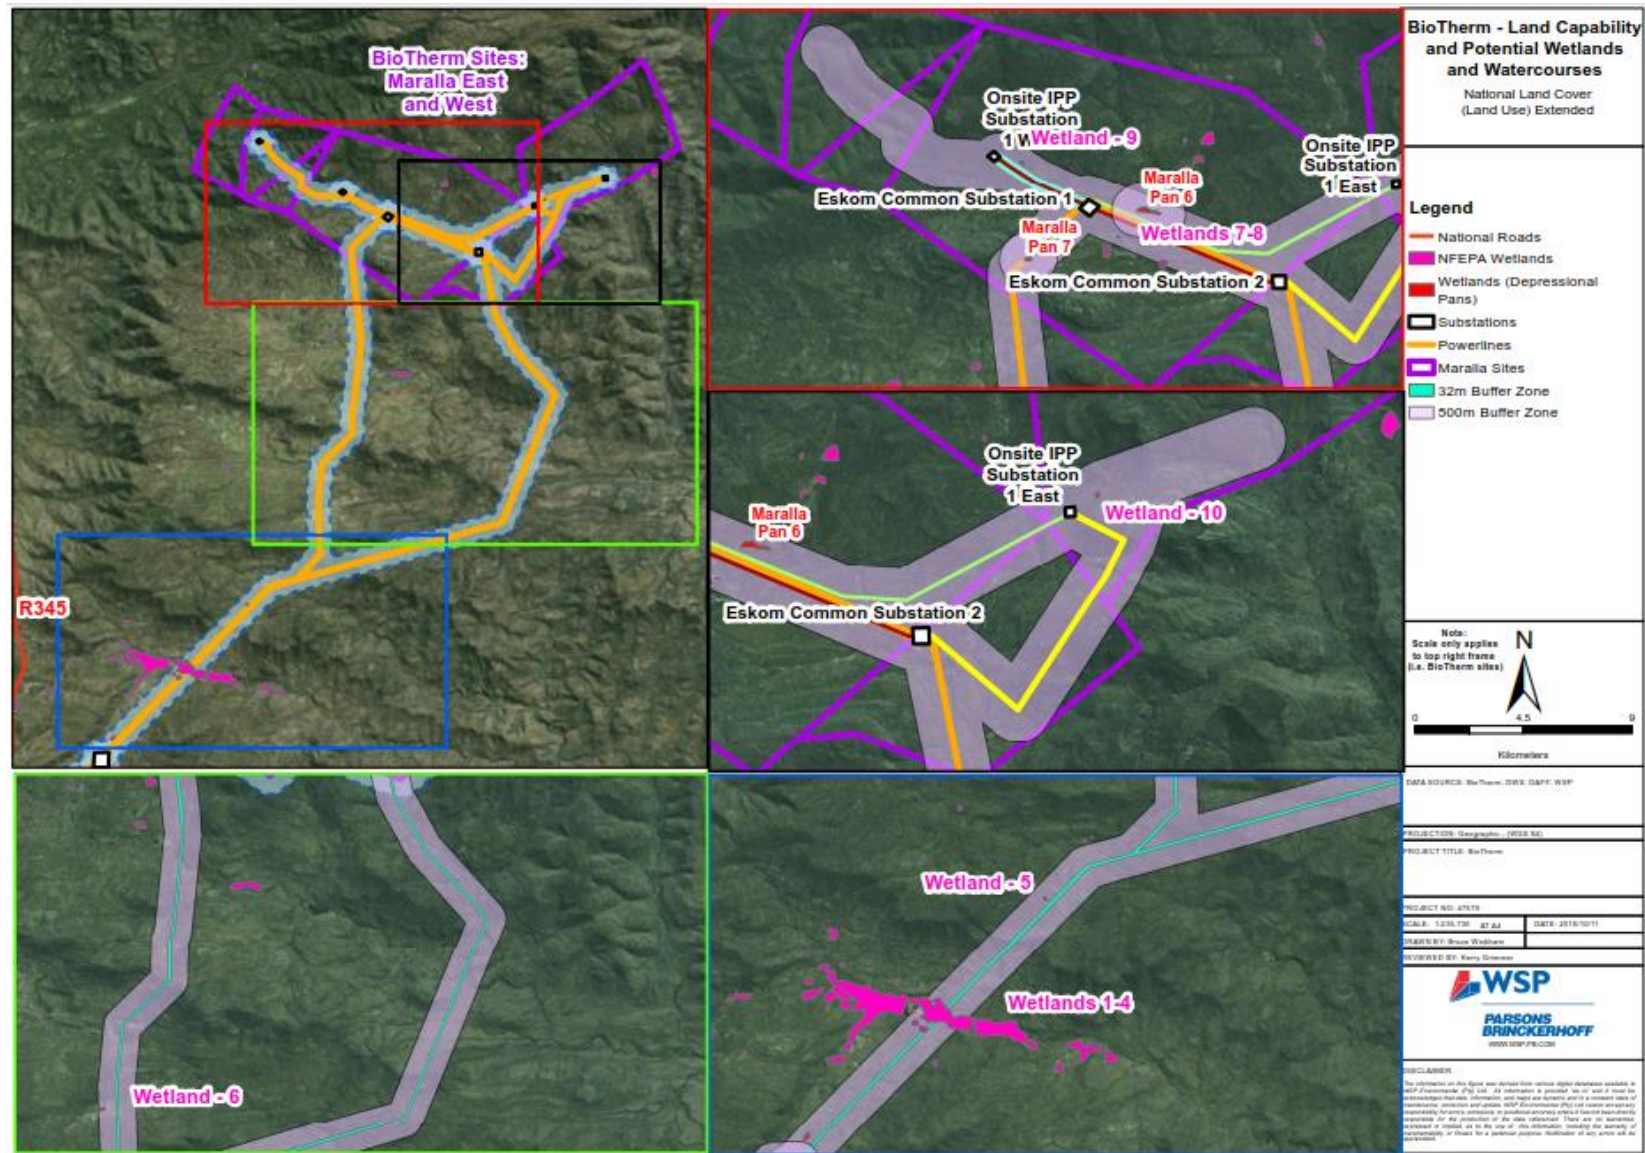


Figure 10: Sensitive Areas for Proposed Powerlines and Substations

5 ASSESSMENT OF IMPACTS

The impacts identified for the proposed Maralla Linear Transmission Integration project are assessed in the section that follows. The methodology for defining the significance of the respective impacts is described in section 1.2 of this report. The impacts will be assessed for the construction, operational and de-commissioning phases of the project.

A cumulative impact assessment was also conducted for the neighbouring BioTherm sites and adjacent renewable energy projects. This section will provide a summary of the findings from the significance rating tables used for each impact. The process for determining the relevant significances of each impact for the various phases of the project is provided in **Appendix A**.

5.1 CONSTRUCTION PHASE

The anticipated impacts for the powerlines and substations during the construction phase of the project are summarised in **Table 8**. The impacts summarised below are relevant to the freshwater habitats identified within the site and 500m radius of the powerlines and substations.

Table 8: Construction Phase Impacts

ACTIVITY	POTENTIAL IMPACT
Site preparation and construction of the powerlines and substations infrastructure.	Loss of aesthetical value of the natural landscape.
	Increased potential of soil erosion due to vegetation clearance, soil disturbance and a high traffic movement on site. Subsequent potential sedimentation of watercourses.
	Potential land contamination from hazardous substances. This includes spillage of concrete onto soil surface, as well as oils, fuel, grease (from construction vehicles) and sewage from temporary on-site ablution facilities.
	Temporary degradation of wetland habitat due to the proposed traversing powerlines and positioning of pylons.
	Alien Invasive and pioneer vegetation recruitment may be potential impact that is exacerbated in areas with channel beds and banks disturbance.

There are no fatal flaws identified for the construction phase associated with the proposed Maralla Linear Transmission Integration project, other than the potential impact to NFEPA wetlands located within 500m radius of the proposed infrastructure. Potential impacts of soil erosion and spillage of hazardous substances were both classified with a low environmental significance, before and after mitigation measures, due to the lower probability of significant erosion or spills occurring.

5.2 OPERATIONAL PHASE

The anticipated impacts for the powerlines and substations during the operational phase of the project are summarised in **Table 9**. The impacts summarised below are relevant to the freshwater habitats identified within the site and 500m radius of the powerlines and substations.

Table 9: Operational Phase Impacts

ACTIVITY	POTENTIAL IMPACT
Day-to-day operational activities during the normal functioning of the powerlines and substations,	Loss of aesthetical value of the natural landscape.
	Increased potential of soil erosion due to vegetation clearance, and more run-off from harden surfaces (i.e. roads). Subsequent potential sedimentation of watercourses.
	Potential land contamination from hazardous substances. This includes spillage of oils, fuel, grease (from site operational and maintenance vehicles) and permanent onsite sewage systems.

including maintenance.	Permanent degradation of wetland habitat due to the proposed traversing powerlines and positioning of pylons.
------------------------	---

Similar to the construction phase, there were no fatal flaws identified during this phase of the project, other than the potential impact to NFEPA wetlands located within 500m radius of the proposed infrastructure. The other negative impacts of potential soil erosion and spillage of hazardous substances were assigned a low environmental significance before and after mitigation measures, due to the majority of the risk/impact being isolated to the construction phase (therefore short term) and the lower probability of significant erosion or spills occurring.

5.3 DECOMMISSIONING PHASE

The anticipated impacts for the powerlines and substations during the operational phase of the project are summarised in **Table 10**. The impacts summarised below are relevant to freshwater habitats located within a 500m radius of the powerlines and substations.

Table 10: De-commissioning Phase Impacts

ACTIVITY	POTENTIAL IMPACT
De-commissioning of the powerlines and substations.	Increased potential of soil erosion due to removal of wind turbine infrastructure, soil disturbance and a high traffic movement on site.
	Alterations of flow regimes of watercourses, in close proximity to the site, or where the road accesses traverse watercourses.
	Potential land contamination from hazardous substances. This includes spillage of oils, fuel, grease (from construction vehicles) and sewage from on-site systems.

The decommissioning phase exhibited the lowest environmental significance rating scores for the associated impacts of the proposed Maralla Linear Transmission Integration project. There were no fatal flaws identified during this phase of the project, other than the potential impact to NFEPA wetlands located within 500m radius of the proposed infrastructure. The potential for soil erosion and spillage of hazardous substances were classified as a low environmental significance rating before and after mitigation measures.

5.4 CUMULATIVE IMPACTS

There are a number of Environmental Authorisations (EA) (either issued or in process) in the area surrounding the Proposed Project site. It must be stressed that the fact that there are several approved EA surrounding the site does not equate to actual 'development'. The surrounding projects, except for the Preferred Bidders, are still subject to the Renewable Energy Independent Power Producer Procurement Programme (REIPPPP) bidding process like the Maralla Linear Transmission Integration project.

In addition to the Esizayo and Maralla sites (including linear), four separate proposed renewable energy projects located within a 100 km radius from the centroid of the BioTherm sites (**Figure 2**). The footprint of all the BioTherm sites and the proposed neighbouring projects spread over several watercourses in the region. While an in-field site walkover in all these neighbouring projects is beyond the scope of this report, a high level desktop assessment was performed, counting the number of watercourses (mostly ephemeral) and wetlands that intersect the proposed footprint of the neighbouring projects. The desktop review of the proposed neighbouring projects (Including BioTherm sites) is summarised in **Table 11**.

The renewable energy projects that have received Environmental Authorisation were investigated to determine any identified potential impacts on freshwater habitats. These individual impacts were tabulated and assigned a significance rating (Low to High) which allowed for the cumulative assessment of these impacts on the landscape. Overall the cumulative impact of the proposed Maralla Linear Transmission Integration site is deemed to be of 'Low' significance (**Appendix B**).

Table 11: Neighbouring Renewable Energy Projects Comparison

ENERGY ENTITY	RENEWABLE ENERGY TECHNOLOGY	FOOTPRINT (KM ²)	NO. OF WATER COURSES INTERSECTIONS	NFEPA WETLANDS INTERSECTIONS (INC. 500M RADIUS)	PARENT FARM PROPERTIES	TOWNS INTERSECTED
Esizayo	Wind	61.0	4	8	→ Aurora 285 → Aanstoot 1/72 → Joseph's Kraal 84	None
BioTherm Maralla East	Wind	42.32	3	6	→ RE/180 Drie Roode Heuvels → RE/204 Schalkwykskraa → RE/268 Welgemoed	None
BioTherm Maralla West	Wind	51.62	5	11	→ RE/180 Drie Roode Heuvels → RE/181 Annex Drie Roode Heuvels → 1/182 Wolven Hoek → 2/182 Wolven Hoek	None
Networx Renewables (Pty) Ltd	Unknown	118.00	4	60	→ Brand Hoek 176 → De Kruis 153	None
Mainstream Renewable Power SA (Pty) Ltd	Unknown	199.12	5	82	→ 1/178 Van Wyks Kraal → 2/178 Van Wyks Kraal → 6/152 Tonteldoosfontein → 1/152 Tonteldoosfontein → 1/179 Schietfontein	None
African Clean Energy Developments (Pty) Ltd	Unknown	332.28	5	58	→ Zwanepoelshoek 184 → Leeuwe Hoek 183 → Orange Fontein 185 → Orangie Fontein 203 → 2/203 Orangie Fontein → 3/203 Orangie Fontein → 4/203 Orangie Fontein → Kentucky 206 → 1/207 Volvenkop → De Hoop 202 → Rheeboeke Fontein 209	None

ENERGY ENTITY	RENEWABLE ENERGY TECHNOLOGY	FOOTPRINT (KM ²)	NO. OF WATER COURSES INTERSECTIONS	NFEPA WETLANDS INTERSECTIONS (INC. 500M RADIUS)	PARENT FARM PROPERTIES	TOWNS INTERSECTED
					<ul style="list-style-type: none"> → 1/209 Rheebokke Fontein → Standvastigheid 210 	
G7 Renewable Energies (Pty) Ltd	Unknown	449.83	9	77	<ul style="list-style-type: none"> → RE/188 Wilgebosch Rivier → RE/200 Karree Bosch → Appels Fontein 201 → Ek Kraal 199 → Klipbanks Fontein 198 → Riet Fontein 197 → Bon Espirange 73 → Fortuin 74 → RE/284 → Hartjies Kraal 77 → Barendskraal 76 → Brandvalley 75 → Kabeltouw 160 	None

The proposed Maralla Linear Site (and associated infrastructure) as well as the neighbouring renewable energy developments potentially intersect freshwater habitat systems. The turbines for the Maralla Linear Site are not located within watercourses, within only a few access roads potentially requiring to traverse ephemeral watercourses. Each of these crossings should not have a regional impact on water resources therefore limiting the cumulative impact on the greater landscape. There was no fatal flaw identified for the cumulative impacts for the proposed Maralla Linear Site. The assessment of these potentially affected ecological features within the four neighbouring renewable energy developments is beyond the scope of this study, and will require an individual assessment for the respective projects in their own scoping and EIA studies. It is assumed that the impacts during the construction, operational and de-commissioning phases are expected to be the same as those summarised above for the Maralla Linear Site.

Potential impacts of soil erosion and spillage of hazardous substances were both classified with a low environmental significance, before and after mitigation measures, due to the majority of the risk/impact being isolated to the construction phase (therefore short term) and the lower probability of significant erosion or spills occurring.

5.5 OPTIONS ANALYSIS

There are two substation location options, each with two powerline route options linking to an ECS (which itself has two options) (**Figure 2**). The operational impacts of these substations and powerline routes are not significantly different from one another in terms of impacts on high-level freshwater habitats (assuming that this infrastructure is not positioned within a freshwater habitat). The major impacts will then be associated with the construction and decommissioning phases which will result in physical disturbance of the environment. The options analysis is based on limiting the environmental impact on freshwater habitats. In terms of freshwater habitats, it comes to location in relation to these habitats and the potential hydrological alterations.

The servitude between the ECS Option 1 and 2 (where majority of the identified wetlands are located) would be utilised under any powerline/substation combination and therefore there is no preferred route possible in terms of minimising the environmental impact. If a preferred ECS is determined, then the powerline options would be automatically determined. However, this would then determine the route for the main powerlines to the main Eskom Komsberg Substation. Each option requires the crossing of freshwater systems will no one option significantly crossing less systems.

As stated above, all the options impact freshwater systems and the area as whole is considered homogenous. Therefore, all options have a potential to negatively impact the surrounding environment and no one option is significantly preferred over the other. However, this is based on the current findings within this report and with the inclusion of an aquatic specialist during the design phase, freshwater habitats may be identified, favouring other options that may have less of an impact on specific systems.

6 MITIGATION AND MANAGEMENT MEASURES

The potential impacts identified in Section 5 of this report, have been assessed with and without mitigation and management measures. These mitigation and management measures are summarised in **Table 12**, for the construction, operation and decommissioning phases of the project.

The same mitigation and management measures are proposed for the cumulative impacts identified in the previous section, however the responsible person may differ according to the renewable energy project developer.

In addition, an aquatic specialist should be present onsite before the site preparation phase of construction to conduct an in-depth site walkover prior to any site work to assess the area for any freshwater habitats which may be affected by the actions conducted during the construction phase.

7 STAKEHOLDER CONSULTATION

7.1 STAKEHOLDER CONSULTATION PROCESS

Public participation is a requirement of the S&EIR process; it consists of a series of inclusive and culturally appropriate interactions aimed at providing stakeholders with opportunities to express their views, so that these can be considered and incorporated into the S&EIR decision-making process. Effective public participation requires the prior disclosure of relevant and adequate project information to enable stakeholders to understand the risks, impacts, and opportunities of the Proposed Project.

A comprehensive stakeholder consultation process was undertaken during the scoping phase. Stakeholders were identified through existing databases, site notices, newspaper adverts and meetings. All stakeholders identified to date have been registered on the project database. All concerns, comments, viewpoints and questions (collectively referred to as 'issues') received to date have been documented and responded to in a Comment and Response Report.

There will be ongoing communication between WSP | Parsons Brinckerhoff and stakeholders throughout the S&EIR process.

7.2 STAKEHOLDER COMMENTS AND RESPONSE

The stakeholder's queries and comments to the Draft Environmental Scoping Report, relating to Freshwater Habitats, have been responded to in **Table 13** below.

Table 12: Mitigation and Management Measures for Potential Impacts

ACTIVITY	MITIGATION AND MANAGEMENT MEASURE	RESPONSIBLE PERSON	APPLICABLE DEVELOPMENT PHASE	INCLUDE AS CONDITION OF AUTHORISATION	MONITORING REQUIREMENTS
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Construction of the powerlines and associated infrastructure (e.g. access roads and cables) should, where feasibly possible, occur during the dry season and the site rehabilitated before major rainfall events occur. Access roads and cables must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised. Regular inspections during operation are required to ensure the structural integrity of the roads and cables. These crossings (and infrastructure located within 500m of a wetland) have a potential of requiring a Water Use Licence in terms of the National Water Act.	Site construction managers (BioTherm contractors); SHEQ representative.	Construction and Operational	Yes – all requirements of Section 21 of the NWA must be compiled with, resulting in the potential need for a water use licence application where a more in-depth freshwater habitat assessment will be required.	A freshwater habitat specialist must conduct an in-depth site walkover prior to the construction phase commencing to assess the area for any freshwater habitats which may be affected by the actions conducted during the construction phase (e.g. road construction, trenching, etc.). Any identified systems must be visibly demarcated.
Increased potential for soil erosion due to vegetation clearance, soil disturbance and high traffic movement on site.	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil compaction, and limited to existing or proposed roadways where practical. Soils excavated during construction of the facility should be appropriately stored in stockpiles which are protected from erosion (i.e. through use of vegetation cover in the case of long-term stockpiles- this should form part of the rehabilitation process after the construction phase). Wind erosion is dominant for the region. Water erosion action is considered limited, however backfilling with soil and use of gabions or Reno Mattresses should be used where evidence of erosion is present.	Site construction managers (BioTherm contractors)	Construction, Operational and Decommissioning	No – activity has been assigned a low environmental significance during the construction phase	A site compliance audit should be conducted (1) prior to construction, (2) during construction on a monthly basis and (3) after rehabilitation measures have been implemented.
Potential spillage of hazardous substances such as oils, fuel, grease from construction and operational vehicles, and sewage from on-site sanitation systems	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper upkeep of machinery and vehicles.	Site construction managers (BioTherm contractors)	Construction, Operational and Decommissioning	No – activity has been assigned a low environmental significance during the construction, operational and decommissioning phases	A site compliance audit should be conducted (1) prior to construction, (2) during construction on a monthly basis and (3) after rehabilitation measures have been implemented.
Degradation of wetland habitat due to the proposed traversing powerlines and positioning of pylons	Should BioTherm be recognised as a Preferred Bidder, the required application for a Water Use Licence (WUL) in terms of Section 21 of the National Water Act (NWA) (Act 36 of 1998) may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the powerlines. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site. Therefore, a more in-depth and thorough freshwater functional assessment should be conducted should BioTherm be recognised as a Preferred Bidder. The detailed freshwater habitat assessment must provide recommendations in terms of placement of the powerlines and pylons in relation to freshwater habitats.	Site construction managers (BioTherm contractors) and onsite specialist	Design, Construction and Decommissioning	Yes – all requirements of Section 21 of the NWA must be compiled with, resulting in the potential need for a water use licence application where a more in-depth freshwater habitat assessment will be required.	A freshwater habitat specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. powerline construction).
Alien Invasive and pioneer vegetation recruitment may be potential impact that is exacerbated in areas with channel beds and banks disturbance.	Once invasive species become established and spread, it can be extraordinarily difficult and costly to control or eradicate them. It is recommended that an effective mechanism to prevent their introduction in the first place be created. A monitoring system for detecting new infestations may also be created and rapid movements towards eradicating newly detected invaders should be made.	Site construction managers (BioTherm contractors)	Construction	No – activity has been assigned a low environmental significance during the construction.	A monitoring plan should be set and a site compliance audit should be conducted prior to construction.

Table 13: Stakeholder Comments and Queries and the associated Responses

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
<p>Colin Fordham (Scientific Services – Cape Nature) 17 October 2016</p>	<p>CapeNature agrees with the Draft Scoping Reports that a Freshwater Habitat Impact Assessment (wetland) report, should be compiled. This report must accurately delineate the extent of any freshwater resources and determine the impact that both WEFs would have on the surrounding freshwater ecosystems. Suggested Terms of Reference for this study include (but are not limited to):</p> <ul style="list-style-type: none"> → Accurate wetland or riparian system delineation and characterisation as per DWAF (2008). All WEF infrastructure and development footprints should be overlaid on this map to accurately determine the impact the WEF would have on the freshwater resources. Suitable buffers should be also being delineated and illustrated. → In line with DWS (2014) guidelines the specialist must determine the Present Ecological State (PES) and Ecological Importance and Sensitivity (EIS) of impacted systems, which will in turn determine the DWS Recommended Ecological Category (REC) → Identification, prediction and description of the potential impacts of that the proposed WEFs would have on the delineated wetland/riparian areas and the significance of these impacts (qualitative assessment), must be determined. → Mitigation measures for the abovementioned identified impacts must be stated and rehabilitation measures proposed should decommissioning take place 	<ul style="list-style-type: none"> → This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required application for a Water Use Licence (WUL) in terms of Section 21 of the National Water Act (NWA) (Act 36 of 1998) may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted should BioTherm be recognised as a Preferred Bidder. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site. Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. road construction). → The potential impacts to the land and freshwater habitat systems were defined at a generic and high level. This entailed a desktop review and site visit from which an initial the scoping report was developed. → Mitigative measures are presented within this report. Further site-specific mitigative measures must be included in the abovementioned full functional assessment.
<p>Adri La Meyer Western Cape Department of Environmental Affairs and Development Planning (WC DEADP)</p>	<p>Aquatic impacts and mitigation</p> <ul style="list-style-type: none"> → The proposed development site includes a key drainage feature namely the Roggeveld River which has been identified as vulnerable to any form of disturbance and development impact (Todd, May2016). This Directorate recommends the establishment of an appropriate ecological and hydrological buffer. which will prevent any potential impacts on the system. 	<ul style="list-style-type: none"> → This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required WULA in terms of NWA may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
17 October 2016	<ul style="list-style-type: none"> → The EIA phase should include an appropriate specialist assessment of the impacts on the aquatic feature or system and other potential impacts on the drainage lines, wetlands and riparian zones on the development site. → The final layout should be informed by the findings of the aforementioned assessment in such a way that it limits the impact on the receiving aquatic environment and delineate watercourses and wetlands, including river crossing, as far as possible. → The physical removal of riparian zones and disturbance to any alluvial watercourses and wetlands should be avoided. → This Directorate supports the use of existing roads regardless if these cross any wetlands to minimise the scale of any potential impacts due to activities that are associated with the proposed development. → This Directorate does not support any transmission line towers, substations or construction camps within the delineated watercourses and associated buffers. → Any potential impacts on the sub-surface drainage lines, as a result of cut and fill activities should be firstly avoided by sound placement of the proposed wind turbines or be minimised through a conservative design and layout approach which takes due cognisance of the site specific biophysical attributes, as well as the broad-scale ecological environment (e.g. corridor connectivity). 	<p>should BioTherm be recognised as a Preferred Bidder. Appropriate buffers for the identified systems must then form part of the in-depth assessment report. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems. Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. road construction).</p> <ul style="list-style-type: none"> → Agreed, as far as possible physical removal of riparian zones and disturbance to any alluvial watercourses and wetlands must be avoided. → Agreed, as far as possible the existing road network must be utilised. → Noted. → Noted, the abovementioned detailed freshwater habitat assessment must provide recommendations in terms of placement of the wind turbines (and associated infrastructure) in relation to freshwater habitats.
<p>Ms Mmamohale Kabasa Department of Environmental Affairs 13 October 2016</p>	<p>It is noted that the property is affected by numerous watercourses and NFEPA wetlands, and that activities that may trigger Section 19 and Section 21 of the National Water Act No. 36 of 1998 were applied for/included in the application form. Please note that a separate hydrological impact assessment must be conducted to assess the impacts of the proposed development on the surface hydrology of the area. The terms of reference for the study must include, inter alia the following:</p> <ul style="list-style-type: none"> → Identification and sensitivity rating of all surface water courses for the impact phase of the proposed development; 	<ul style="list-style-type: none"> → This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required WULA in terms of NWA may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted should BioTherm be recognised as a Preferred Bidder. Appropriate buffers for the identified systems must then form part of the in-depth assessment

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
	<p>→ Identification, assessment of all potential impacts to the water courses and suggestion of mitigation measures; and,</p> <p>Recommendations on the preferred placement of the parabolic troughs and all associated infrastructure and preference must be provided to the avoidance of the watercourses on the property.</p>	<p>report. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems. Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. road construction).</p> <p>→ Noted, the abovementioned detailed freshwater habitat assessment must provide recommendations in terms of placement of the parabolic troughs and all associated infrastructure in relation to freshwater habitats. It must be noted that parabolic troughs are associated with solar renewable energy and not wind.</p>
<p>Mr Sabelo Malaza Department of Environmental Affairs 24 November 2016</p>	<p>It is noted that the property is affected by numerous watercourses and NFEPA wetlands and that activities, which may trigger Section 19 and Section 21 of the National Water Act No. 36 of 1998, were applied for/included in the application form. Please note that a separate hydrological impact assessment must be conducted to assess the impacts of the proposed development on surface hydrology of the area. The terms of reference of the study must include, inter alia, the following:</p> <p>→ Identification and sensitivity rating of all surface water courses for the impact phase of the proposed development;</p> <p>→ Identification, assessment of all potential impacts to the water courses and suggestion of mitigation measures; and,</p> <p>Recommendations on the preferred placement of the parabolic troughs and all associated infrastructure and preference must be provided to the avoidance of the watercourses on the property.</p>	<p>→ This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required WULA in terms of NWA may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted should BioTherm be recognised as a Preferred Bidder. Appropriate buffers for the identified systems must then form part of the in-depth assessment report. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems. Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. road construction).</p> <p>→ Noted, the abovementioned detailed freshwater habitat assessment must provide recommendations in terms of placement of the parabolic troughs and all associated infrastructure in relation to freshwater habitats. It must be noted that parabolic troughs are associated with solar renewable energy and not wind.</p>

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
<p>C Schwartz Department of Water and Sanitation Northern Cape Region (Lower Orange Water Management Area) 25 October 2016</p>	<ul style="list-style-type: none"> → The Department takes note of the proposed activity and therefore provides the following comments: → Any spillage of any hazardous materials including diesel that may occur during construction and operation must be reported immediately to this Department. → Damaging the beds and banks of a water course has been identified as one of the characteristic flow of a watercourse is identified as a water use by the National Water Act and carrying out of such activity will need a Water Use Licence Application in terms of the above-mentioned act. → Stormwater must be diverted from the construction works and roads and must be managed in such a manner as to disperse runoff and to prevent the concentration of stormwater flow. → Please indicate where the water that will be used for construction purposes will be sourced from. 	<ul style="list-style-type: none"> → Noted. → Noted. Spill response has been addressed within the site-specific EMP. It is specified that all major spills are reported to the DWS immediately. A representative onsite must be trained in the use of the spill kit stop, contain and remove contamination, to prevent further pollution of the environment. → Agreed. It is understood that if BioTherm become the preferred bidder then the Water Use Licence Application (WULA) process will proceed. This will then require a full functional assessment (i.e. PES, EIS and EcoServices) of the freshwater habitats that may potentially be impacted upon by the proposed development. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems. → Stormwater management and erosion control have been addressed within this report and the site-specific EMP. A stormwater management plan must be compiled and approved by DWS. → The source of water will be from the local municipality and trucked in using water bowsers. Should the need arise to use water from the site urgently for workers, it will be sourced from the nearest farmer.
<p>Phakamani Buthelezi Breede-Gouritz Catchment Management Agency (BGCMA) 18 November 2016</p>	<ul style="list-style-type: none"> → No operation is allowed within 100m of a water resource or 1:100 year floodline whichever is the greatest. If the proposed activity falls within these criteria, you need to apply for water use licence to ensure that the riparian ecological status of the water resource will not be negatively impacted. → Refer to page 117 of your report. The crossing of watercourses constitutes a Water use Authorisation in terms of section 21 of the National Water Act (NWA) 1998 (Act No. 36 of 1996). Please submit a Water Use License application to this Agency. → Please note that no water maybe abstracted from any surface water body and groundwater unless authorised by this Agency. 	<ul style="list-style-type: none"> → This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required WULA in terms of NWA may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted should BioTherm be recognised as a Preferred Bidder. Appropriate buffers for the identified systems must then form part of the in-depth assessment report which will require flood line information. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems (including the 1:100 flood line). Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
	<ul style="list-style-type: none"> → Please note that any development within 500m from the boundary of any wetland requires a water use license according to this Department's regulations → No surface, ground or stormwater may be polluted as a result of any activities on site. → The rehabilitation of the site must ensure that this final conditions of the site is environmentally acceptable and that there will be no adverse long term effects on the surrounding environment especially the water resources. → If the rehabilitation of the site includes the storage of water authorisation will be required before any water is stored. → Please note that all requirements as stipulated in the National Water Act (NWA) 1998 (Act No 36 of 1998) must be adhered to. → Please note that this Agency reserves the right to amend and/or add to the comments made above in the light of subsequent information received. 	<p>the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase.</p> <ul style="list-style-type: none"> → Noted. → The source of water will be from the local municipality and trucked in using water bowsers. Should the need arise to use water from the site urgently for workers, it will be sourced from the nearest farmer. → Noted. Hence the study site included looking at a 500m radius of the site. This will also have to be taken into consideration during the in-depth functional assessment mentioned above. → Noted. Mitigative measures are presented within this report. Further site-specific mitigative measures must be included in the abovementioned full functional assessment. → Noted. The rehabilitation must be monitored by a suitably qualified specialist to ensure it is successful. Any storage triggering the need for a WUL in terms of Section 21(b) of NWA must be included in the WULA. → Noted. → Noted.
<p>Mr Sabelo Malaza Department of Environmental Affairs 1st December 2016</p>	<p>It is noted that the property is affected by numerous watercourses and NFEPA wetlands and that activities, which may trigger Section 19 and Section 21 of the National Water Act No. 36 of 1998, were applied for/included in the application form. Please note that a separate hydrological impact assessment must be conducted to assess the impacts of the proposed development on surface hydrology of the area. The terms of reference of the study must include, inter alia, the following:</p> <ul style="list-style-type: none"> → Identification and sensitivity rating of all surface water courses for the impact phase of the proposed development; → Identification, assessment of all potential impacts to the water courses and suggestion of mitigation measures; and, → Recommendations on the preferred placement of the parabolic troughs and all associated infrastructure and 	<ul style="list-style-type: none"> → This report provides an initial high-level identification of freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required WULA in terms of NWA may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, a recommendation within this freshwater identification report (Section 8) is a more in-depth and thorough freshwater functional assessment be conducted should BioTherm be recognised as a Preferred Bidder. Appropriate buffers for the identified systems must then form part of the in-depth assessment report. At this stage design details should be available allowing the freshwater specialist to assess specific areas within the site and determine proximity of the structures to freshwater systems. Another recommendation is that the freshwater specialist be present onsite during the construction phase of the project, and conduct an in-depth site walkover prior to any site work to assess

STAKEHOLDER DETAILS	COMMENT	SPECIALIST RESPONSE
	<p>preference must be provided to the avoidance of the watercourses on the property.</p>	<p>the area for any wetlands and watercourses which may be affected by the actions conducted during the construction phase (e.g. road construction).</p> <p>→ Noted, the abovementioned detailed freshwater habitat assessment must provide recommendations in terms of placement of the associated infrastructure in relation to freshwater habitats. It must be noted that parabolic troughs are associated with solar renewable energy and not wind.</p>

8

CONCLUSION

There were several freshwater habitats located within a 500m radius of the proposed powerlines and substations. These habitats need to be investigated infield and confirmed, and should be given consideration before the construction phase of the project commences.

There are no fatal flaws anticipated for the proposed Maralla Linear Transmission Integration project, from a freshwater habitat perspective (assuming that the proposed wind facility infrastructure takes into account the identified freshwater habitats). It is recommended that the mitigation and management measures outlined in this report be followed throughout all phases of the project.

Indirect impacts of increased soil erosion are expected at the site given the dry environment of the region. Furthermore, spillage of hazardous substances onto the land as a result of the activities of the Maralla Linear Transmission Integration project, is a possibility. However, all these potential impacts were classified with a low environmental significance risk, should the appropriate mitigation measure be followed during the construction, operational and decommissioning phases of the project.

This report provides an initial high-level identification and description of the freshwater habitat systems within the site boundary. This is due to the extent of the site, accessibility constraints and lack of information relating to the positioning of operational and road infrastructure. Should BioTherm be recognised as a Preferred Bidder, the required application for a Water Use Licence (WUL) in terms of Section 21 of the National Water Act (NWA) (Act 36 of 1998) may commence. This application (WULA) will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected. Therefore, it is recommended that a more in-depth and thorough study be conducted by an aquatic specialist should BioTherm be recognised as a Preferred Bidder.

It is also recommended that an aquatic specialist must conduct an in-depth site walkover prior to the construction phase commencing, after the proposed construction footprint has been confirmed and demarcated. This is to assess the footprint for any freshwater habitats, allowing for slight alterations in the footprint, to prevent any impacts on the freshwater habitats due to the actions conducted during the construction phase.

9

PLATES

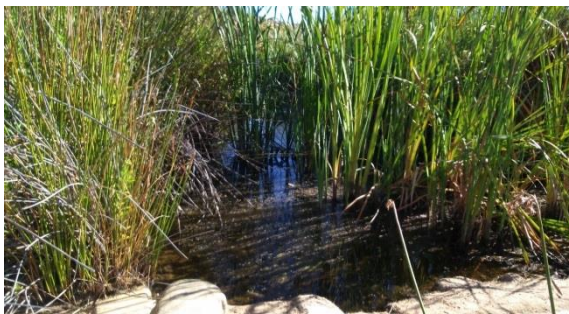


Plate 1: Ephemeral main watercourse



Plate 2 : Natural vegetation with grazing sheep



Plate 3: Irrigated cultivated grazing land



Plate 4: Earth-wall dam with water

10 REFERENCES

- AGIS. (2007). AGIS Agricultural Geo-Referenced Information System. Retrieved March 10, 2016, from AGIS Agricultural Geo-Referenced Information System Web site: <http://www.agis.agric.za/agisweb/agis.html>.
- DWAF (2008). Updated Manual for the Identification and Delineation of Wetlands and Riparian Areas, prepared by M. Rountree, A. L. Batchelor, J. MacKenzie and D. Hoare. Stream Flow Reduction Activities, Department of Water Affairs and Forestry, Pretoria, South Africa.
- Macvicar, C. N. (1991). Soil Classification: A Taxonomic System for South Africa. Pretoria: Department of Agricultural Development.
- Mucina, L., & Rutherford, M. C. (2006). The vegetation of South Africa, Lesotho, and Swaziland. *Strelitzia* 19. Pretoria: South African National Biodiversity Institute.
- Ollis, D., Snaddon, K., Job, N. and Mbona, N. 2013. Classification System for Wetlands and other Aquatic Ecosystems in South Africa. Pretoria. South African National Biodiversity Institute.
- Schifano, G., Eeden van, O. R., & Coertze, F. J. (1970). The Soil Maps of Africa: European Digital Archive of Soil Maps - EuDASM. Retrieved March 7, 2016, from The Soil Maps of Africa: European digital archive of soil maps - EuDASM Web site: http://eusoiils.jrc.ec.europa.eu/esdb_archive/EuDASM/Africa/maps/afr_za2003_4toge.htm
- The Local Government Handbook. Retrieved May 2016, from The Local Government Handbook website: <http://www.municipalities.co.za/provinces/view/7/northern-cape>.
- USGS U.S Geological Survey. (2009). USGS. Retrieved March 10, 2016, from USGS Website: <http://www.usgs.gov/>.
- WSP. 2016. Water Assessment Report for The Letsoai Solar Facilities Letsoai CSP Site 1. Project: BioTherm, Project No. 47579, Report Number: R03.

Appendix A

ENVIRONMENTAL SIGNIFICANCE FOR EACH IMPACT

BioTherm Energy - Maralla Powerline (Wetland)

{insert specialist filed here}

Significance Rating Table

Construction Phase									
Powerline Alternative 1 (Substation 1, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	4	32	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
	With Mitigation	1	2	2	2	10	Low	-	Medium
	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium

Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of bunding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Temporary degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	4	4	32	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							
	With Mitigation	1	2	4	3	21	Low		
Powerline Alternative 2 (Substation 1, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	4	32	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium

Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Temporary degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	6	5	50	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							
	With Mitigation	1	2	4	3	21	Low		
Powerline Alternative 3 (Substation 2, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	4	32	Medium	-	Medium

Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Temporary degradation of wetland/riparian habitat due to the	Nature of impact:	Direct							
	Without Mitigation	2	2	4	4	32	Medium		
	degree to which impact can be reversed:	High							

proposedproposed positioning of the powerlines and pylons	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							
	With Mitigation	1	2	4	3	21	Low		
Powerline Alternative 4 (Substation 2, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	4	40	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
	With Mitigation								
Potential spillage of hazardous substances such as oils, fuel, grease from	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							

as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Temporary degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							
	With Mitigation	1	2	4	3	21	Low		
Eskom Common Substation Alternative 1									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	4	40	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							

traffic movement on site, resulting in a higher potential for soil erosion	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
	With Mitigation								
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
With Mitigation	1	2	0	1	3	Low	-	Medium	
Temporary degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							
With Mitigation	1	2	4	3	21	Low			
Eskom Common Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site or	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	4	40	Medium	-	Medium
	degree to which impact can be reversed:	High							

proximity to the site, or that is proposed to be traversed.	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Construction of the powerlines should occur during the dry season and the site rehabilitated before major rainfall events occur. Powerlines must only cross perpendicular to a watercourse and the chosen alignment must							
	With Mitigation	2	2	2	3	18	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
With Mitigation									
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
With Mitigation	1	2	0	1	3	Low	-	Medium	
Temporary degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing the							

	With Mitigation	1	2	4	3	21	Low		
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Powerline - No-Go

Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							

	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Substation Alternative 1									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Loss of land (including wetlands) previously used for sheep and antelope grazing will be occupied by the powerline and substation infrastructure	Nature of impact:	Direct							
	Without Mitigation	2	2	4	5	40	Medium	-	Medium
	degree to which impact can be reversed:	Low							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum.							
	With Mitigation	1	2	2	4	20	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:								
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							

	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of bunding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								

	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Loss of land (including wetlands) previously used for sheep and antelope	Nature of impact:	Direct							
	Without Mitigation	2	2	4	5	40	Medium	-	Medium
	degree to which impact can be reversed:	Low							

grazing will be occupied by the powerline and substation infrastructure	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum.							
	With Mitigation	1	2	2	4	20	Low	-	Medium
Construction activities will entail vegetation clearance, soil disturbance and high traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of construction should be (where practical) limited to the extent of the project footprint, and activities outside should be kept to a minimum. Traffic of construction vehicles should be kept to a minimum to reduce soil							
With Mitigation	1	2	2	2	10	Low	-	Medium	
Potential spillage of hazardous substances such as oils, fuel, grease from construction vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
With Mitigation	1	2	0	1	3	Low	-	Medium	
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							

	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Substation - No-Go

Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

BioTherm Energy - Maralla Powerline (Wetland)

{insert specialist filed here}

Significance Rating Table

Operational Phase									
Powerline Alternative 1 (Substation 1, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	5	4	4	44	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Medium

Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Medium
Powerline Alternative 2 (Substation 1, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	5	8	4	60	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							

	With Mitigation	1	4	2	2	14	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Medium
Permanent degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing							
	With Mitigation	1	2	4	3	21	Low		
Powerline Alternative 3 (Substation 2, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	5	4	4	44	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							

	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	3	21	Low	-	Medium
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Powerline Alternative 4 (Substation 2, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site or	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	5	8	4	60	Medium	-	Medium
	degree to which impact can be reversed:	High							

proximity to the site, or that is proposed to be traversed.	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of bunding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Medium
Permanent degradation of wetland/riparian habitat due to the proposed positioning of the	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							

powerlines and pylons	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing								
	With Mitigation	1	2	4	3	21	Low			
Eskom Common Substation Alternative 1										
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence		
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect								
	Without Mitigation	2	5	8	4	60	Medium	-	Medium	
	degree to which impact can be reversed:	High								
	degree of impact on irreplaceable resources:	Low								
	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be								
	With Mitigation	2	1	2	2	10	Low	-	Medium	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect								
	Without Mitigation	2	4	4	3	30	Low	-	Medium	
	degree to which impact can be reversed:	High								
	degree of impact on irreplaceable resources:	Low								
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to								
	With Mitigation	1	4	2	2	14	Low	-	Medium	
Potential spillage of hazardous substances such as oils, fuel, grease from	Nature of impact:	Indirect								
	Without Mitigation	2	4	2	2	16	Low	-	Medium	
	degree to which impact can be reversed:	High								

maintenance vehicles, and sewage from on-site sanitation systems	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Medium
Permanent degradation of wetland/riparian habitat due to the proposed proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing							
	With Mitigation	1	2	4	3	21	Low		
Eskom Common Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	5	8	4	60	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerlines must only cross perpendicular to a watercourse and the chosen alignment must endeavour that the span across the watercourse is minimalised to restrict the number of pylons within a system (which should be							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Vegetation cleared for	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium

vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Medium
Permanent degradation of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct							
	Without Mitigation	2	2	8	5	60	Medium		
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing							
With Mitigation	1	2	4	3	21	Low			
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	With Mitigation							

	Mitigation Measures							
	With Mitigation							
Powerline - No-Go								
Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Substation Alternative 1									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Loss of land (including wetlands) previously used for sheep and antelope grazing will be occupied by the powerline and substation infrastructure	Nature of impact:	Direct							
	Without Mitigation	2	4	4	5	50	Medium	-	Medium
	degree to which impact can be reversed:	Low							
	degree of impact on irreplaceable resources:	Low							
Mitigation Measures	Powerline and substation Infrastructure should be limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum.								

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							

	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Loss of land (including wetlands) previously used for sheep and antelope grazing will be occupied by the powerline and substation infrastructure	Nature of impact:	Direct							
	Without Mitigation	2	4	4	5	50	Medium	-	Medium
	degree to which impact can be reversed:	Low							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerline and substation Infrastructure should be limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum.							
	With Mitigation	1	4	2	3	21	Low	-	Medium
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Medium
	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Medium

Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	degree to which impact can be reversed:	High						
	degree of impact on irreplaceable resources:	Low						
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and						
	With Mitigation	1	4	0	1	5	Low	-
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
Substation - No-Go								
Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	With Mitigation							

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

BioTherm Energy - Maralla Powerline (Wetland)

{insert specialist filed here}

Significance Rating Table

Decommissioning Phase									
Powerline Alternative 1 (Substation 1, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
	Nature of impact:	Direct and Indirect							

Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Without Mitigation	2	2	4	4	32	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Temporary/ Permanent degradation of wetland/riparian habitat due to the proposed traversing powerlines	Nature of impact:	Direct							
	Without Mitigation	2	3	4	4	36	Medium	-	
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	
Powerline Alternative 2 (Substation 1, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
With Mitigation	1	2	2	2	10	Low	-	Medium	
	Nature of impact:	Indirect							

Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	3	6	5	55	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Temporary/ Permanent degradation of wetland/riparian habitat due to the proposed traversing powerlines	Nature of impact:	Direct							
	Without Mitigation	2	3	6	5	55	Medium	-	
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	
Powerline Alternative 3 (Substation 2, Option 1)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
	Nature of impact:	Direct and Indirect							

Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
With Mitigation	1	2	0	1	3	Low	-	Medium	
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	4	32	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
With Mitigation	2	1	2	2	10	Low	-	Medium	
	Nature of impact:	Direct							
	Without Mitigation	2	3	4	4	36	Medium	-	

Temporary/ Permanent degradation of wetland/riparian habitat due to the proposed traversing powerlines	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	
Eskom Common Substation Alternative 1									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	5	50	Medium	-	Medium

Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Temporary/ Permanent degradation of wetland/riparian habitat due to the proposed traversing powerlines	Nature of impact:	Direct							
	Without Mitigation	2	3	6	5	55	Medium	-	
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	
Eskom Common Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium

Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of bunding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	5	50	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Temporary/ Permanent degradation of wetland/riparian habitat due to the proposed traversing powerlines	Nature of impact:	Direct							
	Without Mitigation	2	3	6	5	55	Medium	-	
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	
Powerline Alternative 4 (Substation 2, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)		Status (+ve or -ve)	Confidence
	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	4	3	24	Low	-	Medium

Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
Alterations of flow regimes of watercourses, in close proximity to the site, or that is proposed to be traversed.	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	2	6	5	50	Medium	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.							
	With Mitigation	2	1	2	2	10	Low	-	Medium
Temporary/ Permanent degradation of wetland/riparian habitat	Nature of impact:	Direct							
	Without Mitigation	2	3	6	5	55	Medium	-	
	degree to which impact can be reversed:	High							

wetland riparian habitat due to the proposed traversing powerlines	degree of impact on irreplaceable resources:	Low						
	Mitigation Measures	After the decommissioning, rehabilitation of the site must occur immediately to ensure no residual impacts remain. A rehabilitation specialist must compile the rehabilitation plan and monitoring its implementation.						
	With Mitigation	2	1	2	2	10	Low	-
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable							
	Mitigation Measures							
	With Mitigation							

Powerline - No-Go

Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
Substation Alternative 1								
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:	Direct and Indirect						
	Without Mitigation	2	2	4	3	24	Low	- Medium

Increased potential of soil erosion due to removal of powerlines and substations, soil disturbance and a high traffic movement on site.	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of de-construction vehicles should be kept to a minimum to reduce							
	With Mitigation	1	2	2	2	10	Low	-	Medium
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	2	2	2	12	Low	-	Medium
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and proper							
	With Mitigation	1	2	0	1	3	Low	-	Medium
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							

	With Mitigation	1	2	0	1	3	Low	-	Medium
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
Substation - No-Go								
Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

BioTherm Energy - Maralla Powerline (Wetland)

{insert specialist filed here}

Significance Rating Table

Cumulative Impacts

Powerline Alternative 1 (Substation 1, Option 1)

Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
Loss of wetland/riparian habitat due to the proposed positioning of the powerlines and pylons	Nature of impact:	Direct						
	Without Mitigation	2	2	8	5	60	Medium	
	degree to which impact can be reversed:	High						
	degree of impact on irreplaceable resources:	Low						
	Mitigation Measures	The WULA application will require detailed functional assessments (i.e. PES, EIS and EcoServices) of freshwater habitats potentially affected by the site and powerlines. At this stage design details should be available allowing						
	With Mitigation	1	2	4	3	21	Low	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect						
	Without Mitigation	2	4	4	3	30	Low	Low
	degree to which impact can be reversed:	High						
	degree of impact on irreplaceable resources:	Low						
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to						
	With Mitigation	1	4	2	2	14	Low	Low

	Nature of impact:							
	Without Mitigation							
	degree to which							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Powerline Alternative 2 (Substation 1, Option 2)

Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low

	Nature of impact:							
	Without Mitigation							
	degree to which							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Powerline Alternative 3 (Substation 2, Option 1)

Potential Impact		Extent	Duration	Magnitude	Probability	Significance	Status	Confidence
------------------	--	--------	----------	-----------	-------------	--------------	--------	------------

Potential Impact		(E)	(D)	(M)	(P)	(S=(E+D+M)*P)	(+ve or -ve)	Confidence	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Powerline Alternative 4 (Substation 2, Option 2)									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low

Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Low
Eskom Common Substation Alternative 1									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							

	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							

	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Powerline - No-Go

Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							

	Without Mitigation								
	degree to which								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
Substation Alternative 1								
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence
	Nature of impact:	Direct						
	Without Mitigation	2	4	4	5	50	Medium	- Low

Loss of land (including wetlands) previously used for sheep and antelope grazing will be occupied by the powerline and substation infrastructure	degree to which impact can be reversed:	Low							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerline and substation Infrastructure should be limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum.							
	With Mitigation	1	4	2	3	21	Low	-	Low
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of hardstanding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Low
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								

	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	With Mitigation							

	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
Substation Alternative 2									
Potential Impact		Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
Loss of land (including wetlands) previously used for sheep and antelope grazing will be occupied by the powerline and substation infrastructure	Nature of impact:	Direct							
	Without Mitigation	2	4	4	5	50	Medium	-	Low
	degree to which impact can be reversed:	Low							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Powerline and substation Infrastructure should be limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum.							
	With Mitigation	1	4	2	3	21	Low	-	Low
Vegetation cleared for powerlines and substation, soil disturbance and stockpiles, and increased	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	4	3	30	Low	-	Low
	degree to which impact can be reversed:	Low							

stockpiles, and increased traffic movement on site, resulting in a higher potential for soil erosion	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	Areas of disturbance should be (where practical) limited to the extent of the project footprint, and activities outside of the site should be kept to a minimum. Traffic of maintenance vehicles should be kept to a minimum to							
	With Mitigation	1	4	2	2	14	Low	-	Low
Potential spillage of hazardous substances such as oils, fuel, grease from maintenance vehicles, and sewage from on-site sanitation systems	Nature of impact:	Direct and Indirect							
	Without Mitigation	2	4	2	2	16	Low	-	Low
	degree to which impact can be reversed:	High							
	degree of impact on irreplaceable resources:	Low							
	Mitigation Measures	The proper handling and storage of hazardous materials, the use of bunding in storage areas of hazardous substances and where spillages are possible. The use of bunding around storage of hazardous materials and							
	With Mitigation	1	4	0	1	5	Low	-	Low
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							

	With Mitigation								
Substation - No-Go									
Potential Impact	Mitigation	Extent (E)	Duration (D)	Magnitude (M)	Probability (P)	Significance (S=(E+D+M)*P)	Status (+ve or -ve)	Confidence	
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								
	Mitigation Measures								
	With Mitigation								
	Nature of impact:								
	Without Mitigation								
	degree to which impact can be reversed:								
	degree of impact on irreplaceable resources:								

	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							
	Nature of impact:							
	Without Mitigation							
	degree to which impact can be reversed:							
	degree of impact on irreplaceable resources:							
	Mitigation Measures							
	With Mitigation							

Appendix B

CUMULATIVE IMPACT ASSESSMENT

BIO THERM – CUMULATIVE ASSESSMENT

APPROACH

The Department of Environmental Affairs (DEA) has requested that a detailed cumulative assessment is undertaken for each of the proposed BioTherm projects. The cumulative assessment must take the specialist studies from the surrounding Environmental Authorisations into account.

In order to ensure that a consolidated cumulative assessment can be developed for each project, a template has been produced to ensure that the specialist studies across the disciplines utilise the same approach.

Each specialist discipline will be required to compile the table below and provide a qualitative discussion on the overall cumulative impact of the projects in the study area.

MASTER ASSUMPTIONS

The following assumptions and limitations have been identified in relation to the above approach:

- à Due to the number of different significance rating methodologies utilised across the various projects, significance ratings have been simplified to include only Low, Medium and High ratings.
- à In the event that specialist studies were unable to be obtained, this has been noted.
- à Solar – All approved and ongoing environmental authorisations within a 70km radius above been considered
- à Wind – All approved and ongoing environmental authorisations within an 80 radius above been considered

PROPOSED DEVELOPMENT NAME	DEA REFERENCE	CURRENT EA STATUS	PROPONENT	EXTENT	PROPOSED CAPACITY	FARMS	IMPACTS											PROPOSED MEASURES	MITIGATION
							Construction			Operation			Decommissioning						
							Watercourses and wetlands	Water erosion	Sediment, leaks and spills	Watercourse sedimentation	Water erosion	Sediment, leaks and spills	Sediment, leaks and spills	Water erosion					
Western Cape Province																			
Proposed Photovoltaic (PV) Solar Energy Facility On A Site South Of Sutherland, Within The Karoo Hoogland Municipality Of The Namakwa District Municipality, Northern Cape Province	12/12/20/2235	BAR	Inca Komsberg Wind (Pty) Ltd	2	10 MW														
Proposed establishment of the Surplaat wind energy facility and associated infrastructure on a site near Sutherland, Western Cape and Northern Cape.	12/12/20/1583	S&EIR	Moyeng Energy (Pty) Ltd	28 600	120 MW														
Proposed establishment of the Witberg Bay wind energy facility, Laingsburg Local Municipality, Central Karoo District, Western cape	12/12/20/1966/A2	Amendment	Witberg Wind Power (Pty) Ltd		Unknown														
Proposed renewable energy facility at Konstabel	12/12/20/1787	S&EIR	South Africa Mainstream Renewable Power Development		170 MW														
Proposed development of a renewable Energy facility at Perdekraal, Western Cape - Split 1	12/12/20/1783/2/AM1	Amendment	South Africa Mainstream Renewable Power Development		Unknown														
Proposed Touwsrivier Solar energy facility	12/12/20/1956	S&EIR	Unknown	215	36 MW		H			H					L				
				Total Ha	Total MW														
				128 276	2667 MW														
Significance Totals per impact	Significance Rating					Total Hectares per impact													

PROPOSED DEVELOPMENT NAME	DEA REFERENCE	CURRENT EA STATUS	PROPONENT	EXTENT	PROPOSED CAPACITY	FARMS	IMPACTS												PROPOSED MEASURES	MITIGATION
							Construction				Operation				Decommissioning					
							Watercourses and wetlands	Water erosion	Sediment, leaks and spills		Watercourse sedimentation	Water erosion	Sediment, leaks and spills		Sediment, leaks and spills	Water erosion				
	High Significance							215					215							
	Medium Significance																			
	Low Significance						35	35	26		35	35	26		26 529	215				
	Positive Impacts						330	330	529		330	330	529							

The following EAs surrounding the solar developments have been either withdrawn or have lapsed and are therefore not been considered as part of the cumulative impact assessment:

PROPOSED DEVELOPMENT NAME	DEA REFERENCE	CURRENT EA STATUS	PROPONENT	EXTENT	PROPOSED CAPACITY	FARMS
Proposed wind energy facility near Komsberg, Western Cape	12/12/20/2228	S&EIR	Inca Komsberg Wind (Pty) Ltd		300 MW	
Proposed wind and solar project near Laingsburg, Western Cape	12/12/20/2328	S&EIR	Unknown		50 MW	