



Access Road

ENTRANCE

House

Pole No: NUB 38 / 18 / 1

PROPOSES MAST
12m x 12m = 144m²



vodacom

NOTES:

- DRAWINGS ARE FOR INFORMATION AND PERMITTING FROM THE MUNICIPALITY ONLY. CONSTRUCTION DRAWINGS NEEDS TO BE PRODUCED BY THE APPOINTED SUB-CONTRACTOR
- ALL UNDERGROUND SERVICES(SHOWN OR NOT) NEEDS TO BE CONFIRMED ON SITE BEFORE CONSTRUCTION
- VODACOM TO USE ACCESS ROAD FROM R510 (VODACOM TO INSTALL 30 AMP BREAKER)
- 55M LATTICE MAST 12M X 12M SURROUNDED BY STEEL PALISADE FENCE
- VODACOM TO KEEP 9M FROM ESKOM POWER LINES PER ESKOM POLICY

CoORDINATES:	24° 59' 04.80" S
HASL: 1019m	27° 14' 21.80" E

DEVELOPLAN
 PIETERSBURG INCORPORATED
 Reg. No. 9910599/21

P.O. Box 1883
 Polokwane, 0700
 Tel: 015 - 291 4176 / 7
 Fax: 086 218 3267


Town planners & Environmental consultants
tecoplan@mweb.co.za

VODACOM SITE NAME
WILDEBEESTLAAGTE

PROPERTY DESCRIPTION
PORTION 58 OF THE FARM
WILDEBEESTLAAGTE 411 - KQ
DIRT ROAD OFF R510
THABAZIMBI LOCAL MUNICIPALITY
LIMPOPO

SITE LAYOUT

DATE 2021/05	BASE STATION NUMBER 016 0783
NO. 6	SCALE 1:500

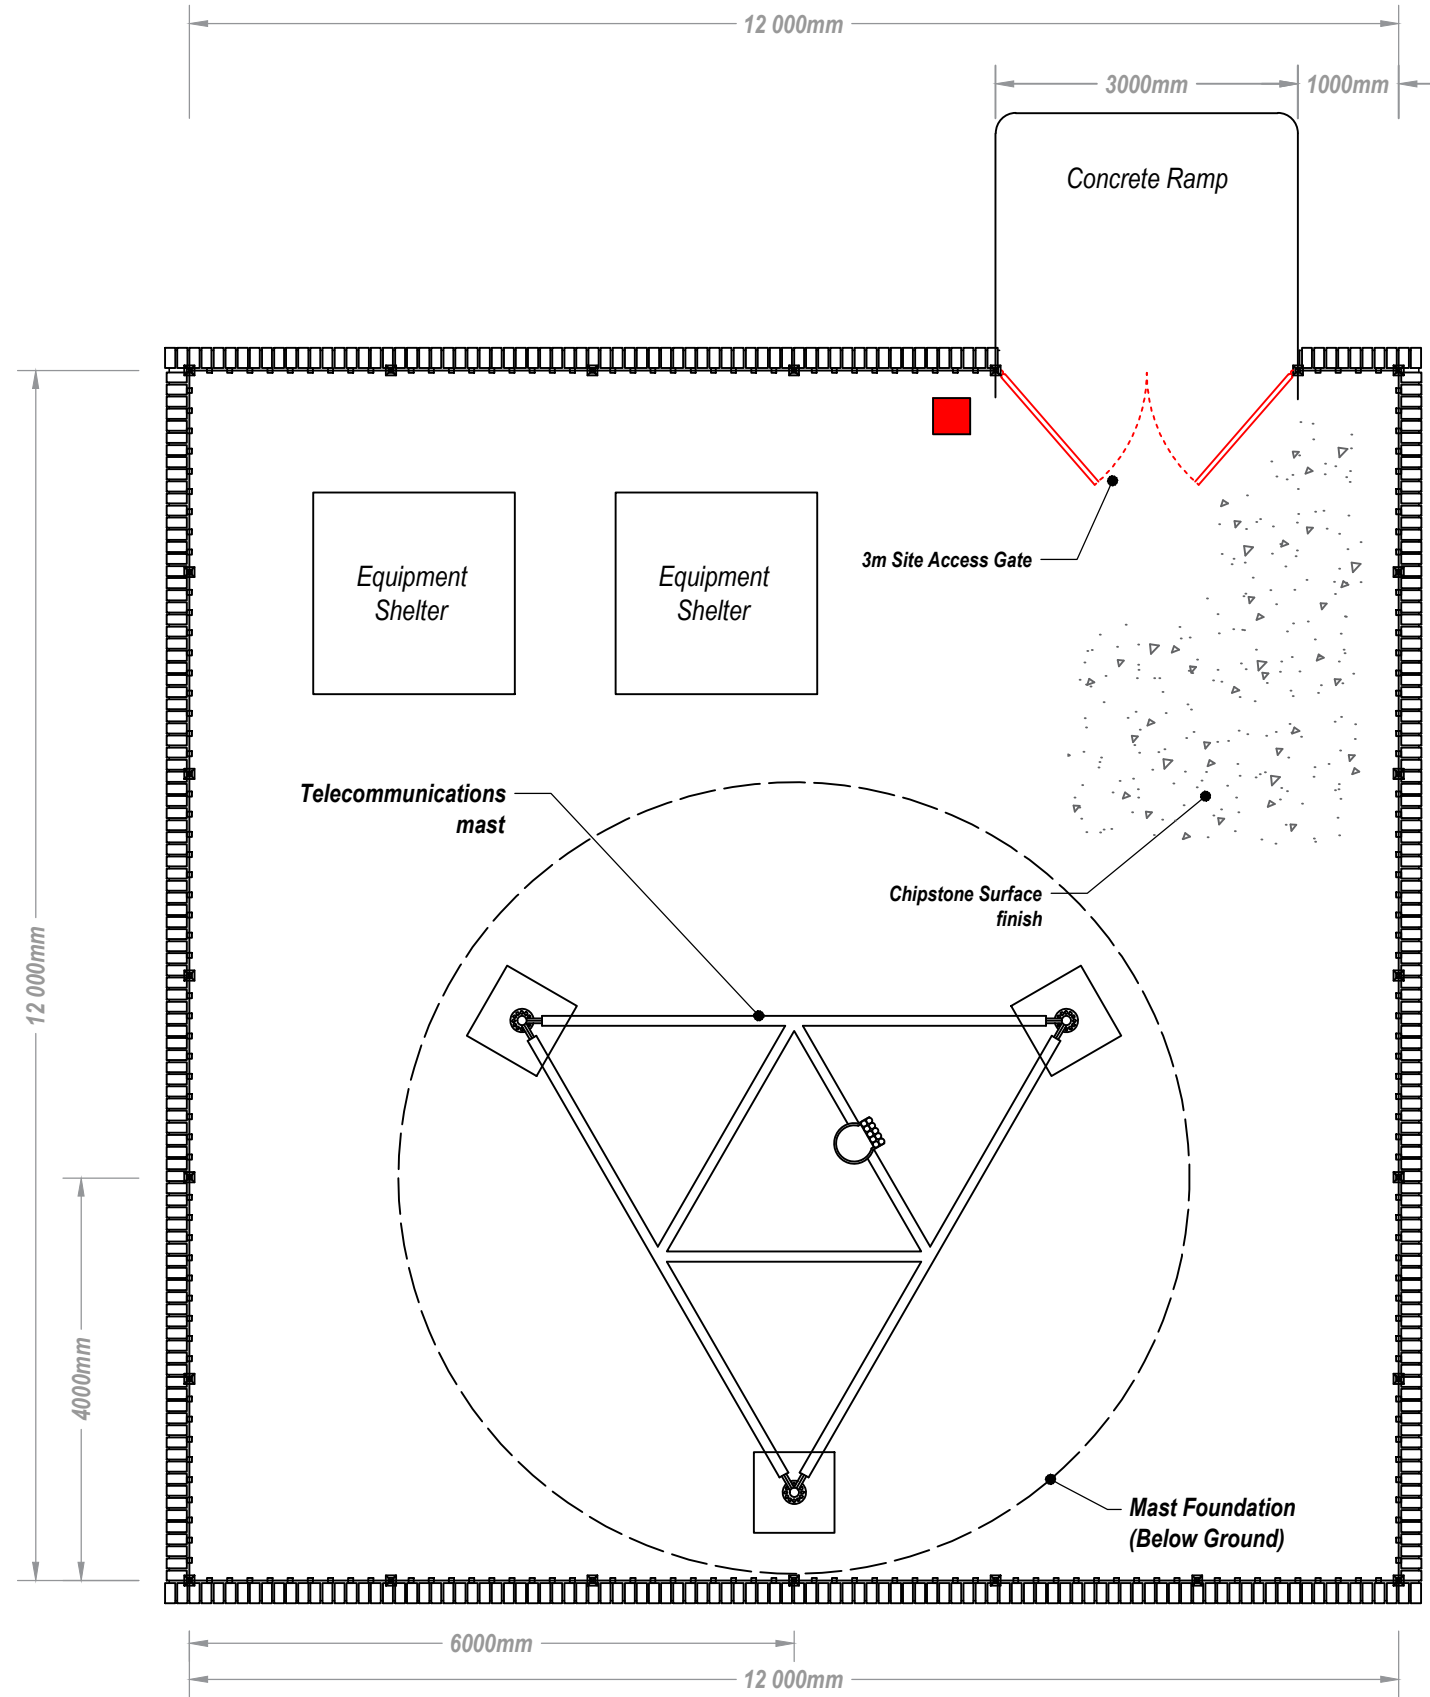

vodacom

NOTES:

- DRAWINGS ARE FOR INFORMATION AND PERMITTING FROM THE MUNICIPALITY ONLY. CONSTRUCTION DRAWINGS NEEDS TO BE PRODUCED BY THE APPOINTED SUB-CONTRACTOR
- ALL UNDERGROUND SERVICES(SHOWN OR NOT) NEEDS TO BE CONFIRMED ON SITE BEFORE CONSTRUCTION
- VODACOM TO USE ACCESS ROAD FROM R510 (VODACOM TO INSTALL 30 AMP BREAKER)
- 55M LATTICE MAST 12M X 12M SURROUNDED BY STEEL PALISADE FENCE
- VODACOM TO KEEP 9M FROM ESKOM POWER LINES PER ESKOM POLICY

CoORDINATES:	24° 59' 04.80" S
HASL: 1019m	27° 14' 21.80" E

DEVELOPLAN
 PIETERSBURG INCORPORATED
 Reg. No. 99/10599/21

P.O. Box 1883
 Polokwane, 0700
 Tel: 015 - 291 4176 / 7
 Fax: 086 218 3267

Town planners & Environmental consultants
tecoplan@mweb.co.za

VODACOM SITE NAME
 WILDEBEESTLAAGTE


PROPERTY DESCRIPTION
 PORTION 58 OF THE FARM
 WILDEBEESTLAAGTE 411 - KQ
 DIRT ROAD OFF R510
 THABAZIMBI LOCAL MUNICIPALITY
 LIMPOPO

BASE STATION LAYOUT

DATE 2021/05	BASE STATION NUMBER 016 0783
NO. 7	SCALE 1:75

Fire Notes:

Vodacom Shall Install 9.0Kg dry powder fire Extinguisher near the wall at a height of approx. 1.0m above ground. Appropriate Fire/Safety Signage to be provided.

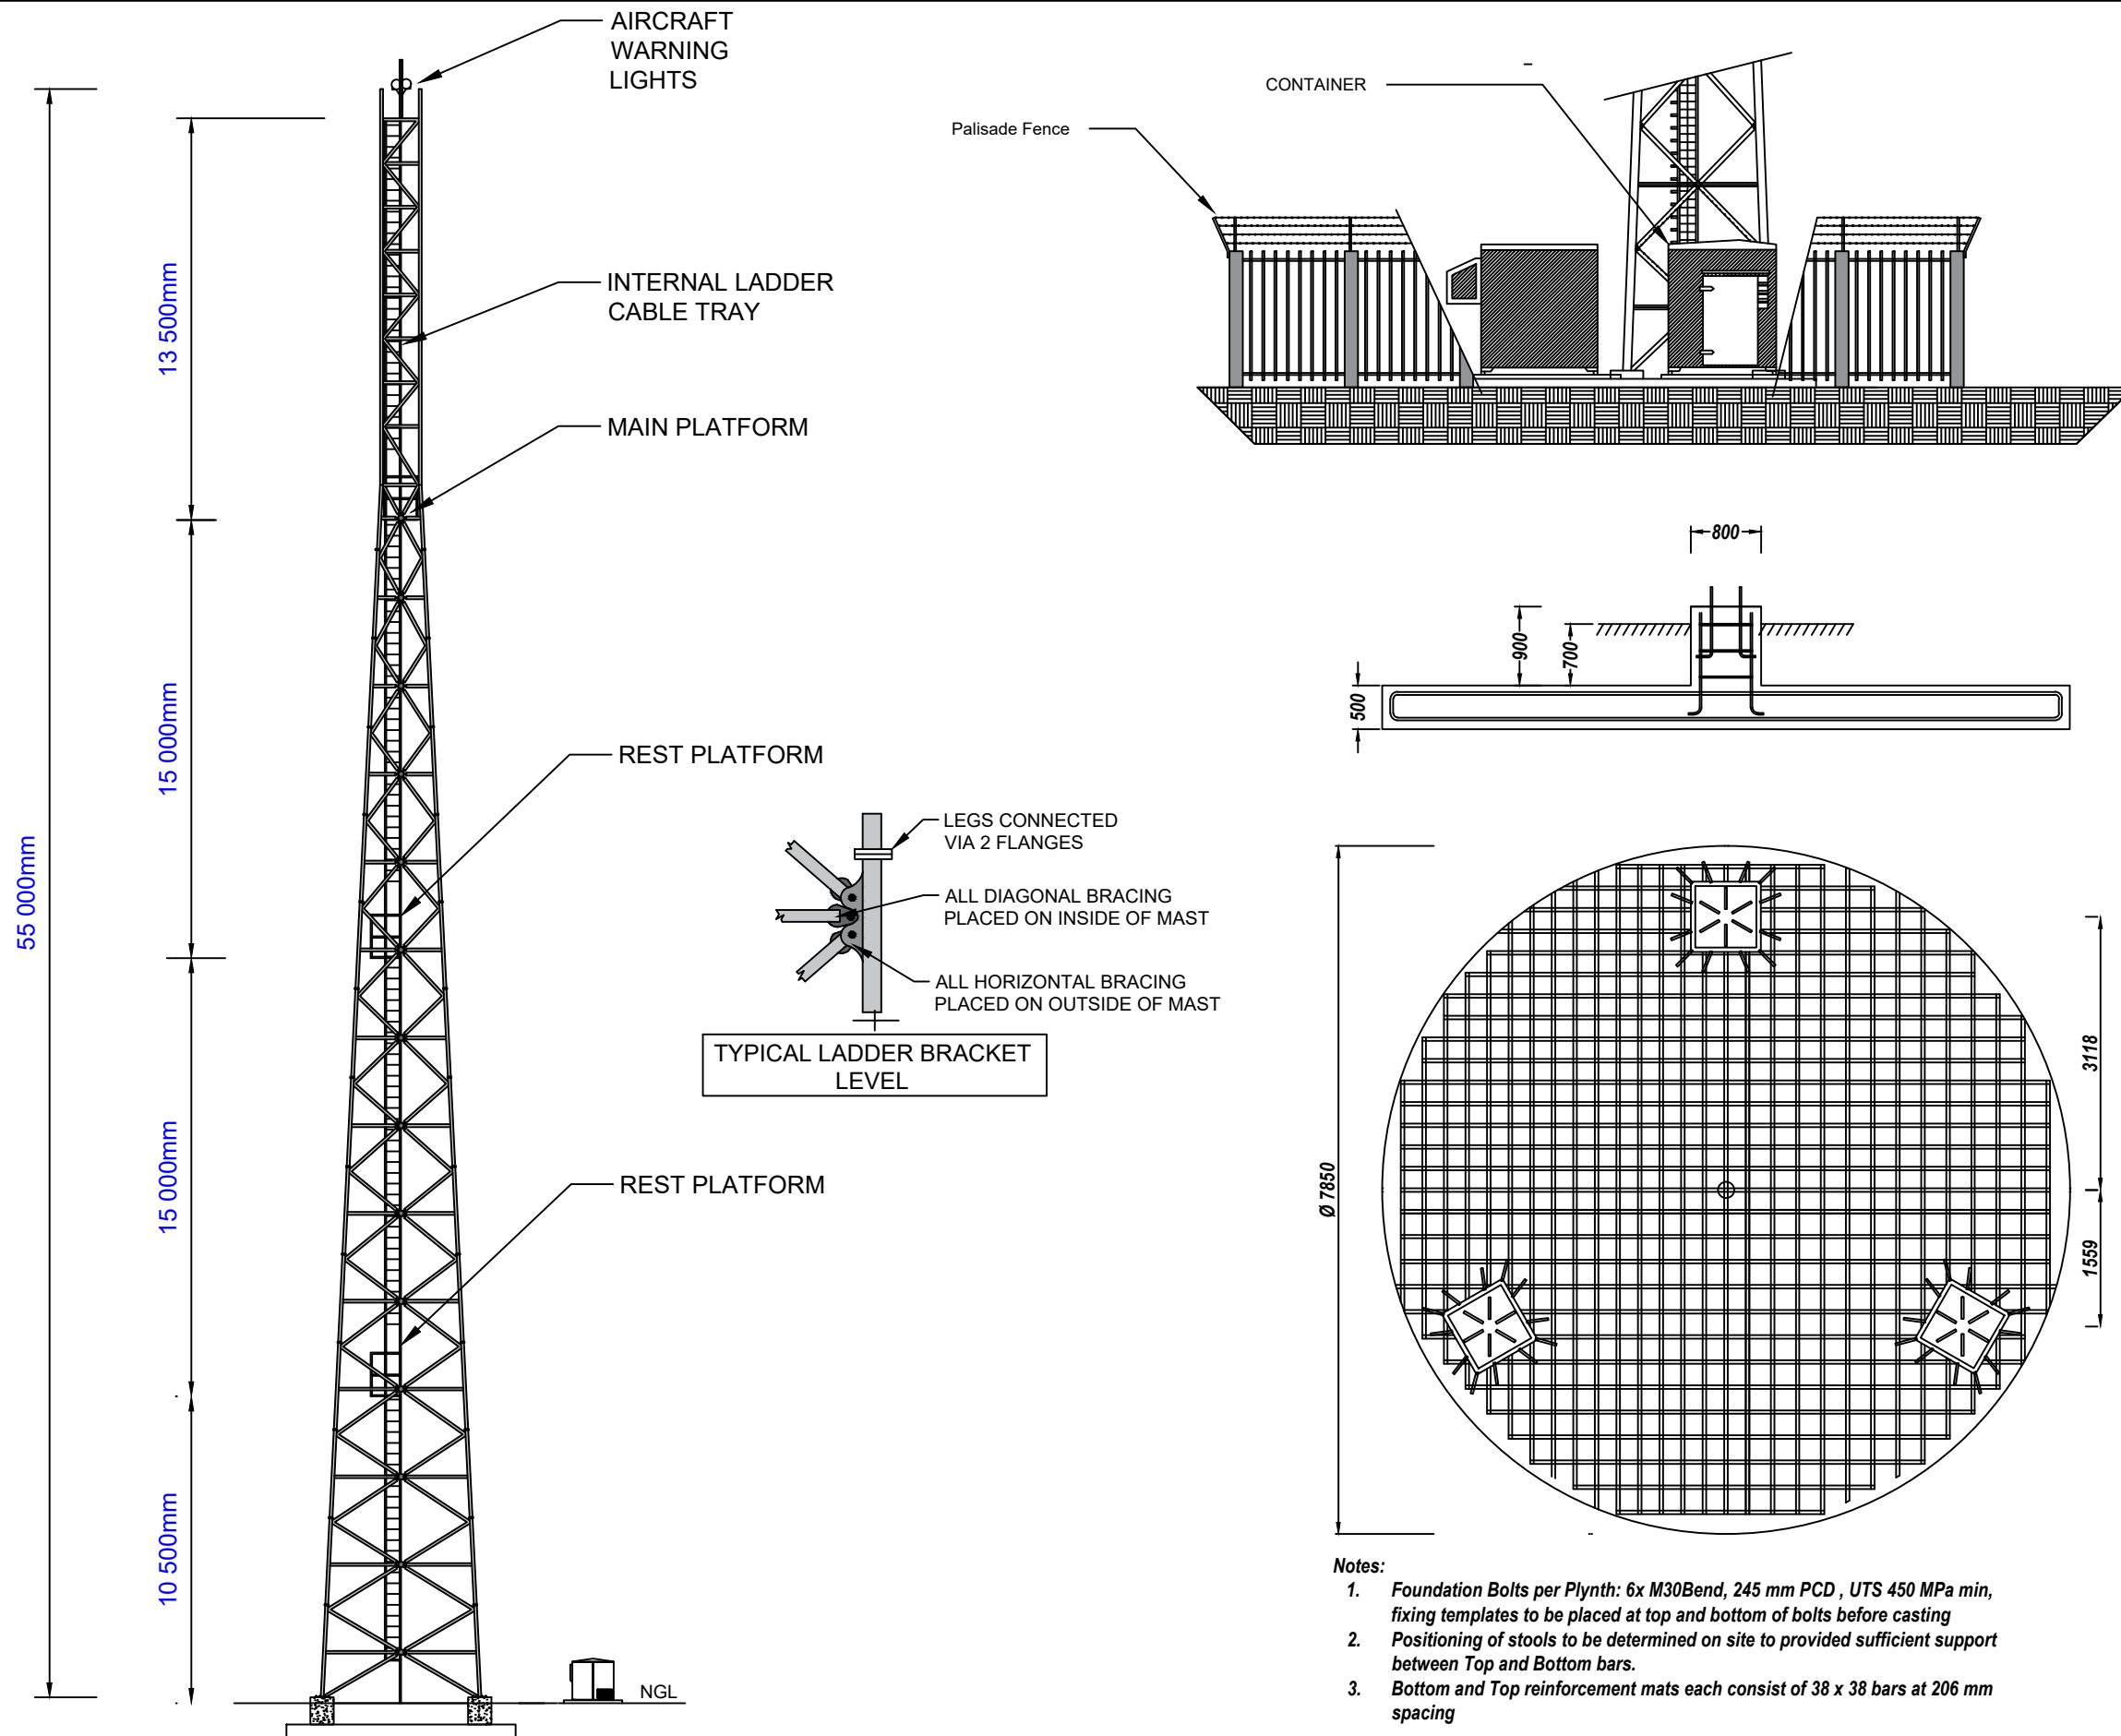

- NOTES:**
- DRAWINGS ARE FOR INFORMATION AND PERMITTING FROM THE MUNICIPALITY ONLY. CONSTRUCTION DRAWINGS NEEDS TO BE PRODUCED BY THE APPOINTED SUB-CONTRACTOR
 - ALL UNDERGROUND SERVICES (SHOWN OR NOT) NEEDS TO BE CONFIRMED ON SITE BEFORE CONSTRUCTION
 - VODACOM TO USE ACCESS ROAD FROM R510 (VODACOM TO INSTALL 30 AMP BREAKER)
 - 55M LATTICE MAST 12M X 12M SURROUNDED BY STEEL PALISADE FENCE
 - VODACOM TO KEEP 9M FROM ESKOM POWER LINES PER ESKOM POLICY

CoORDINATES: 24° 59' 04.80" S
HASL: 1019m 27° 14' 21.80" E

DEVELOPLAN
 PIETERSBURG INCORPORATED
 Reg. No. 9910599/21
 P.O. Box 1883
 Polokwane, 0700
 Tel: 015 - 291 4176 / 7
 Fax: 086 218 3267
 Town planners & Environmental consultants
tecoplan@mweb.co.za

VODACOM SITE NAME
 WILDEBEESTLAAGTE

PROPERTY DESCRIPTION
 PORTION 58 OF THE FARM
 WILDEBEESTLAAGTE 411 - KQ
 DIRT ROAD OFF R510
 THABAZIMBI LOCAL MUNICIPALITY
 LIMPOPO

ELEVATION

DATE 2021/05	BASE STATION NUMBER 016 0783
NO. 9	SCALE NTS

- Notes:**
- Foundation Bolts per Plynth: 6x M30Bend, 245 mm PCD, UTS 450 MPa min, fixing templates to be placed at top and bottom of bolts before casting
 - Positioning of stools to be determined on site to provided sufficient support between Top and Bottom bars.
 - Bottom and Top reinforcement mats each consist of 38 x 38 bars at 206 mm spacing