


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	11
Trees to Trim	
Bushclearing required (m)	230m

## GAMMA 891 LT

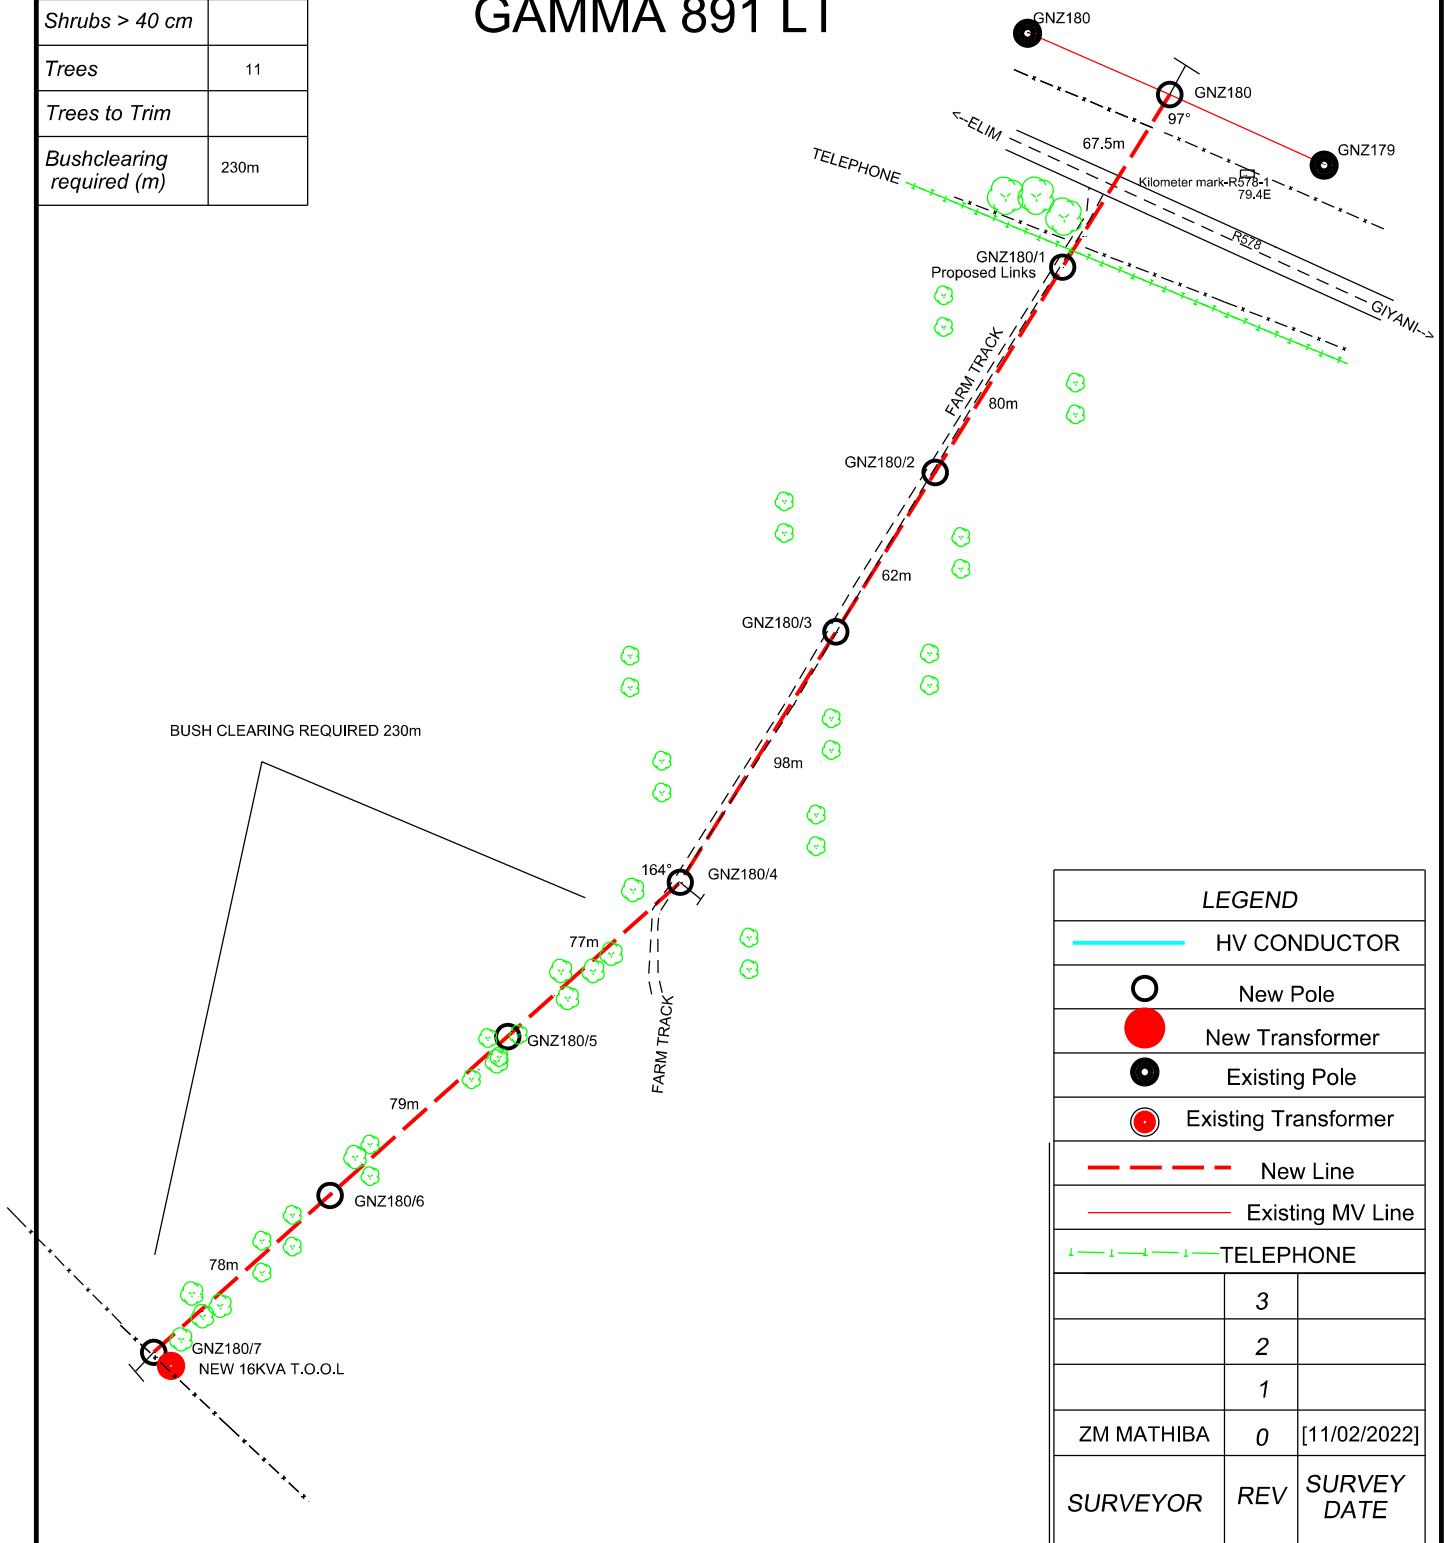

LEGEND		
	HV CONDUCTOR	
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	TELEPHONE	
	3	
	2	
	1	
ZM MATHIBA	0	[11/02/2022]
SURVEYOR	REV	SURVEY DATE

FEEDER: GYANI NDENGEZA 22KV	CUSTOMER: MARINGA SHINGULANE STEPHEN	<p>THIS DRAWING IS THE PROPERTY OF ESKOM Disclaimer: Eskom is not responsible for any errors displayed on this drawing</p>
PROJECT NO: G485541427	PROPERTY: GAMMA 891 LT	
CONDUCTOR: FOX	CONTACT DETAILS	
LENGTH OF LINE: 542m	SCALE: [1:2 500] PAGE: [1] of [1]	
SURVEYOR: Z.M MATHIBA		
DRAUGHTSPERSON: Z.M MATHIBA		