


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	
Bushclearing required (m)	

## GAMMA 891 LT

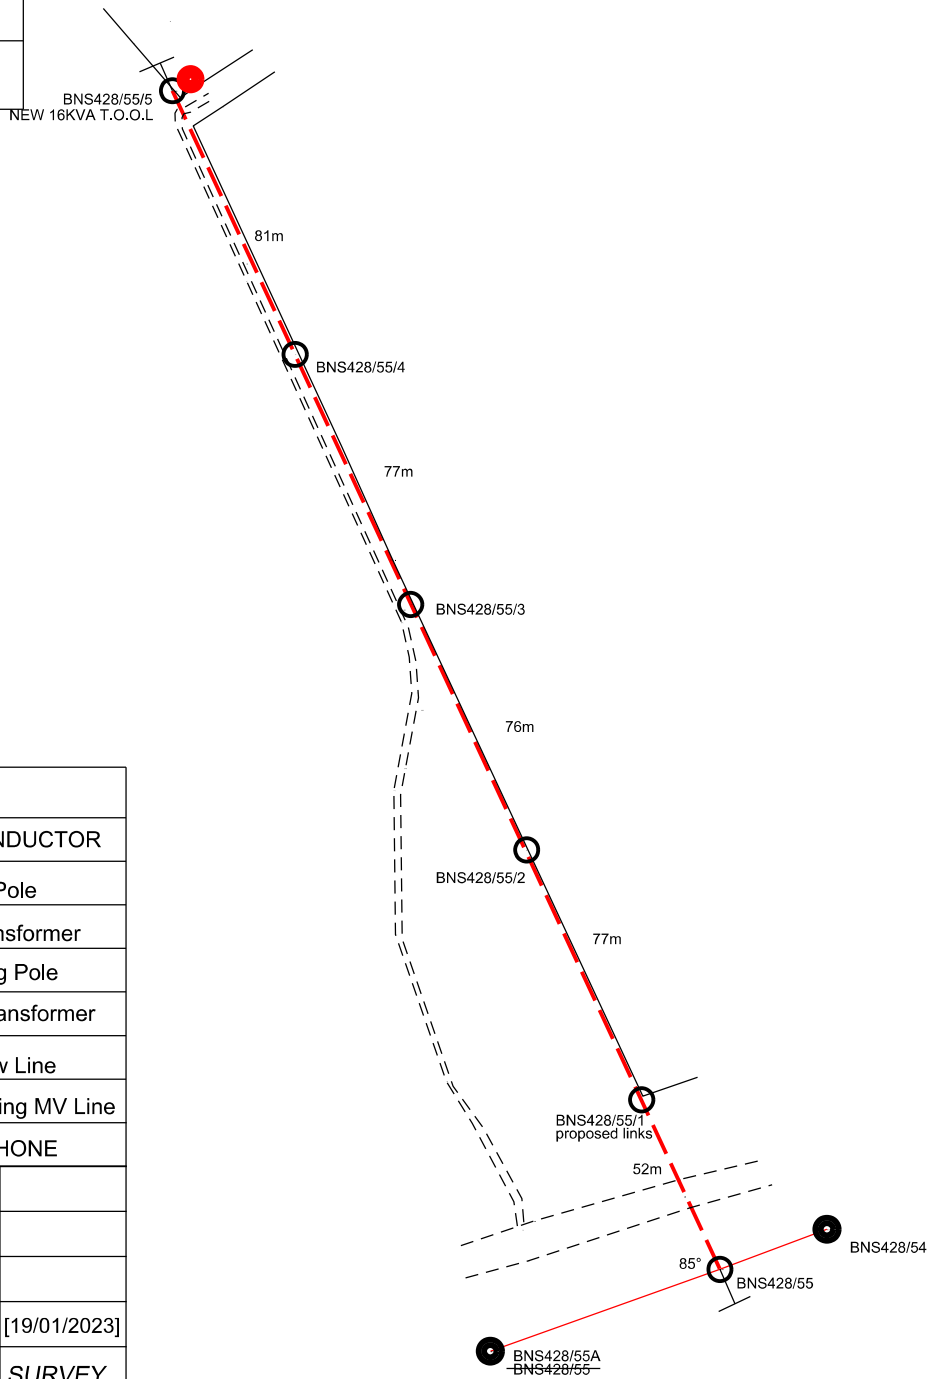

LEGEND		
	HV CONDUCTOR	
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	TELEPHONE	
	3	
	2	
	1	
ZM MATHIBA	0	[19/01/2023]
SURVEYOR	REV	SURVEY DATE

FEEDER: BAMBENI SHAWELA 22KV

CUSTOMER:

PROJECT NO: G584923113

MAWEWE KENNETH NKHWASHU

CONDUCTOR: FOX

PROPERTY: GAMMA 891 LT

LENGTH OF LINE: 363m

SURVEYOR: Z.M MATHIBA

CONTACT DETAILS

DRAUGHTSPERSON: Z.M MATHIBA

SCALE: [1:2 500]

PAGE: [1] of [1]



THIS DRAWING IS THE PROPERTY OF ESKOM  
Disclaimer: Eskom is not responsible for any errors displayed on this drawing