


| | |
|----------------|---------------------|
| Reference | CAD-Line Survey-LOU |
| Effective Date | 15/10/2015 |
| Revision | 01 |

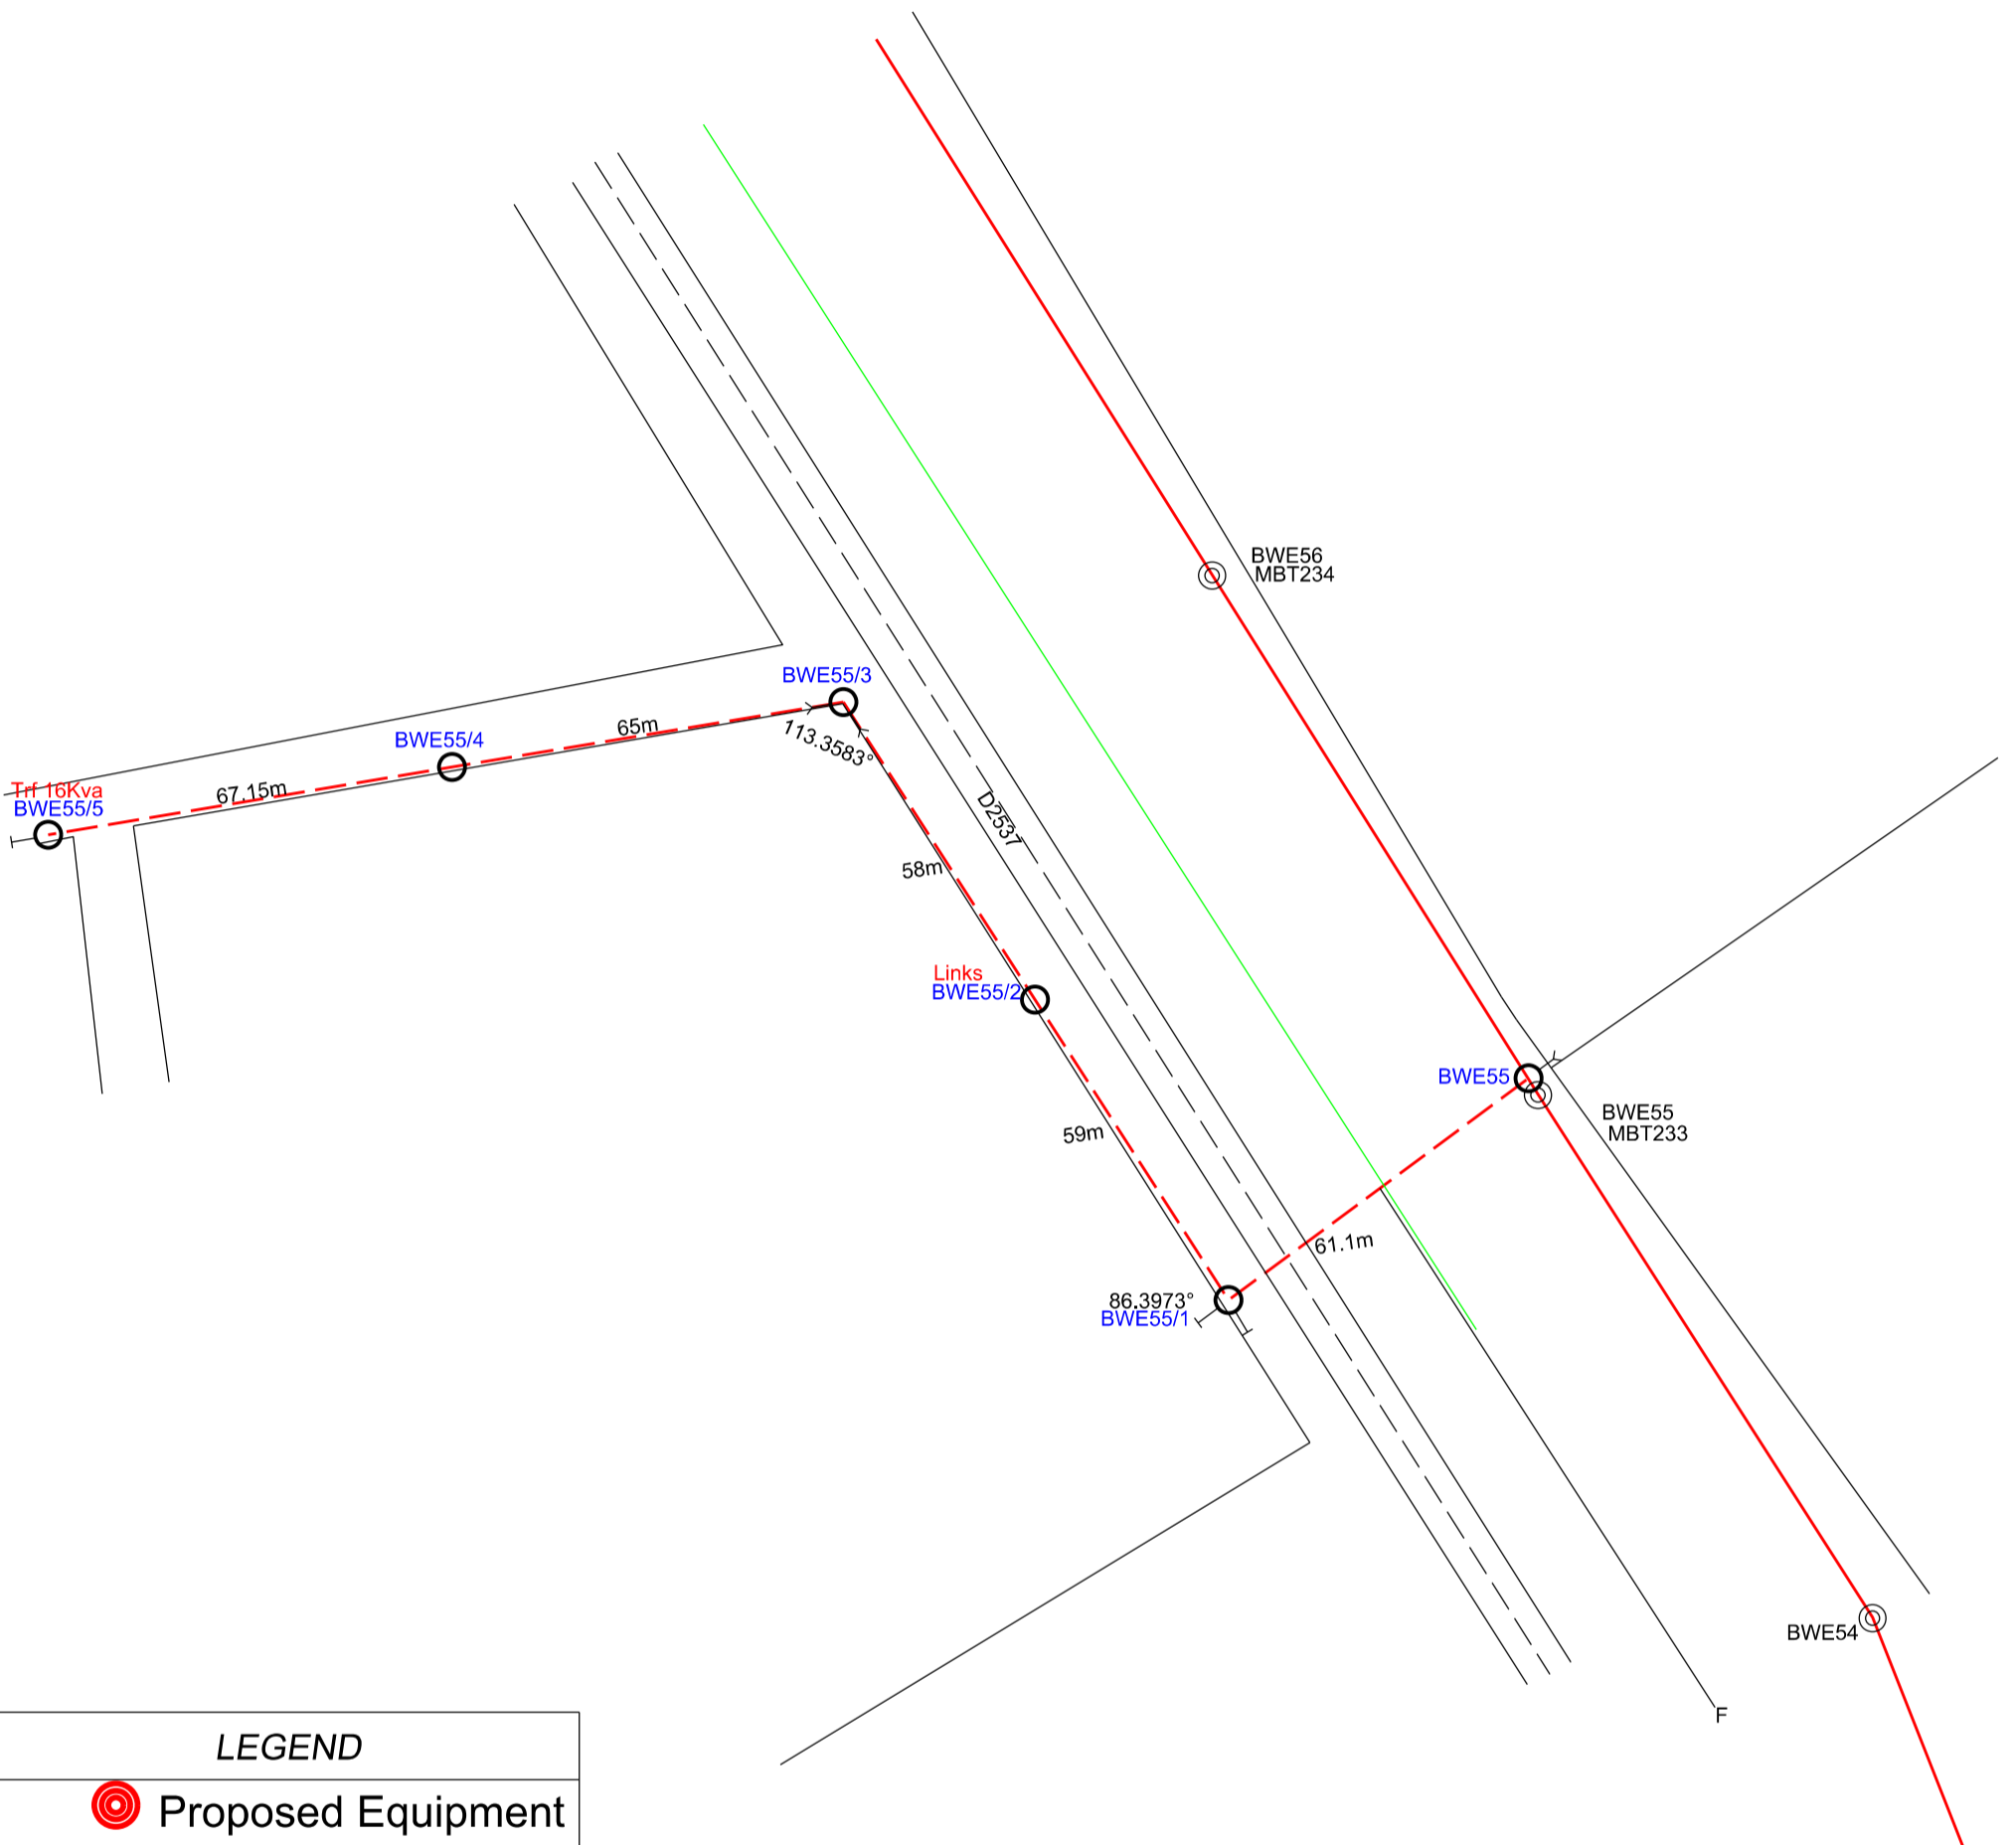

| LEGEND | |
|--------|--------------------|
| | Proposed Equipment |
| | Proposed Pole |
| | Existing Pole |
| | Existing Line |
| | Proposed Line |
| | Existing Trf |
| | Man Hole |
| | Pipe Line |

| SURVEYOR | REV | SURVEY DATE |
|----------|-----|-------------|
| | 3 | |
| | 2 | |
| | 1 | |
| | 0 | |

| | |
|-----------------|-------------------------------------|
| FEEDER: | Burgersfort West Elephant Hill 22KV |
| PROJECT NUMBER: | GB513088011 |
| CONDUCTOR: | |
| LENGTH OF LINE: | 310m |
| SURVEYOR: | M. Mokgwadi |
| DRAUGHTSPERSON: | L. Nkuna |

| | |
|------------------|-------------------------|
| CUSTOMER: | Digoro |
| PROPERTY: | Aapiesdoorndraai 298 KT |
| CONTACT DETAILS: | 015 230 1704 |
| SCALE: | |
| PAGE: | [1] of [1] |

THIS DRAWING IS THE PROPERTY OF ESKOM
Disclaimer: Eskom is not responsible for any errors displayed on this drawing