
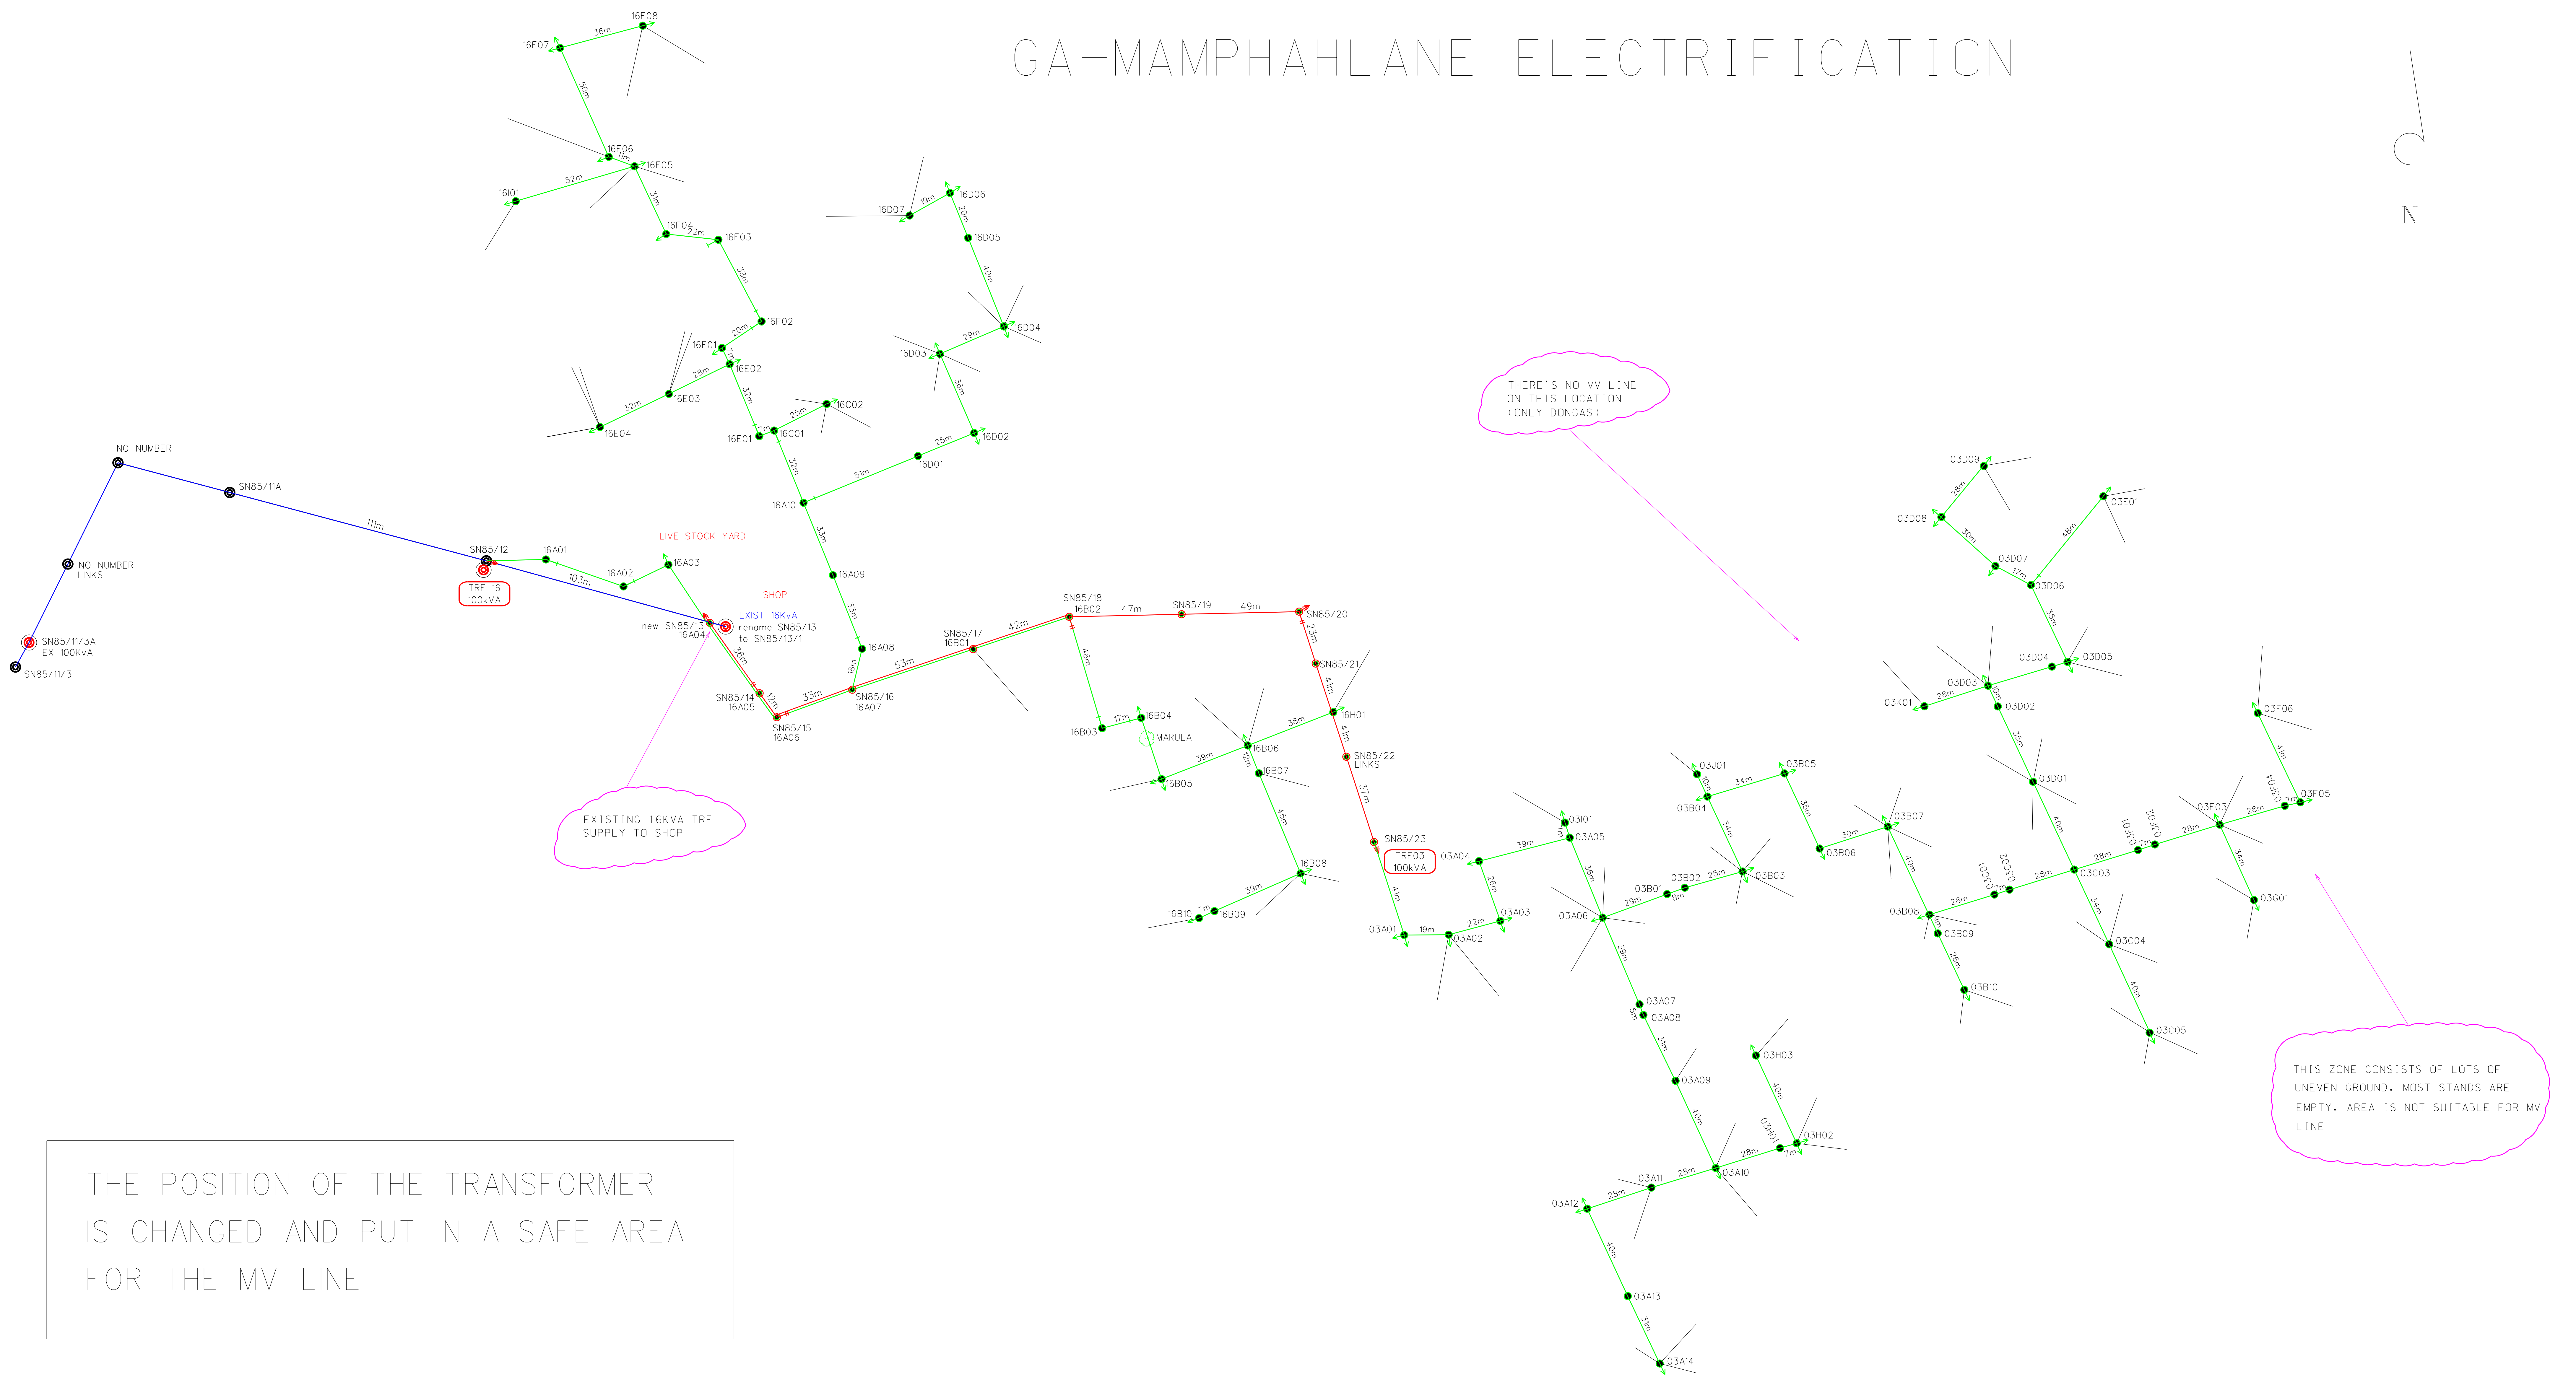


GA-MAMPHAHLANE ELECTRIFICATION

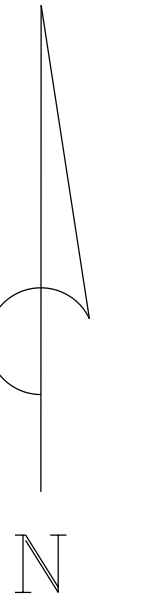

THE POSITION OF THE TRANSFORMER IS CHANGED AND PUT IN A SAFE AREA FOR THE MV LINE

EXISTING 16kVA TRF SUPPLY TO SHOP

THERE'S NO MV LINE ON THIS LOCATION (ONLY DONGAS)

THIS ZONE CONSISTS OF LOTS OF UNEVEN GROUND. MOST STANDS ARE EMPTY. AREA IS NOT SUITABLE FOR MV LINE