



Report to SiVEST

Desktop Geotechnical Specialist Study for the:

PROPOSED CONSTRUCTION AND OPERATION OF THE BATTERY ENERGY STORAGE SYSTEM (BESS) AND ASSOCIATED INFRASTRUCTURE FOR THE AUTHORISED MIERDAM PHOTO VOLTAIC (PV) SOLAR ENERGY FACILITY LOCATED NEAR LOCATED THE TOWN OF PRIESKA, IN THE SIYATHEMBA LOCAL MUNICIPALITY, PIXLEY KA SEME DISTRICT IN THE NORTHERN CAPE PROVINCE OF SOUTH AFRICA

DEA Reference:	2020-09-0030
Report Prepared by:	GaGE Consulting (Pty) Ltd
Issue Date:	6 November 2020
Version No.:	F0
GaGE Ref No.:	KSV20700/G0262



Report to:



SiVEST Environmental Division
51 Wessel Road, Rivonia,
2129

Project name:

Mierdam Photo Voltaic (PV) Solar Energy Facility Battery Energy Storage System (BESS)

Report title:

Desktop Geotechnical Specialist Study

Report number:

KSV20700/G0262 revision F0

Revision	Date	Comment	Prepared by	Reviewed by
F0. FINAL	06/10/2020	Issued to client for distribution	SNB	FPP

Revision Details:

Report by:	Approved by:
<hr/> Steven Bok <i>BSc Hons (Geology) Pr.Sci.Nat</i>	<hr/> Fernando Pequenino PrEng (SA) 20070109 <i>BEng(Civil) BEng(Hons)(Geotech) MSAICE</i>

This document is copyrighted and remains the property of GaGE Consulting (Pty) Ltd

PROPOSED CONSTRUCTION AND OPERATION OF THE BATTERY ENERGY STORAGE SYSTEM (BESS) AND ASSOCIATED INFRASTRUCTURE FOR THE AUTHORISED MIERDAM PHOTO VOLTAIC (PV) SOLAR ENERGY FACILITY LOCATED NEAR LOCATED THE TOWN OF PRIESKA, IN THE SIYATHEMBA LOCAL MUNICIPALITY, PIXLEY KA SEME DISTRICT IN THE NORTHERN CAPE PROVINCE OF SOUTH AFRICA

Executive Summary

This desktop geological and geotechnical specialist study assessed the proposed development of a Battery Energy Storage System (BESS) and associated infrastructure for the authorised Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3), located near Prieska in the Siyathemba Local Municipality, Pixley ka Seme District in the Northern Cape Province of South Africa. The assessment area comprises of a 500 m radius around the authorised substation position.

The assessment area slopes gently towards the south, and although localised undulations and erosional features appear to occur, no potentially unstable conditions were identified. There are no distinct drainage features on the site, although signs of overland surface flow are noted in the southern section. The study area has an arid climate. The bedrock comprises of tillite, boulder shale, sandstone, siltstone, shale of the Dwyka Group and is overlain in the southern section by surficial alluvial deposits, inferred to comprise of silty sands or sandy silts. A shallow bedrock profile is anticipated over the section underlain by the Dwyka Group while a slightly deeper profile is expected beneath the southern section. Founding conditions will be adequate for founding the proposed infrastructure at shallow depths on conventional footings, although a deeper footing depth will be required where alluvial sands are encountered.

No rock outcrop, faults, lineaments or other geological features were identified. The potential for preserved fossils to be present at shallow depth is considered to be low.

No fatal flaws have been identified that would render the proposed BESS site unsuitable from a geological and geotechnical perspective. No geologically or geotechnically sensitive areas were identified within or near the assessment area. While certain sections of the assessment area considered marginally more suitable for development from a geotechnical perspective other areas, other factors are likely to be more critical in determining the final BESS layout. No preferences for the final BESS layout within the assessment area are therefore provided.

The proposed BESS is assessed to have a “Negative Low impact - the anticipated impact will have negligible negative effects and will require little to no mitigation” from a geological and geotechnical viewpoint. The mitigation measures provided in this report to minimise the impacts relate to the appropriate engineering design of earthworks and site drainage, erosion control and topsoil and spoil material management. These do not exceed civil engineering and construction best practice. It is recommended that the proposed activity be authorised.

NATIONAL ENVIRONMENTAL MANAGEMENT ACT, 1998 (ACT NO. 107 OF 1998) AND ENVIRONMENTAL IMPACT REGULATIONS, 2014 (AS AMENDED) - REQUIREMENTS FOR SPECIALIST REPORTS (APPENDIX 6

Regulation GNR 326 of 4 December 2014, as amended 7 April 2017, Appendix 6	Section of Report
1. (1) A specialist report prepared in terms of these Regulations must contain- a) details of- i. the specialist who prepared the report; and ii. the expertise of that specialist to compile a specialist report including a curriculum vitae;	1.3 Appendix B
b) a declaration that the specialist is independent in a form as may be specified by the competent authority;	Appendix A
c) an indication of the scope of, and the purpose for which, the report was prepared;	1.1, 1.2
(cA) an indication of the quality and age of base data used for the specialist report;	1.4, References
(cB) a description of existing impacts on the site, cumulative impacts of the proposed development and levels of acceptable change;	5, 6
d) the date and season of the site investigation and the relevance of the season to the outcome of the assessment;	Not applicable
e) a description of the methodology adopted in preparing the report or carrying out the specialised process inclusive of equipment and modelling used;	1.4, Appendix C
f) details of an assessment of the specific identified sensitivity of the site related to the proposed activity or activities and its associated structures and infrastructure, inclusive of a site plan identifying site alternatives;	3, 6, 7
g) an identification of any areas to be avoided, including buffers;	None identified
h) a map superimposing the activity including the associated structures and infrastructure on the environmental sensitivities of the site including areas to be avoided, including buffers;	No sensitivities identified
i) a description of any assumptions made and any uncertainties or gaps in knowledge;	2
j) a description of the findings and potential implications of such findings on the impact of the proposed activity, (including identified alternatives on the environment) or activities;	5,6,7
k) any mitigation measures for inclusion in the EMPr;	6.1 Table 6-1
l) any conditions for inclusion in the environmental authorisation;	6.1 Table 6-1
m) any monitoring requirements for inclusion in the EMPr or environmental authorisation;	6.1 Table 6-1
n) a reasoned opinion- i. (as to) whether the proposed activity, activities or portions thereof should be authorised; (iA) regarding the acceptability of the proposed activity or activities; and ii. if the opinion is that the proposed activity, activities or portions thereof should be authorised, any avoidance, management and mitigation measures that should be included in the EMPr, and where applicable, the closure plan;	6.1, 8 6.1 Table 6-1
o) a description of any consultation process that was undertaken during the course of preparing the specialist report;	Not applicable
p) a summary and copies of any comments received during any consultation process and where applicable all responses thereto; and	None
q) any other information requested by the competent authority.	None
2) Where a government notice <i>gazetted</i> by the Minister provides for any protocol or minimum information requirement to be applied to a specialist report, the requirements as indicated in such notice will apply.	Not applicable

Table of Contents

Executive Summary.....	iii
NATIONAL ENVIRONMENTAL MANAGEMENT ACT, 1998 (ACT NO. 107 OF 1998) AND ENVIRONMENTAL IMPACT REGULATIONS, 2014 (AS AMENDED) - REQUIREMENTS FOR SPECIALIST REPORTS (APPENDIX 6...iv	
Table of Contents.....	v
Figures.....	vi
Tables.....	vi
1. Introduction.....	1
1.1. Scope and Objectives.....	1
1.2. Terms of Reference.....	1
1.3. Specialist Credentials.....	1
1.4. Assessment Methodology.....	1
2. Assumptions and Limitations.....	2
3. Technical Description.....	2
3.1. Project Location.....	2
3.2. Project Description.....	3
3.2.1. Alternatives.....	4
4. Legal Requirement and Guidelines.....	4
5. Description of the Receiving Environment.....	4
5.1. Climate.....	4
5.2. Topography and Drainage.....	5
5.3. Bedrock Geology.....	5
5.4. Engineering Geology.....	6
5.5. Desktop Geotechnical Appraisal.....	6
6. Identification and Assessment of Impacts.....	8
6.1. Impact of the Project on the Geological Environment.....	8
7. Comparative Assessment of Alternatives.....	1
8. Conclusion and Summary.....	1
8.1. Summary of Findings.....	1
8.2. Impact Statement and Conclusion.....	1
References.....	2
Appendix A. Specialist Declaration of Interest and Undertaking Under Oath.....	A
Appendix B. Specialist CV.....	B
Appendix C. Environmental Impact Assessment (EIA) Methodology.....	C



Figures

Figure 2-1 BESS is located on the authorised Mierdam Photovoltaic (PV) Energy Facility	3
Figure 2-1 Extract of 1:150 000 scale Geological Map 3022 BRITSTOWN.....	6
Figure 2-1 Inferred Ground Units	7

Tables

Table 2-1 Summary of Geotechnical Conditions.....	7
Table 6-1 Impact Assessment Methodology Matrix	9

1. Introduction

GaGE Consulting (Pty) Ltd has been appointed by SiVEST (PTY) Ltd, on behalf of South Africa Mainstream Renewable Power Mierdam (Pty) Ltd to undertake the assessment of the development of a Battery Energy Storage System (BESS) and associated infrastructure for the authorised Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3), located near the town of Prieska, in the Siyathemba Local Municipality, Pixley ka Seme District in the Northern Cape Province of South Africa.

In terms of the Environmental Impact Assessment (EIA) Regulations, which were published on 04 December 2014 and amended on 07 April 2017 [promulgated in Government Gazette 40772 and Government Notice (GN) R326, R327, R325 and R324 on 7 April 2017], various aspects of the proposed development are considered listed activities under GNR 327 and GNR 324 which may have an impact on the environment and therefore require authorisation from the National Competent Authority (CA), namely the Department of Environment, Forestry and Fisheries (DEFF), prior to the commencement of such activities. This desktop geological and geotechnical specialist study has been commissioned to assess and verify the BESS under the applicable specialist protocols.

1.1. Scope and Objectives

Assess the geological and geotechnical conditions and impacts associated with the installation of a BESS on the Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3), including potential fatal flaws, if present.

The following key considerations were taken into account during the desktop study:

- The geological and geotechnical conditions (ground conditions) and the influence thereof on the competency of founding of civil infrastructure and structures
- Site topography and influence thereof on the site stability and suitability
- The presence of geological or geomorphological features such as faults, lineaments and unstable ground
- The presence of problem soils, geotechnical constraints, shallow groundwater conditions
- Geologically significant or sensitive features such as ridges, outcrops and exposures

1.2. Terms of Reference

The terms of reference were provided by SiVEST to allow a consistent approach to the various specialist studies and allow enable comparison of environmental impacts, efficient review, and collation of the specialist studies into their Basic Assessment report. This study is undertaken in accordance with the requirements provided in Regulation GNR 326 of 4 December 2014, as amended 7 April 2017, Appendix 6.

A detailed description of the infrastructure required for the BESS including layouts of the proposed development were provided by SiVEST.

1.3. Specialist Credentials

This study has been undertaken by Steven Bok, a Professional Natural Scientist registered by the South African National Council for Natural Scientific Professions (SACNASP) registration number 400279/07 (Geological Science). Mr Bok's CV is attached in Appendix A.

1.4. Assessment Methodology

The assessment involved a review of the following information:

- i) 1:250 000 Scale Geological Map 3022 BRITSTOWN (Council for Geoscience, 1991)

- ii) Aerial photographs (Google Earth imagery, current and historical)
- iii) Technical report titled “Prieska Solar PV/WindFarm Project Report on Preliminary Geotechnical Investigation” produced by Mainstream Renewable Power dated February 2012 (Version Number 1)
- iv) Technical report titled “Proposed Development of a Wind & Solar Power Generation Plant near Copperton, NC Visual Impact Assessment Report, EIR Phase” produced by Mainstream Renewable Power dated March 2012
- v) Technical report titled “Proposed Wind and Photovoltaic Energy Facilities Near Prieska, Northern Cape Final Soil and Agricultural Assessment Report” produced by SiVEST dated May 2012
- vi) Screening Report for Environmental Authorisation (national web based environmental screening tool)
- vii) General site photographs provided by SiVEST
- viii) Literature as referenced within this report

An Environmental Impact Assessment matrix was used to quantify the impacts of the project on the receiving environment (provided by SiVEST and attached as Appendix C).

2. Assumptions and Limitations

The services performed by GaGE Consulting (Pty) Ltd were conducted in a manner consistent with the level of care and skill ordinarily exercised by members of the geotechnical profession practising under similar conditions in the locality of the project. The interpretation of the site conditions is based on available information, experience in the general project area and professional judgement and is considered to provide sufficient confidence to meet the objectives of this specialist study. The nature of geotechnical engineering is such that conditions at variance with those described may be encountered on site. Engineering recommendations provided in this report are preliminary and must be confirmed through further intrusive investigations.

Third party information has been utilised in good faith.

A site visit was not undertaken.

3. Technical Description

3.1. Project Location

The BESS is located on the authorised Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3), located near located the town of Prieska, in the Siyathemba Local Municipality, Pixley ka Seme District in the Northern Cape Province of South Africa.

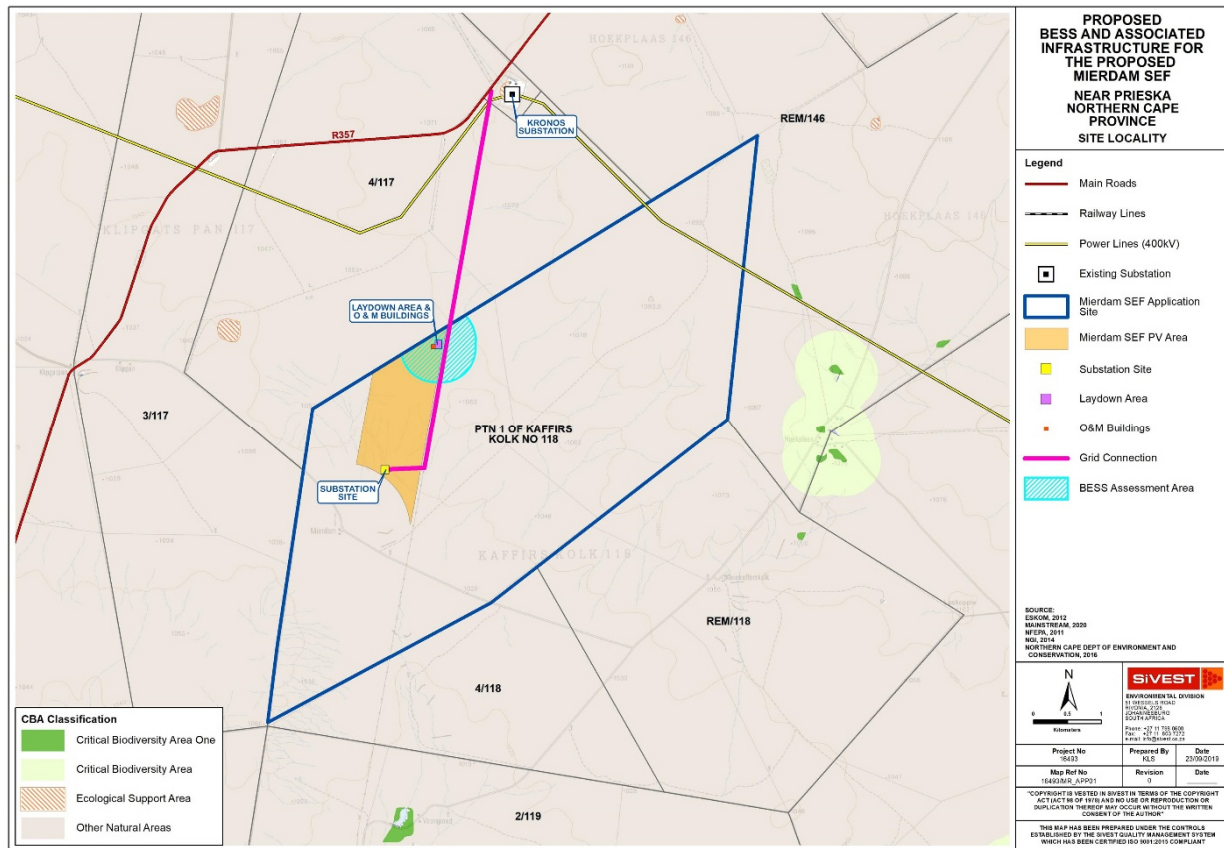


Figure 3-1 BESS is located on the authorised Mierdam Photovoltaic (PV) Energy Facility

3.2. Project Description

South Africa Mainstream Renewable Power Mierdam (Pty) Ltd is proposing the construction and operation of Battery Energy Storage System (BESS) and associated infrastructure for the authorised Mierdam PV (12/12/20/2320/2/AM3). The need for a BESS stems from the fact that electricity is only produced by the Renewable Energy Facility while the sun is shining, while the peak demand may not necessarily occur during the day-time. Therefore, the storage of electricity and supply thereof during peak-demand will mean that the facility is more efficient, reliable and electricity supply more constant.

The BESS will:

- Store and Integrate a greater amount of renewable energy from the Renewable Energy Facility into the electricity grid
- This will assist with the objective to generate electricity by means of renewable energy to feed into the National Grid which will be procured under either the Renewable Energy Independent Power Producer Procurement Program (REIPPPP), other government run procurement programmes or for sale to private entities if required

The Mierdam PV BESS will be located adjacent to the approved Mierdam PV substation associated with the approved Mierdam PV. To reduce electrical losses the BESS must be in close proximity to the on-site 33/132kV substation. A ~5ha study site has been established around the approved substation (500m zone) to allow for the micro-siting / specialist guidance regarding placement can be made

3.2.1. Alternatives

No site alternatives for this proposed development were considered as the placement of the proposed BESS is dependent on the location of the Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3).

Technology alternatives are limited to battery types, namely Redox flow batteries and Solid State Batteries. No other activity alternatives are being considered.

The BESS alternatives are:

BESS Specifications	
BESS Footprint	Up to 2Ha
BESS Capacity	200MWh
BESS Technology	Lithium Ion
BESS Type Alternative- Solid State Batteries	Containerised systems assembled within shipping containers and delivered to the project site. Dimensions are approximately 17 m long x 3.5 m wide x 4 m high. Containers will be placed on a raised concrete plinth (30 cm) and may be stacked on top of each other to a maximum height of approximately 15 m. Additional instrumentation, including inverters and temperature control equipment, may be positioned between the battery containers.

The 'no-go' alternative is the option of not constructing and operating a BESS in support of the authorised Renewable Energy (RE) facility. This alternative would result in no additional environmental impact other than that assessed during the EIA for the RE facility

The 'no-go' option is an option; however, this would prevent the Mierdam PV Facility from contributing to the environmental, social and economic benefits associated with the development of the renewables sector.

The above-mentioned alternatives (including 'no-go' alternative) will all be assessed by the appointed specialists as part of the BA process. All the above-mentioned location alternatives will be informed by the identified environmental sensitive and/or 'no-go' areas (i.e. status quo). The respective alternatives being considered as part of the BA process for the proposed development will also be comparatively assessed.

4. Legal Requirement and Guidelines

The desktop study was undertaken according to the guidelines provided by The South African Institution of Civil Engineering Site Investigation (SAICE) Code of Practice published by The Geotechnical Division of SAICE, 2010.

This report has been prepared to meet the requirements for a specialist report as provided in Regulation GNR 326 of 4 December 2014, as amended 7 April 2017, Appendix 6.

5. Description of the Receiving Environment

The following description of the receiving environment is relevant to assessing the geological and geotechnical impacts.

5.1. Climate

Climate plays a fundamental role in rock weathering and soil development. The effect of climate on the weathering processes (i.e. soil formation) in a particular area can be determined from the climatic N-value, defined by Weinert (1980). A climatic

N-Value of 5 or less implies a water surplus and the dominant mode of weathering is chemical decomposition. These climatic conditions are favourable for the development of a deep residual soil profile. Where the climatic N-value is greater than 5, mechanical disintegration is the predominant mode of rock weathering. In these drier areas residual soils are typically shallow.

Weinert's climatic N-value for the site is approximately 25. This implies an arid climate with an extremely shallow residual soil profile. Very shallow bedrock can be anticipated (unless the rock is covered with transported soils). This climate is conducive to the formation of pedogenic calcrete.

5.2. Topography and Drainage

The topography in the general area surrounding the site is characterised by flat plains with areas of slightly more undulating relief, including some low ridges. The assessment area slopes gently towards the south, although localised undulations and erosional features appear to occur. There are no distinct drainage features on the site, although signs of overland surface flow are noted in the southern section of the assessment area.

The natural topography and drainage do not appear to have been impacted by any previous activities.

5.3. Bedrock Geology

According to the 1:1250 000 scale geological map 3022 BRITSTOWN, the bedrock geology beneath the BESS assessment area comprises "tillite, boulder shale, sandstone, siltstone, shale, varved shale" of the Dwyka Group of the Karoo Supergroup (designated **C-Pd**). The Dwyka Group comprises of various glacial, sub-glacial and subaqueous sediments but is commonly associated with the massive diamictite facies, comprising of generally clast-rich diamictite (Johnson, *et.al.* 2006) also referred to as tillite. The tillite rock comprises of a fine dark grey rock matrix with characteristic rounded to angular frequently striated drop stones of various origin. The stratified diamictite facies comprises of bedded diamictite, mudrock, sandstone and conglomerate. A carbonate-rich facies is also present.

Surficial alluvial deposits are shown to underlie the south western section of the assessment area. While a description of these materials is not provided on the geological map, they are anticipated to comprise of silty sands or sandy silts.

Intrusive rocks of the Namaqualand Metamorphic Province are shown to occur approximately 300 m north of the site (designated **Mg**). These rock units are expected to occur with depth below the Dwyka Group sediments but are unlikely to be encountered during construction or influence the geotechnical conditions.

Occasional Kimberlite pipes, sometimes associated with kimberlite fissures are in the general area, but not in close proximity to the site.

Distinct rock outcrop is not evident from the aerial photography. However, given the shallow bedrock, weathered tillite rock could be exposed in erosional features.

No faults, lineaments or other geological features are illustrated on the geological map or are visible from aerial photography.

Certain sedimentary rock units of the Dwyka Group are fossiliferous, and the environmental sensitivity classified as "High Sensitivity" for the paleontology theme. While the sensitivity for the site was not assessed further, the potential for preserved fossils to be present at shallow depth is considered to be low due to mechanical disintegration and calcification of the upper bedrock profile (described further in Section 5.4).

No mining activities have taken place on or close to the BESS assessment area.

An extract from the 1:250 000 scale geological map 3022 BRITSTOWN is provided below with the assessment area shown in red.

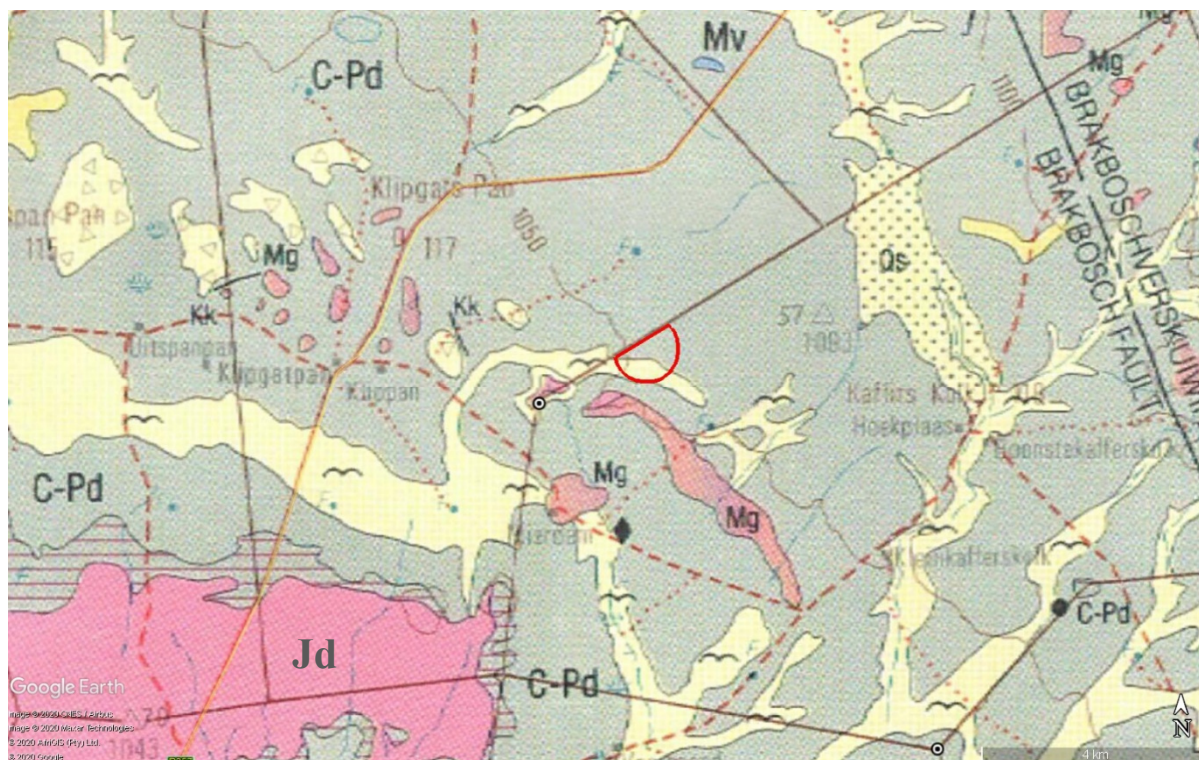


Figure 5-1 Extract of 1:150 000 scale Geological Map 3022 BRITSTOWN

5.4. Engineering Geology

Brink (1983) highlights that variable soils and weathering profiles and subsequently variable geotechnical conditions can develop on tillite bedrock, with the nature of the profile development largely controlled by the climate and geomorphological history. Expansive soils are known to develop in the Vryburg/Kimberley/Hopetown area. However, given the more arid climate these soils are not expected to be prominently developed at the site.

Tillite bedrock is often intensely jointed and develops a blocky structure. Hard rock may also disintegrate on exposure to the atmosphere.

The geotechnical investigation report reference in Section 1.4 provides information that enables a satisfactory preliminary assessment of the geotechnical conditions within the assessment area. As part of this investigation one test pit was excavated within the western section of assessment area (designated TP2 M) and two were dug close to the boundary or near the site boundary (TP2 M and TP8 M). The test pits TP1 M and TP2 M encountered a shallow, sandy transported surficial soil horizon, approximately 0.30 m thick underlain by a disintegrated residual layer, described as a “firm” to “stiff” sandy silt, extending to between 0.70 m and approximately 1.20 m. This is in turn underlain by weathered and fractured rock described as siltstone. Refusal of the TLB occurred at 1.70 and 1.15 m in TP1 M and T2 M, respectively.

A firm to stiff clayey soil profile was encountered in TP8 M near the eastern site boundary to refusal depth at 0.95 m. This profile is anomalous and was not intersected in the other test pits excavated in the surrounding areas.

Based on the profile photographs, the soil profile is weakly calcified although extensively developed calcrete is not present. No test pits were excavated within the section of the site shown to be underlain by alluvial sands on the geological map and a deeper soil profile may be expected in this area.

5.5. Desktop Geotechnical Appraisal

Based on the desktop study, the proposed BESS assessment area may be divided into two Ground Units where similar geotechnical conditions are anticipated. These correspond to areas underlain by rock units of the Dwyka Group and those

underlain by alluvial deposits. The boundary of the two zones is approximate only and will need to be confirmed on site through intrusive investigations.



Figure 5-2 Inferred Ground Units

Both ground units are considered suitable for the development of the BESS infrastructure, from a geotechnical viewpoint, provided that standard engineering design and construction measures are implemented to mitigate the identified geotechnical constraints. While Zone I is considered marginally more suitable for development from a geotechnical perspective, other factors are likely to be more critical in determining the final BESS layout.

The anticipated geotechnical constraints and mitigation measures are summarised in Table 2-1.

Table 5-1 Summary of Geotechnical Conditions

Ground Unit	Geology	Geotechnical Conditions / Constraints	Impacts on Engineering Design and Construction
I	Tillite, shale, sandstone	<ul style="list-style-type: none"> • Shallow bedrock • Thin soil cover • Hard excavation conditions 	<ul style="list-style-type: none"> • Good founding conditions for structures at shallow depths • Conventional shallow foundations suitable • Conventional subgrade preparation for roads • Hard excavation conditions for trenching / earthworks
II	Alluvial Sands/silts	<ul style="list-style-type: none"> • Loose to medium dense sandy soils • Potentially collapsible soils • Moderate soil cover • Moderate bedrock depth • Increased erosion potential 	<ul style="list-style-type: none"> • Deeper spread footings (found below alluvial sands) • Soft excavation conditions becoming intermediate with depth • Unstable trench sidewalls – shoring/battering required • Surface drainage measures required

6. Identification and Assessment of Impacts

No fatal flaws have been identified that would render the proposed BESS site unsuitable from a geological and geotechnical perspective.

The BESS is containerised and the impact of the activity on the geological environment is limited to topsoil stripping, excavations for plinth foundations, trenching, the construction of access roads and associated light infrastructure. Bulk earthworks, where required for the construction of platforms and access roads, may be a significant impact.

6.1. Impact of the Project on the Geological Environment

The main impact of the BESS development from a geological perspective is the displacement and possible removal of soil and rock materials. These activities will predominantly take place during the construction phase. The degree of disturbance is largely dependent on the topography of the project site and the nature of the proposed infrastructure. Steep slopes are unfavourable as these require bulk earthworks to create working platforms and access roads. Earthworks on steep slopes increases the risk of soil movements or slope failure.

The risk of soil erosion is also increased during construction activities, by the removal of vegetation and by possible disturbance to the natural surface drainage environment. These activities may prevent infiltration of rainwater, increase surface runoff and cause concentration of surface water flow. Erosion will increase the disturbance and displacement of soils and the impact may extend beyond the infrastructure footprint/s over time.

The effects of BESS development on the geological environment was evaluated using an Environmental Impact Assessment (EIA) Methodology, provided by SiVEST, which aids in determining the significance of an environmental impact on an environmental parameter through a systematic analysis. The EIA methodology is attached as Appendix C.

Based on the impact significance ratings presented in Table 6-1, the development of the proposed BESS on the Droogfontein 3 Solar Photovoltaic (PV) Energy Facility, from a geological and geotechnical perspective, will be "Negative Low impact".

The topography of the site is gentle and significant earthworks are not anticipated (although some minor earthworks are anticipated where local undulations occur). The soils and topography render the site moderately susceptible to soil erosion. No ridges or rock outcrops which may be of geological importance were identified.

Table 6-1 Impact Assessment Methodology Matrix

ENVIRONMENTAL PARAMETER	ISSUE / IMPACT / ENVIRONMENTAL EFFECT/NATURE	ENVIRONMENTAL SIGNIFICANCE BEFORE MITIGATION						RECOMMENDED MITIGATION MEASURES	ENVIRONMENTAL SIGNIFICANCE AFTER MITIGATION											
		E	P	R	L	D	I / M		TOTAL	STATUS (+ OR -)	S	E	P	R	L	D	I / M	TOTAL	STATUS (+ OR -)	S
Construction Phase																				
Disturbance/ displacement/ removal of soil and rock	Ground disturbance during platform earthworks, road subgrade preparation, trenching	1	4	2	2	3	1	12	-	Low	1) Design facility layout to minimise earthworks and levelling based on high resolution ground contour information 2) Correct topsoil and spoil management	1	4	2	1	3	1	11	-	Low
Soil Erosion	Increased erosion due to vegetation clearing, alteration of natural drainage	1	4	2	2	2	1	11	-	Low	1) Temporary berms and drainage channels to divert surface runoff where needed 2) Landscape and rehabilitate disturbed areas timeously (e.g. regrassing) 3) Correct engineering design of road and site drainage 4) Use designated access and laydown areas only to minimise	1	4	2	1	2	1	7	-	Low



ENVIRONMENTAL PARAMETER	ISSUE / IMPACT / ENVIRONMENTAL EFFECT/NATURE	ENVIRONMENTAL SIGNIFICANCE BEFORE MITIGATION							RECOMMENDED MITIGATION MEASURES	ENVIRONMENTAL SIGNIFICANCE AFTER MITIGATION											
		E	P	R	L	D	I/M	TOTAL		STATUS (+ OR -)	S	E	P	R	L	D	I/M	TOTAL	STATUS (+ OR -)	S	
Operational Phase																					
Soil Erosion	Increased erosion due to alteration of natural drainage	1	2	1	1	2	1	1	1	1	1	1	1	1	2	1	2	1	6	-	Low
1) Maintain drainage channels 2) Monitor for erosion and remediate and rehabilitate timeously																					
Decommissioning Phase																					
Disturbance/ displacement/ removal of soil and rock	Ground disturbance during platform earthworks, road rehabilitation, removal of subsurface infrastructure	1	4	2	2	2	2	1	1	2	2	1	1	2	1	2	2	1	10	-	Low
1) Restore natural site topography 2) Landscape and rehabilitate disturbed areas timeously (e.g. regrassing)																					

ENVIRONMENTAL PARAMETER	ISSUE / IMPACT / ENVIRONMENTAL EFFECT/NATURE	ENVIRONMENTAL SIGNIFICANCE BEFORE MITIGATION							RECOMMENDED MITIGATION MEASURES	ENVIRONMENTAL SIGNIFICANCE AFTER MITIGATION										
		E	P	R	L	D	I/ M	TOTAL		STATUS (+ OR -)	S	E	P	R	L	D	I/ M	TOTAL	STATUS (+ OR -)	S
Soil Erosion	Increased erosion due to ground disturbance during rehabilitation activities	1	2	2	2	2	2	1	9	-	Low	1	1	1	1	2	1	6	-	Low
Cumulative																				
Disturbance/ displacement/ removal of soil and rock	No cumulative effect																			
Soil Erosion																				

7. Comparative Assessment of Alternatives

Layout alternatives which subsequently informed the area for the potential construction of the proposed substation and subsequent BESS assessment area were identified and comparatively assessed as part of the BA process undertaken in 2016.

No geologically or geotechnically sensitive areas were identified within or near the assessment area. While Zone I is considered marginally more suitable for development from a geotechnical perspective than Zone II (as per Figure 2-1), other factors are likely to be more critical in determining the final BESS layout. No preferences for the final BESS layout within the assessment area are therefore provided.

8. Conclusion and Summary

8.1. Summary of Findings

This desktop geotechnical specialist study was undertaken for the installation of a BESS on the authorised Mierdam Photovoltaic (PV) Energy Facility (12/12/20/2320/2/AM3). The assessment area may be underlain by tillite, boulder shale, sandstone, siltstone, shale bedrock. Surficial alluvial deposits comprising of silty sands or sandy silts are expected to underlie the south western section of the assessment area. Some geotechnical constraints have been identified, including the presence of shallow bedrock and loose/collapsible sands. These constraints may be mitigated via standard engineering design and construction measures. Shallow spread footings are considered suitable to support the structures.

No fatal flaws have been identified that would render the proposed BESS site unsuitable from a geological and geotechnical perspective.

The proposed BESS is assessed to have a “Negative Low impact - the anticipated impact will have negligible negative effects and will require little to no mitigation”. The recommended mitigation measures provided to minimise the impacts relate to the appropriate engineering design of earthworks and site drainage, erosion control and topsoil and spoil material management. These do not exceed civil engineering and construction best practice.

Further intrusive geotechnical investigations should be undertaken to confirm the engineering recommendations provided in this report.

8.2. Impact Statement and Conclusion

From a geotechnical and geological perspective, no fatal flaws, sensitivities, or areas to be avoided have been identified within or close to the BESS assessment area. It is therefore recommended that the proposed activity be authorised.

References

Brink, A.B.A. Engineering Geology of Southern Africa, The Karoo Sequence, Volume 3. Building Publications, 1983

Brink, A.B.A. Engineering Geology of Southern Africa, Post-Gondwana Deposits, Volume 4. Building Publications, 1985.

Johnson, M.R. Anhaeusser, C.R. Thomas, R.J. The Geology of South Africa. Council for Geoscience, 2006.

Appendix A. Specialist Declaration of Interest and Undertaking Under Oath



Appendix B. Specialist CV

Appendix C. Environmental Impact Assessment (EIA) Methodology