



ENGINEERING SURVEY DESIGN DRAWING


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Rem Of Farm Eerste Geluk 626 LS

Bush Clearing Needed

Possible Rock

Be Aware Of Pipe Lines

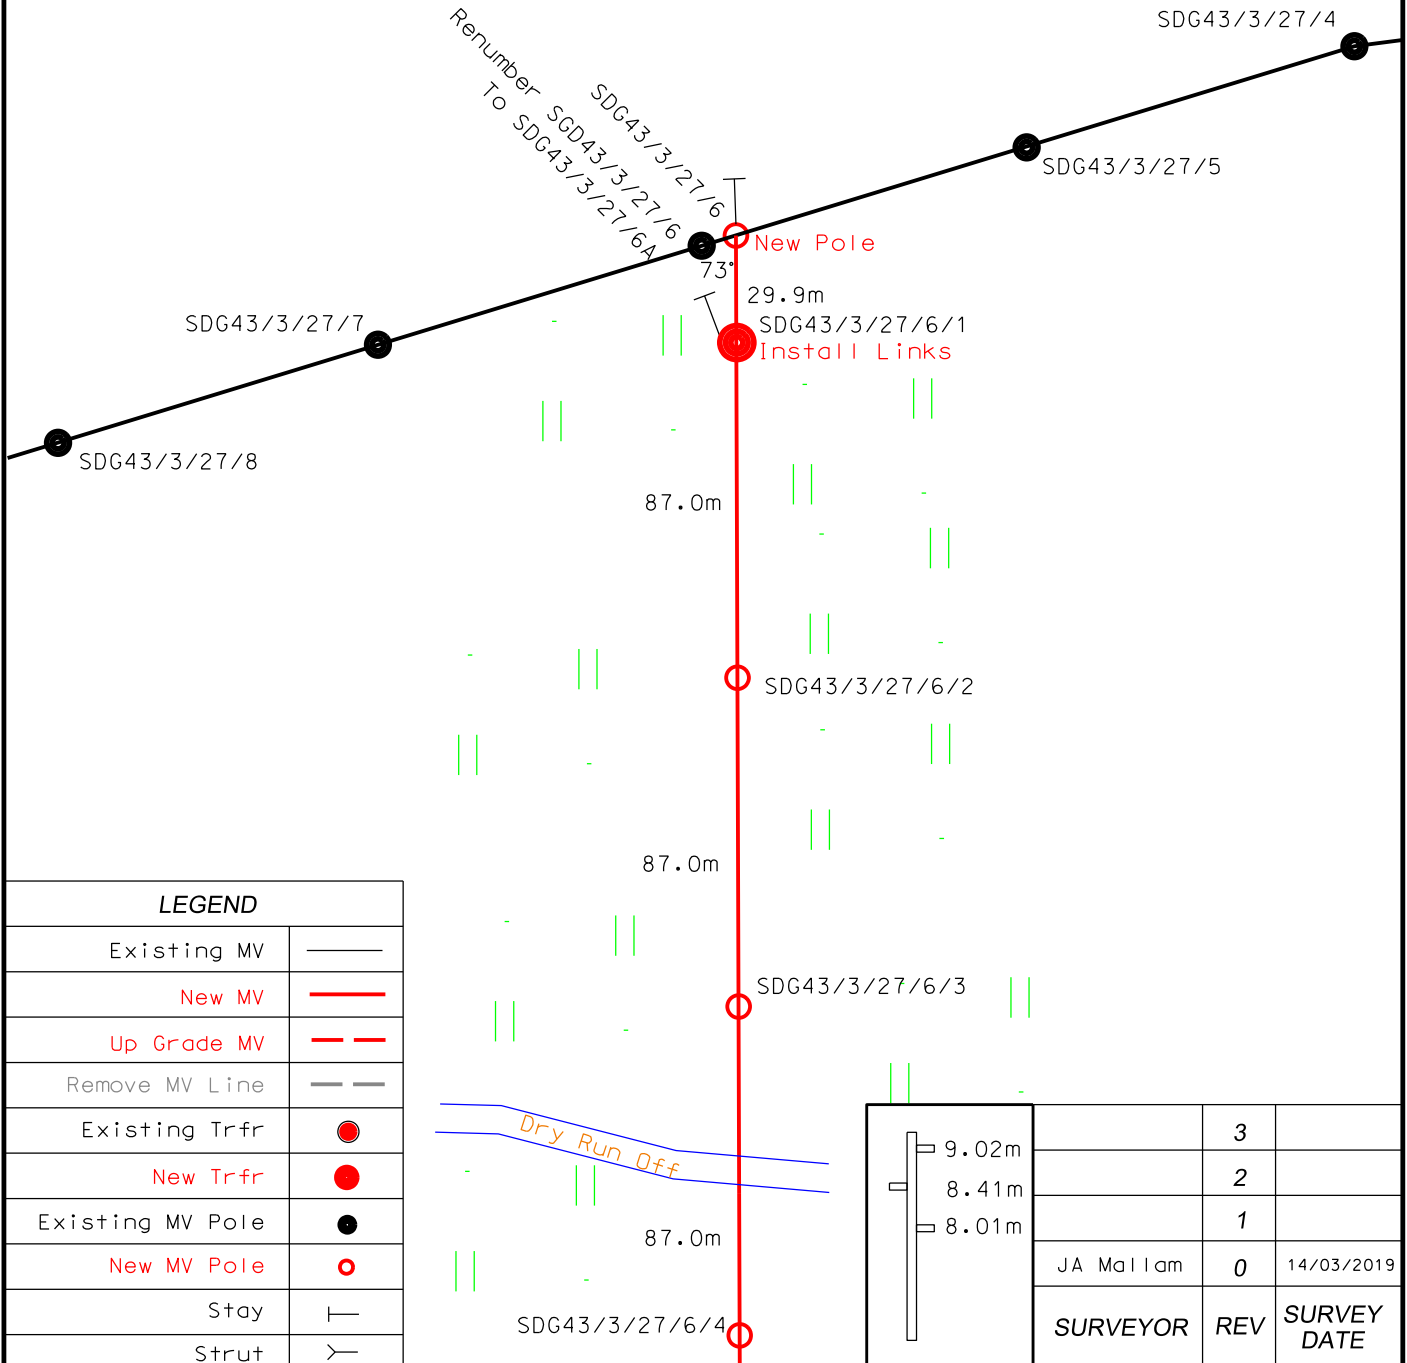

LEGEND

Existing MV	—
New MV	—
Up Grade MV	- - -
Remove MV Line	- - -
Existing Trfr	●
New Trfr	●
Existing MV Pole	●
New MV Pole	○
Stay	┆
Strut	>


		3	
		2	
		1	
	JA Mallam	0	14/03/2019
SURVEYOR	REV	SURVEY DATE	

FEEDER:	SOETDORING 11kV
PROJECT NO:	
CONDUCTOR:	
LENGTH OF LINE:	0.783 km
SURVEYOR:	EngSurv
DRAUGHTSPERSON:	JA Mallam

CUSTOMER:	H04-0718_F1_Pol-Munic-Bloodriver
PROPERTY:	Rem Of Farm Eerste Geluk 626 LS
CONTACT DETAILS	015 298 8306
SCALE:	1:2000
PAGE:	1 of 2

N

THIS DRAWING IS THE PROPERTY OF ESKOM
Disclaimer: Eskom is not responsible for any errors displayed on this drawing



Rem Of Farm Eerste Geluk 626 LS
Bush Clearing Needed

Possible Rock

Be Aware Of Pipe Lines

87.0m

SDG43/3/27/6/5

87.0m

SDG43/3/27/6/6

87.0m

SDG43/3/27/6/7

76.1m

77.0m

97°

SDG43/3/27/6/8

78.8m

SDG43/3/27/6/9

SDG43/3/27/6/10

25KVA TRF

H04-0718

H04-0718_F1

Bush Clearing Needed

Possible Rock

Be Aware Of Pipe Lines

Rem Of Farm Eerste Geluk 626 LS