




# ENGINEERING SURVEY DESIGN DRAWING

Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Bush Clearing Needed  
Possible Rock


**Be Aware Of Pipe Lines**

Rem Of Farm EERSTE GELUK 626 LS

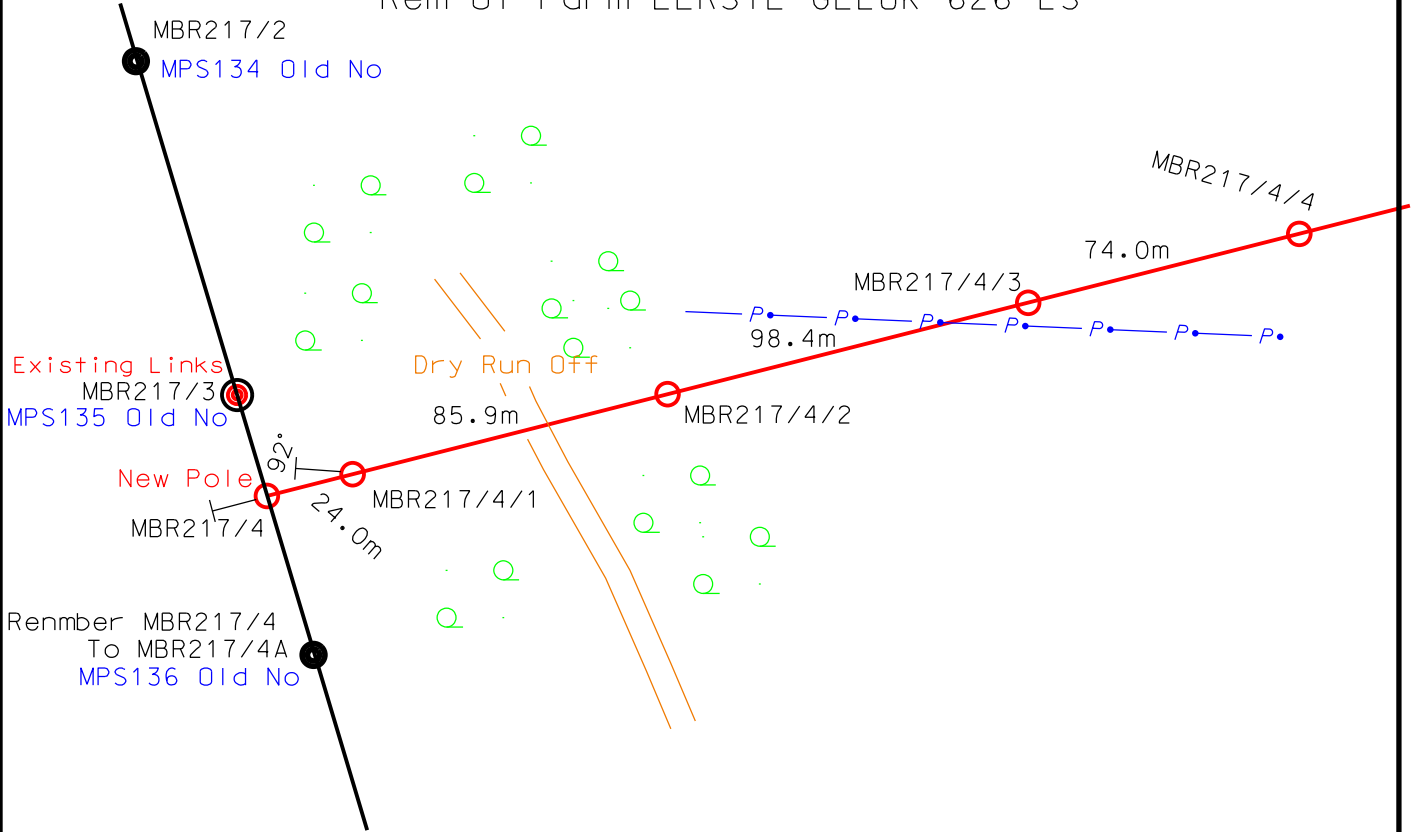

### LEGEND


Existing MV	—
New MV	—
Up Grade MV	- - -
Remove MV Line	- - -
Existing Trfr	●
New Trfr	●
Existing MV Pole	●
New MV Pole	○
Stay	┆
Strut	┆

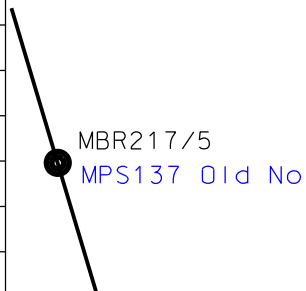

	MBR217/4	3	
		2	
	JA Mallam	1	13/07/2021
	JA Mallam	0	15/03/2019
SURVEYOR	REV	SURVEY DATE	

FEEDER:	BLOEDRIVER 11kV	CUSTOMER:	H16-1202_D8_Sand North_Pol-Munic
PROJECT NO:	H16-1202_D8	PROPERTY:	Rem Of Farm EERSTE GELUK 626 LS
CONDUCTOR:		CONTACT DETAILS	015 298 8306
LENGTH OF LINE:	1.019km	SCALE:	1:2000
SURVEYOR:	EngSurv	PAGE:	1 of 3
DRAUGHTSPERSON:	JA Mallam		


THIS DRAWING IS THE PROPERTY OF ESKOM  
Disclaimer: Eskom is not responsible for any errors displayed on this drawing




Bush Clearing Needed  
Possible Rock

**Be Aware Of Pipe Lines**

Rem Of Farm EERSTE GELUK 626 LS

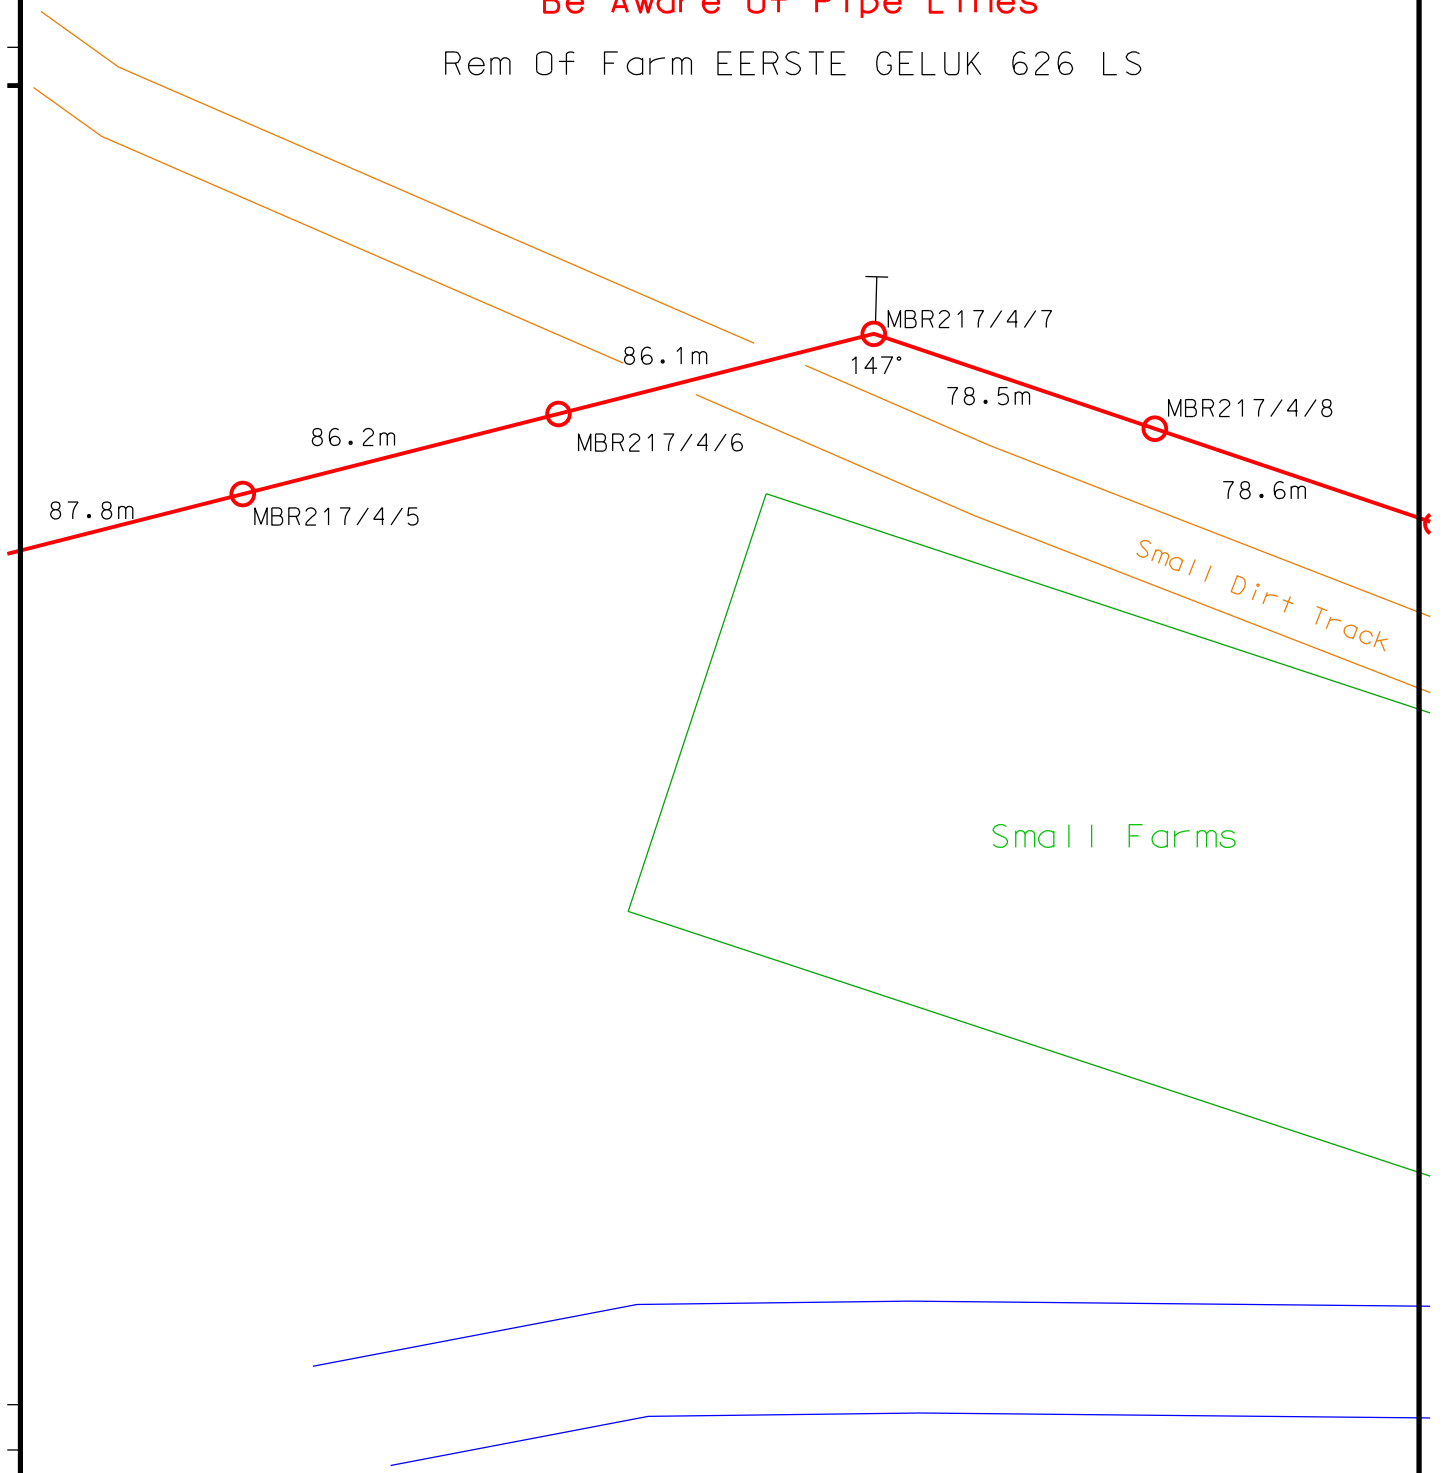



Bush Clearing Needed  
Possible Rock

**Be Aware Of Pipe Lines**

Rem Of Farm EERSTE GELUK 626 LS

