



PROPOSED NEW FIRST FLOOR
1:50

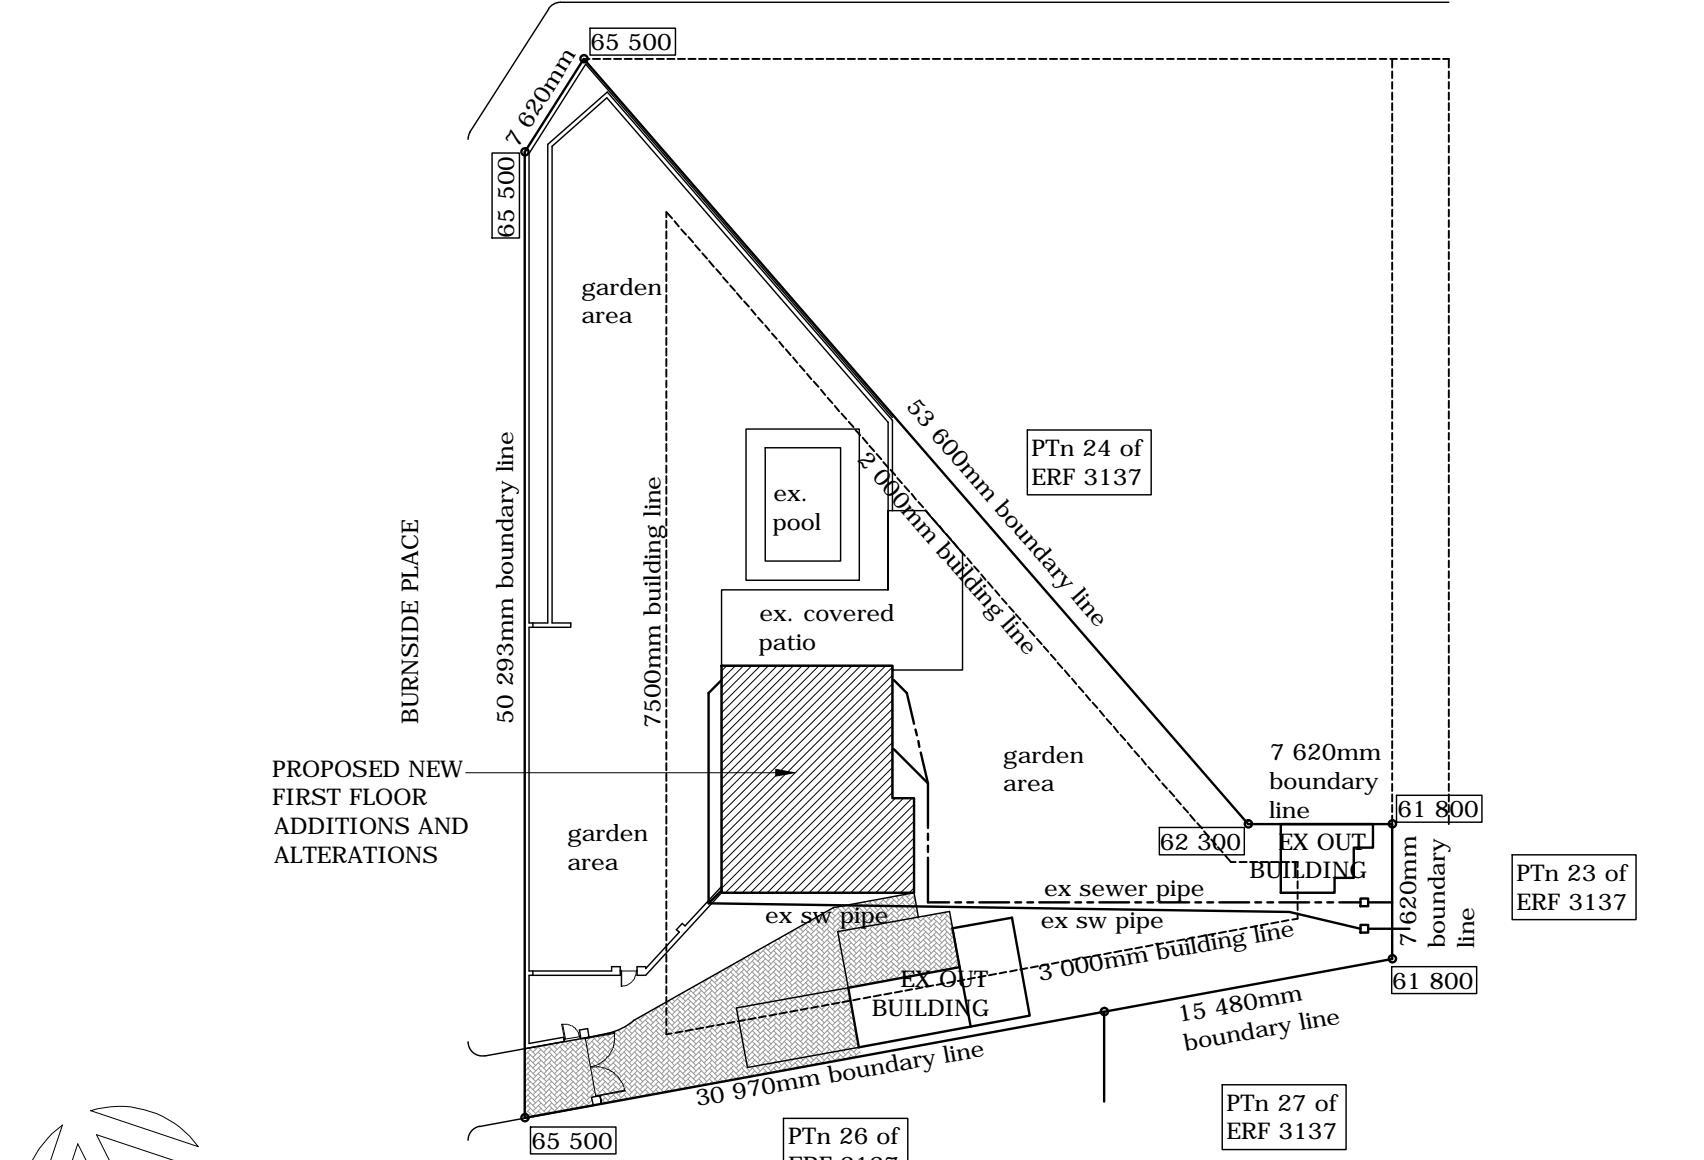

SITE PLAN
1:400

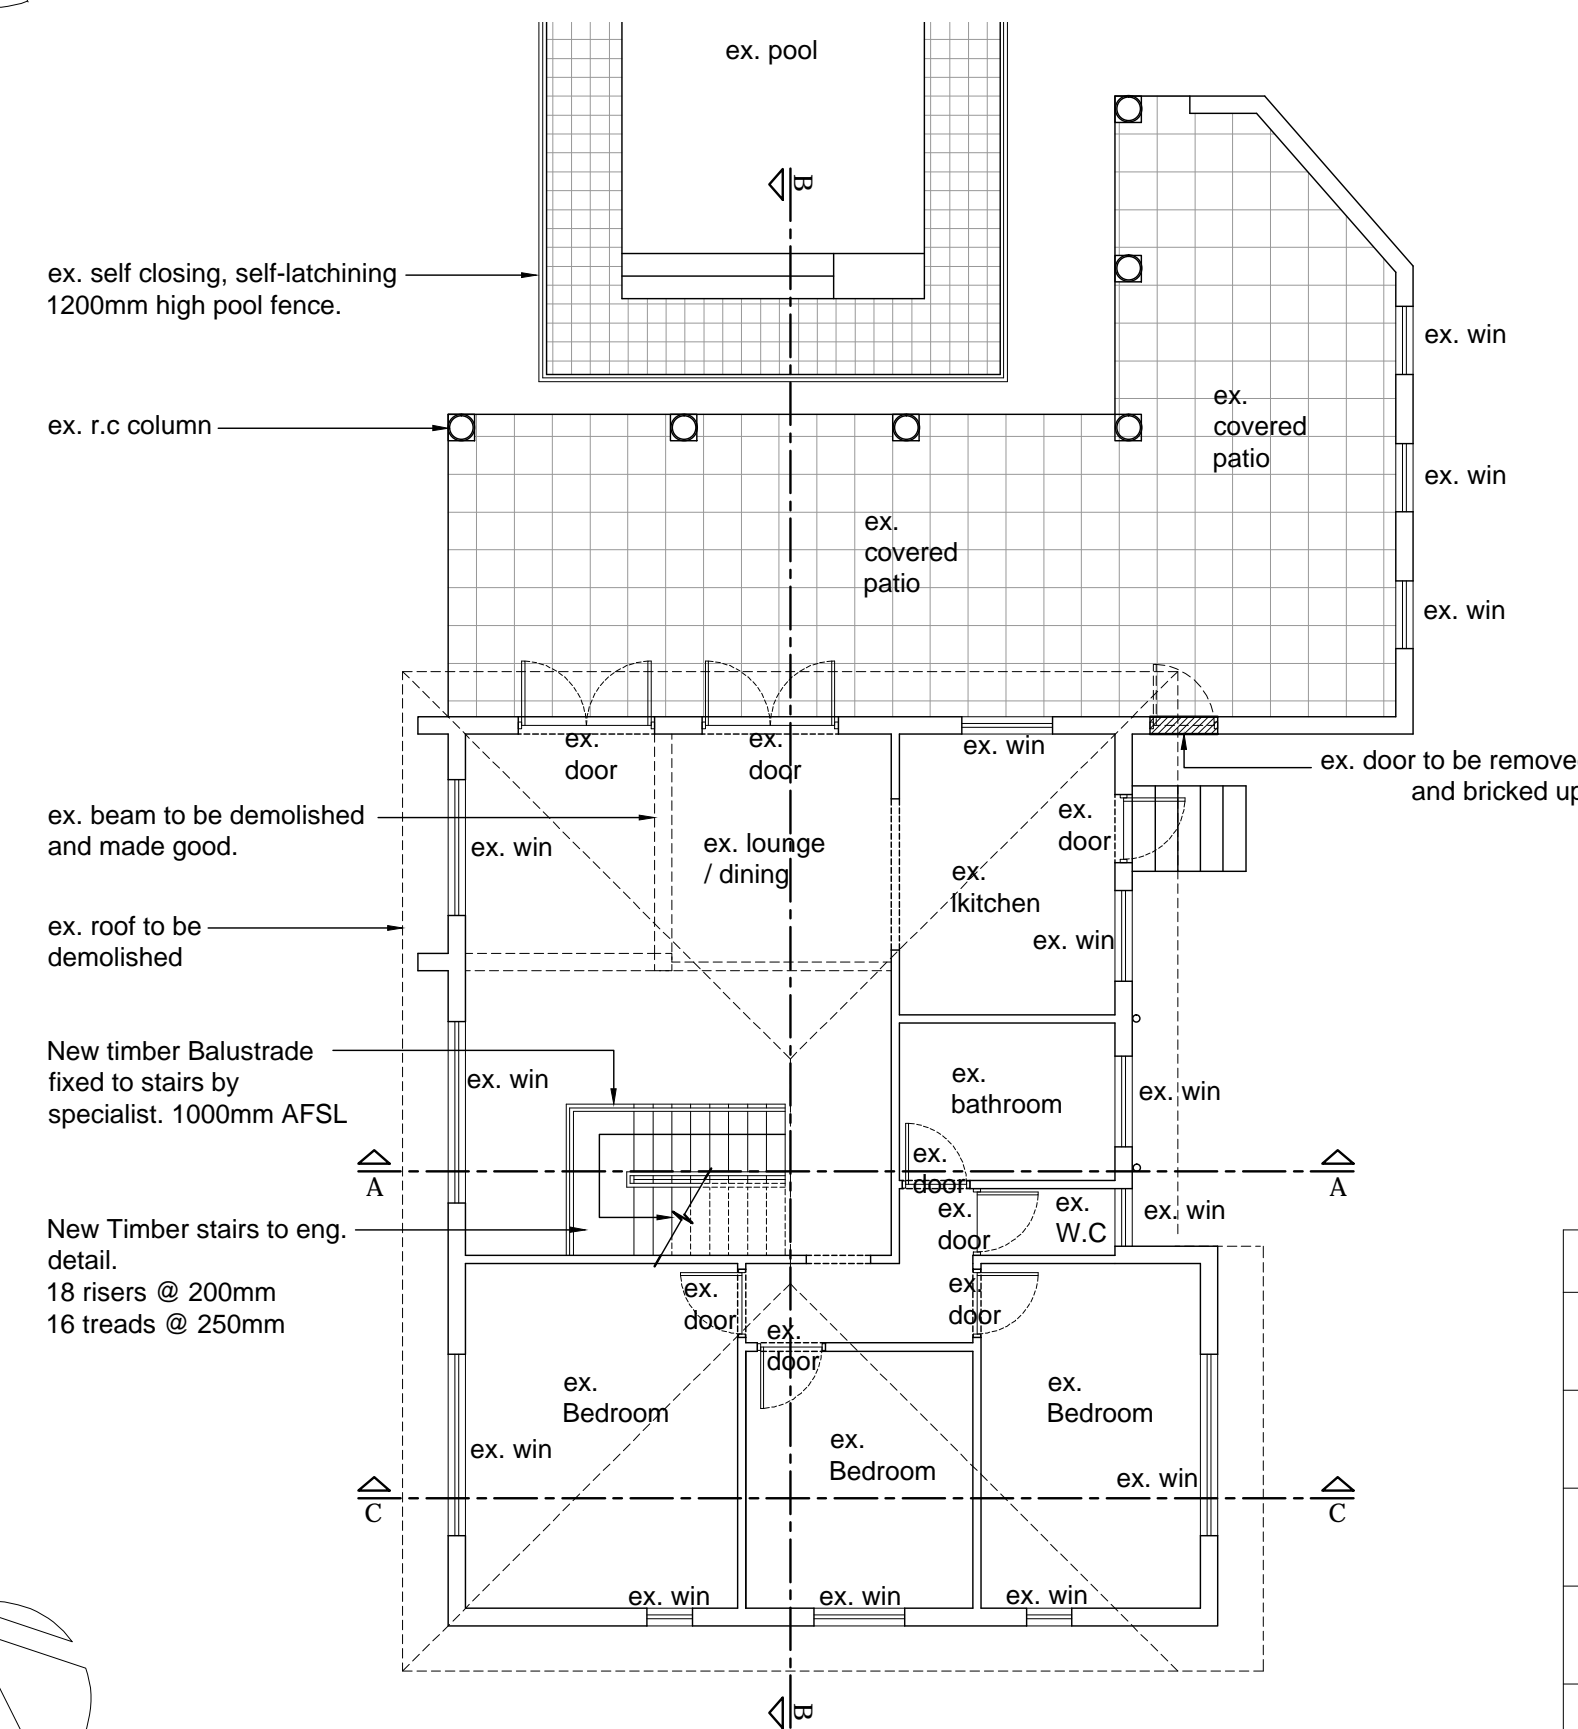

EXISTING GROUND FLOOR
1:100

<p>GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>GLAZING: 1. 4mm GLASS (CLEAR) monolithic annealed 2. Total glazed area = 4.0m² 3. Side Hung aluminium window</p>	<p>GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>GLAZING: 1. 4mm GLASS (CLEAR) monolithic annealed 2. Total glazed area = 0.9m² 3. Side Hung Cottage pane aluminium window</p>	<p>GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>GLAZING: 1. 4mm GLASS (CLEAR) monolithic annealed 2. Total glazed area = 1.7m² 3. Side Hung Cottage pane aluminium window</p>	<p>GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>GLAZING: 1. 4mm GLASS (CLEAR) monolithic annealed 2. Total glazed area = 0.7m² 3. Top Hung Cottage pane aluminium window</p>	<p>GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>GLAZING: 1. 4mm GLASS (CLEAR) monolithic annealed 2. Total glazed area = 0.7m² 3. Top Hung Cottage pane aluminium window</p>	<p>GENERAL NOTES</p> <p>1. ALL LEVELS AND DIMENSIONS TO BE CHECKED ON SITE BY CONTRACTOR PRIOR TO ANY CONSTRUCTION WORK BEING DONE</p> <p>2. ALL DISCREPANCIES TO BE REPORTED TO AUTHOR IMMEDIATELY FOR RECTIFICATION</p> <p>3. ALL WORK TO BE IN ACCORDANCE WITH SANS 10400 AND ALL MATERIALS USED TO BE OF SABS APPROVED STANDARDS</p> <p>4. ALL STRUCTURAL WORK TO BE TO ENGINEERS DETAIL AND SPECIFICATION, AND UNDER HIS SUPERVISION</p> <p>5. ALL SLIDING AND FOLDING GLASS DOORS TO BE SAFETY GLASS, ANY GLASS BELOW 900mm TO BE SAFETY GLASS IN ANY DOORS AND WINDOWS.</p> <p>6. PRE-CAST UNITS TO BE PROVIDED OVER ALL DOORS AND WINDOWS, UNLESS OTHERWISE SPECIFIED</p> <p>7. ALL GLAZING TO COMPLY WITH PART N OF SANS 10400</p> <p>8. win. - DENOTES WINDOW</p> <p>9. ALL DOOR AND WINDOWS VIEWED FROM OUTSIDE UNLESS OTHERWISE STATED</p> <p>11. ALL WINDOWS AND DOORS TO BE INSTALLED AND FINISHED ACCORDING TO MANUFACTURE'S SPECIFICATION BY SPECIALIST.</p>
---	--	--	---	---	---

SCHEDULE OF AREAS	
SITE AREA	1334.00m²
PERMITTED COV	533.6m² (40%)
PERMITTED FAR	1067.00m² (0.8)
existing cov	196.15m²
existing FAR	166.25m²
PROPOSED NEW COV	0m²
PROPOSED NEW FAR	114.46m²
TOTAL NEW COV	196.15m²
TOTAL NEW FAR	280.71m²

- WALLS:**
- EXTERNAL:**
- 38 X 114 mm SAP TIMBER FRAME WITH EXTERNAL SKIN OF 9 mm NUTEK CEMENT FIBRE PANELS WITH SKIM COAT PLASTER & PAINT TO MATCH EXISTING AND INTERNAL SKIN OF 15 mm GYPSUM BOARD PANELS WITH BULK INSULATION BETWEEN BOTH PANELS.
 - FLASHING INSTALLED BETWEEN NUTEK PANELS, TIMBER FRAME AND EXIST OR NEW
- INTERNAL:**
- 38 X 114 mm SAP TIMBER FRAME & 15 mm RHINOBOARD PANELS BOTH SIDES - SKIMMED & PAINTED
- SUSPENDED TIMBER FLOORS:**
- 18mm SHUTTERBOARD PANELS FIXED TO 38 x 114 FLOOR JOIST @ APPROX. 400mm CTRS ON 50 X 228 FLOOR BEARER BEAMS, AND 15mm RHINOBOARD PANEL UNDERSIDE FLOOR JOIST, SECURED WITH HOOP IRON TO DROPPERS FIXED TO EX WALL PLATES.
- ROOF AND CEILING:**
- EXISTING ROOF TILES AND TIMBER TO BE REMOVED. THE EXISTING TIE BEAMS AND CEILING PANELS AND BATONS TO REMAIN
 - REUSE ROOF TILES AND SECURE WITH 8mm WIRE TIES ON 38 X 38 mm BATTENS ON PVC UNDERLAY ON 38 X 144 mm GANGNAILED TIMBER TRUSSES @ APPROX. 700 mm CTRS ON 38 X 114 mm WALL PLATES. ROOF PITCH AS SPECIFIED.
 - CEILING - GYPSUM BOARD ON 38 x 38mm BRANDINGER FIXED UNDERSIDE TRUSSES
 - PCV FASCIA, BARGE BOARDS AND FLASHING TO MATCH EXISTING

DRAINAGE: TO COMPLY TO SANS 10400-P

EXISTING RETICULATIONS TO BE CHECKED AND DAMAGED FITTINGS REPLACED. RAINWATER: GUTTERS AND DOWNPIPES TO MATCH EXIST AND TO COMPLY WITH N.B.R. AND SANS 10400 - 160 mm PVC PIPES BELOW AND ABOVE NGL AND 160mm UPVC RIBBED PIPES BELOW STRUCTURES. 50mm WASTE PIPES AND 110 mm SOIL PIPES - PVC PIPES ABOVE AND BELOW NGL AND UPVC / UPVC RIBBED PIPES BELOW STRUCTURES. PIPES BELOW NGL & STRUCTURES TO HAVE IE'S & RE'S AT ALL BENDS AND JUNCTIONS RE'S EVERY 10 METRES MIN. ON STRAIGHT RUNS AND A 110 mm PVC VENT PIPE AT HEAD OF DRAIN SYSTEM. ALL WASTE & SOIL PIPES TO HAVE MINIMUM FALL OF 1:40. 4) ROOF ROOMS RAIN WATER PIPES TO DISCHARGE WATER VIA SPREADER OVER EXISTING DWELLING ROOF. RAINWATER PENETRATION TEST TO COMPLY WITH S.A.B.S 685.

WATERPROOFING SHOWERS & BATHS ETC.

COAT BELOW SHOWER TRAY AND BATH TUB AND ADJACENT WALLS AND WASH HAND BASIN SPLASH WALL WITH EPOXY SEALANT, FIT TILES AND SEAL ALL SANWARE AND TILE JOINTS/SPACINGS WITH SILICONE SEALANT. ALL BATHROOM INTERNAL WALL PANELS TO BE 15mm WATER RESISTANCE GYPSUM RHINOWALL.

STAIRCASE: TO COMPLY WITH MM3 & DD2.4 OF SABS 0400-1990.

- RISERS = MAXIMUM 200 mm HIGH (228 x 50 mm TIMBER).
TREADS = MINIMUM 250 mm WIDE (280 x 50 mm TIMBER).
HEAD HEIGHT = MINIMUM 2100 mm CLEARANCE.
ALL BALUSTRADES = MINIMUM HEIGHT OF 1000 mm.

GLAZING:

- AS PER SANS 10400-N - SEE WINDOW & DOOR SCHEDULES
- LIGHTING AND VENTILATION AS PER SANS 10-400 PART 0

TRANSPARENT GLAZING:

WHERE TRANSPARENT GLAZING IS USED AND IS NOT LIKELY TO BE APPARENT TO, OR SUSPECTED BY, ANY PERSON APPROACHING IT, SUCH GLAZING SHALL BEAR MARKINGS THAT SHALL RENDER IT APPARENT TO SUCH PERSON

SAFETY GLAZING:

THE PANES OF ALL SAFETY GLAZING SHALL BE PERMANENTLY MARKED BY THE INSTALLER IN SUCH A MANNER THAT THE MARKINGS ARE VISIBLE IN INDIVIDUAL PANES AFTER INSTALLATION.

HOT WATER SYSTEMS

- 15mm INTERNAL DIAMETER COPPER PIPING FROM GEYSERS AND HEAT PUMPS INSULATED WITH ECO-FLEX SNAP ON INSULATING TUBING - R VALUE = 1.0
- ALL ELECTRIC GEYSERS, SOLAR GEYSERS AND HEAT PUMPS TO BE INSTALLED BY SPECIALIST STRICTLY AS PER MANUFACTURERS INSTRUCTIONS
- GEYSERS IN ROOF SPACE TO BE MOUNTED IN A DRIP TRAY (NOT OPTIONAL) WHICH IS FIXED ACROSS THE ROOF TRUSSES WITH A MINIMUM OF TWO SUPPORTS AND THE DRIP TRAY TO HAVE A 50mm PVC WASTE PIPE THAT DRAINS THE TRAY OF WATER OUT OF THE ROOF SPACE.
- EXTERNAL GEYSERS AND HEAT PUMPS TO BE MOUNTED ON THE EXTERNAL WALL WITH A MINIMUM OF TWO WALL BRACKETS.
- ALL ELECTRIC GEYSERS TO BE INSULATED WITH 110mm THICK "ISOTHERM" FLEXIBLE POLYESTER BLANKET - R VALUE = 2.29
- ELECTRIC GEYSERS AND HEAT PUMPS TO BE CONNECTED TO EARTH LEAKAGE
- ON COMPLETION OF INSTALLATION AND TESTS, SPECIALIST TO SUBMIT A COMPLIANCE CERTIFICATE TO THE LOCAL COUNCIL.

ADDRESS	NAME & ID no	SIGNATURE	TEL. NUMBER

PROJECT : PROPOSED NEW FIRST FLOOR ADDITIONS AND ALTERATIONS FOR MRS L. MAGILL ON PORTION 25 OF ERF 3137 DURBAN NORTH, 1 BURNSIDE PLACE, BROADWAY DURBAN NORTH

RATE NUMBER

DRAWING TITLE : SITE PLAN FIRST FLOOR PLAN DOOR & WINDOW SCHEDULE, AREA SCHEDULE
CLIENT INFO : Mrs L. Magill 0845495706

OWNERS SIGNATURE

AUTHORS SIGNATURE

DATE : 28/02/2014

SCALE : 1:400; 1:100; 1:50

DESIGNED BY

: MRP

DRAWN BY

: M.R.P

DRAWING no : 2014 / 02 / 28 / 001