


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	
Bushclearing required (m)	

UPGRADE PH/PH TO 3PHASE 444m
FROM KKR196/26/4/3 TO KKR196/26/4/10

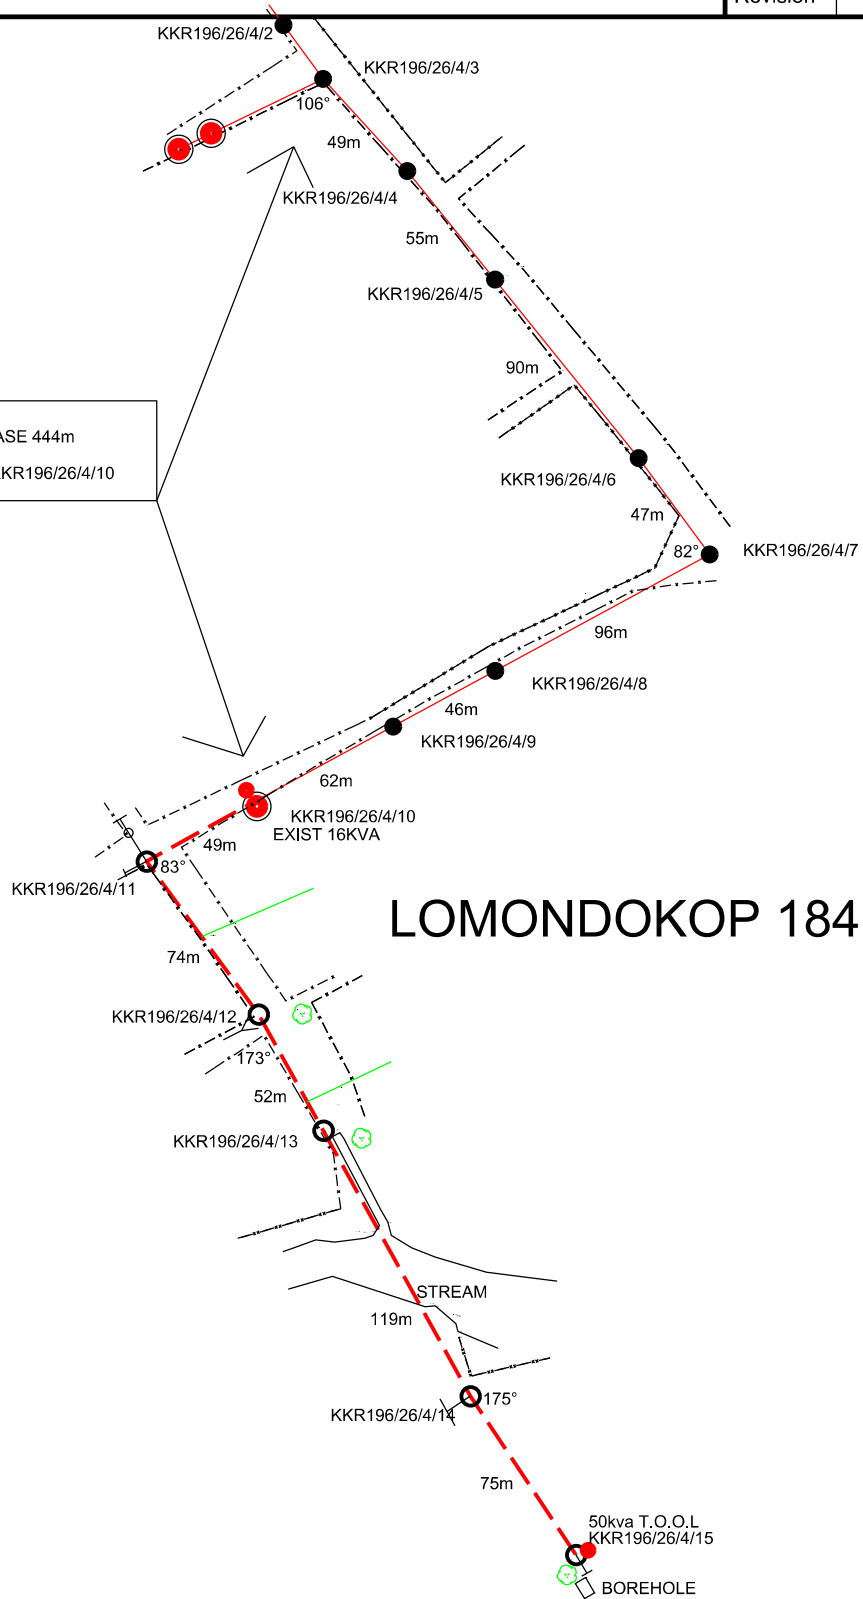

LOMONDOKOP 184 LT

LEGEND		
	LV MV Sharing Pole	
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	LV LINE	
	3	
	2	
	1	
ZM MATHIBA	0	[18/05/2021]
SURVEYOR	REV	SURVEY DATE

FEEDER: KEEROM 11KV	CUSTOMER: I CONSULT ENGINEERS	<p>THIS DRAWING IS THE PROPERTY OF Eskom Disclaimer: Eskom is not responsible for any errors displayed on this drawing</p>
PROJECT NO: M354453054	PROPERTY: LOMONDOKOP 184 LT	
CONDUCTOR: FOX	CONTACT DETAILS	
LENGTH OF LINE: 370m + (444m of UPGRADE)=814m	SCALE: [1:2 500]	
SURVEYOR: Z.M MATHIBA	PAGE: [1] of [1]	
DRAUGHTSPERSON: Z.M MATHIBA		