


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	4
Bushclearing required (m)	765

MUYEXE PEGGING (GREATER GIYANI 897 MS)

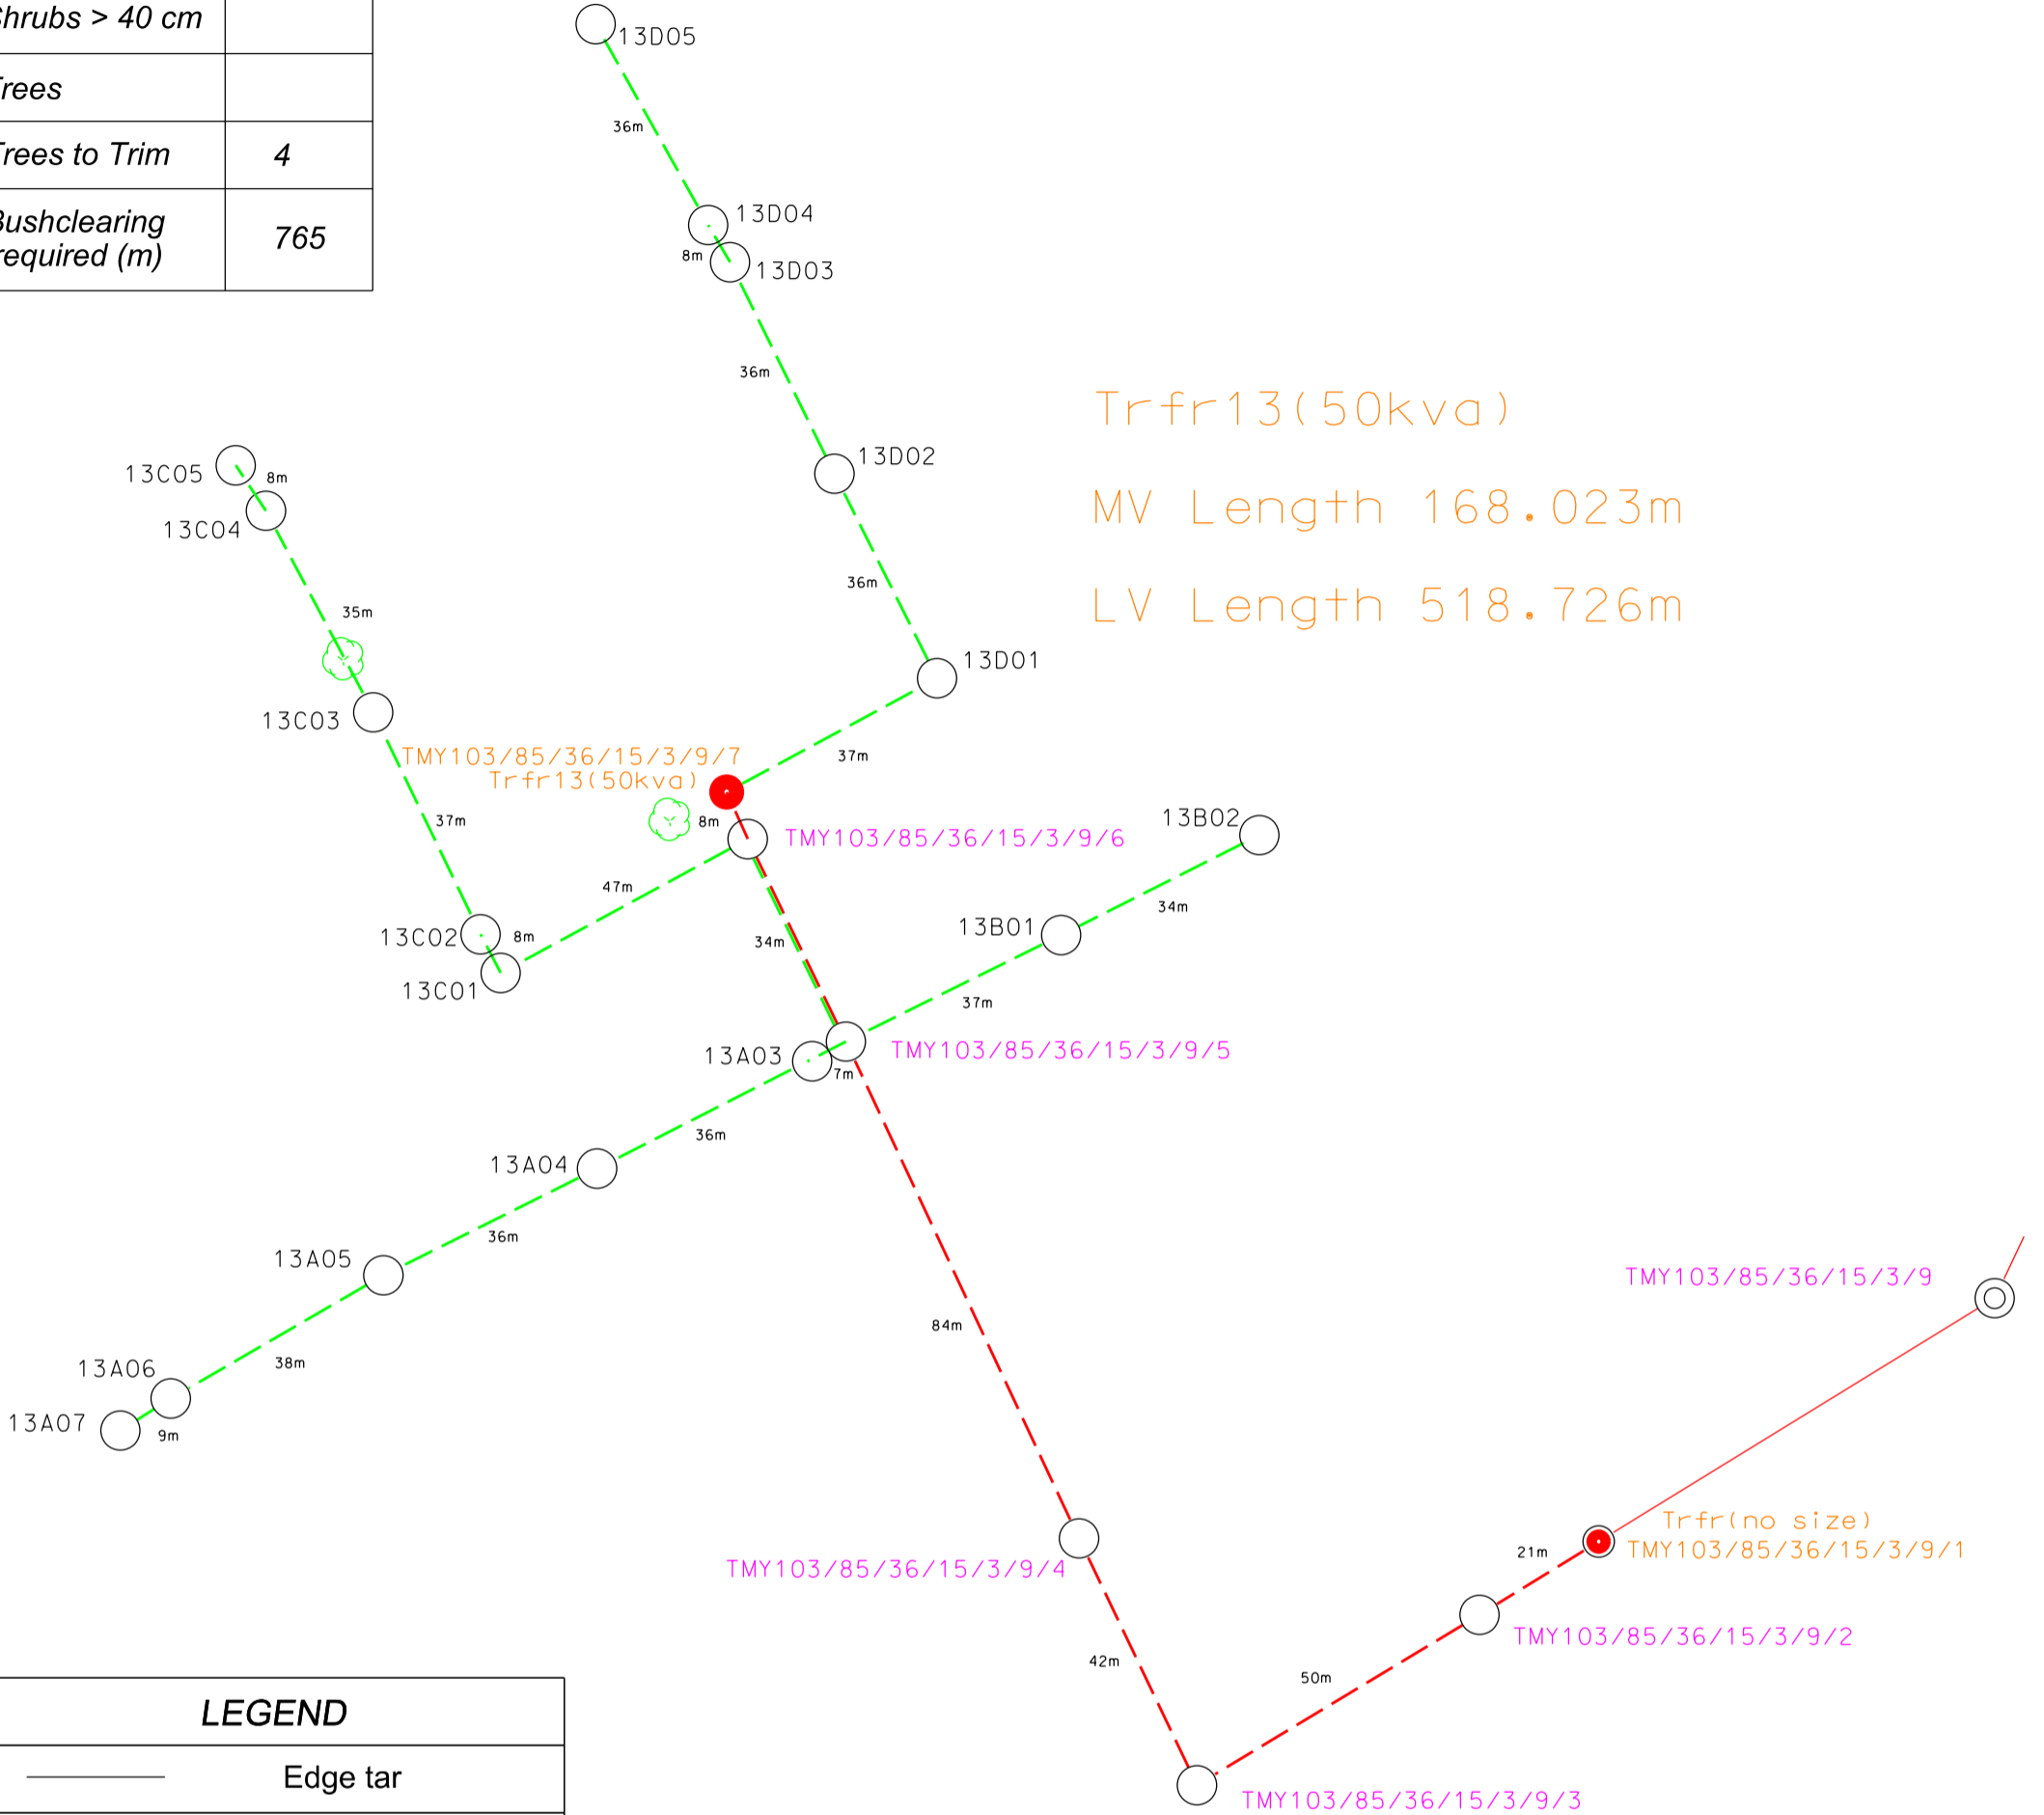

Trfr13(50kva)
 MV Length 168.023m
 LV Length 518.726m

LEGEND	
	Edge tar
	Exst. Line
	New Line
	Edge gravel road
	Exst. equipment
	Exst. pole
	New Equipment
	New pole

	3	
	2	
	1	
NP Matibe	0	18/03/2021
SURVEYOR	REV	SURVEY DATE

FEEDER: Thomo/Muyexe 22kv
PROJECT NO: Muyexe Pegging
CONDUCTOR: [Fox 3 Ph and bundle]
LENGTH OF LINE: MV 854.491m LV 2283.877m
SURVEYOR: NP Matibe
DRAUGHTSPERSON: NP Matibe

CUSTOMER: Eskom
PROPERTY: Farm of GREATER GIYANI 897 MS
CONTACT DETAILS 015 92 4697
SCALE: [1:2 500]
PAGE: [1] of 3

THIS DRAWING IS THE PROPERTY OF ESKOM
 Disclaimer: Eskom is not responsible for any errors displayed on this drawing