


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	10
Bushclearing required (m)	

NWELI VILLAGE

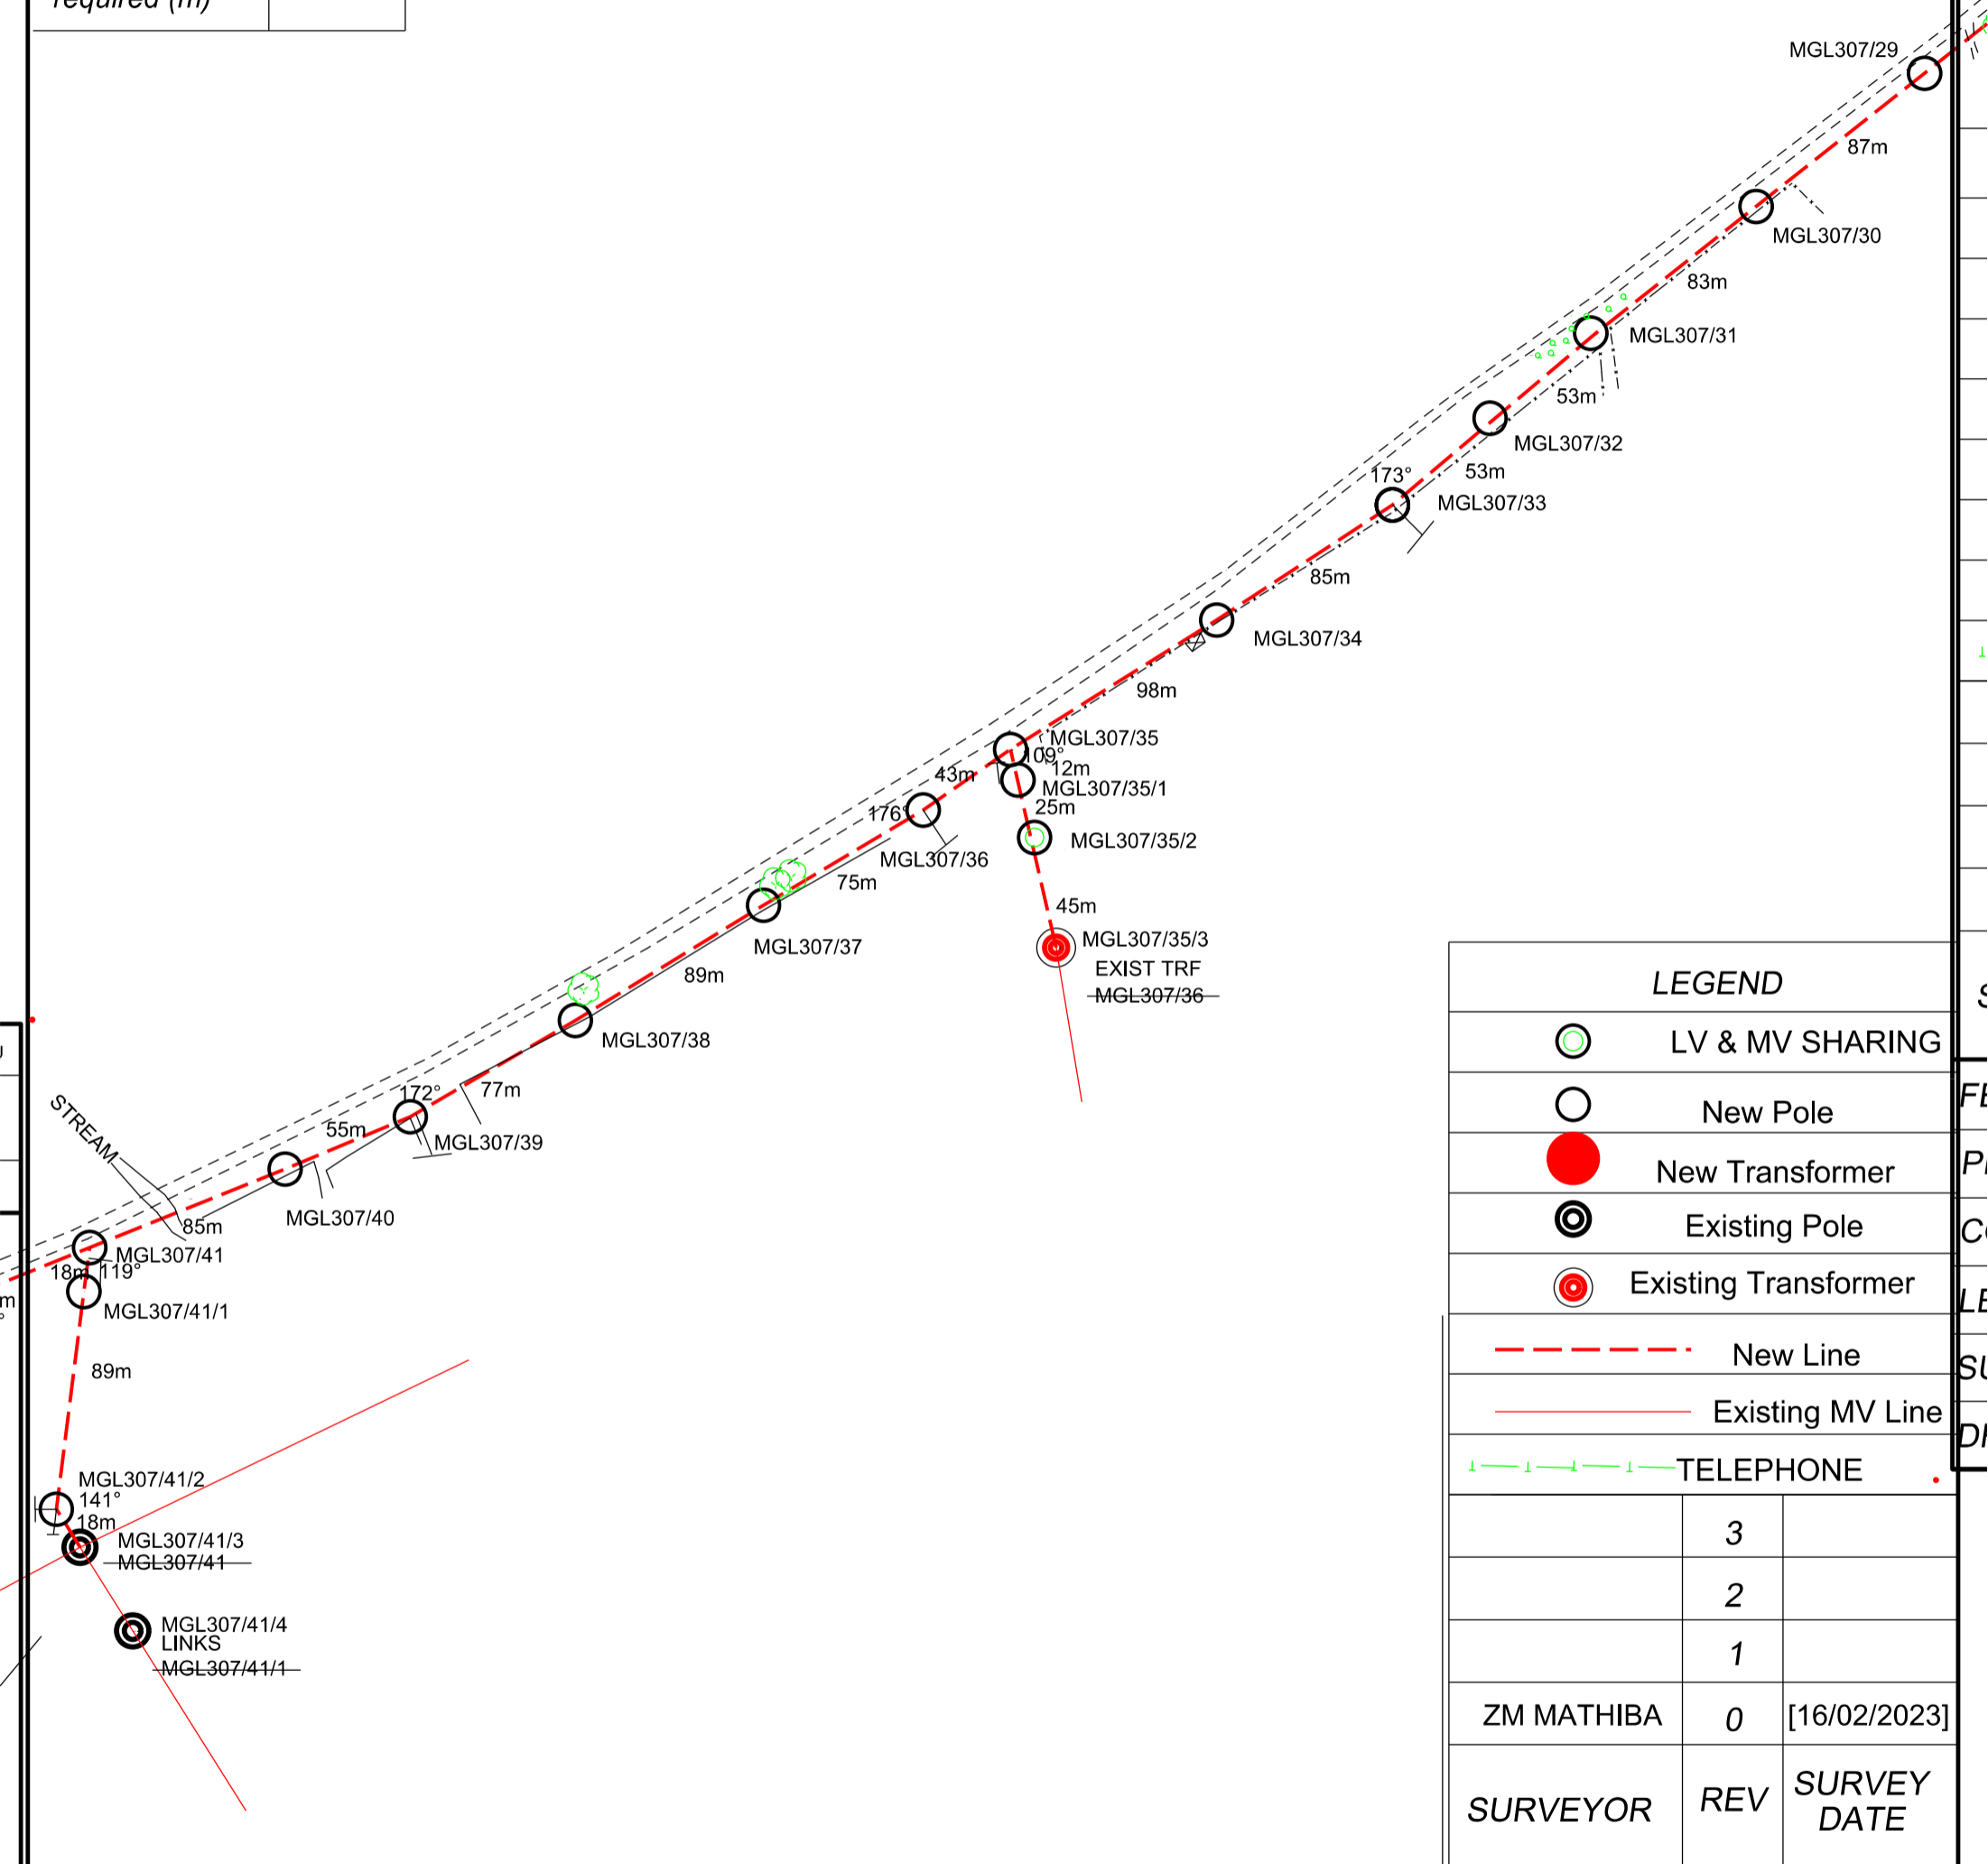

FEEDER: MALAMULELE-GANDLANANI 22KV
PROJECT NO: NWELI-GML LINE DEVIATION
CONDUCTOR: FOX
LENGTH OF LINE: 2604m
SURVEYOR: Z.M MATHIBA
DRAUGHTSPERSON: Z.M MATHIBA

CUSTOMER: NWELI VILLAGE MALAMULELE CNC
PROPERTY: NWELI VILLAGE
CONTACT DETAILS
SCALE: [1:2 500]
PAGE: [2] of [3]

THIS DRAWING IS THE PROPERTY OF ESKOM
Disclaimer: Eskom is not responsible for any errors displayed on this drawing