


Orlight SA (Pty) Ltd Solar PV Project Kenhardt Line Options and Land Tenure

Legend

- Substation
- Kenhardt Solar PV Plant Study Area
- Option A (30 MW)
- Option A (70 MW)
- Option B (30 MW)
- Option B (70 MW)
- Option C (30 MW)
- Option C (70 MW)
- Main Roads
- National Roads
- Farm Boundaries
- Farm Portions

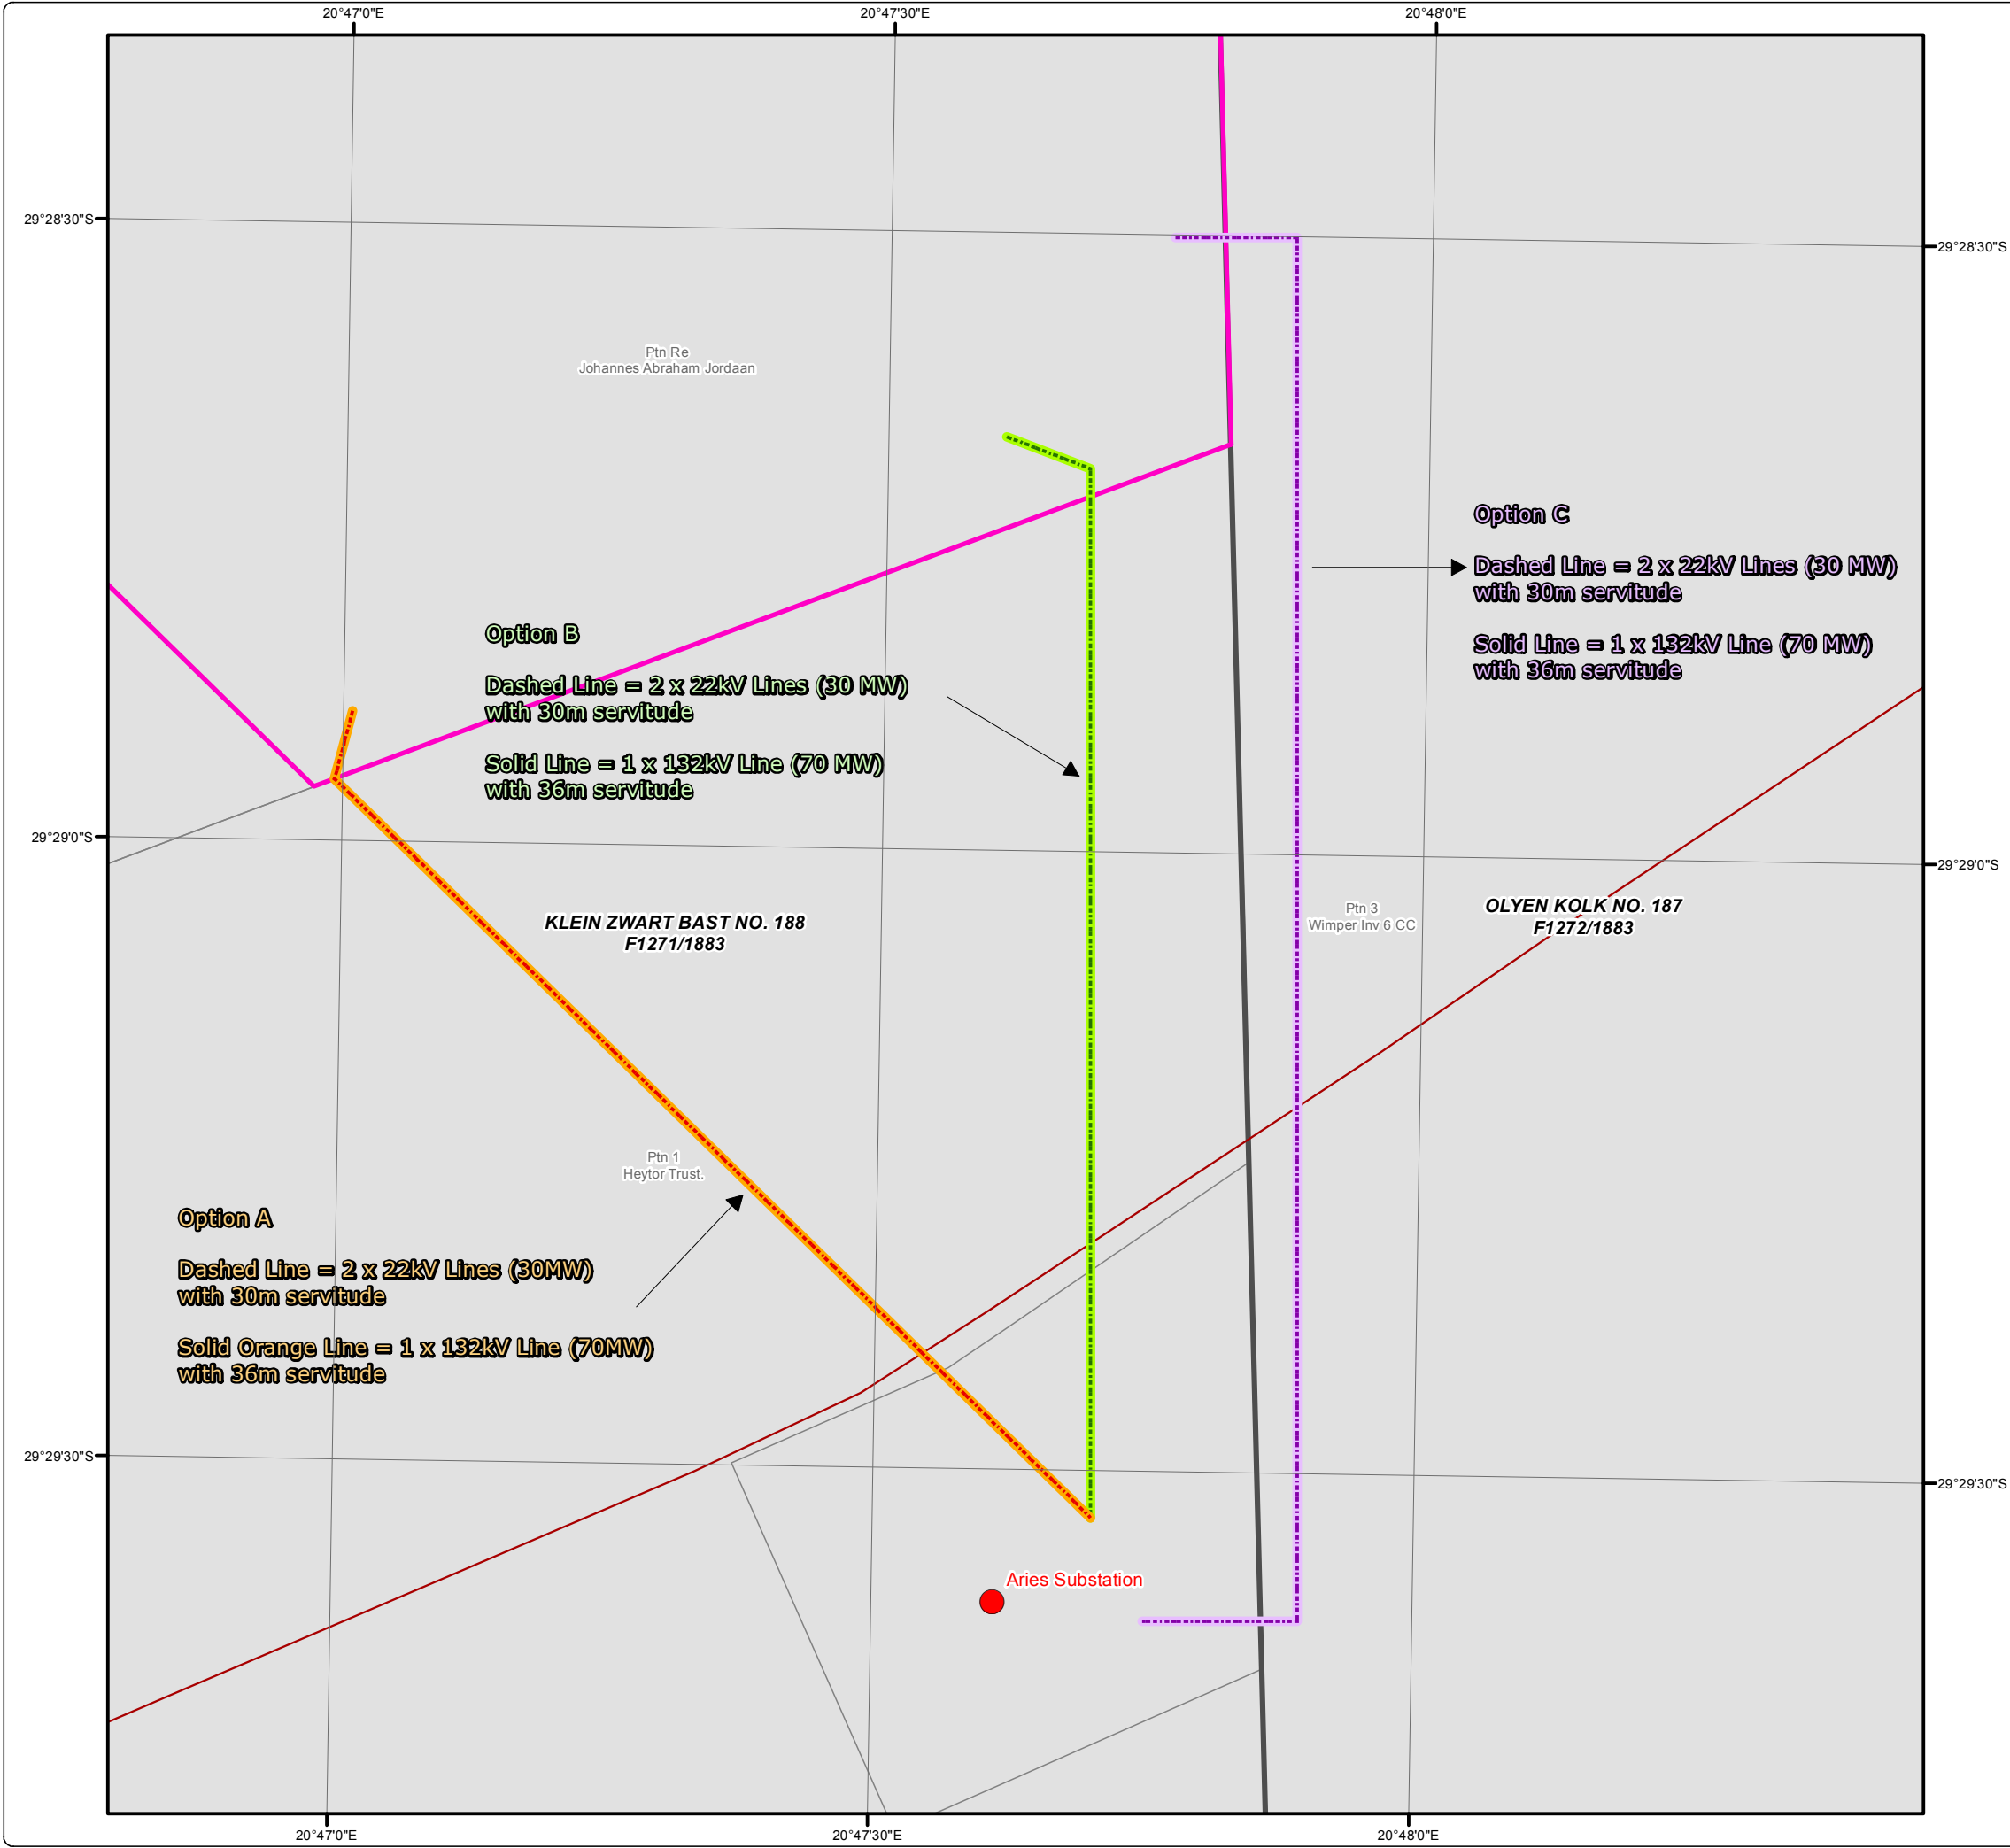

Option B
 Dashed Line = 2 x 22kV Lines (30 MW) with 30m servitude
 Solid Line = 1 x 132kV Line (70 MW) with 36m servitude

Option C
 Dashed Line = 2 x 22kV Lines (30 MW) with 30m servitude
 Solid Line = 1 x 132kV Line (70 MW) with 36m servitude

Option A
 Dashed Line = 2 x 22kV Lines (30MW) with 30m servitude
 Solid Orange Line = 1 x 132kV Line (70MW) with 36m servitude

KLEIN ZWART BAST NO. 188
F1271/1883

OLYEN KOLK NO. 187
F1272/1883



ORLIGHTSA
RENEWABLE ENERGY



DIGBY WELLS
ENVIRONMENTAL

www.digbywells.com

Projection: Transverse Mercator Revision Number: 1
 Datum: Hartebeesthoek 1994 Date: 27/03/2012
 Central Meridian: 19°E Ref #: amc.BSGR1384.201203.115

