


- NOTES:**
1. REMOVE AND STOCKPILE TOPSOIL TO 200mm DEPTH
 2. THE CROSS-SECTION IS NOT BASED ON THE REQUIREMENT OR SPECIFICATION OF A SPECIFIC TURBINE SUPPLIER
 3. ROADWAY TO PROVIDE 150KPA BEARING PRESSURE
 4. CRANE PLATFORM TO PROVIDE 250KPA BEARING PRESSURE

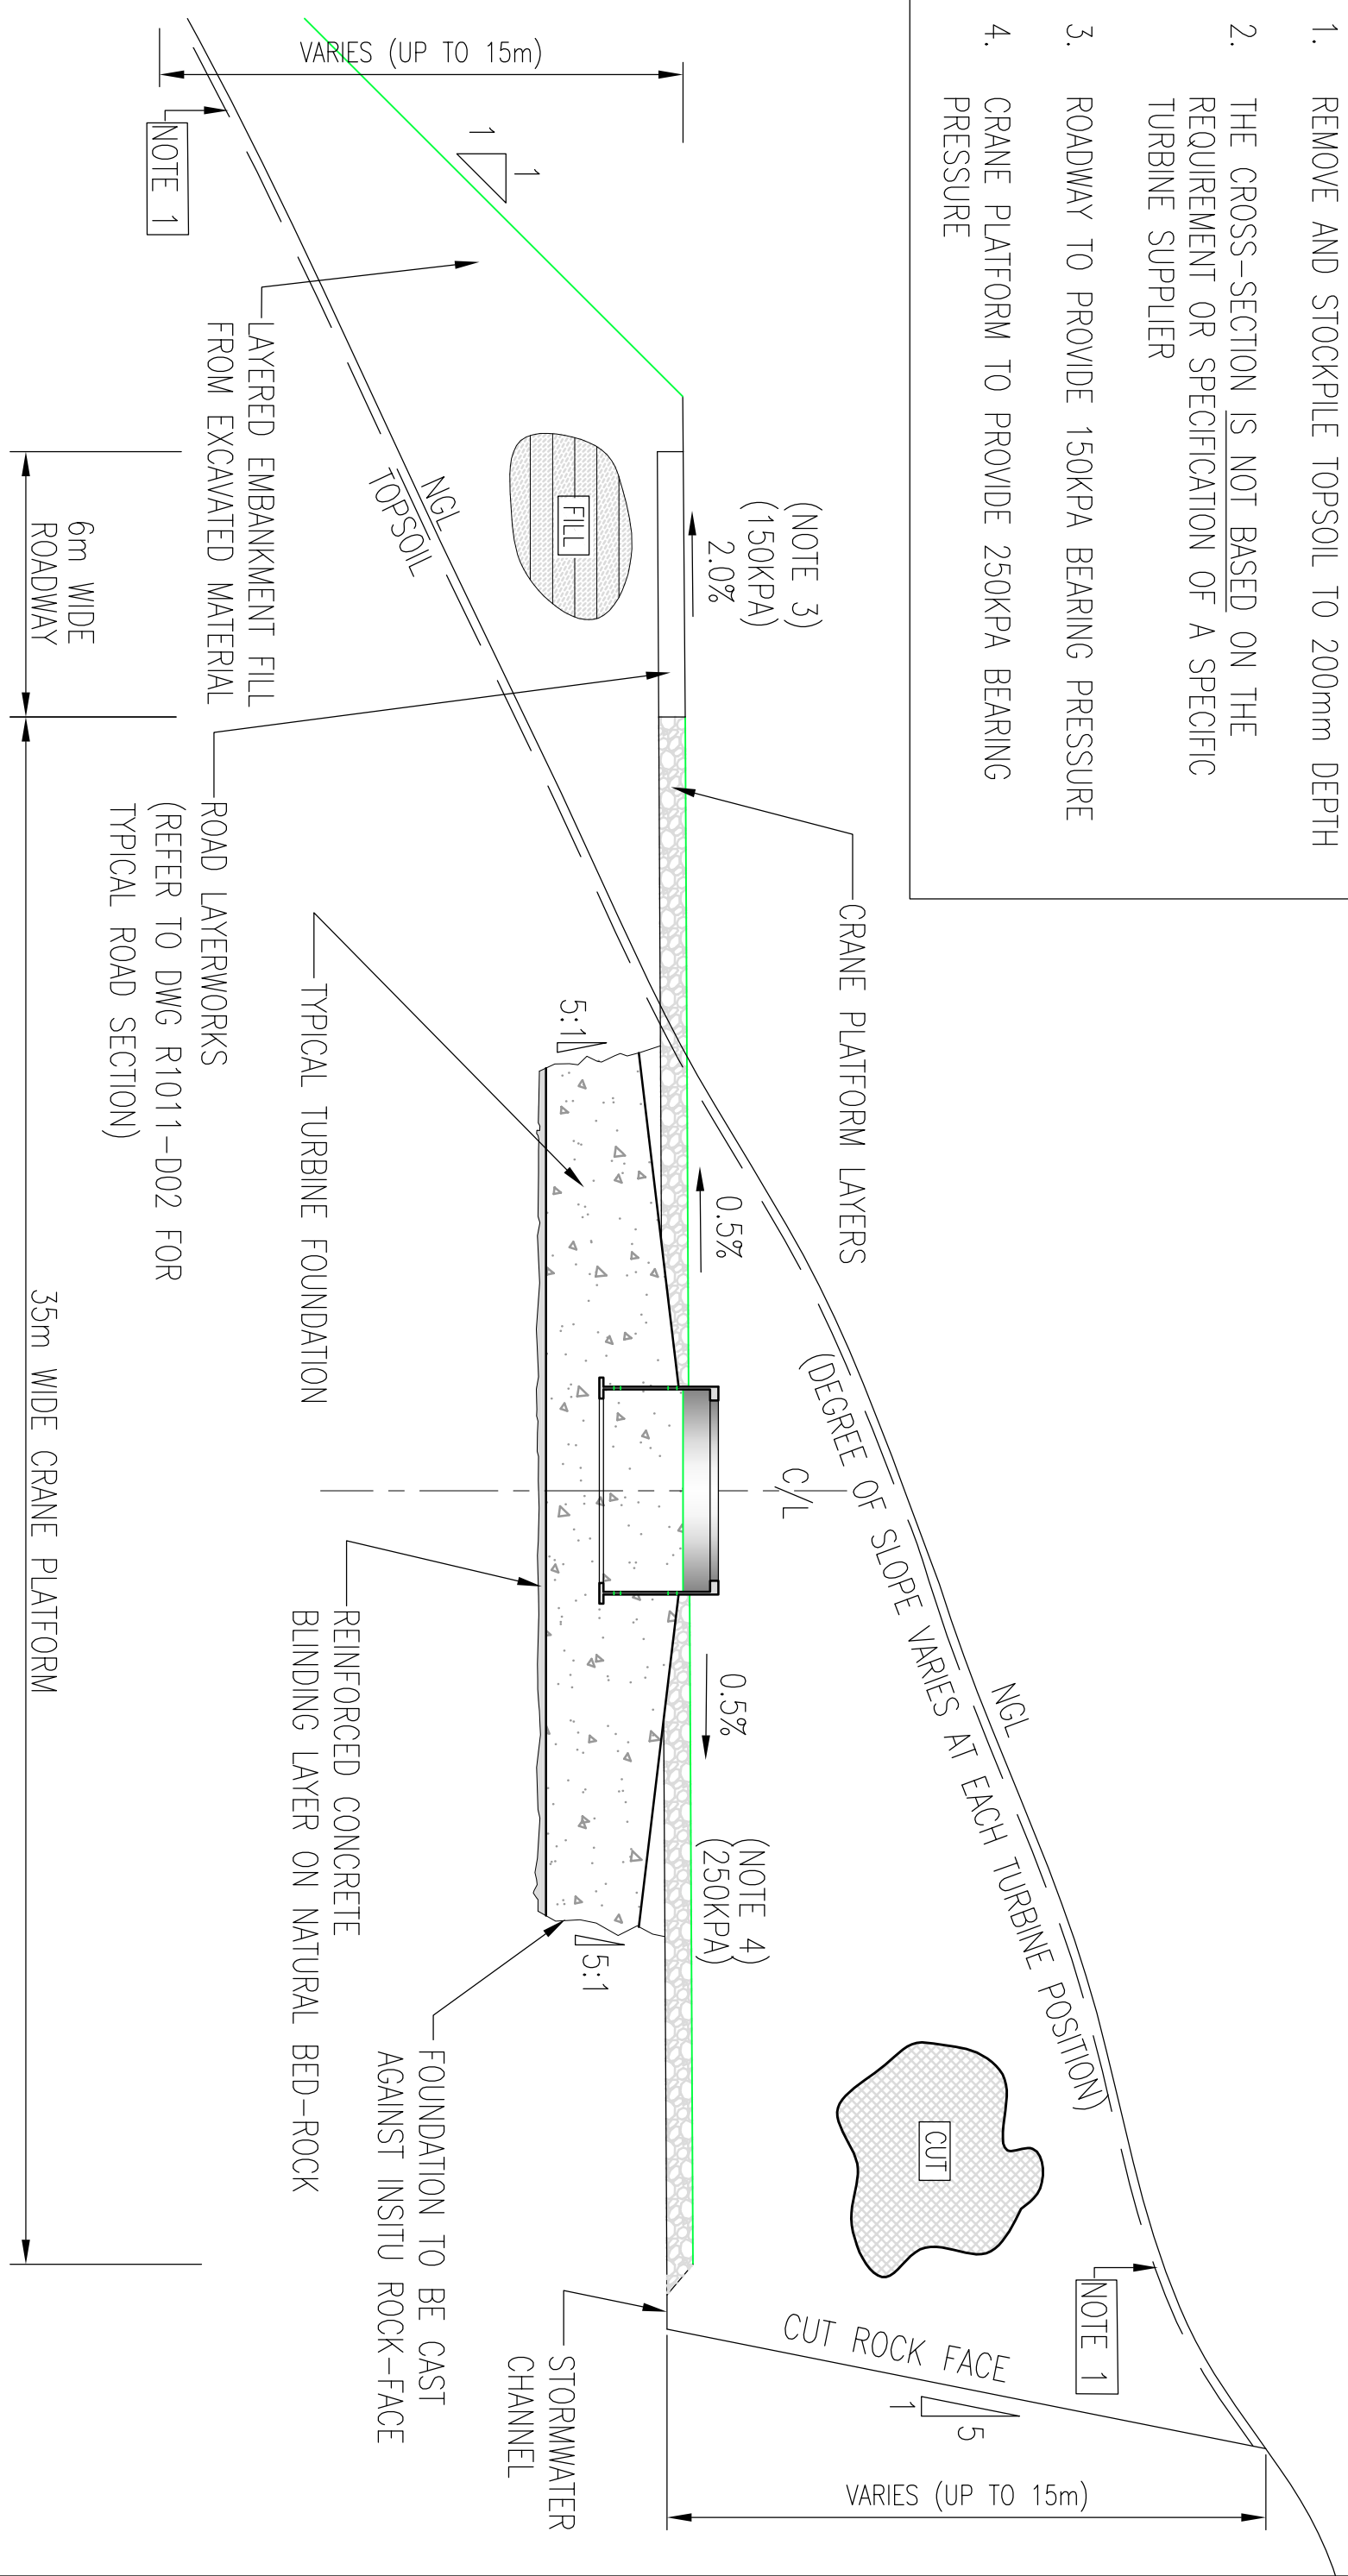

DESIGNED	L.G	PROJECT DIRECTOR	B.E	STATUS:	PRELIMINARY	SCALE:	N.T.S
CHECKED	S.S	PROJECT MANAGER	H.N	DRAWING No:	R1011-D04	REVISION:	0
NO.	DRAWN	DATE	DESIGNED	L.G	PROJECT MANAGER	STATUS:	PRELIMINARY
0	L.G.	PRELIMINARY PLATFORM LAYOUT	27/03/2015	DATE	27/03/2015	DESIGNED	L.G
		REVISION				CHECKED	S.S
						DESIGNED	L.G

AFC
FRICOAST ENGINEERS

Central, Rose/Honebeck Street
Central, Fort Elizabeth, 6001
PO Box 5104
Malmesbury, 6005

Tel: +27 (41) 505-8000
Fax: +27 (41) 585-3437
info@fricoast.com

ROODEPLAAT WIND FARM
TYPICAL CROSS-SECTION FOR
TURBINE FOUNDATION & PLATFORM