


Pole no: D115-168-16-6-8

Tee off angle 180°00'00"

22kV

LAT: 26° 31' 36.7", LONG: 29° 44' 39.6"

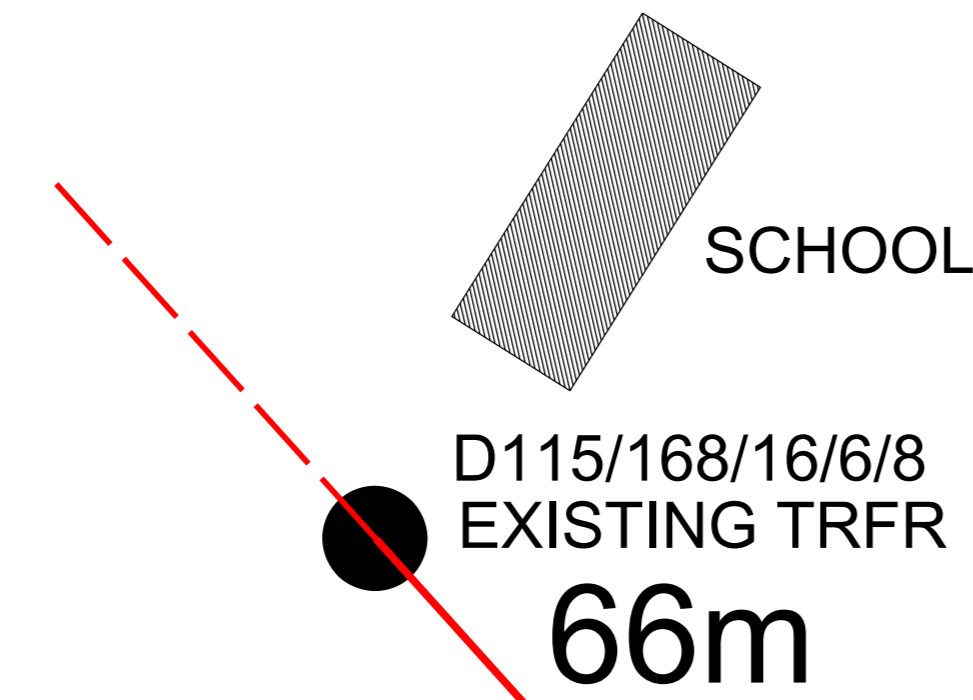

D115/168/16/6/9

66m

100m

D115/168/16/6/10

100m

D115/168/16/6/11

100m

D115/168/16/6/12

100m

D115/168/16/6/13

100m

D115/168/16/6/14

100m

D115/168/16/6/15

100m

D115/168/16/6/16

67m

141.6°

D115/168/16/6/17

60m

49

30

D115/168/16/6/18
32kVA TRFR

REMHOOGTE ELECTRIFICATION

32kVA 1Ø

Project no: REMHOOGTE ELECTRIFICATION

NAME : REMHOOGTE ELECTRIFICATION

Total Length of line: MV=0.893km

LV=0.079km

Surveyor: D. KUKARD

PORTION 11

REMHOOGTE 428 IS

NOTE: RED PEGS on site indicate structure position.

PLEASE NOTE:
No protected trees/plants may be cut/trimmed/removed unless the applicable tree permit is issued and handed to the construction contractor.