


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

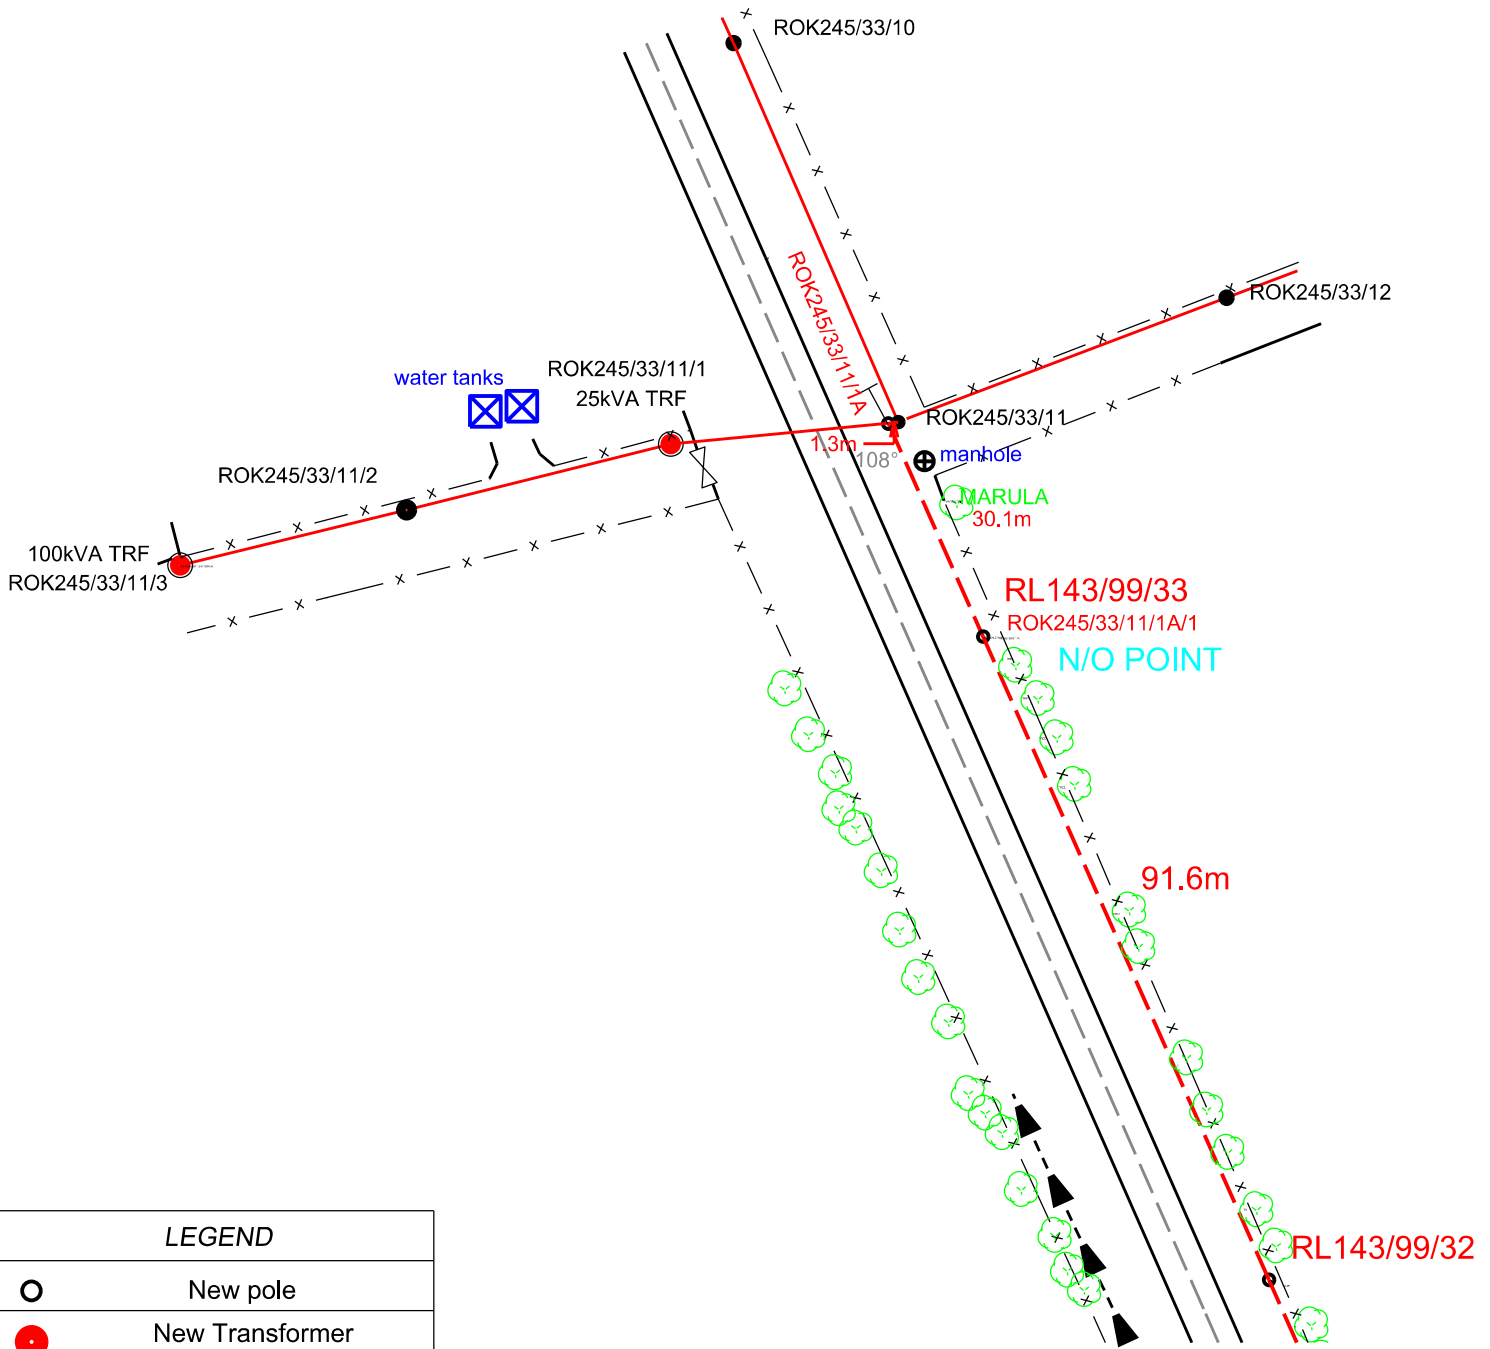

LEGEND

- New pole
- New Transformer
- Existing Pole
- Existing MV line
- New MV line
- Existing LV line
- Line to be dismantled

80% bush clearing required

	3	
	2	
	1	
BALOYI MI	0	2022/04/07
SURVEYOR	REV	SURVEY DATE

FEEDER:	LEEUKRAAL 22KV	CUSTOMER:	ESKOM
PROJECT NO:	RUST DE WINTER - LEEUKRAAL 22KV FEEDER	PROPERTY:	
CONDUCTOR:		CONTACT DETAILS	0152990459
LENGTH OF LINE:	2739.7m	SCALE:	PAGE: [1] of [7]
SURVEYOR:	BALOYI MI		
DRAUGHTSPERSON:	BALOYI MI		



THIS DRAWING IS THE PROPERTY OF Eskom
Disclaimer: Eskom is not responsible for any errors displayed on this drawing