All works to be carried out in accordance with the relevant parts of SANS10400:2010 regulations.

THE ARCHITECT WILL NOT BE RESPONSIBLE FOR ANY DEVIATIONS TO APPROVED PLANS, IT IS THE CLIENTS/OWNERS RESPONSIBILITY TO ENSURE THAT THESE COMPLY WITH SANS 10400 AND ACQUIRE Windows & Doors: MUNICIPAL APPROVAL

THE APPOINTED INTERIOR DESIGNER ASSUMES RESPONSIBILITY FOR ANY DEVIATIONS TO APPROVED

UNDER NO CIRCUMSTANCES SHOULD CONSTRUCTION COMMENCE WITHOUT APPROVED MUNICIPAL DRAWINGS!!!

tion Works:

All demolition works to be carried out in accordance with SANS10400:2010 Part E.

Excavations:

All excavations deeper than 3,0m to be as per the eng's details. Excavations to comply with SANS 10400:2010 Part G. Excavations to be maintained in a safe condition at all times. between the

Foundations: The foundation design to comply with SANS10400:2010 Part H, and as per the eng's specifications and details. All retaining wall foundations to engineers details. All foundations to be taken down to virgin soil.

For 230mm non-retaining walls foundations to be 700x230mm. All foundations on fill to engineer's details

Floor slabs:

• Suspended floor slabs, to be as per engineer's details.

• Concrete surface beds to comply with SANS10400:2010 Part J.

• Floor slab to engineers details. Concrete floor slab reinforced with welded mesh reinforcement ref. 193 on 250um • Staircases to comply with SANS 10400:2011 Part M. green damproofing membrane under floors with turned up taped joints on earth filling compacted to 93% MODAASHTO density. Soil poisoning & ant guard by specialist.

• All penetrations through damproofing must be taped with a pressure sensitive approved tape.

• Compaction to comply with SANS 10400:2010 Part J 4.4.

All work to be in accordance with SANS 10400:2010.

 All slip and movement joints as per engineers specification. All foundations to engineers details.

 Horizontal and vertical damp proof course (dpc) shall be of black polyethylene sheeting having embossed surface to comply 375 microns thick.

• Saw-cut joints in the surface bed slab to be as per the eng's details.

• Min 30mm screed over floor slab to receive specified floor finish.

• Floors for all ablution facilities to be waterproofed with an approved waterproofing material. Waterproofing to be turned up onto the wall at min. 75mm high.

Brickwork:

• Masonry walls to comply with SANS 10400:2010 Part K.

• 230 walls tied together with metal ties evenly spaced at not more than 600mm apart to every 3rd course. Wall t

• 110mm brick wall reinforced with 75mm wide reinforcing one row to every 3 courses in height.

• Provide brick force to every course above windows, doors and openings.

Allow for open vertical perpends on external skins, equally spaced.

• Facebrick (or un-plastered walls) finish to external wall. Outer face of inner skin to be bagged and bitumen tarred Allow for dpc at window head and cill levels.

All foundation and plinth brickwork to be NFX bricks. All un-plastered walls to be NFX bricks.

• 10mm impregnated softboard at all junctions between brickwork & concrete, as well as between old and new

brickwork. Joints to be filled with polysulphide sealant.

• Brickforce to be placed in the first six courses of brickwork on strip foundations, thereafter placed in every 4th course in all brick walls.

• As shown on elevations, Internal & External walls to be plastered and painted with SABS approved PVA externa

• Vertical and horizontal waterproofing (damp-proof) to external walls to be as per SANS 10400:2010 Part K.

All internal and external walls to engineer's details.

• FIRE NOTE VERTICAL SERVICE DUCTS/SHAFTS TO BE FIRE PROTECTED & FIRE STOPPED AT EVERY LEVEL WITH A

DRAINAGE

all sanitary fittings to be trapped in accordance with local authority by -laws

all gulley surrounds and manhole covers to be 75mm above grd.

- — - - Ø 100 PVC STORMWATER PIPE @ MIN 1:60 FALL

anchor blocks to be provided where gradient exceeds 1:5

any loads imposed on the drain

- — — Ø 100 PVC SEWER PIPE @ MIN 1:60 FALL

====== imposed on the drain

inspection eyes to be provided at all bends, junctions and change in direction

100Ø upvc ribbed pipe laid where any structure passes over sewer line being protected from

passes over sewer line being protected from any loads

100Ø upvc ribbed pipe laid where any structure

FIRE RESISTANCE OF 120 MINUTES

Stormwater:

· Stormwater lines and goods to wet services engineers details & to comply with SANS 10400 Part

· All services and pipes beneath building to be hardened uPVC as per engineers specification.

General:

· It is the owners responsibility to make sure that all of the SANS requirements are adhered too, during

construction. · Compliance with Part XA SANS 10400:2011XA and

SANS 204. · Read in conjunction with the energy efficiency

document that is attached.

· The owner and the contractor to comply with the site operations requirements in terms of SANS

10400:2010 Part F. · No dimensions to be scaled or scanned from

drawings.

· All dimensions to be checked on site · Contractor is responsible for correct setting out of the buildings, all internal and external walls with particular

· Contractor to verify all levels, heights and dimensions on site and to check the same against the

reference to boundaries, building lines etc.

drawings before

putting any work in hand. · Contractor is to locate and identify existing services

on the site and to protect these from damage throughout the

reported immediately

duration of the works. · Any errors, discrepancies or omissions to be

· Contractor is to build in approved 4 ply D.P.C. whether or not these are shown on drawings, to all

windows, doors, grilles or other openings in external walls.

· Any gueries arising from all the above must be

reported and clarified before any work is put in hand. · Figured dimensions are to be used at all times. · Structural work to professional engineers details and

must be in accordance with SANS10400:2011 Wet services to professional engineers details and must be in accordance with SANS 10400:2011

· Mechanical work to professional engineers details and must be in accordance with SANS10400:2011 · Owner to point out the boundary pegs to the

contractor prior to any construction works commencing on site. If boundary pegs cannot be located, a land surveyor is to be appointed to locate the boundary pegs. It is the owners & contractors responsibility to contact

the author of the plans to obtain clarity on any information reflected on these drawings or if additional

information is required.

Windows & doors:

New aluminum windows & doors.

Refer to schedules.

• Lintels to comply with sans 10400:2011 Part K 4.29 all to engineers detail

Painted soffits:

• Soffits to be painted with SABS approved ceiling paint.

• Soffit to be prepared to receive one coat primer, one intermediate coat and 2 or more top coats.

Ceiling Insulation:

• minimum 135mm Flexible fibre glass blanket, thermal insulation to be installed in the ceiling void

brandering over the ceiling boards.

 RC roof slabs to structural eng. details & specifications. Floor finishes in as shown to eng. details & installed according to manufacturers specifications.

• Roof installation to comply with SANS 10400:2010 Part L and SANS 10400:2011 Part T. The roof assembly to comply with SANS204:2011: 4.3.6. A minimum R-Value of 2.7m².K/W is to be achieved. Refer to the Energy Efficiency calculation document, that is attached.

Staircases:

• Treads to comply with SANS 10400:2011 Part M4.5.

• Balustrades to be provided at 1m high and as per the eng's details and is to comply with SANS10400:2011

Part M:4.3.

• Escape staircases to be 1500mm wide and to comply with SANS 10400:2011 Part T & Part M

Balustrades:

• 12mm toughened safety glass @ 1000mm high fixed on 200mm high upstand to act as 1.2m high balustrade with SANS 10400:2011 Part M:4.3. Wind loading test to be done by engineer prior to design & manufacture.

Installation according to manufacturers specifications. • 1.2m high aluminum balustrade around pool with self-closing & self-latching gate to be fixed to surrounding

deck in compliance with SANS 10400 Part D

• 1.0m high aluminum or Frameless Glass balustrade with maximum 100mm diameter Railing.

Glazing:

• Glazing to comply with SANS 10400:2012 Part N.

• Refer to window schedules for specifications.

• All shower enclosures to be 6mm toughened safety glass to comply with SANS 10400 Part N

Lighting & Ventilation:

• Lighting & ventilation to comply with SANS 10400:2010 Part O.

• Natural ventilation to be provided to rooms through operable windows or doors at 5% of the floor area.

Natural lighting to be provided at 10% of the floor area.

• Artificial Ventilation to mechanical eng. details & to comply with SANS 10400: Part O

• All internal bathrooms to be extended to external at a rate of 25l/s per bathroom with a light of 160 lux.


Drainage Notes:

• All brick walls to be reinforced with reinforcing one row to every 4th course, to comply with SANS 10400:2010 part • Drainage & rain water goods to wet services engineers details & to comply with SANS 10400: Part P

• All services and pipes beneath building to be hardened uPVC as per engineers specification. • Anchor blocks required for all drains steeper than 1:5 gradient as per SANS 10400 Part P

• If you have read all of the above, I commend you, please call me for a free chocolate, dont expect an expensive one

as architects dont get paid very well..

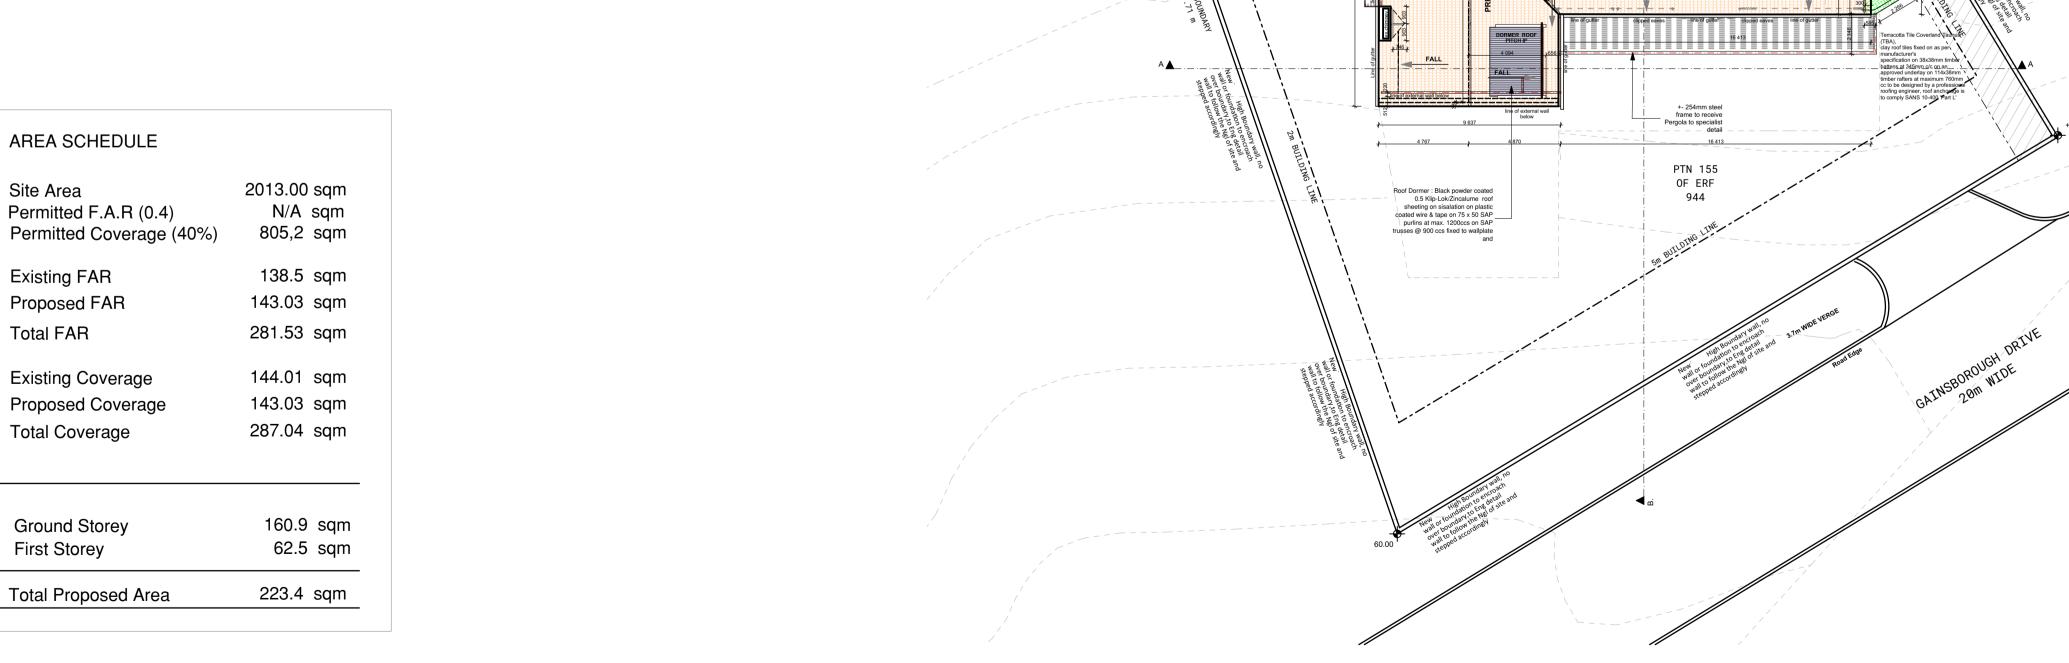

PTN 98 OF

ERF 944

SITE BOUNDARY

9.29 m

PTN 99 OF

ERF 944

7 \$4.0 SERVITUDE / 2m_BUILDING/LINE / / / /

Replace ex roof with: 39°, Terracolta COVERTILI
DOUBLE ROMAN
clay roof tiles with tapez ridge tiles fixed en as pe

400 °F All roof eaves to be enclosed with treated & statimber slats Stained dark br All Aluminum rain water goods to be white powder o

Lok/Zincalume roof sheeting on sisalation on site coated wire & tape on 75 x 50 SAP purlins _

plastic coated wire & tape on 75 x 50 SAP puriins at max. 1200ccs on SAP trusses @ 900 ccs fixed

PTN 156

OF ERF

SITE PLAN

PTN 154





CASE ID: 22460

09 October 2023 **APPROVED**

CONTACT

SUN TRUST IT 235/2005

072 117 8852

SUBMISSION



Architecture///Urban design Suhayl Ballim for U D G

specialists

SACAP: 7265

Turnkey property development

URBAN DEVELOPMENT

GROUP

B.Acrh[adv] cum, laude

PROJECT

1:200

PROPOSED ADDITIONS AND ALTERATIONS TO EXISTING DWELLING

ON 27 GAINSBOROUGH DRIVE, ATHLONE PTN 155 OF ERF 944, DURBAN NORTH

CHECKED SB **DRAWING NUMBER** 15 MARCH 2023

SITE PLAN

MS N.KADER FOR SUN TRUST

DRAWN DATE UDG > 70 **100 REV 1 SCALE** 1:100 A1