


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Cut	85%
Trees to Trim	
Bushclearing required (m)	85%

SWA387326835
PORT 2 ROOIKOP WITLAAGTE 181 JR

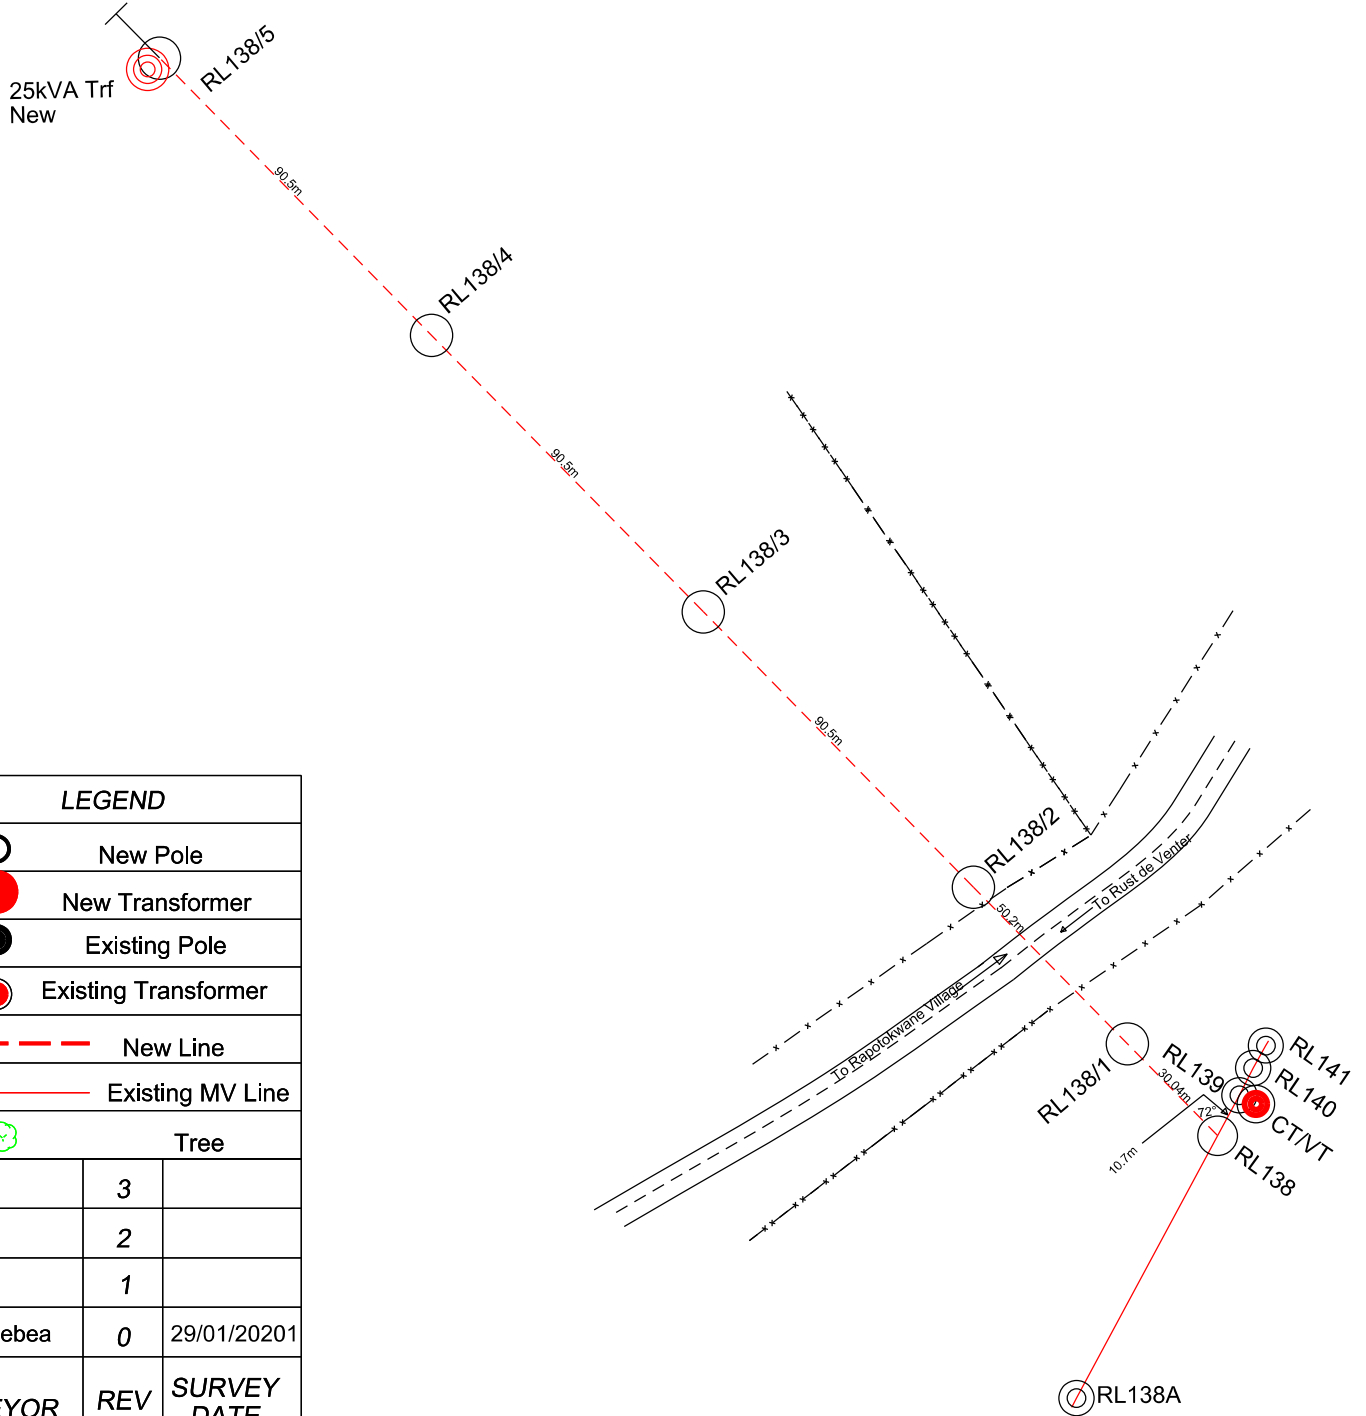

LEGEND		
	New Pole	
	New Transformer	
	Existing Pole	
	Existing Transformer	
	New Line	
	Existing MV Line	
	Tree	
	3	
	2	
	1	
T M Lebea	0	29/01/20201
SURVEYOR	REV	SURVEY DATE

FEEDER:	RUST DER WINTER-LEEUKRAAL 22kV
PROJECT NO:	SWA387326835
CONDUCTOR:	(3 Phase)
LENGTH OF LINE:	351.8m
SURVEYOR:	Tshepo Lebea
DRAUGHTSPERSON:	Tshepo Lebea

CUSTOMER:	MALEFO FOR CCZ CHURCH KWALITO
PROPERTY:	PORT 2 ROOIKOP WITLAAGTE 181 JR
CONTACT DETAILS	+2764 517 4825
SCALE:	[1:2 500]
PAGE:	[1] of [1]

THIS DRAWING IS THE PROPERTY OF ESKOM
Disclaimer: Eskom is not responsible for any errors displayed on this drawing