

SECTION F: APPENDICES

Basic Assessment for the Proposed Construction and Operation of Electrical Grid Infrastructure to support the Sutherland, Sutherland 2 and Rietrug Wind Energy Facilities (WEFs), Northern and Western Cape Provinces: DRAFT BASIC ASSESSMENT REPORT

BASIC ASSESSMENT REPORT

APPENDIX C: FACILITY ILLUSTRATIONS

SECTION F: APPENDICES

Basic Assessment for the Proposed Construction and Operation of Electrical Grid Infrastructure to support the Sutherland, Sutherland 2 and Rietrug Wind Energy Facilities (WEFs), Northern and Western Cape Provinces: DRAFT BASIC ASSESSMENT REPORT

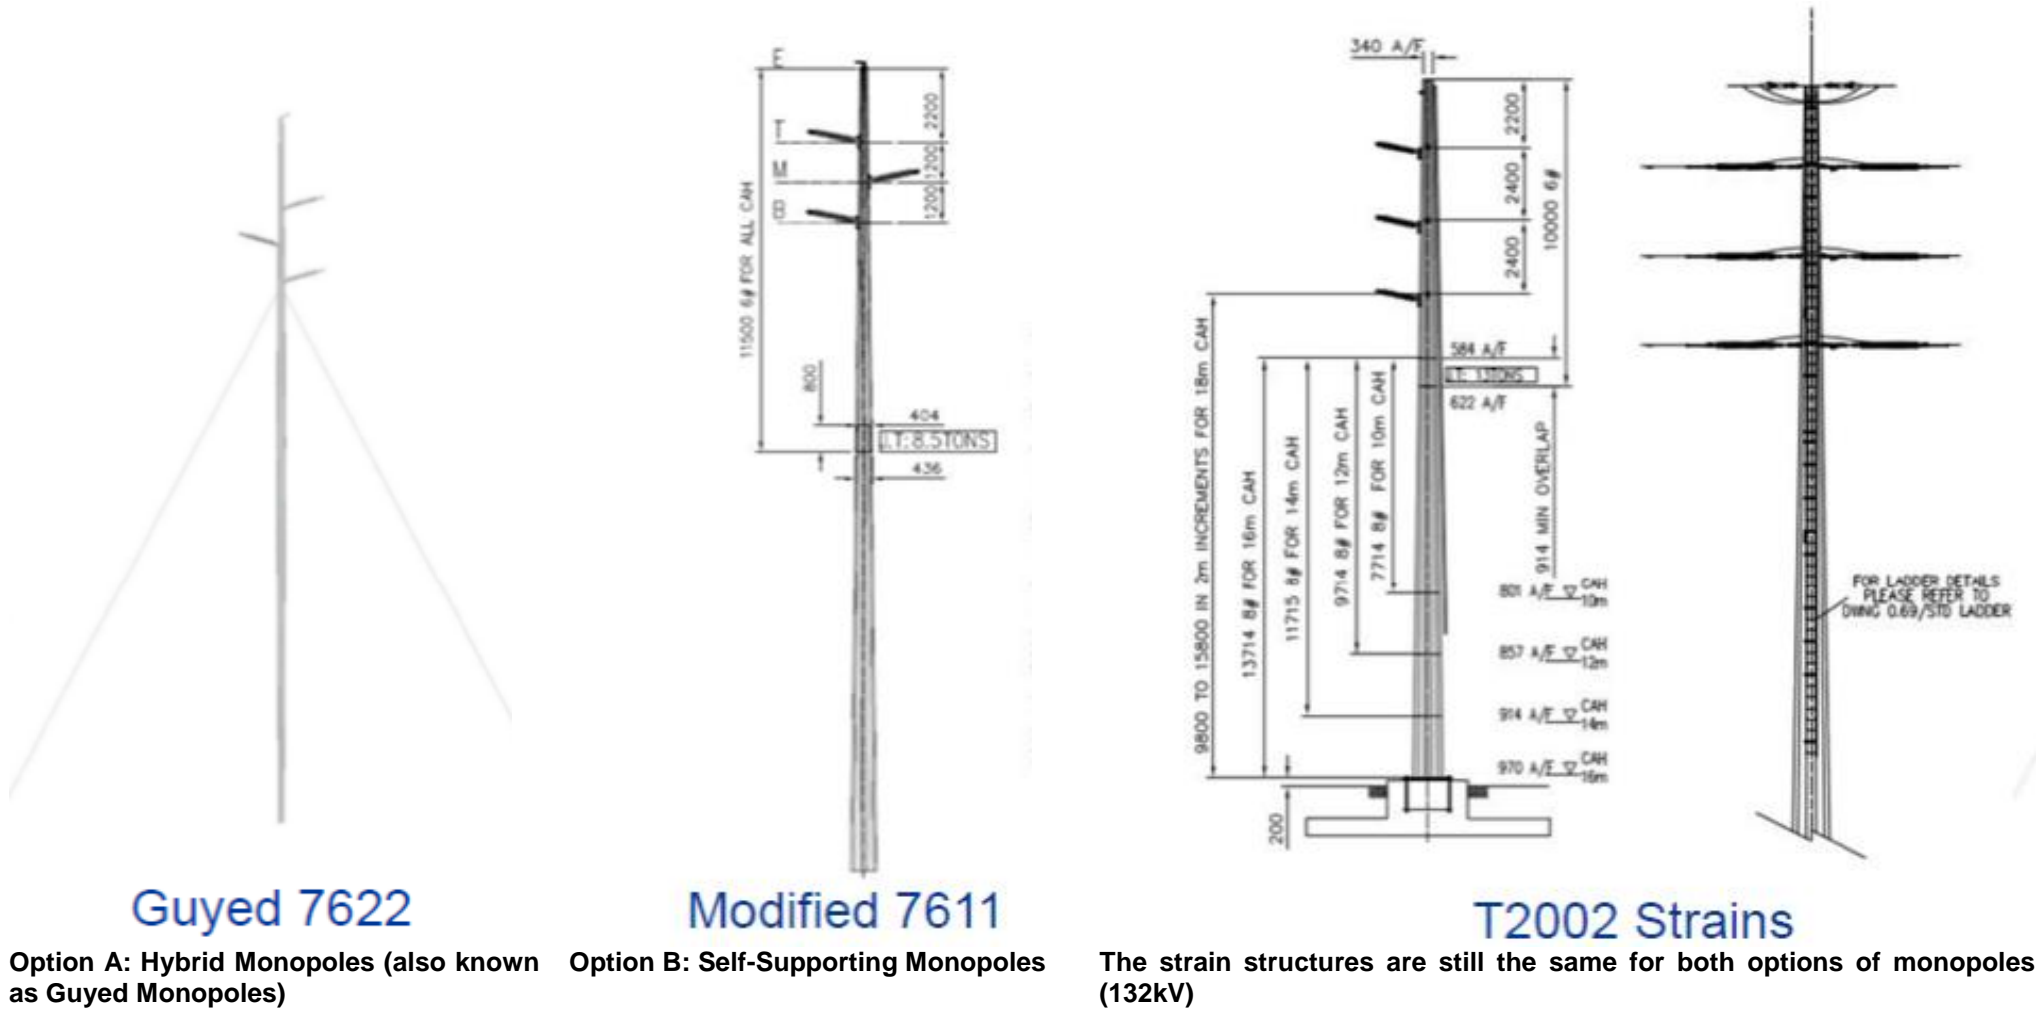


Figure 1: Indicative drawings of the pylon structures being considered for the proposed 132 kV power line

SECTION F: APPENDICES

Basic Assessment for the Proposed Construction and Operation of Electrical Grid Infrastructure to support the Sutherland, Sutherland 2 and Rietrug Wind Energy Facilities (WEFs), Northern and Western Cape Provinces: DRAFT BASIC ASSESSMENT REPORT

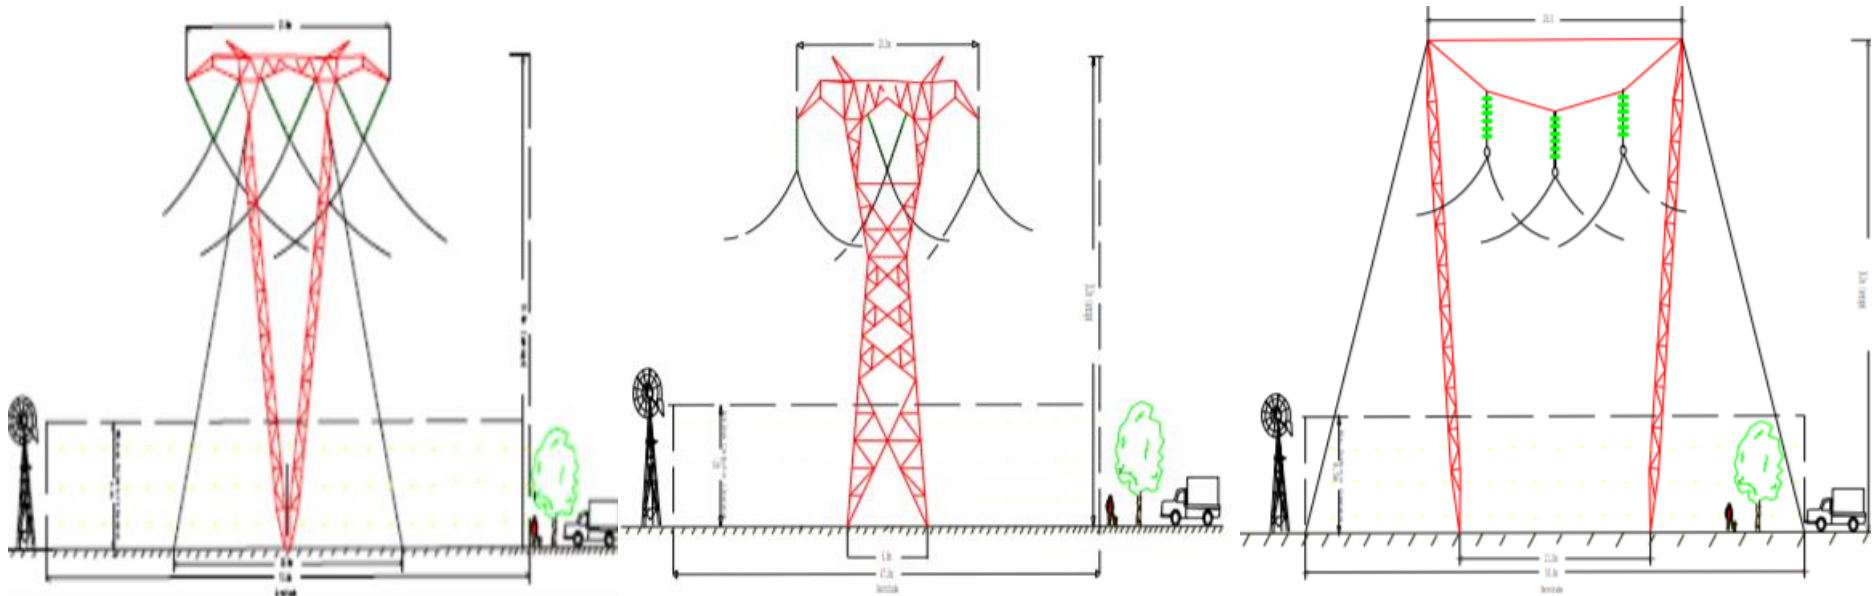


Figure 2: Indicative drawings of the pylon structures potentially being considered for the proposed 400 kV power line (From Left: Guyed V Towers, Strain Towers, and Cross Rope Suspension Tower (Source: Eskom, 2011)).