

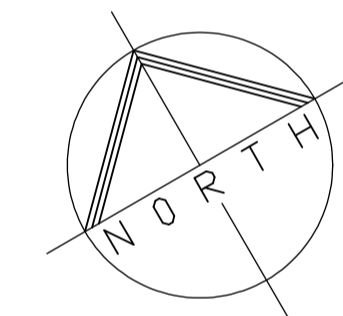


CUSTOMER:	VODACOM PTY LTD
PROPERTY:	UNSURVEYED STATE LAND
FEEDER:	SMI - MASISI 22KV
PROJECT NO:	HA MANENZHE BS42110
CONDUCTOR:	3 PHASE FOX
LENGTH OF LINE:	610.9m
SCALE:	1:1000
SURVEYOR:	MCB - E STEENKAMP
DRAUGHTSPERSON:	E STEENKAMP
DATE:	03-08-2015
PAGE 1 OF 1 / A1	

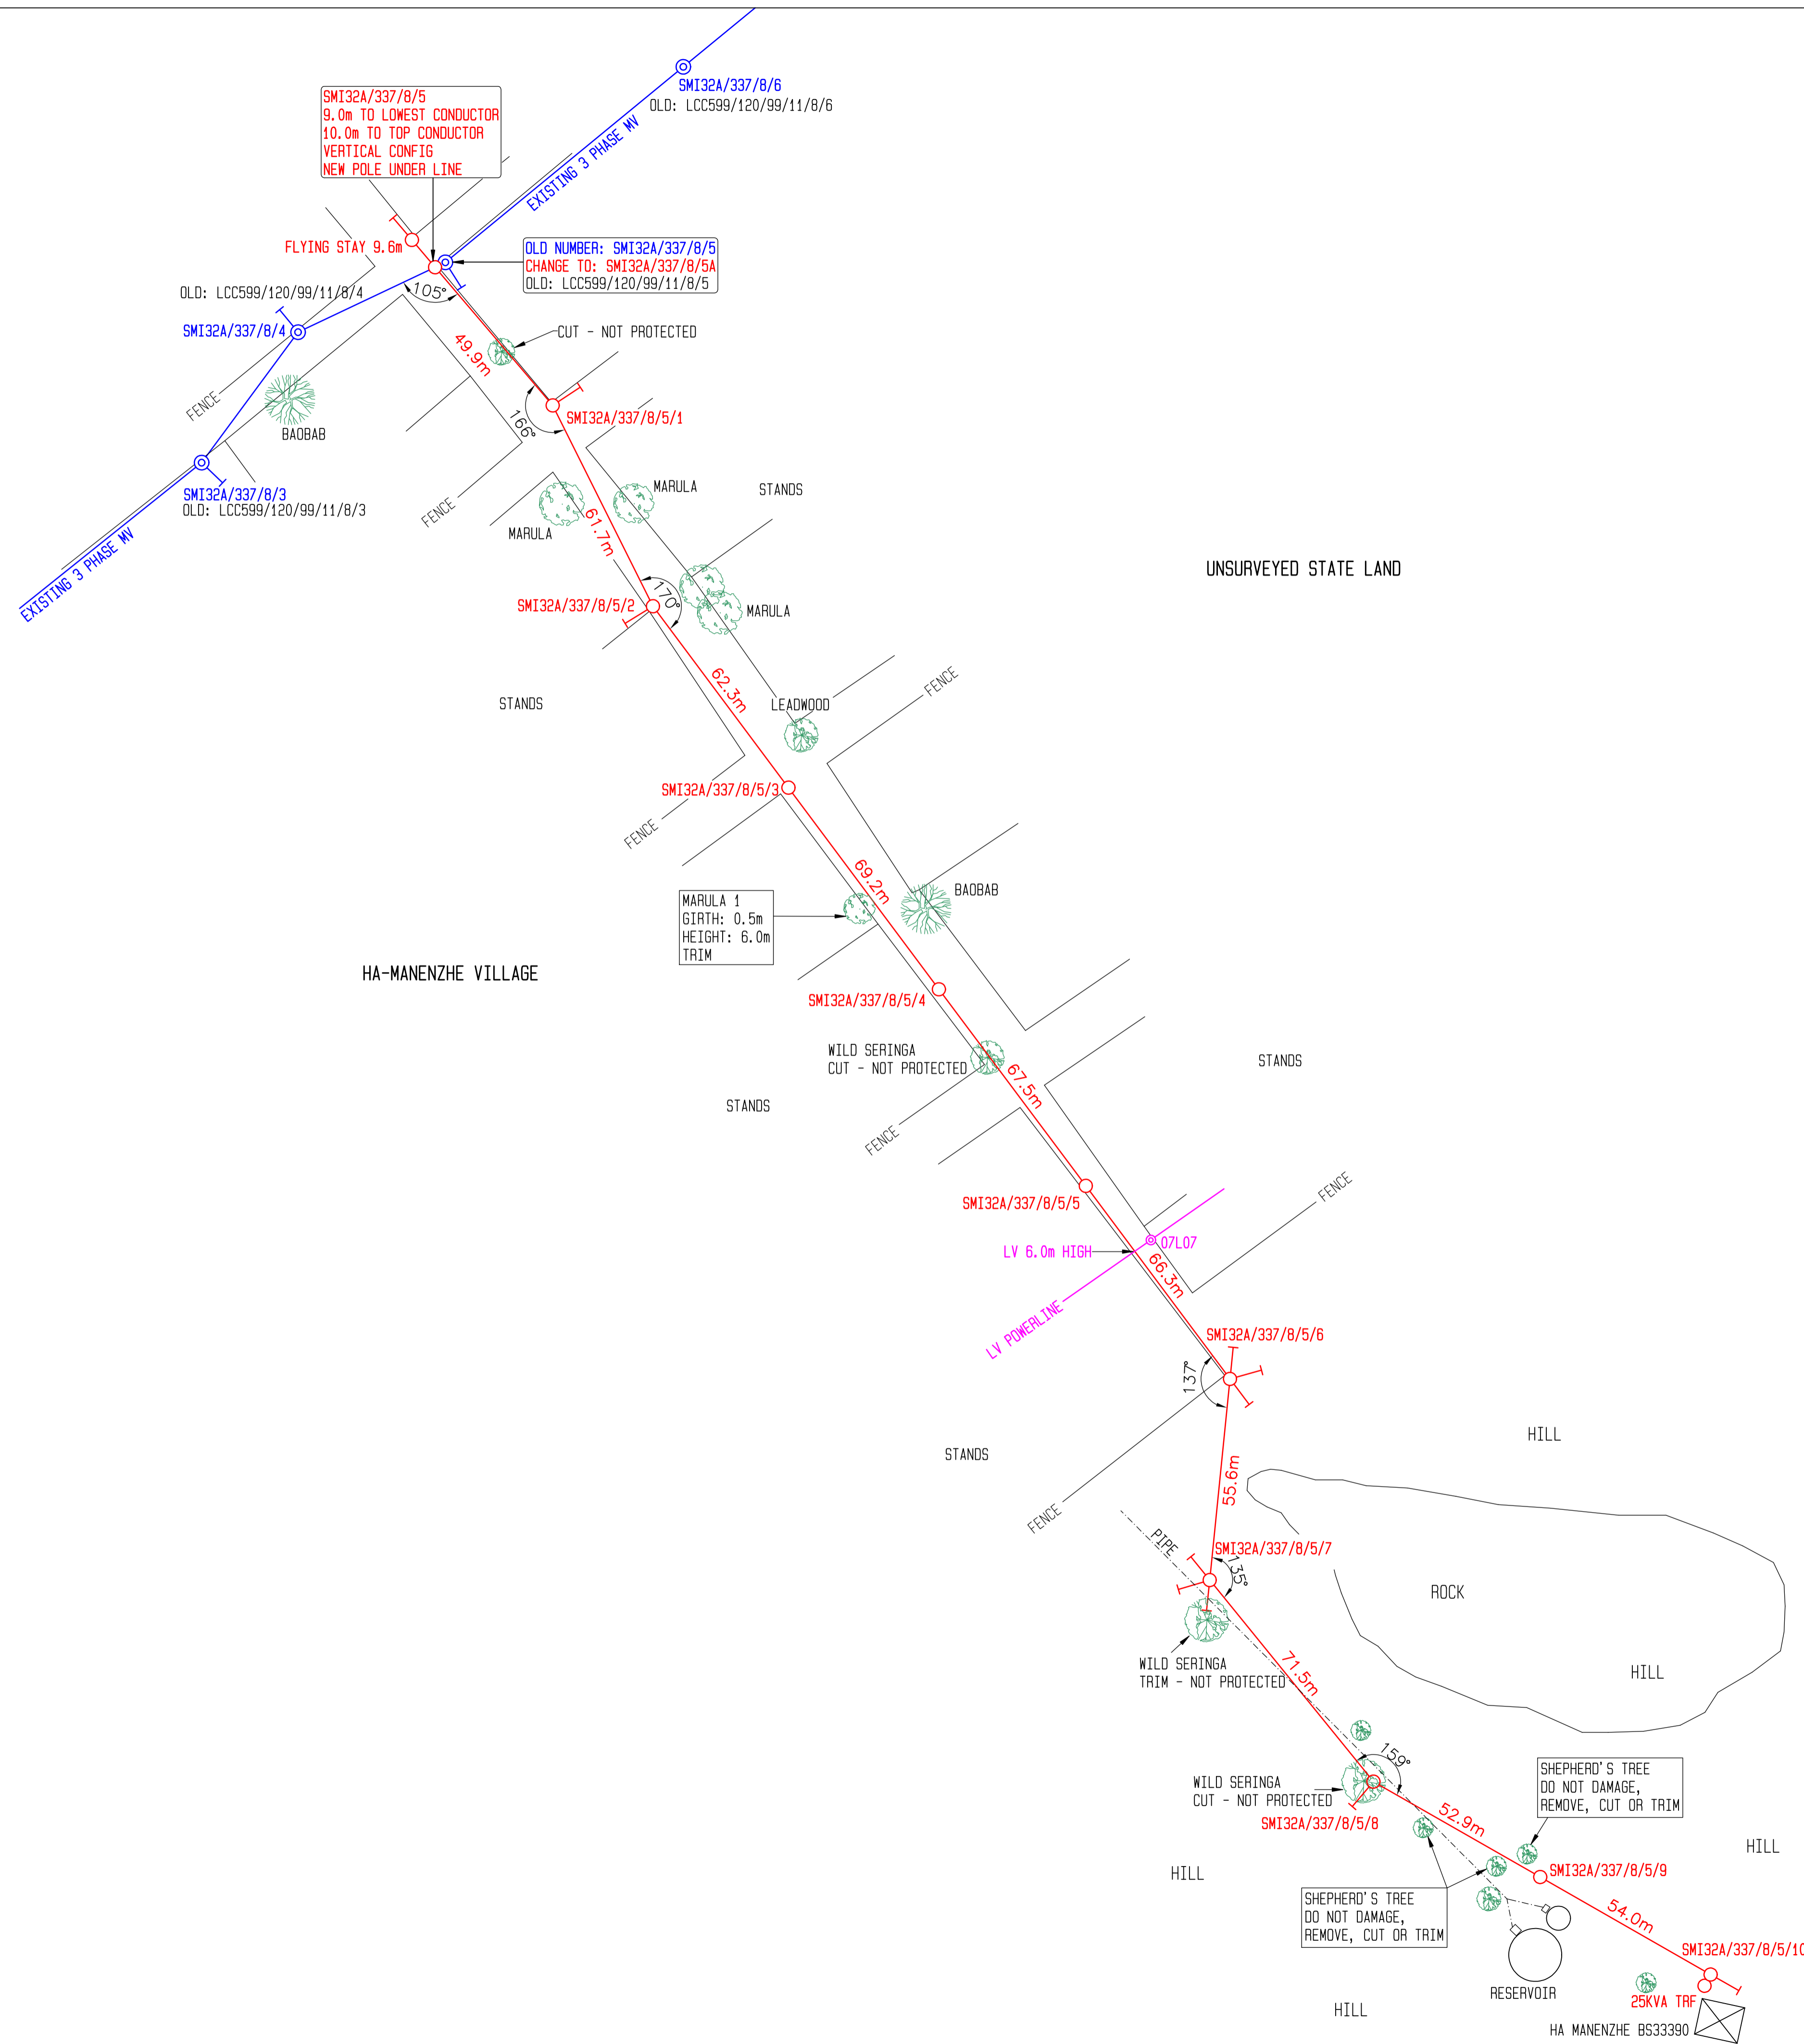

- * PERCENTAGE BUSHCLEARING NEEDED = 30%
- * IS A TREE PERMIT REQUIRED - YES
- * INSTALL 3 PHASE MV LINE
- * INSTALL 25KVA TRANSFORMER O.D.L (RIGHT) AT POLE SMI32A/337/8/5/10

PROTECTED TREES MAY NOT BE DAMAGED (CUT OR TRIMMED) WITHOUT A LICENSE FROM DWAF

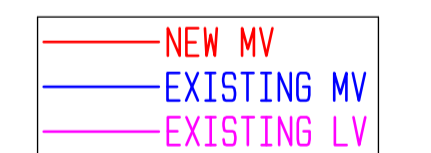

TREE PERMIT REQUIRED TO TRIM ONE MARULA