


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	1
Bushclearing required (m)	102

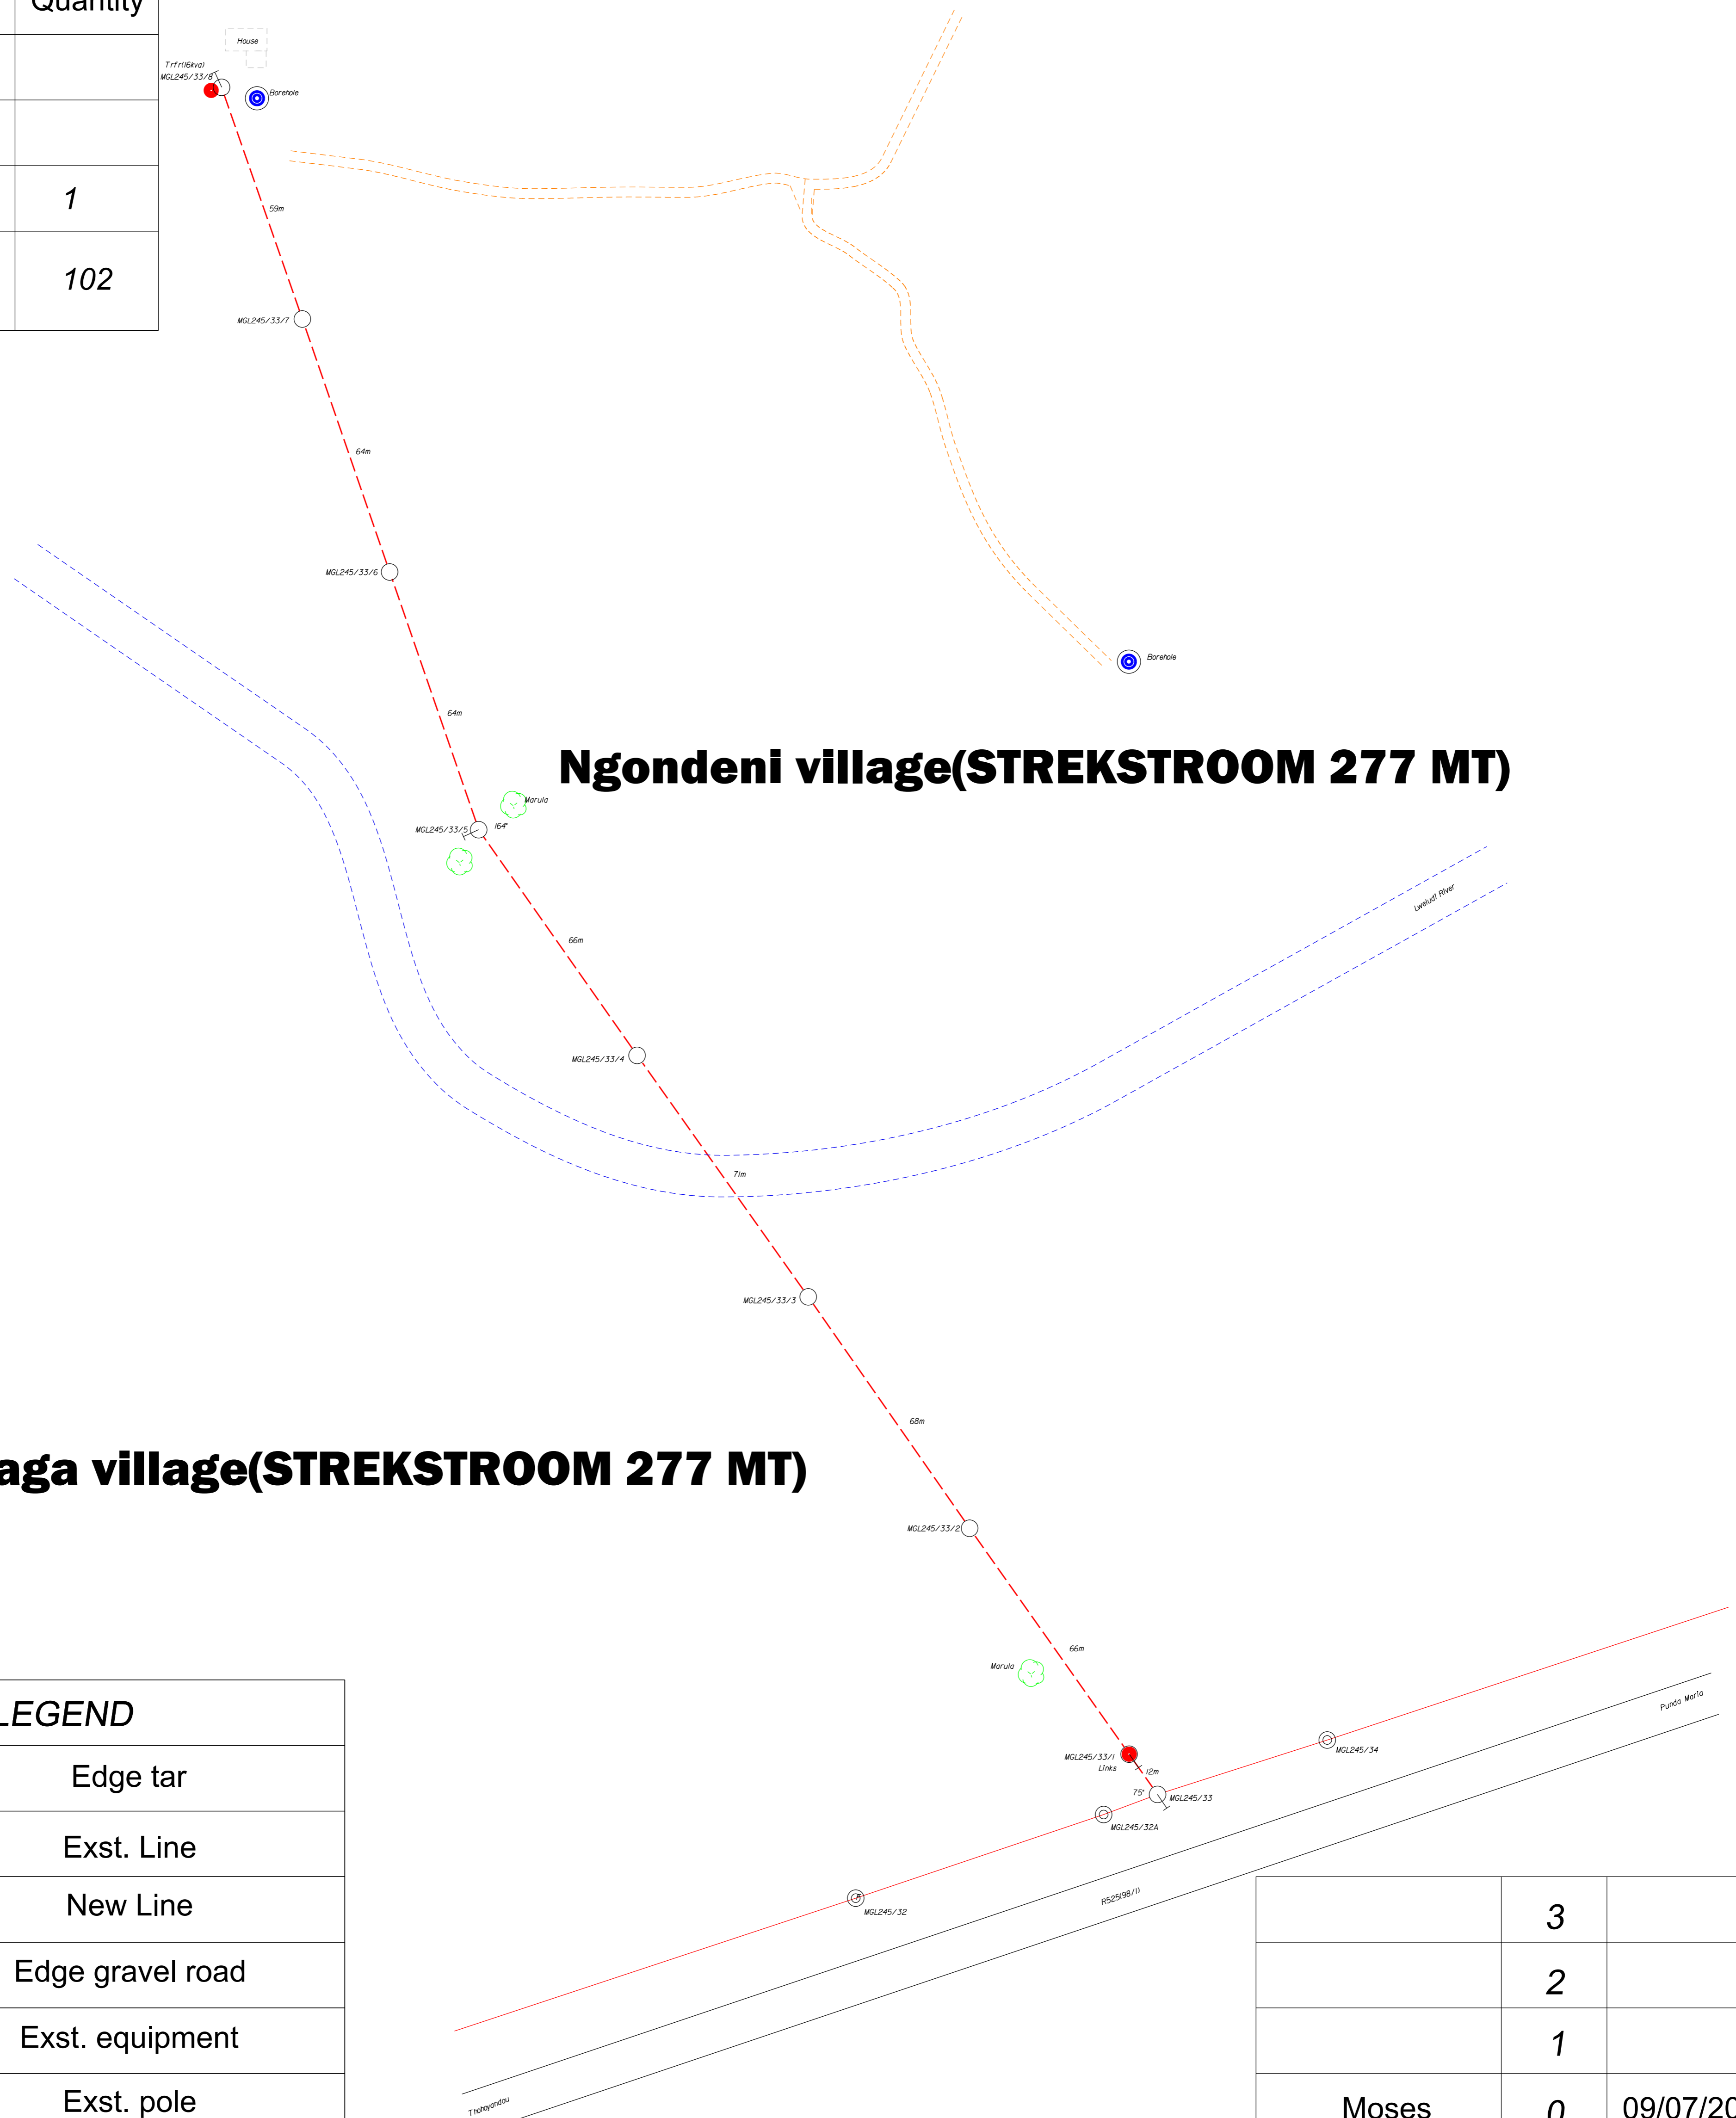

Ngondeni village(STREKSTROOM 277 MT)


Muraga village(STREKSTROOM 277 MT)

LEGEND

	Edge tar
	Exst. Line
	New Line
	Edge gravel road
	Exst. equipment
	Exst. pole
	New Equipment
	New pole

	3	
	2	
	1	
Moses	0	09/07/2021
SURVEYOR	REV	SURVEY DATE

FEEDER: [SG - Geluk 22 kV]	CUSTOMER: Sipholi Ndshavhelafhi
PROJECT NO: THT425230345	PROPERTY: Farm of STREKSTROOM 277MT
CONDUCTOR: [Fox 3 Ph]	CONTACT DETAILS 082 635 5499
LENGTH OF LINE: 471.78m	SCALE: [1:2 500]
SURVEYOR: Moses	PAGE: [1] of [1]
DRAUGHTSPERSON: Moses	

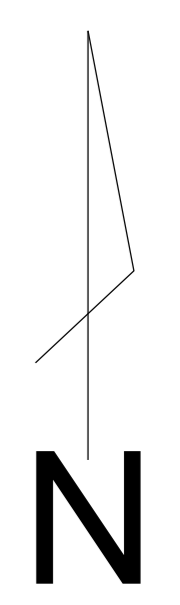

THIS DRAWING IS THE PROPERTY OF ESKOM
Disclaimer: Eskom is not responsible for any errors displayed on this drawing