


Reference	CAD-Line Survey-LOU
Effective Date	15/10/2015
Revision	01

Description	Quantity
Shrubs > 40 cm	
Trees	
Trees to Trim	
Bushclearing required (m)	

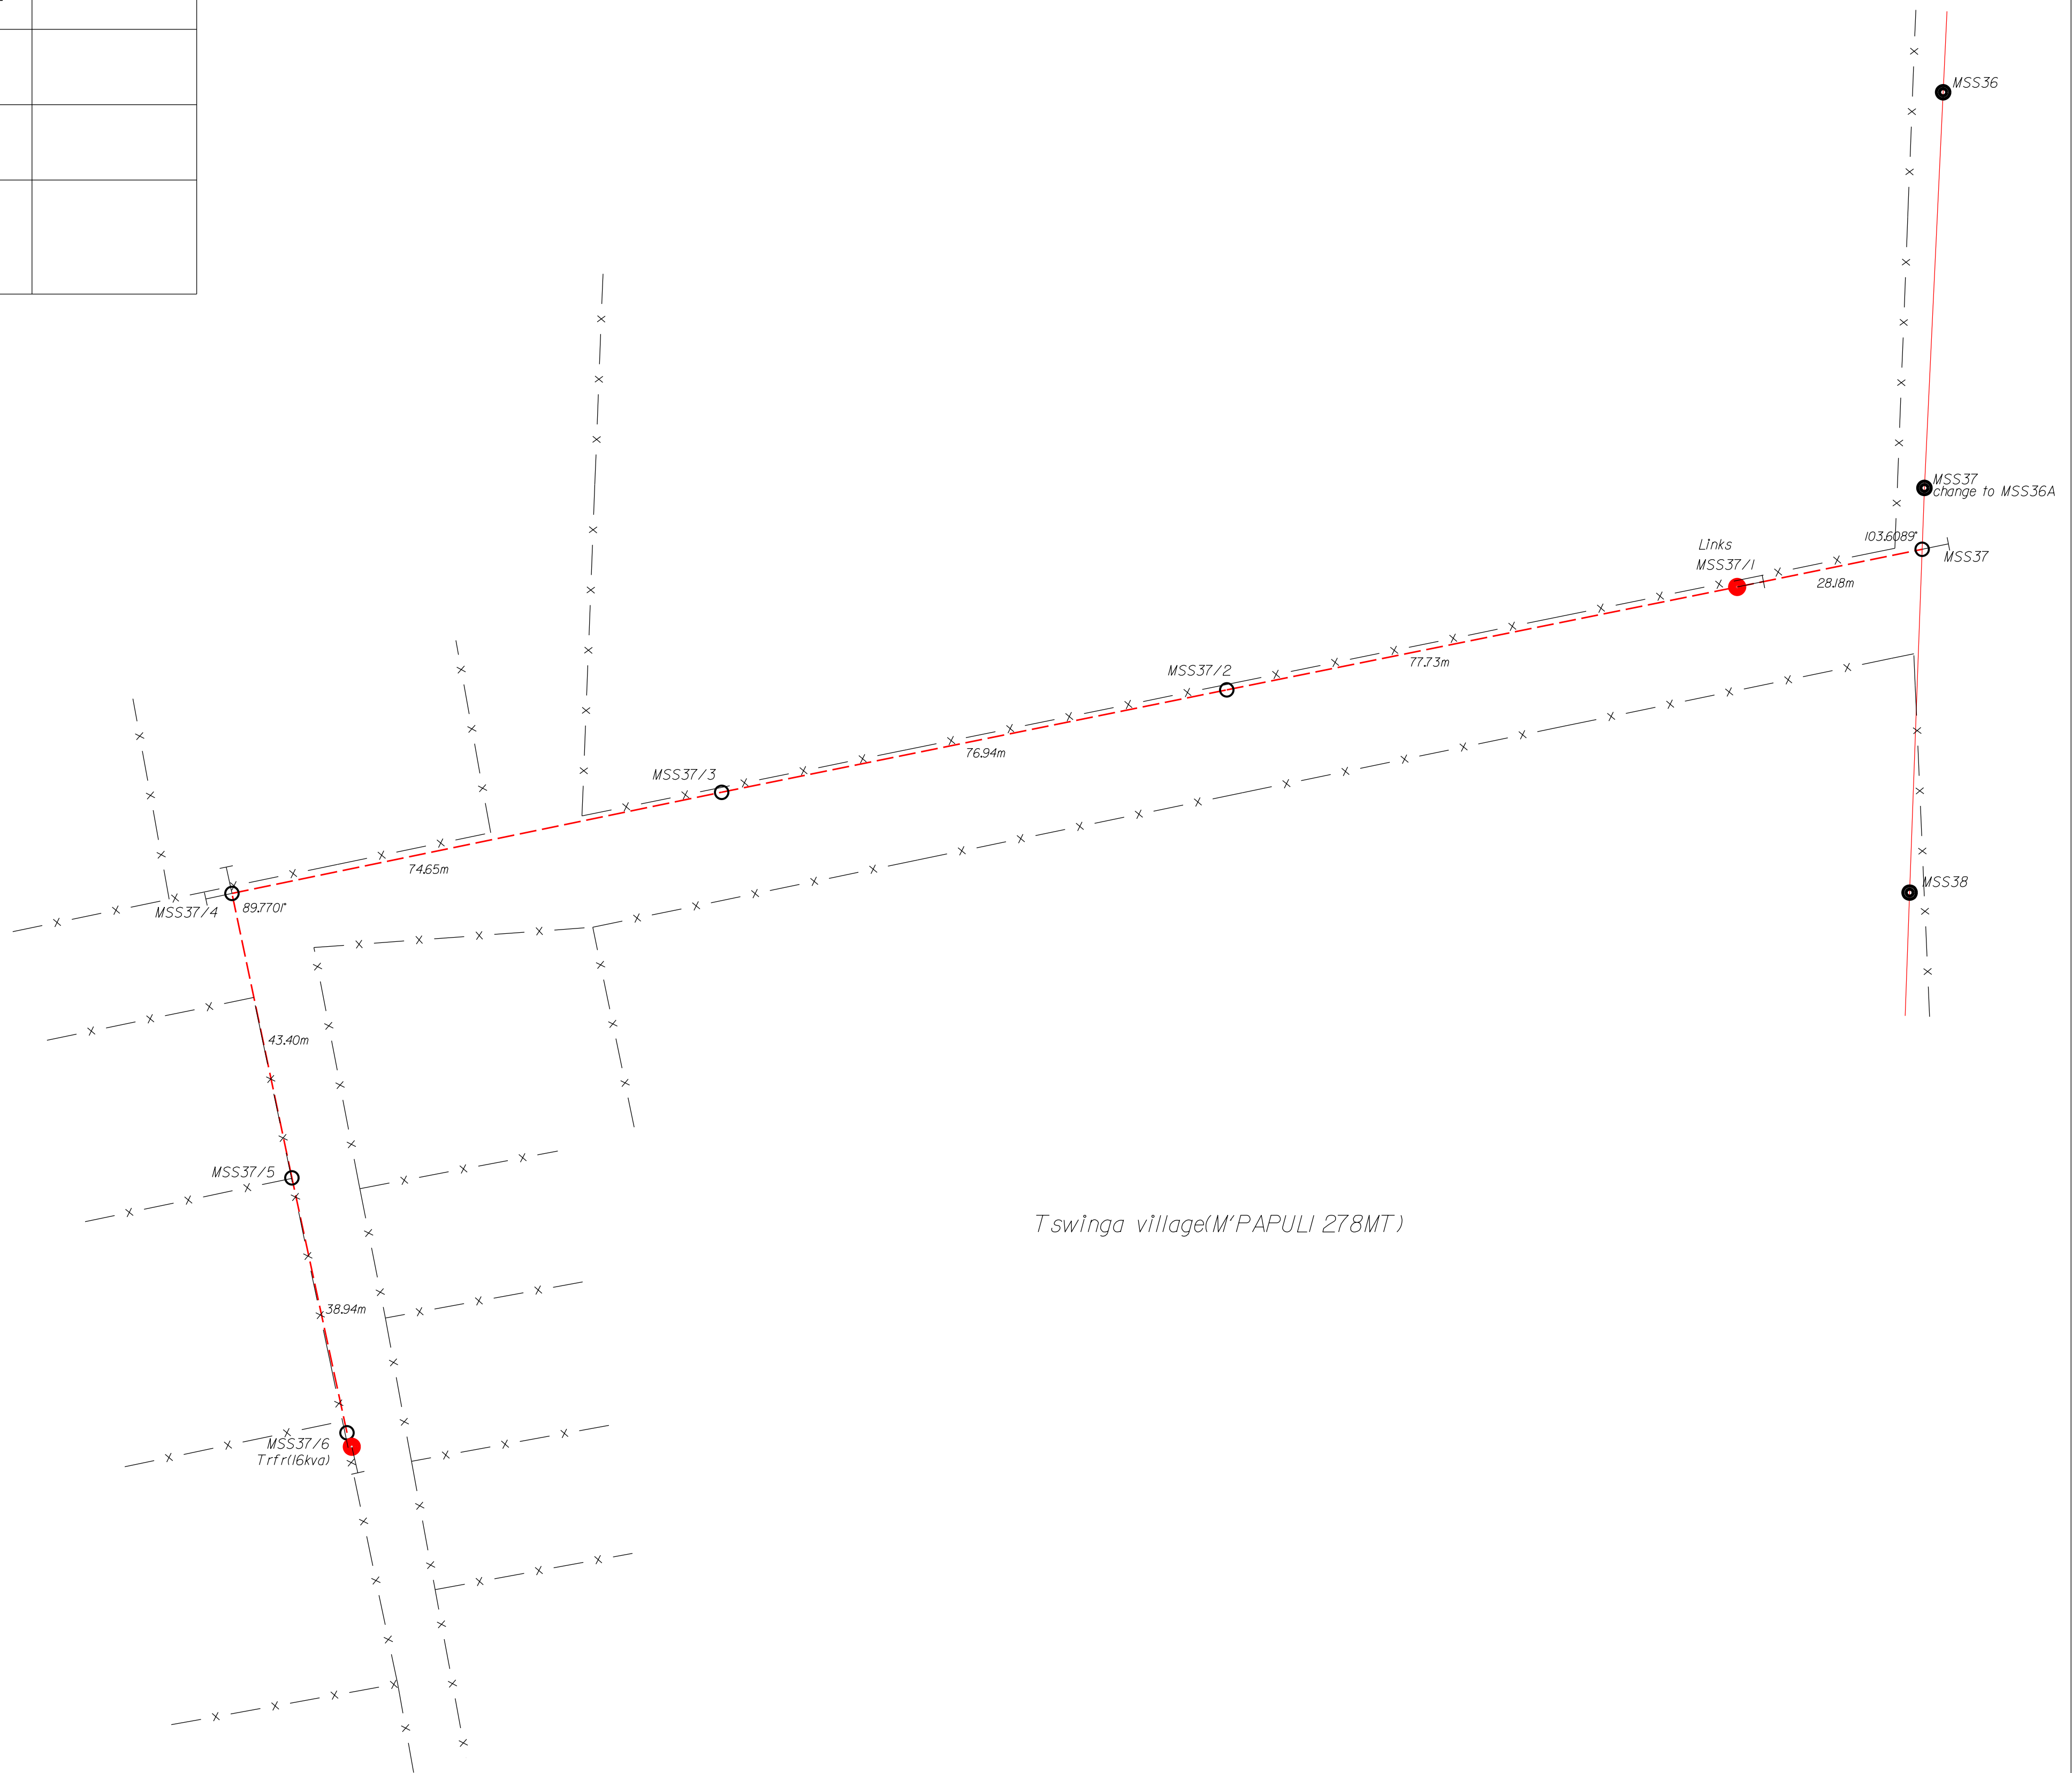

LEGEND

	Edge tar
	Exst. Line
	New Line
	Edge gravel road
	Exst. equipment
	Exst. pole
	New Equipment
	New pole

	3	
	2	
	1	
Moses	0	09/05/2023
SURVEYOR	REV	SURVEY DATE

FEEDER: Muledane/Sibasa 22kv

CUSTOMER: Mulalo Netshisumbewa

PROJECT NO: THT610334446

CONDUCTOR: [Fox 3 Ph]

PROPERTY: Farm of M'PAPULI 278MT

LENGTH OF LINE: 339.84m


SURVEYOR: Moses

CONTACT DETAILS 073 674 4590

DRAUGHTSPERSON: Moses

SCALE: [1:2 500]

PAGE: [1] of [1]



THIS DRAWING IS THE PROPERTY OF Eskom
Disclaimer: Eskom is not responsible for any errors displayed on this drawing