


DOORNDRAAI EAST 235

NB:USE DISTRIBUTION TECHNICAL BULLETIN 06TB-038 TO PLANT THE POLES FROM VM88-86-152-37-10-3 UP TO VM88-86-152-37-10-10.

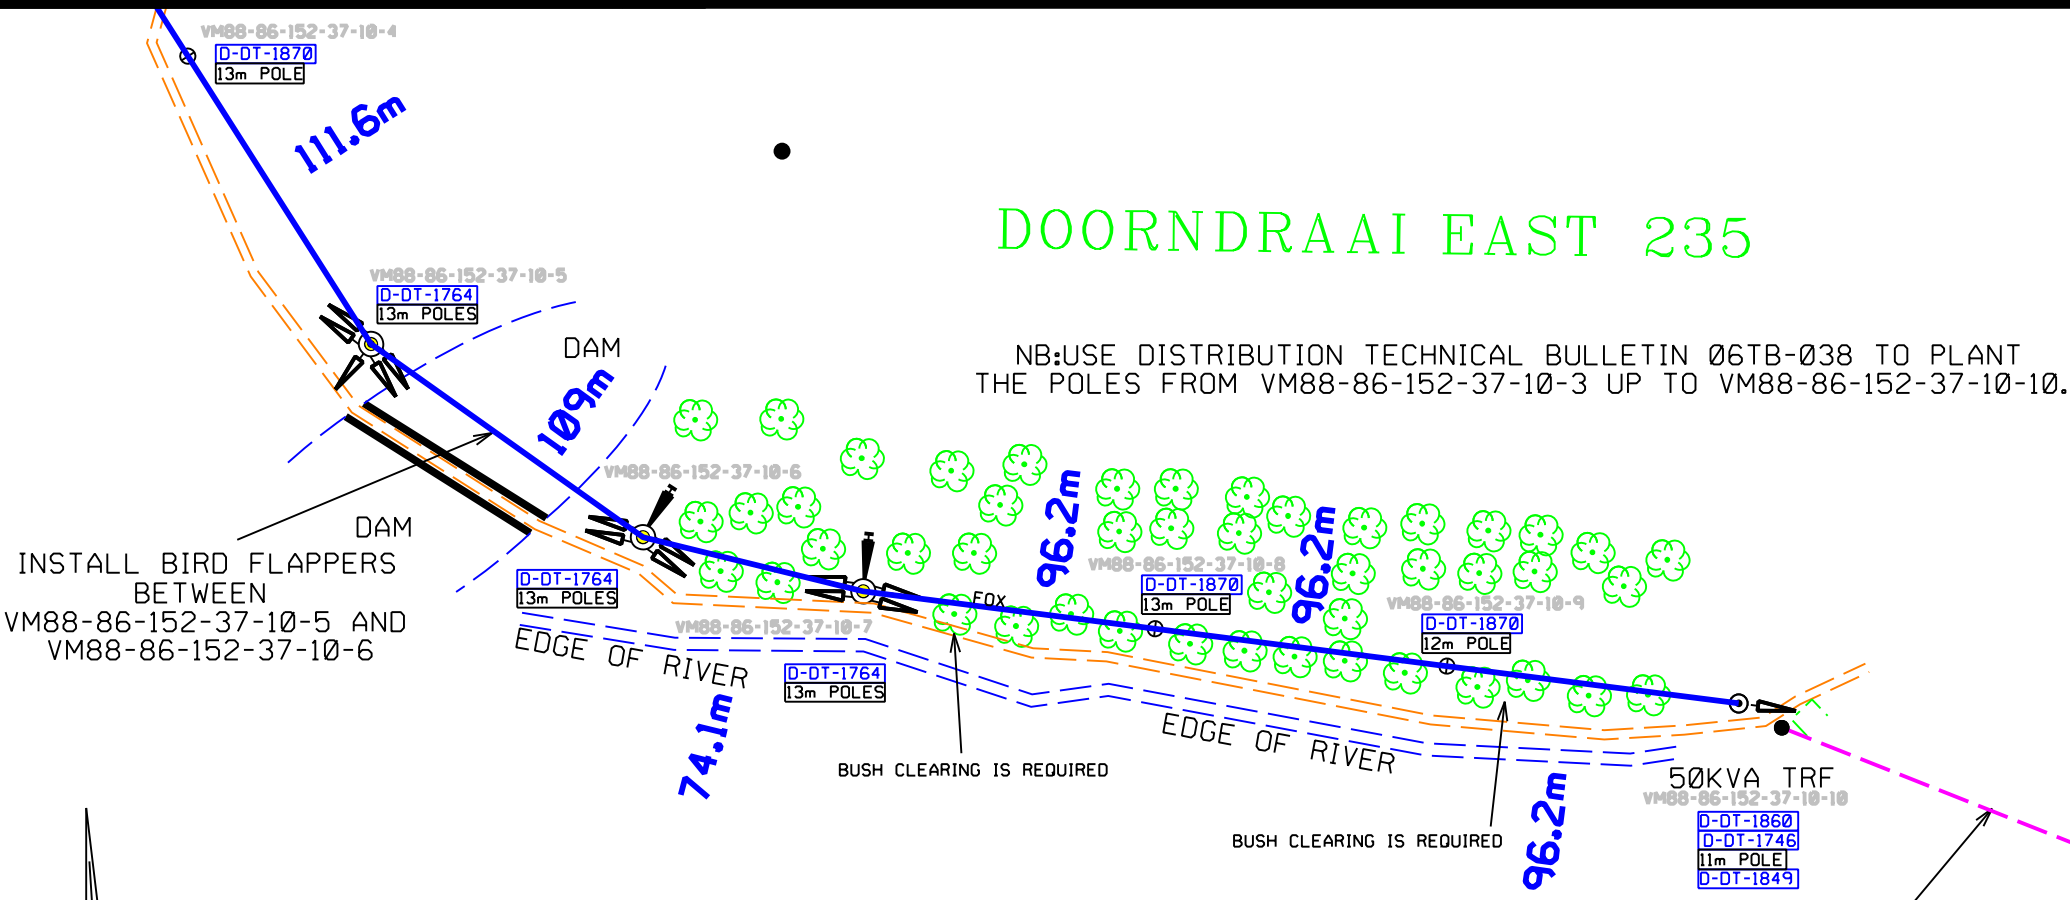

NB:USE DISTRIBUTION TECHNICAL BULLETIN 06TB-038 TO PLANT THE POLES FROM VM88-86-152-37-10-3 UP TO VM88-86-152-37-10-10.

POWER LINE TO BE DISMANTLED BETWEEN BW510-73 AND BW510-73-8