


Environmental Impact Report : Proposed Route Corridors (Preferred and Alternative)

Eskom Kimberley Strengthening Phase 4 Project Route Map: Boundary -Ulco

(Approximately 94km 400kV powerline from Boundary to Ulco, including a new Ulco Tx Substation adjacent to the existing Ulco Dx Substation)

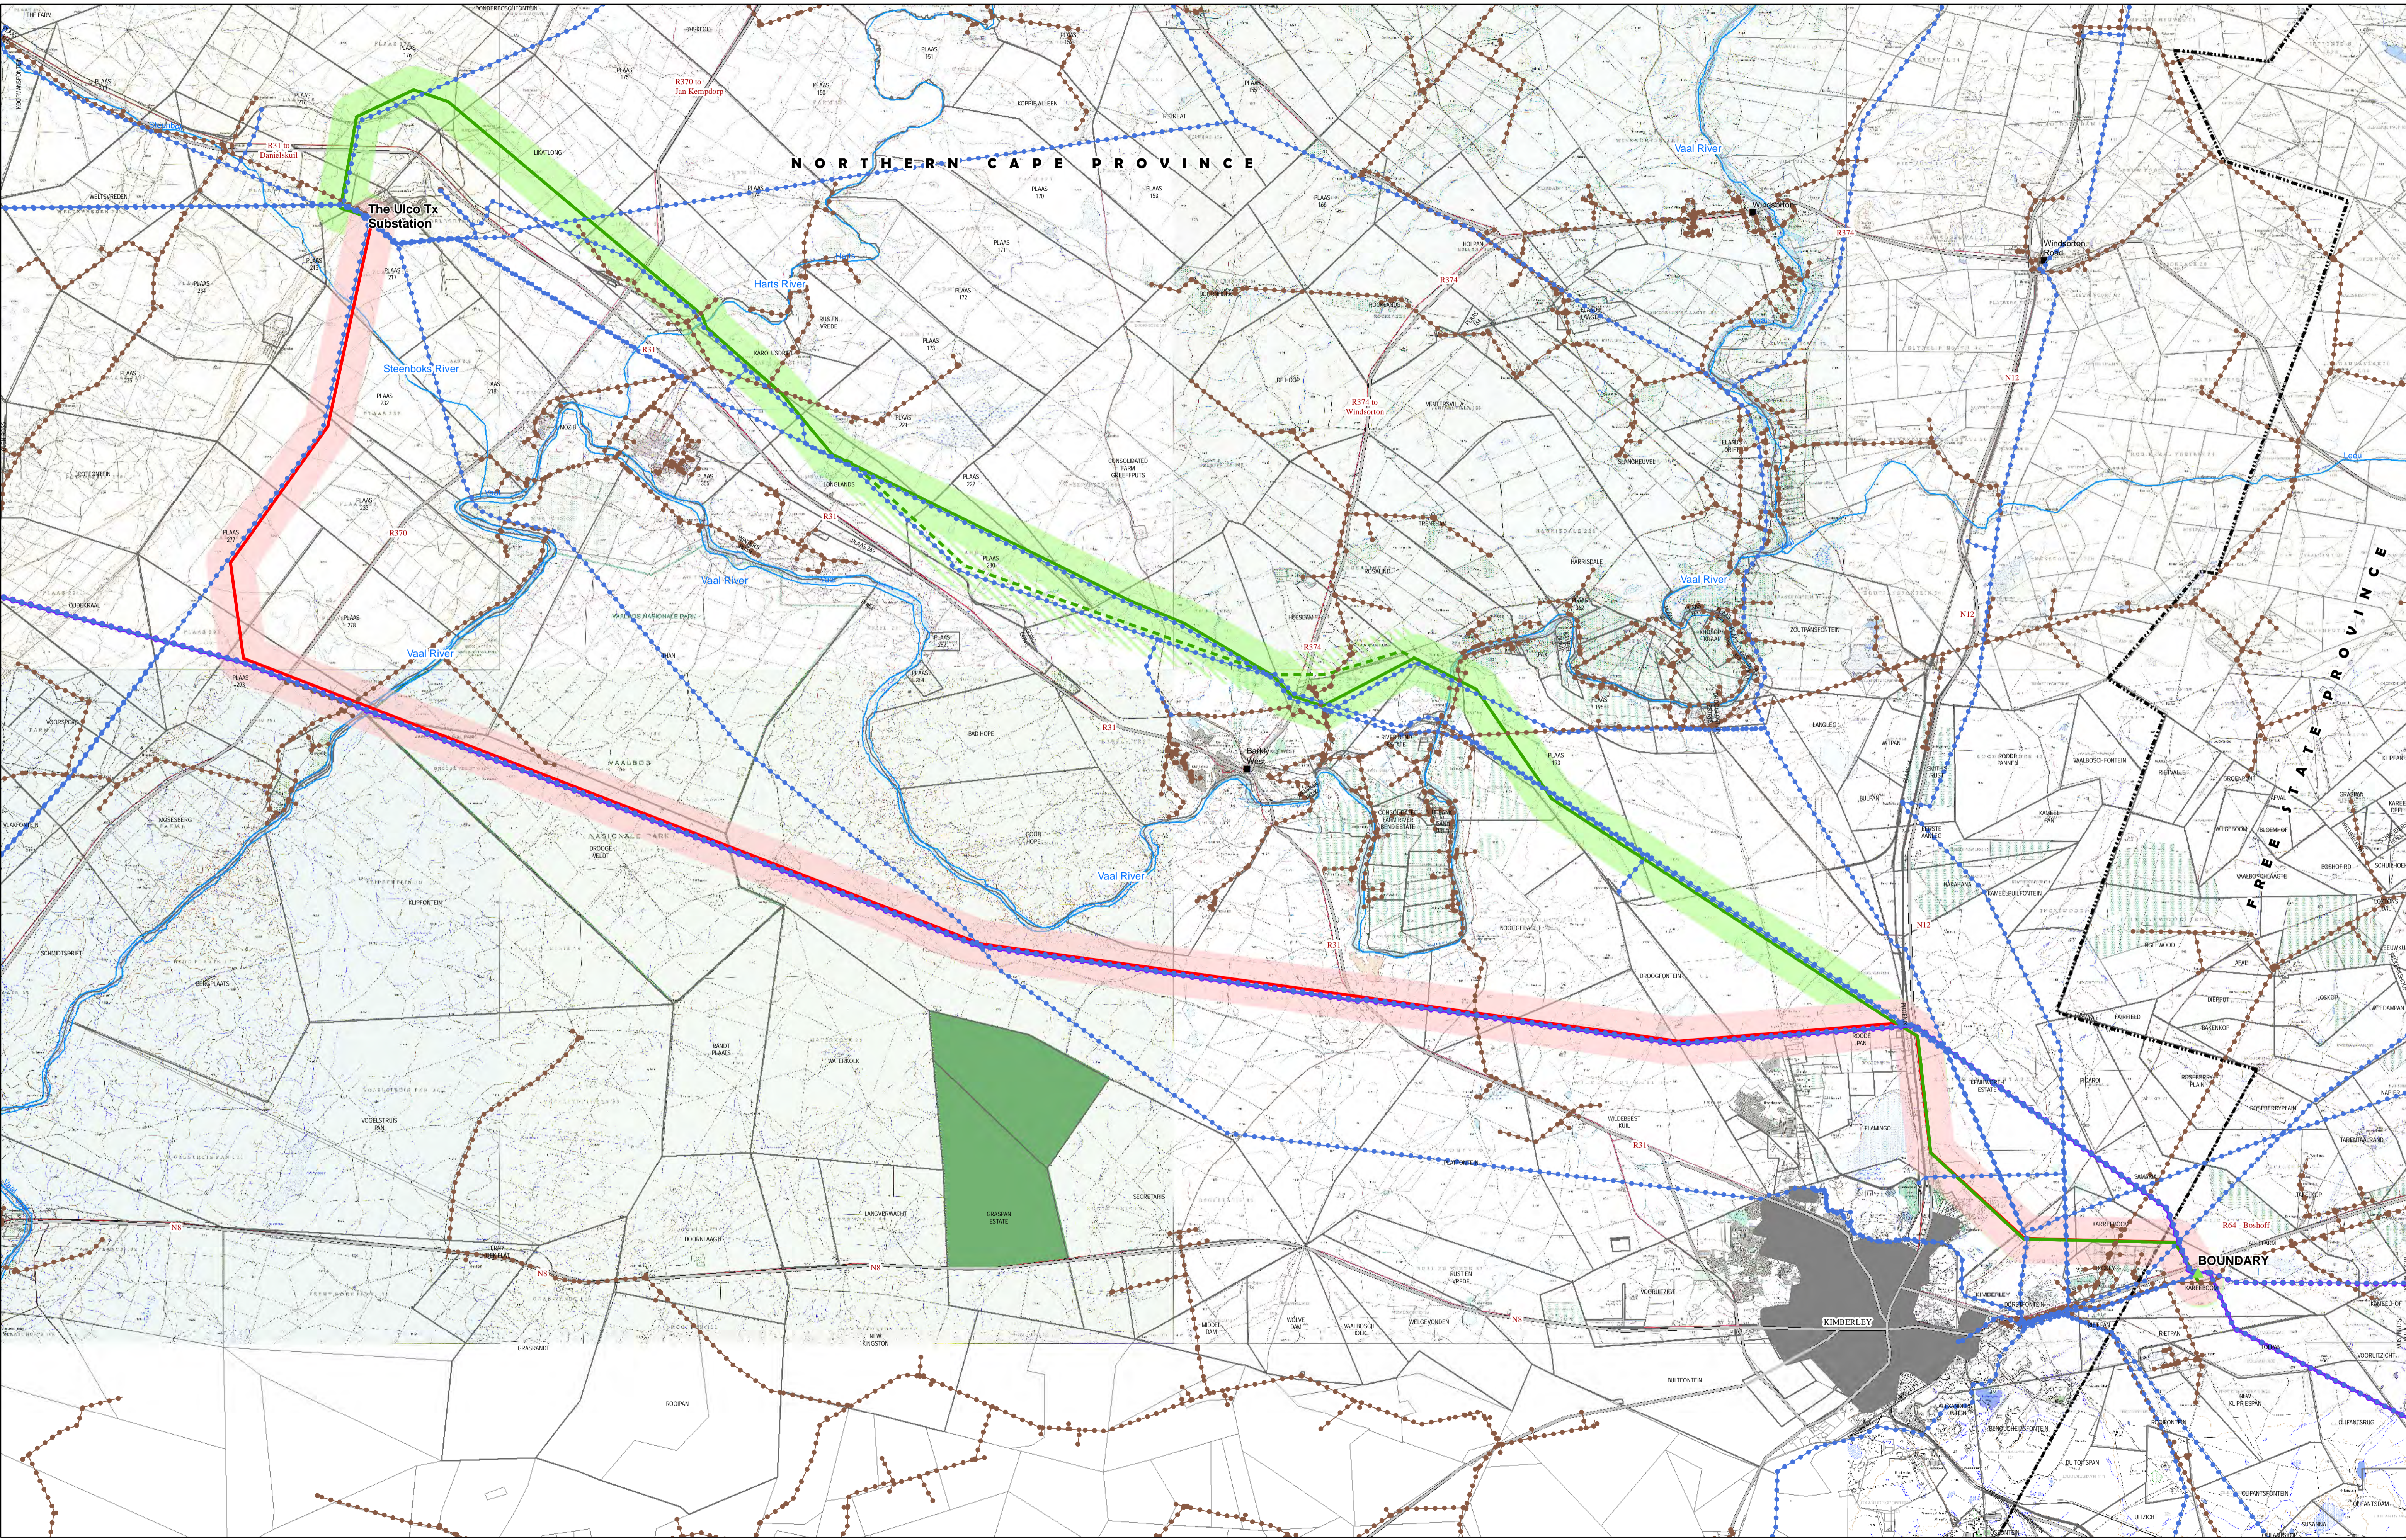

- Towns / Places
- Dams
- Farms
- Protected areas
- Provincial Borders
- Major Towns
- HV Distribution power lines
- Rivers
- Distribution power lines
- Roads
- Transmission power lines
- Route One Preferred
- Route One Corridor: Preferred
- Route Two: Alternative (a)
- Route Two: Alternative (b)
- Route Two Corridor: Alternative (a)
- Route Two Corridor: Alternative (b)
- ▲ Boundary Tx Substation
- ▲ The proposed new Ulco Tx Substation to be constructed adjacent to the existing Ulco Dx Substation