


GENERAL NOTES:

1. ALL MARINE WORKS ARE SCHEMATIC ONLY.
2. THE SUPPLIER TO USE THE MARINE PIPEWORK SCHEMATIC AS A GUIDE ONLY AND HE SHOULD CHOOSE POSITIONS OF INLET STRUCTURES AND OUTLET DISCHARGE POINTS BASED ON HIS OWN DESIGN TAKING COGNISANCE OF AMONGST OTHERS THE WATER QUALITY REQUIRED AT THE PLANT AS WELL AS DAMAGE DUE TO ENVIRONMENTAL CONDITIONS, SUCH AS WAVE AND SHORELINE VARIATION.
3. ALL PHASE 1 PIPEWORK TO BE DECOMMISSIONED AFTER COMPLETION OF PHASE 2.
4. ALL PUMP STATION POSITIONS TO BE VERIFIED.
5. SUPPLIERS DESIGN SHALL ENSURE PIPELINE STABILITY AND PROTECTION ALONG THE ENTIRE PIPELINE(S) LENGTH, INCLUDING THE BEACH CROSSING, TIDAL ZONE, SURF ZONE AND OFFSHORE PORTION.
6. ALL PIPELINE(S) LOCATED ON THE BEACH AND TIDAL ZONE AREA SHALL BE BURIED TO ALLOW MINIMUM 1 M COVER FOR AESTHETIC PURPOSES. ALL PIPELINE(S) LOCATED INSIDE THE TIDAL POOL AREA SHALL BE BURIED ALONG THE BEACH AREA AS WELL AS WITHIN THE TIDAL POOL, EXTENDING TO THE BOUNDARY FENCE FOR AESTHETIC PURPOSES.
7. ALL BUOYS AND OTHER AIDS TO NAVIGATION MARKERS SHALL MEET THE SAMSA STANDARDS IN TERMS OF MARINE NOTICE No. 8 OF 2016

LEGEND

DESCRIPTION	SYMBOL
2xØ355mm HDPE PE100 PN10 RAW WATER ABSTRACTION DELIVERY (ON SHORE) PIPELINE	--- --
Ø355mm HDPE PE100 PN10 BRINE DISCHARGE PIPELINE	- - - -
Ø315mm HDPE PE100 PN16 INJECTION PIPELINE	- . - . - .
OFFSHORE RAW WATER 1xØ315 ABSTRACTION PIPELINE	- . . . - . . .
OFFSHORE TIDAL POOL SUPPLEMENTAL PIPELINE (DELIVERY PIPE OF 1xØ250mm AND SUCTION PIPE OF Ø355mm)	- . - . - . - .
OFFSHORE BRINE DISCHARGE PIPELINE 1xØ355mm HDPE PE100 PN10	- . . . - . . .
PROPOSED SITES	[]

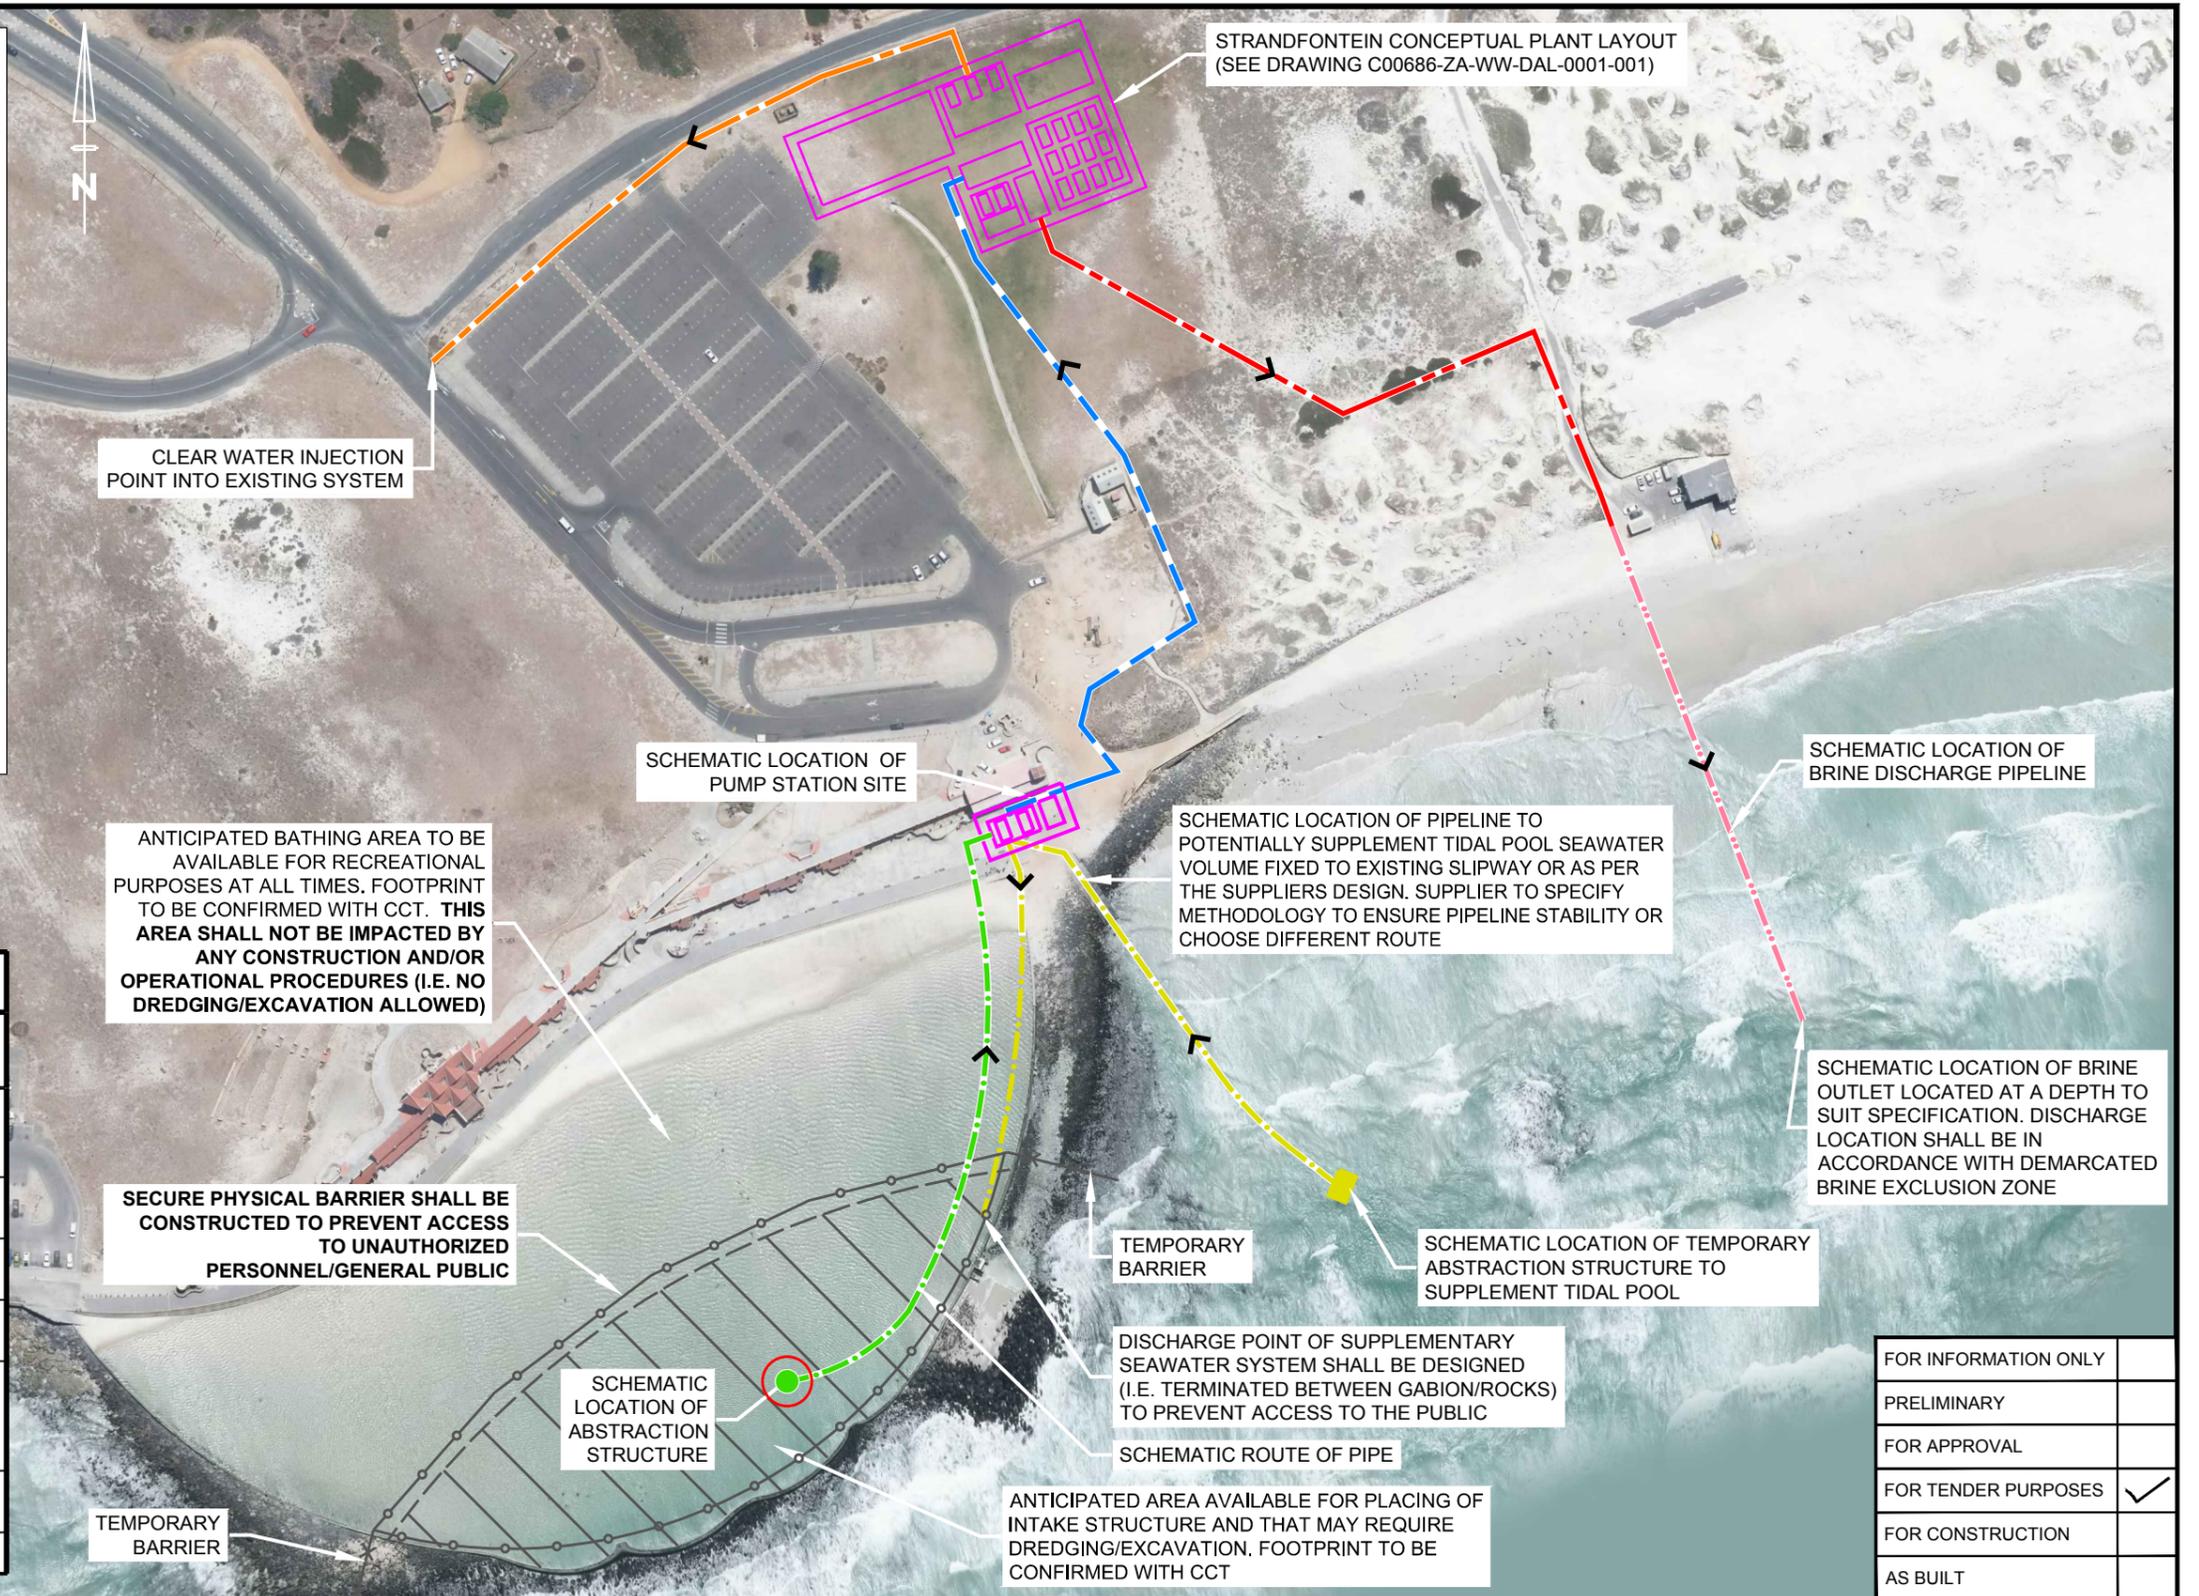

REV	DATE	REVISION DESCRIPTION	DRAWN	DESIGNED	REV ENGINEER	CONSULTING ENGINEER
A	25/08/17	FOR TENDER	KL	DS	WS	WPRSA
B	11/09/17	ADDENDUM 1 CHANGES	KL	VJ	WS	WPRSA

OneWayTM
to zero harm

Copyright ©
WorleyParsons Services Pty Ltd
ABN 61 001 279 812

CLIENT
CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

PROJECT
WATER RESILIENCE PROJECT

DRAWING DESCRIPTION
STRANDFONTEIN PHASE 1 GENERAL ARRANGEMENT CONCEPTUAL LAYOUT

"This drawing is prepared solely for the use of the contractual customer of WorleyParsons and WorleyParsons assumes no liability to any other party for any representations contained in this drawing."

DATE
AUGUST 2017

SCALE: (ORIGINAL A3)
1:2000

DRG No.
C00686-ZA-WW-DGA-0001-001

REV.
B

WorleyParsons
resources & energy
P.O.Box 398
BELLVILLE 7535
TEL:+27 21912 3000
FAX:+27 21912 3222
e-mail: capetown.office@worleyparsons.com

FOR INFORMATION ONLY
PRELIMINARY
FOR APPROVAL
FOR TENDER PURPOSES ✓
FOR CONSTRUCTION
AS BUILT