


# RESTRICTED DISCHARGE ZONE COORDINATES

POINT	Y	X
1	41509.748	3773582.635
2	41231.190	3773611.669
3	40961.747	3773477.114
4	40702.844	3773364.810

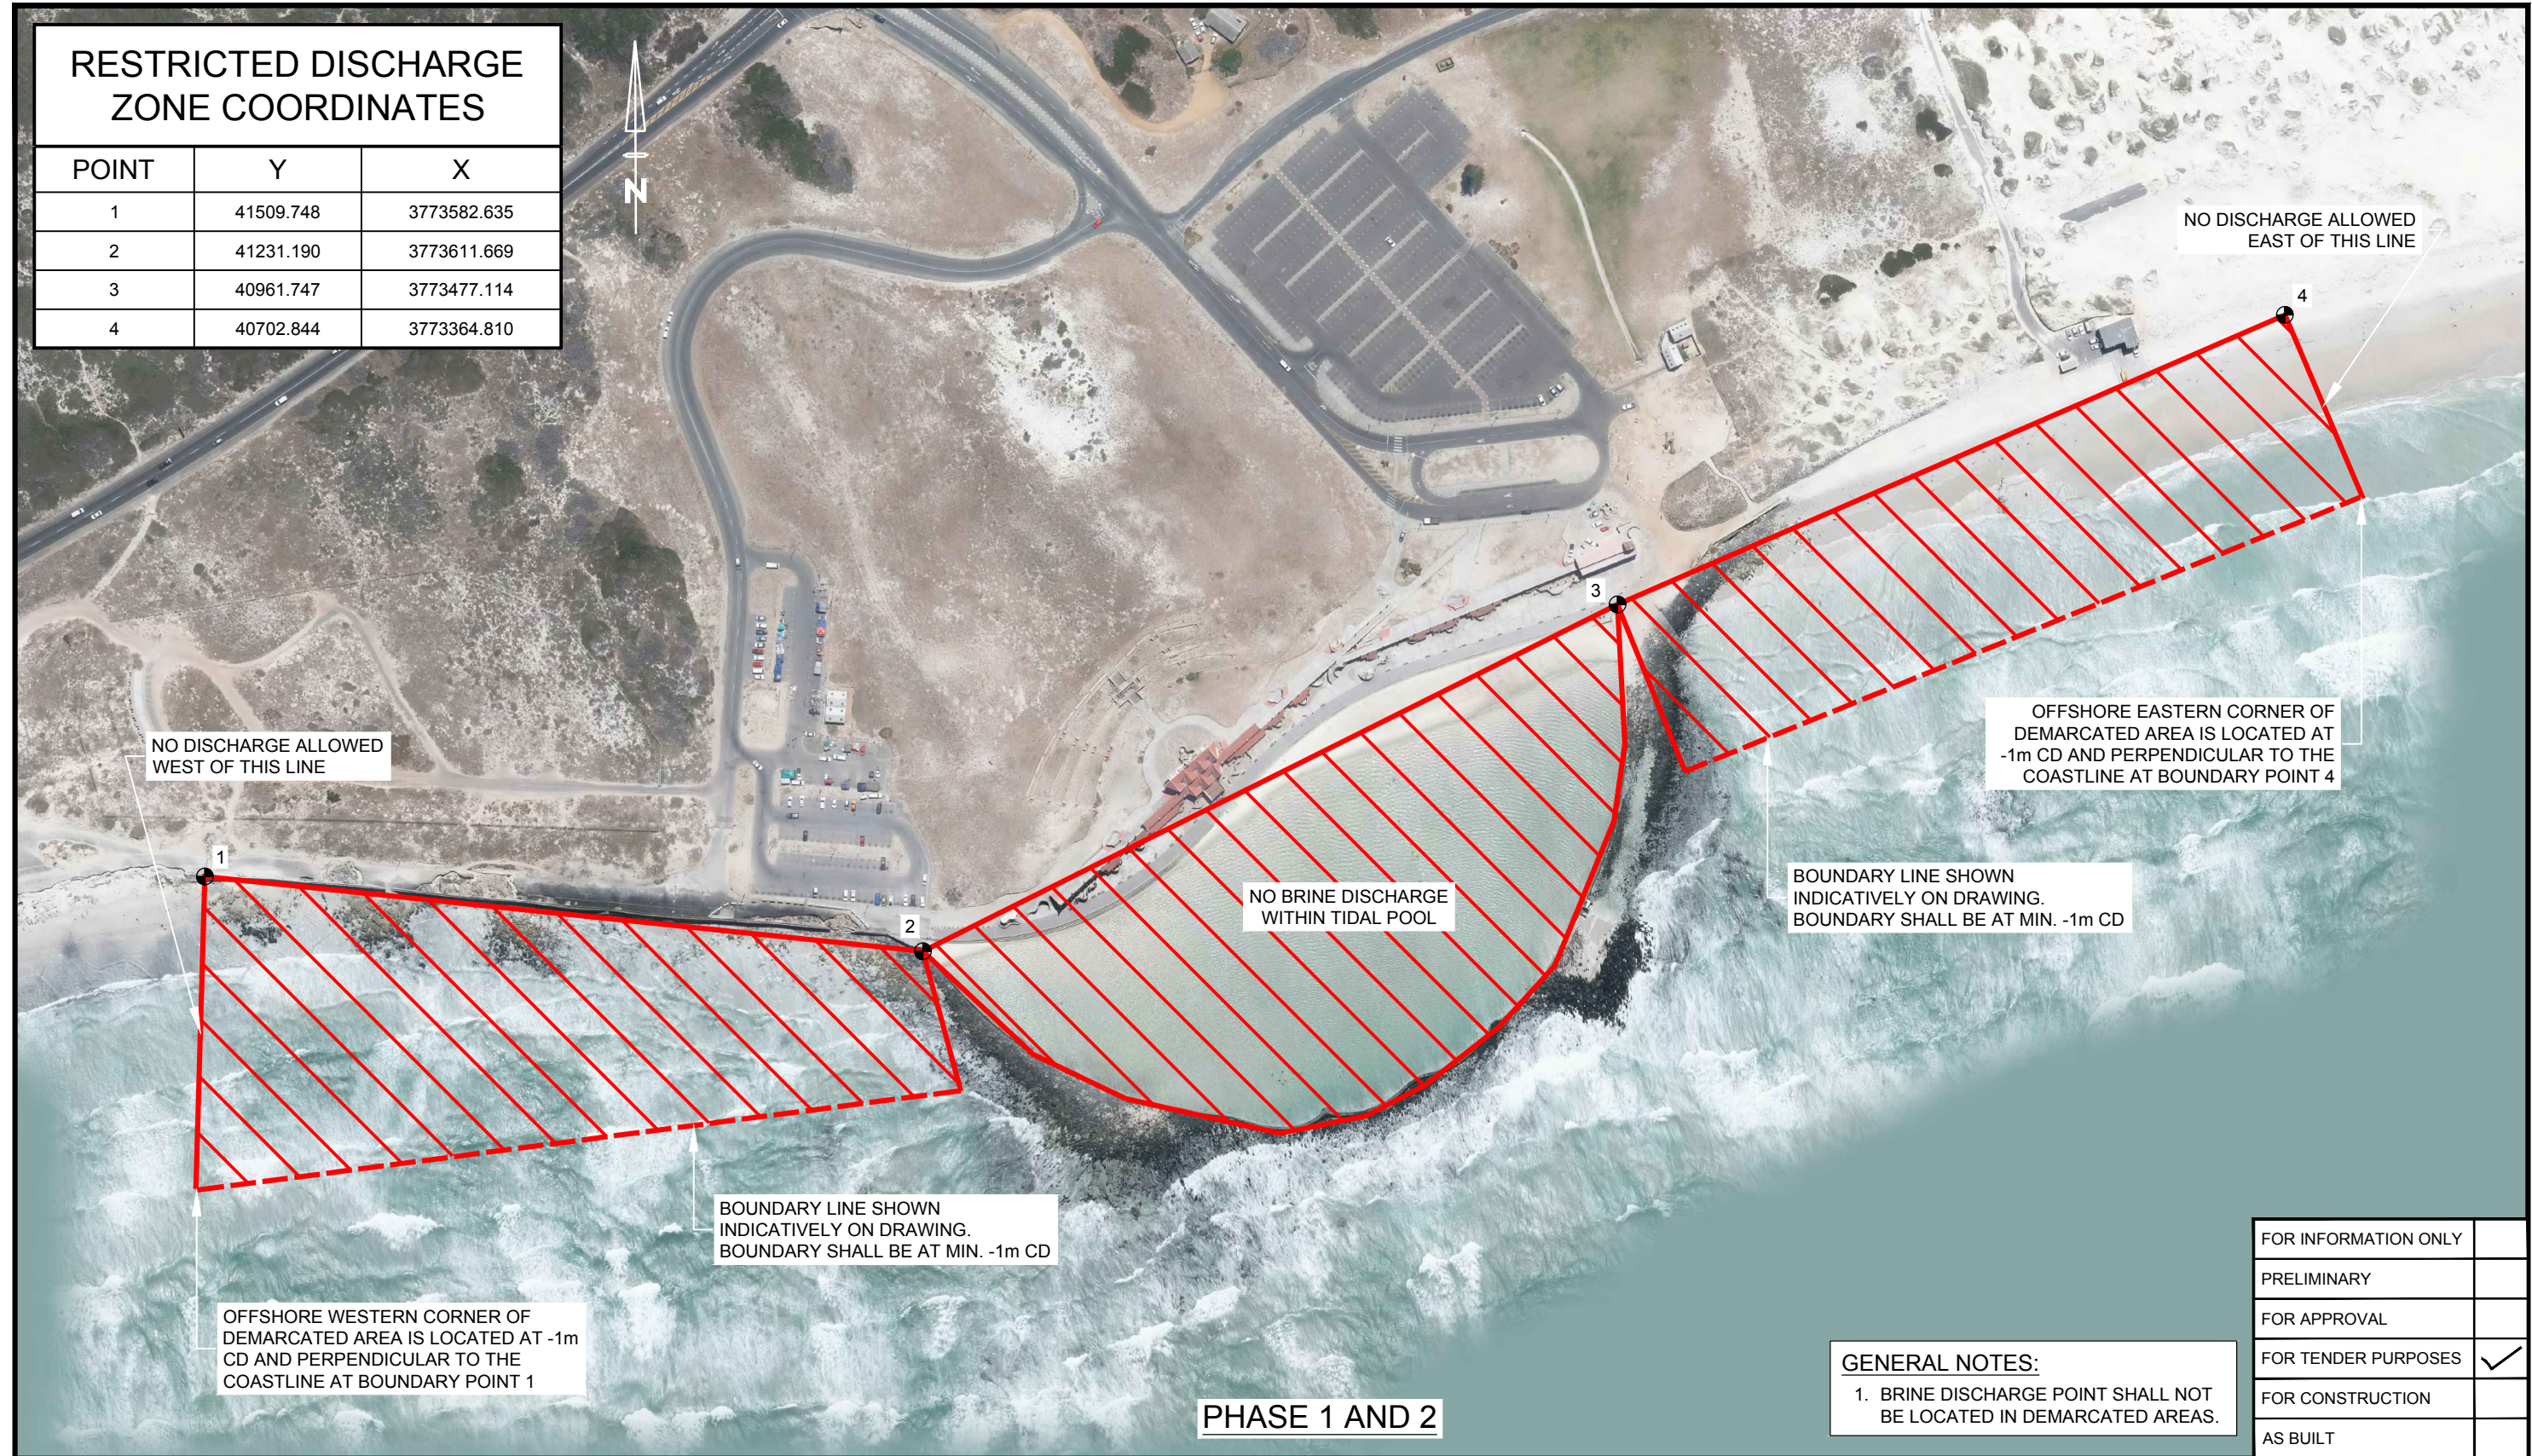

## PHASE 1 AND 2

**GENERAL NOTES:**  
 1. BRINE DISCHARGE POINT SHALL NOT BE LOCATED IN DEMARCATED AREAS.

FOR INFORMATION ONLY	
PRELIMINARY	
FOR APPROVAL	
FOR TENDER PURPOSES	<input checked="" type="checkbox"/>
FOR CONSTRUCTION	
AS BUILT	

REV	DATE	REVISION DESCRIPTION	DRAWN	DESIGNED	REV ENGINEER	CONSULTING ENGINEER
A	11/09/17	FOR TENDER	KL	MLR	MC	WPRSA



CLIENT  
 CITY OF CAPE TOWN  
 ISIXEKO SASEKAPA  
 STAD KAAPSTAD

PROJECT  
**WATER RESILIENCE PROJECT**

 **WorleyParsons**  
 resources & energy  
 P.O.Box 398  
 BELLVILLE 7535  
 TEL:+27 21912 3000  
 FAX:+27 21912 3222  
 e-mail: capetown.office@worleyparsons.com

DATE: AUGUST 2017  
 SCALE: (ORIGINAL A3) 1:2500

DRG No. C00686-ZA-MA-DAL-0006-001  
 REV. A

DRAWING DESCRIPTION  
**STRANDFONTEIN: PHASE 1 AND 2 DISCHARGE POINT RESTRICTED AREAS**

"This drawing is prepared solely for the use of the contractual customer of WorleyParsons and WorleyParsons assumes no liability to any other party for any representations contained in this drawing."